



City of Seattle


STANDARD PLANS for MUNICIPAL CONSTRUCTION

2020 EDITION

Note to Users:

Amendments to the 2020 Edition Standards, when available, can be found on-line at the following URL:

<http://www.seattle.gov/utilities/construction-and-development/standard-specs-plans/amendments>

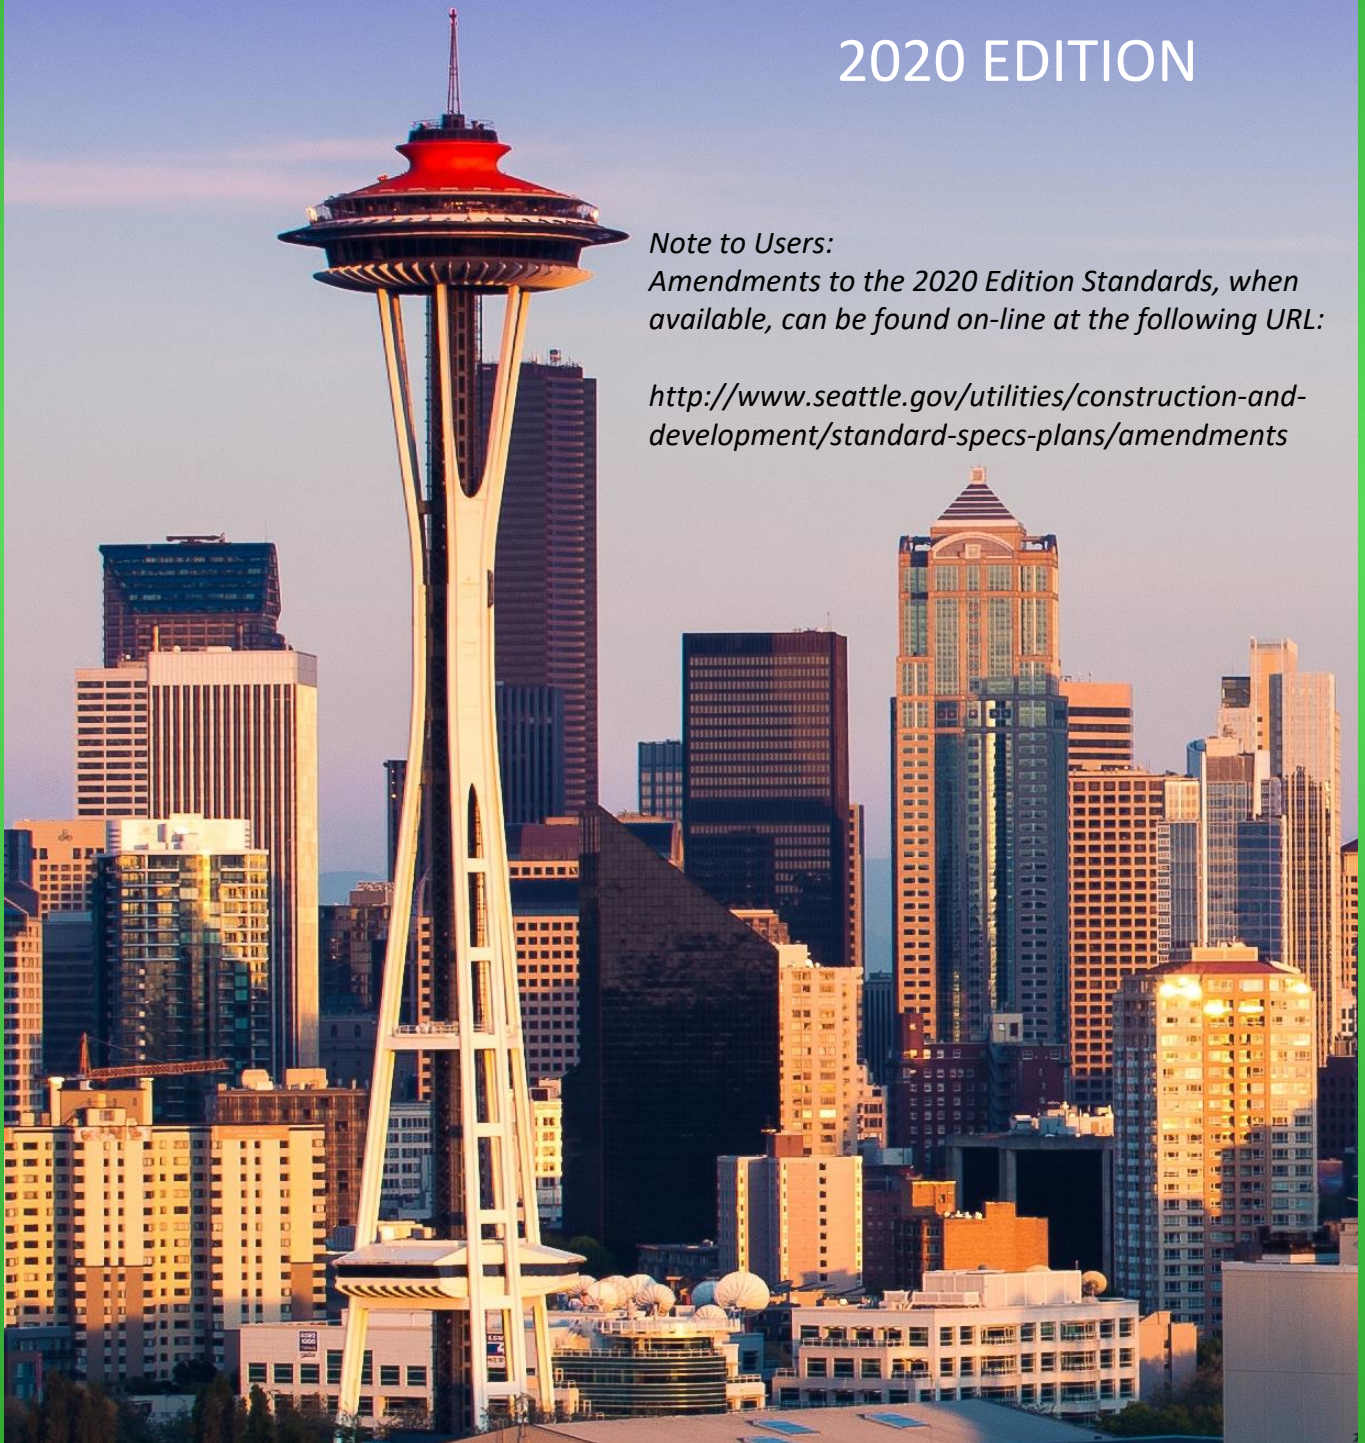


This Page Intentionally Left Blank


CITY OF SEATTLE
2020 Edition
STANDARD PLANS
FOR
MUNICIPAL CONSTRUCTION

Prepared by
Seattle Public Utilities
Mami Hara, General Manager / CEO


Reviewed and Approved by

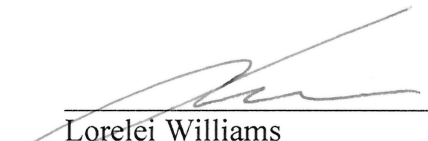
Lorelei Williams
Seattle Transportation


1/24/20
Date


Mike Haynes
Seattle City Light


1/29/20
Date


Scott Stevens
Seattle Parks and Recreation


1/28/2020
Date


Jae Lee
Seattle Center

1/28/20
Date

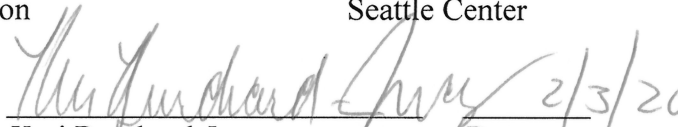
Keri Burchard-Juarez
Seattle Public Utilities

2/3/20
Date

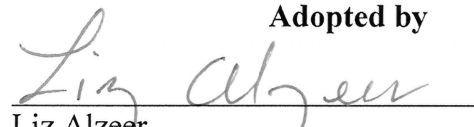Adopted by

Liz Alzeer
Finance and Administrative Services

2/4/20
Date

Distributed by

Seattle Public Utilities
700 – 5th Avenue
Suite 4700
Seattle, Washington 98124
206-684-5950

This Page Intentionally Left Blank

2020 Edition City of Seattle Standard Plans for Municipal Construction

PREFACE

The 2020 Edition City of Seattle Standard Plans for Municipal Construction (2020 Standard Plans) have been prepared by Seattle Public Utilities in cooperation with the Department of Finance and Administrative Services, Seattle Department of Transportation, Seattle Parks and Recreation, Seattle City Light, and the Seattle Center. These Plans have been coordinated with the 2020 Edition City of Seattle Standard Specifications for Road, Bridge, and Municipal Construction.

The 2020 Standard Plans apply whenever any public or private construction is performed within the Rights-of-Way of the City of Seattle, including work performed by private parties at their own expense under authority granted by ordinance of the City Council or by permit from the Seattle Department of Transportation's Street Use section.

For the convenience of our users, the table of contents entries shown in **BOLD TEXT** with a vertical line in the margin (as shown here) indicate where 2020 Editions Standard Plans were revised from the corresponding 2017 Edition Standard Plans. A revision date, located in the upper right corner of each Standard Plan, also indicates when Standard Plans are new or recently revised.

Our sincere thanks and appreciation to all who participated in the effort of producing this 2020 Edition of our Standard Plans, and to the many other City personnel who provided review and submitted comments.

In particular, thanks to the following stakeholders who shouldered most of the work in authoring and reviewing changes, coordinating among their departments' subject matter experts, meeting deadlines, and cooperatively resolving inconsistencies within and between the Standard Specifications and the Standard Plans:

Department of Financial and Administrative Services: Liz Alzeer, Mark Nakagawara, Pam Honma, and City Contracting Staff.

Seattle Public Utilities: Charles Oppelt, Pat Schreibe, Kathy Laughlin, Steve Colony, Rene Malacon, Steve Read, Jason Miller, Mark Fredrickson, and Aziz Alfi.

Seattle Department of Transportation: Abner Gallardo, Erich Ellis, Jeff Curtis, Scott Hart, Yuling Teo, Stephen Wilson, Shane Dewald, Amy Yamabe, Ross McFarland, Ben Hansen, Lok Chan, Marvin Meischke, Mike Shaw, Mario Macias, Ainalem Molla, Carter Danne, Brian Forsythe, and James Clark.

Seattle Parks and Recreation: Scott Stevens, Rebecca Rufin, R. Frank Robinson, and Narinna Kay

Seattle City Light: Minyoung Her, Michael Danielsen, Mike Nordin, Yaochiem Chao, Stan Eng, Jade Mott, Stephen Crume, and Kelly Davidson

Seattle Center: Diane Hilmo and Stephen Levensgood

The hardcopy version of this document is available at the Department of Finance and Administrative Services Treasury Services cashier counter located in the Seattle Municipal Tower, 700 Fifth Avenue, Suite 4200, Seattle, Washington 98104, 206-684-5214. The 2020 Standard Plans may also be ordered on-line from the website listed below. Additional features on the website include an archive of previous editions of our Standards dating back to 1910, CAD files of our Standard Plans, and proposed amendments to this edition (including pdf redline markups showing what has changed).

<http://www.seattle.gov/utilities/construction-and-development/standard-specs-plans>

Despite considerable efforts to produce a completely error-free document, minor errors will inevitably be included in this 2020 Edition of our Standard Plans. If you discover errors in this document, please alert us by sending an email to the City's Construction Standards Engineer at **City_Standards_Engineer@Seattle.gov**.

If conflicts are discovered between this copy of the 2020 Standard Plans and any version of the 2020 Standard Specifications, the current edition of the 2020 Standard Specifications takes precedence.

This preface is for informational purposes only and is not to be used to interpret or affect the terms of the Contract between the City of Seattle as the Owner and the Contractor.

Randy Earlywine, P.E.
City Construction Standards Engineer
Project Controls Division
Seattle Public Utilities

Dean Huber
Standard Plans CAD Manager
Eng. and Tech. Services Div.
Seattle Public Utilities

Tanya Treat, P.E.
Director
Eng. and Tech. Services Div.
Seattle Public Utilities

This Page Intentionally Left Blank

2020 Edition City of Seattle Standard Plans for Municipal Construction

Table of Contents

For the convenience of some of our users, the Table of Contents shows revised Plans with a vertical bar as well as bold type.

000 General-Legal-Miscellaneous

Datum	Elevations & Datums	001	
	Elevations & Datums	001a	
Abbreviations	Abbreviations	002a-002f	
Standard Symbols	Electrical	003a	
	Electrical	003b	
	Electrical	003c	
	Electrical	003d	
	Signalization / Channelization & Signage	003e	
	Paving	003f	
	Paving	003g	
	Sewer & Drainage	003h	
	Sewer & Drainage	003i	
	Sewer & Drainage	003j	
	Topographic & Misc	003k	
	Topographic & Misc	003l	
	Topographic & Misc	003m	
	Topographic & Misc	003n	
	Private Utilities	003o	
	Water	003p	
	Water	003q	
	Water	003r	
Payment	Sewer/Drainage Measurement Diagram	010	
Monument	Monument Frame & Cover	020a	
	Monument Frame & Cover	020b	
	Survey Monument	020c	
Miscellaneous	Desirable Locations for Utilities (Residential Street)	030	
	Stabilized Construction Entrance	040	

100 Landscape Planting

Trees	Deciduous Tree Planting in Planting Strip	100a	
	Tree & Shrub Planting on Slopes	100b	
	Tree Planting in Amended Trench	100c	
	Coniferous Tree Planting	101	
Shrub & Ground Cover	Shrub Planting	110	
	Ground Cover Planting	111	
	Planting Pattern	112	
	Median Planting	113	
Irrigation	Hose Bib Assembly & Quick Coupler Valve	121	
	Irrigation Valves	122	
	Irrigation Valves	123	
	Irrigation Valves	124	
	Irrigation Valves	125	
	Pop Up & Fixed Irrigation Heads	126	
	Irrigation Controller Pedestal & Enclosure Grounding	127	

2020 Edition City of Seattle Standard Plans for Municipal Construction

	Irrigation Trenches	128
	Irrigation Controller Cabinet	129
Tree Protection	Tree Protection During Construction	132a
	Reusable Temporary Protection Fence	132b
	Tree Protection During Trenching, Tunneling or Excavation	133
Grading	Slope Rounding	140
	Rock Facing	141
	Soil Amendment and Depth	142

200 Sewer-Drainage Appurtenances

Maintenance holes	Type 204a Maintenance Hole	204a
	Type 204b Maintenance Hole	204b
	Type 204.5a Maintenance Hole	204.5a
	Type 204.5b Maintenance Hole	204.5b
	Type 205a Maintenance Hole	205a
	Type 205b Maintenance Hole	205b
	Type 206a Maintenance Hole	206a
	Type 206b Maintenance Hole	206b
	Type 207a Maintenance Hole	207a
	Type 207b Maintenance Hole	207b
	Type 208a Maintenance Hole	208a
	Type 208b Maintenance Hole	208b
	Type 209a Maintenance Hole	209a
	Type 209b Maintenance Hole	209b
	Type 210a Maintenance Hole	210a
	Type 210b Maintenance Hole	210b
	Type 211a Maintenance Hole	211a
	Type 211b Maintenance Hole	211b
	Type 212a Maintenance Hole	212a
	Type 212b Maintenance Hole	212b
	Flexible Joint for VCP Connection	215
	Rebuild Existing Brick Maintenance Hole	220
Materials	2'-0" Diameter Frame & Cover	230
	Sewer Replacement Cover	231
	Maintenance Hole Ladder Step & Handhold	232a
	Maintenance Hole Ladder Step & Handhold	232b
	Outside Drop Connection	233a
	Inside Drop Connection	233b
	6" or 8" Vertical Connection to Concrete or Clay	234a
	6" or 8" Vertical Connection to Ductile Iron	234b
Catch Basins	Type 240 Catch Basin	240
	Type 241 Catch Basin	241a
	Type 241 Catch Basin Installations	241b
	Type 242 Catch Basin	242
	Precast Catch Basin Top Slab	243a
	Precast Catch Basin Extension Risers	243b
Inlets	Type 250 Inlet	250
	Type 252 Inlet	252
	Inlet/Catch Basin Location & Installation	260a
	Catch Basin & Inlet Installation	260b
	Catch Basin & Inlet with 563b Hood	260c
	Typical Catch Basin Connection	261

2020 Edition City of Seattle Standard Plans for Municipal Construction

	Type 262 Inlet Frame	262
	Type 263 Inlet Frame	263a
	Type 263 Alternative Inlet Hood	263b
	Inlet Frame & Grate	264
	Vaned Grate	265
	Type 266 Replacement Vaned Grate	266
	Outlet Trap	267
	Extension for Inlet	268
	Beehive Grate for Bioretention	269
Flow Control	Flow Control Structure with Detention Pipe	270
	CMP Detention Pipe Private System Only	271a
	CMP Detention Structure End Plate Details Types A & B	271b
	CMP Detention Structure End Plate Details Types C	271c
	CMP Detention Structure End Plate Dimensions	271d
	Flow Control Device Assembly	272a
	PVC Shear Gate for Use in ROW Only	272b
	Type 277 Junction Box & Installation	277
	Vertical Clean Out/Corrugated Metal Pipe	278
Pipe Installation	Tee Installation Corrugated Metal Pipe	279
	8" Clean Out	280
	Bioretention Under Drain Clean-out & Observation Port	281
	Corrugated Metal Pipe Coupling Bands	282a
	Corrugated Metal Pipe Coupling Bands	282b
	Side Sewer Installation	283
	Typical Trench Detail for Sewer & Storm Drain	284
	Pipe Bedding Sewer/Storm Drain	285
Clearance Plans	Sewer & Water Spacing & Clearances	286a
	Sewer & Water Spacing & Clearances	286b
Drains	Bridge Drain	290
	PVC Subsurface Drain Pipe	291
	Infiltrating Bioretention with Sloped Sides	292
	Infiltrating Bioretention with Sloped Sides & Under Drain	293a
	Non-Infiltrating Bioretention with Sloped Sides & Under Drain	293b
	Vegetated Conveyance Swale	294
	Typical Drain Curb Cut for Bioretention	295a
	Drain Curb Cut Type 1	295b
	Drain Curb Cut Type 2	295c
	Drain Curb Cut Type 3	295d
	Presettling Zone	299
300 Watermain Appurtenances		
Pipe Connections	Connections to Existing Watermains	300a
	Connections to Existing Watermains	300b
	Connections to Existing Watermains	300c
Hydrants	Type 310 Hydrant Setting Detail	310a
	Type 310 Hydrant Setting Detail	310b

2020 Edition City of Seattle Standard Plans for Municipal Construction

	Type 311 Hydrant Setting Detail	311a
	Type 311 Hydrant Setting Detail	311b
	Fire Hydrant Marker Layout	312
	Wall Requirements for Hydrants	313
	Fire hydrant Locations & Clearances	314a
	Clearances for Typical Water Service Vaults	314b
Valves	Cast Iron Valve Box & Operating Nut Extension	315a
	Cast Iron Valve Box & Operating Nut Extension	315b
	Air Release Air Vacuum Valve	320
Concrete Blocking	Watermain Thrust Blocking Vertical Fittings	330a
	Watermain Thrust Blocking Vertical Fittings	330b
	Watermain Thrust Blocking Horizontal Fittings	331a
	Watermain Thrust Blocking Horizontal Fittings	331b
Blow Off	2" Blow Off Type A Non Traffic Installation	340a
	2" Blow Off Detail Type B Traffic Installation	340b
Pipe Bedding	Watermain Trench and Bedding	350
Miscellaneous	Watermain Electrolysis Test Station	360
	Type 361a Valve Chamber Frame & Cover	361a
	Type 361b Valve Chamber Frame & Cover	361b
	Type 361c Valve Chamber Frame & Cover	361c
	Type 361d Valve Chamber Frame & Cover	361d
	Joint Bonding for DIP Watermains & Joint Bonding Detail	362
	Electrolysis Test Station Wire Installation Details	363
	Sacrificial Anode Bonded to Pipe	364
	Sacrificial Anode Installation Details	365

400 Street Paving & Appurtenances

Paving	Half Section, Grading	400
	Residential Pavement Sections	401
	Commercial and Arterial Pavement Sections	402
	Roadway Cement Concrete Alley Pavements	403
	Pavement Patching	404a
	Pavement Patching	404b
	Pavement Patching Zone of Influence	404c
	Roadway Concrete Pavement Repair	405a
	Pavement Repair Dowel Bar & Tie Bar Details	405b
	Roadway Concrete Pavement Joints	405c
	Through Joints and Optional Keyways for Cement Concrete Roadway	405d
	Frame & Cover Cement Concrete Reinforcement Detail	406
Curbs	Type 410 Curb	410
	Curb Joints & Dowels	411
	Extruded Curb	412
	3' Precast Traffic Curb (Dual Sloped)	413a
	8' Block and Radial Traffic Curb	413b
	Traffic Circle Details	415
Sidewalks	Concrete Sidewalk Details	420
	Sidewalk with Monolithic Curb	421

2020 Edition City of Seattle Standard Plans for Municipal Construction

	Curb Ramp Details	422a
	Curb Ramp Details	422b
	Curb Ramp Details	422c
	Curb Ramp Details	422d
	Curb Ramp Details	422e
	Curb Ramp Details	422f
	Curb Ramp Details	422g
	Curb Ramp Details	422h
	Curb Ramp Details (Intentionally Omitted)	422i
	Curb Ramp Details (Intentionally Omitted)	422j
	Curb Ramp Details	422k
	Curb Ramp Sections	422l
	Expandable Tree Pit Detail	424a
	Tree Pit Detail	424b
	Alternative Walkways	425
Driveways	Type 430a & 430b Driveways	430
	Cement Concrete Driveway Placed with Cement Concrete Sidewalk	431
	Multi-Purpose Trail at Street Crossing	432a
	Multi-Purpose Trail at Street Crossing	432b
	Speed Hump	436a
	Speed Cushion	436b
Stairway, Steps	Cement Concrete Stairway & Handrail	440a
	Cement Concrete Stairway & Handrail	440b
	Cement Concrete Stairway & Bike Runnel	440c
	Cement Concrete Stairway & Single Bike Runnel	440d
	Cement Concrete Steps	441
	Steel Pipe Handrail	442
	Pedestrian Railing	443
Fence	Chain Link Fence	450a
	Chain Link Fence	450b
	Chain Link Gates	450c
Miscellaneous	Temporary Pedestrian Walkway	456
	Ecology Block, Concrete	460
	Fixed & Removable Wood Bollard	463
	Removable Steel Bollard	464
	Fixed Steel Bollard	465
500 Signalization-Lighting		
Signal Controller	Signal Controller Cabinet & Foundation	500a
	Signal Controller Foundation Conduit Layout	500b
	Service Cabinet Foundation Detail	501a
	Joint Signal Controller/Service Cabinet Foundation Detail	501b
Vehicular Signal	Vehicular Signal Mounting	510a
	Vehicular Signal Mounting	510b
	Signal Head Bracket Assembly	511
Pedestrian Signal	Pedestrian Signal Clamshell Mounting	520
	Pedestrian Pushbutton Post & Foundation	521

2020 Edition City of Seattle Standard Plans for Municipal Construction

	Accessible Pedestrian signal (APS) PED Pushbutton Assembly	522a
	Bicycle Pushbutton Assembly	522b
	Pedestal & Foundation	524
	Rectangular Rapid Flashing Beacon	525
Loop Detectors	Detector Loop Lead-In	530a
	Detector Loop Details	530b
	Detector Loop Wire & Signal Cable Splice	530c
Pole Foundations	Traffic Signal Pole Foundation Detail	541a
	Strain Pole Foundation	
	Schedule / Notes (Type T, V, X & Z)	541b
	Street Light Pole Foundations	543a
	Pedestrian Street Light Pole Foundations	543b
Handholes	Handholes	550a
	Handholes	550b
	Polymer Concrete Handholes	550c
	Polymer Concrete Handholes	550d
Poles	Steel Mast Arm Pole	562a
	Steel Mast Arm Pole Foundation Schedule & Detail (w/o METRO Trolley Loads)	562b
	Miscellaneous Steel Pole Details	563a
	Miscellaneous Steel Pole Details	563b
	Terminal Cabinet Pole Mounting	564
	Strain Pole Details (Type V, X & Z Poles)	566a
	Strain Pole Details (Type V, X & Z Poles)	566b
	Type T Strain Pole Details Traffic Signal Only	567a
	Type T Strain Pole Details Traffic Signal Only	567b
	Steel Street Light Pole With Bracket Arm	572
Conduit Risers	Traffic Conduit Riser	580
600 Signs		
Overhead	Span Wire Installation	601a
	Overhead Signs Span Wire Mounted	601b
	Sign Installation (Non-Spanwire Mounting)	601c
Pole Mounted	Standard Sign Installation Steel Poles	610
	SNS Bracket for Steel Poles	615
	Traffic Sign Mounting on Metal Poles	616
Post Mounted	Stop and Yield Sign Post and Anchor Installation	620
	Warning and Regulatory Sign Post	621a
	Warning and Regulatory Sign Post Anchor Installations	621b
	Street Name Sign Installation	622
	Street Name Sign Pedestal Installation	623
	Post Cap	624
	Traffic Sign Posts	625
	Object Marker Installation in Traffic Circle	626
	Metro Bus Zone Sign Installation	630
	Pedestrian Wayfinding Sign	631

2020 Edition City of Seattle Standard Plans for Municipal Construction

700 Pavement Markings

Traffic Buttons/Lane Markers		Traffic Buttons and Lane Markers	700
Channelization	Typical Left Turn Channelization and Legend Placement		710a
	Typical Lane Drop Channelization and Legend Placement		710b
	Typical Intersection Guideline Channelization		710c
	Typical White Barrier Area Channelization		711
	Typical Crosswalk & Stop Line Installation Details		712
	Curb Marking Details		713
	Typical Angled Parking Stall Channelization		714
	Trail Obstruction Channelization		715
	Typical Curbside Red Bus Lane Layout		717a
	Legends / Symbols	Mandatory Movement Arrows	
Optional Movement Arrows			721
Optional Movement Arrows with Oblique Arrows			722
Merge Arrows			723
Speed Hump & Speed Cushion Symbol			728
Yield Line Layout & Yield Line Triangle Symbols			729
Pavement Markings Legends			730
International Symbol for Accessibility			740
Pedestrian Symbol			741
Red Bus Lane Markings			750
Helmeted Bicyclist Symbol with Arrow			770
Sharrow & Bike Symbol			771
Bicycle Detector Symbol			772
Bike DOT Symbol with Arrow			773
Greenway Markings			774
Cross Bike Pavement Marking			780
Bike Lane Pavement Marking at Driveway		781	

800 Structures

Walls	Support Wall	800
	Curb Wall	801

Vertical Datums within the City of Seattle:

The National Geodetic Survey (NGS) Benchmark 944 7130 TIDAL 7 PID SY0289 is a disk set 3.0 feet above the concrete sidewalk in the SW granite cornerstone of the National Building located on the NE corner of the intersection of the Western Avenue and Madison Street, Seattle, Washington.

The following elevations are values for that benchmark in different datums.

NAVD 88 = 19.26 feet
 NGVD 29 = 15.67 feet
 King Co & Metro = 115.67
 Obsolete COS Datum = 9.54 feet
 USACOE = 22.51 feet
 MLLW = 21.59 feet

NAVD88 = The North American Vertical Datum of 1988 (Official City of Seattle Datum per Ordinance #121291 of October 9, 2003)

NGVD 29 = The National Geodetic Vertical Datum of 1929

King Co & Metro = Add 100 feet to NGVD 29

Obsolete COS = The Old City of Seattle Elevation. Plans, profiles and records prior to 2004 use this datum. Add 9.7 feet to this datum to get to NAVD88.

USACOE = US Army Corps of Engineers Lake Washington & Lake Union Datum

MLLW = Mean Lower Low Water Datum (TIDAL EPOCH 1983 TO 2001)

NOTES

1. Tidal elevations vary according to tidal observations in 18 year epochs.
2. The Old (Obsolete) City of Seattle Datum varies between 9.1 and 9.9 feet below NAVD88 depending on the location in the City. The difference between these two datums must be ascertained from field observations in each specific area. Add approximately 9.7 feet to the old COS Datum to get to the NAVD elevation.


REF STD SPEC SEC 1-07.16(1)A, 1-07.28



City of Seattle

NOT TO SCALE

ELEVATIONS & DATUMS

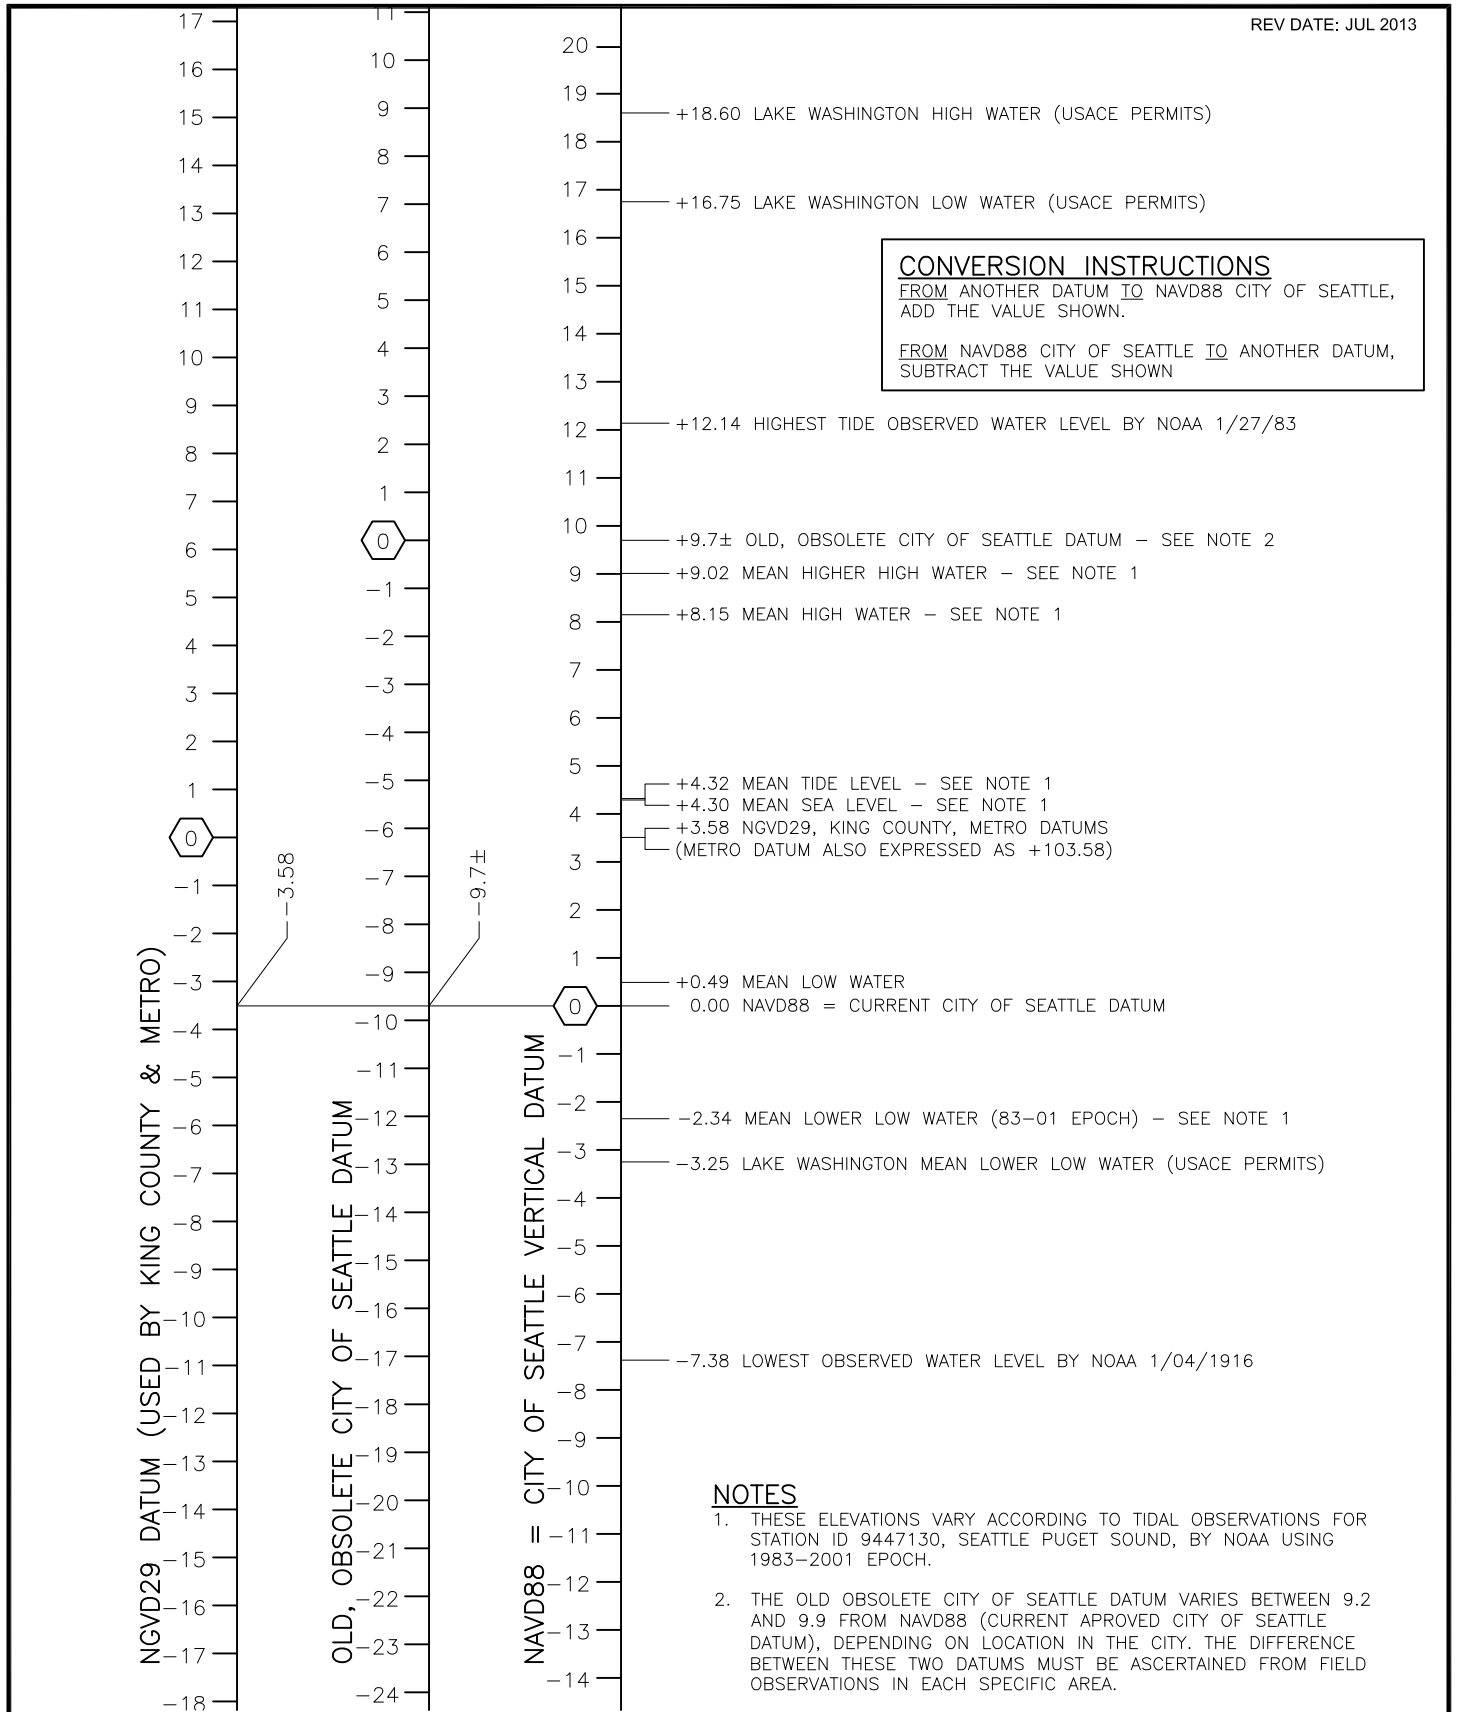

CONVERSION INSTRUCTIONS
 FROM ANOTHER DATUM TO NAVD88 CITY OF SEATTLE, ADD THE VALUE SHOWN.
 FROM NAVD88 CITY OF SEATTLE TO ANOTHER DATUM, SUBTRACT THE VALUE SHOWN

NOTES
 1. THESE ELEVATIONS VARY ACCORDING TO TIDAL OBSERVATIONS FOR STATION ID 9447130, SEATTLE PUGET SOUND, BY NOAA USING 1983-2001 EPOCH.
 2. THE OLD OBSOLETE CITY OF SEATTLE DATUM VARIES BETWEEN 9.2 AND 9.9 FROM NAVD88 (CURRENT APPROVED CITY OF SEATTLE DATUM), DEPENDING ON LOCATION IN THE CITY. THE DIFFERENCE BETWEEN THESE TWO DATUMS MUST BE ASCERTAINED FROM FIELD OBSERVATIONS IN EACH SPECIFIC AREA.

REF STD SPEC SEC 1-07.16(1)A, 1-07.28



City of Seattle

NOT TO SCALE

ELEVATIONS & DATUMS

ABAN	Abandon(ed)	BLVD	Boulevard
ABW	Asphalt Bike Way	BM	Bench Mark
ACV	Automatic Control Valve	BO	Blow Off
ACP	Asphalt Concrete Pavement	BOC	Beginning of Curb
ADA	Americans with Disabilities Act	BPD	Backflow Prevention Device
ADJ	Adjust	BR	Bare Root, Brick
AHD	Ahead	BRG	Bearing
AIC	Aerial Interconnect Cable	BRKN	Broken
AL	Aluminum	BSMT	Basement
AP	Angle Point	BTW	Between
APP	Approved	BV	Ball valve
APPROX	Approximate	BVC	Beginning of Vertical Curve
APWA	American Public Works Association	C&G	Curb & Gutter
ASPH	Asphalt	CAL	Caliper
ATB	Asphalt Treated Base	CALC	Calculation
AV	Air Valve	CB	Cable, Catch Basin
AVB	Automatic Vacuum Breaker	CBW	Concrete Bike Way
AVE	Avenue	C-C	Center to Center
AVG	Average	CC	Concrete Culvert
AW	Asphalt Walk	CD	Conduit
AWG	American Wire Gage	CDF	Controlled Density Fill
AWWA	American Water Works Assoc.	CEM	Cement
BAT	Backflow Assembly Tester	CF	Cubic Feet
B&B	Ball & Burlap	CH	Chamber
BC	Bolt Circle, Back of Curb	CIP	Cast Iron Pipe
BF	Bottom Face	CL	Center Line or Class
BFV	Butterfly Valve	☉	Center Line
BK	Back	CLF	Chain Link Fence
BLDG	Building	CLR	Clearance
BLK	Block	CMP	Corrugated Metal Pipe
BLKG	Blocking	CO	Clean Out
BLKHD	Bulkhead	COMP	Compression
BLRD	Bollard	CONC	Concrete

REF STD SPEC SEC 1-01.2



City of Seattle

NOT TO SCALE

ABBREVIATIONS

COND	Condition
CONN	Connect/Connection
CONSTR	Construction
CONT	Continuous
CORP	Corporation
COS	City of Seattle
CPEP	Corrugated Polyethylene Pipe
CR	Cross, Curb Radius
CSB	Chief Seattle Base
CSECP	Construction Stormwater & Erosion Control Plan
CULV	Culvert
CW	Concrete Walk
CY	Cubic Yard
DB	Direct Burial Cable
DC	Direct Current
DCVA	Double Check Valve Assembly
DEPT	Department
DGV	District Gate Valve
DIA \emptyset	Diameter
DIP or DI	Ductile Iron Pipe
DIPRA	Ductile Iron Pipe Research Assoc.
DR	Drive
DS	Downspout
DWG	Drawing
DWY	Driveway
E	East
EA	Each
ECB	Electrical Cable
ECC	Eccentric
ECD	Electrical Conduit
ED	Electrical Duct
EL/ELEV	Elevation
ELEC	Electric/Electrical

EMH	Electrical Maintenance Hole
ENCL	Enclosure
ENGR	Engineer
EOC	End of Curb
EQ	Equal
ESAL	Equivalent Single Axle Loads
ESMT	Easement
EV	Electrical Vault
EVC	End of Vertical Curb
EW	Each Way
EX	Existing
EXP	Expansion
FACB	Fire Alarm Cable
FAHH	Fire Alarm Handhole
FC	Face of Curb
FCS	Flow Control Structure
FDN	Foundation
FF	Far Face, Finished Floor
FG	Finished Grade
FIG	Figure
FIPT	Female Iron Pipe Thread
FL	Flow Line
FLG	Flange
FLR	Floor
FLT	Flat Bar
FM	Force Main
FO or FOC	Fiber Optics
FS	Far Side
FT	Feet
FTB	Fluidized Thermal Backfill
FTG	Footing
G	Gas
G REG	Gas Regulator

REF STD SPEC SEC 1-01.2



City of Seattle

NOT TO SCALE

ABBREVIATIONS

GA	Gauge
GAL	Gallon
GALV	Galvanize/Galvanized
GAS V	Gas Valve
GFCI	Ground Fault Circuit Interrupter
GIP	Galvanized Iron Pipe
GM	Gas Meter
GND	Ground
GP	Guy Pole
GPM	Gallons Per Minute
GR	Grade
GRHH	Ground Rod Handhole
GS	Gas Service
GSI	Green Stormwater Infrastructure
GSP	Galvanized Steel Pipe
GV	Gate Valve
GVC	Gate Valve Chamber
GVL	Gravel
HB	Horizontal Bend
HBR	Hose Bib Riser
HDPE	High Density Polyethylene
HEX	Hexagon/Hexagonal
HGL	Hydraulic Grade Line
HH	Handhole
HI	High
HMA	Hot Mix Asphalt
HORIZ	Horizontal
HPG	High Pressure Gas
HPS	High Pressure Sodium
HR	Hour
HSE	House
HT	Height
HYD	Hydrant

ID	Inside Diameter/Dimension
I/D	Incentive/Disincentive
IE	Invert Elevation
IF	Inside Face
IN	Inch(es)
INL	Inlet
INT	Intersection
INV	Invert (Line)
IP(S)	Iron Pipe (Size)
IRC	Irrigation Controller
IRRG	Irrigation
IRRGV	Irrigation Valve
ISO	Isolation Coupling
JB	Junction Box
JT	Joint
K	Kips (1000 lbs)
KSI	Kips Per Square Inch
KV	Kilovolt
LAL	Limited Access Line
LB, LBS	Pound, Pounds
LF	Linear/Lineal Feet
LID	Local Improvement District
LIT	Large Inlet Top (Catch Basin)
LOC	Locate/Location
LONGIT	Longitudinal
LP	Light Pole
LS	Lump Sum
LSCAPE	Landscape, Landscaping
LT	Left
LTG	Lighting
LUM	Luminaire
MA	Mast Arm
MATL	Material

REF STD SPEC SEC 1-01.2




City of Seattle

NOT TO SCALE

ABBREVIATIONS

MAX	Maximum
MB	Mailbox
MCV	Manual Control Valve
MDV	Manual Drain Valve
MH	Maintenance Hole
MIC	Monument in Case
MIN	Minimum
MIPT	Male Iron Pipe Thread
MISC	Miscellaneous
MJ	Mechanical Joint
ML 	Monument Line
MNRL AGG	Mineral Aggregate
MOD	Modify/Modified
MON	Monument
MW	Monitor Well
N	North
NAD	North American Datum
NAVD	North American Vertical Datum
NF	Near Face
NGVD	National Geodetic Vertical Datum
NIC	Not in Contract
NO	Number
NOM	Nominal
NS	Near Side
NTS	Not To Scale
OC	On Center
OD	Outside Diameter/Dimension
OF	Outside Face
OH	Overhead
PAV	Pavement
PC	Point of Curvature
PCC	Point of Compound Curve
PCW	Pervious Concrete Walk

PDP	Perforated Drain Pipe
PE	Plain End
PED	Pedestrian
PG	Performance Grade
PH	Phase
PI	Point of Intersection
PL	Plate, Place, Polyethylene
	Property Line
POC	Point on Curve
PP	Power Pole
PPB	Pedestrian Push Button
PR	Pair
PRC	Point of Reverse Curve
PROP	Proposed
PRKG	Parking
PRV	Pressure Reducing Valve
PS	Pipe Sewer Combined
PSD	Pipe Storm Drain
PSDD	Pipe Storm Drain Detention
PSI	Pounds per Square Inch
PSIA	Pounds per Square Inch Absolute
PSIG	Pounds per Square Inch Gauge
PSS	Pipe Sewer Sanitary
PT	Point of Tangency
PVB	Pressure Vacuum Breaker
PVC	Polyvinyl Chloride
PVT	Private
QTY	Quantity
R	Radius
R&R	Remove & Replace
R/W	Right of Way
RCP	Reinforced Concrete Pipe
RD	Roof Drain

REF STD SPEC SEC 1-01.2



City of Seattle

NOT TO SCALE

ABBREVIATIONS

RDWY	Roadway
RECONN	Reconnect
RED	Reducer
REF	Refer/Reference
REINF	Reinforce/Reinforcement
RELOC	Relocate
REM	Remove
REPL	Replace
REQD	Required
RET	Retire/Retired
RET WALL	Retaining Wall
RF	Rock Facing
RGS	Rigid Galvanized Steel
RIT	Round Inlet Top
RJ	Restrained Joint
RLWY	Railway
RP	Rock Pocket
RPBA	Reduced Pressure Backflow Assembly
RR	Railroad
RS	Rigid Steel
RT	Right
S	South
SB	Sandbox
SCH	Schedule
SCL	Seattle City Light
SDS	Street Designation Sign
SD	Service Drain
SDOT	Seattle Department of Transportation
SEC	Section
SHLD	Shield
SHT	Sheet
SL	Sleeve, Street Light
§	Survey Line

SLHH	Street Light Handhole
SNS	Street Name Sign
SP	Strain Pole
SPCS	Spaces
SPEC	Specifications
SPR	Seattle Parks & Recreation
SPU	Seattle Public Utilities
SQ	Square
SS	Stainless Steel, Side Sewer-Combined
SSD	Sub-Surface Drain
SSS	Side Sewer-Sanitary
SSTONE	Sandstone
ST	Street
STA	Station
STD	Standard
STL	Steel
STL P	Steel Pipe
STM LOG	Steam Log
STRUCT	Structure/Structural
SW	Sidewalk
SY	Square Yard
SYS	System
T	Tee
TB	Test Boring
TC	Traffic Control
TCB	Telephone Cable
TCD	Telephone Conduit
TCHH	Traffic Control Handhole
TD	Telephone Duct
TEB	Telephone Enclosure Box
TEL	Telephone
TEMP	Temporary
TF	Top Face

REF STD SPEC SEC 1-01.2



City of Seattle

NOT TO SCALE

ABBREVIATIONS

ITEM


EXISTING

PROPOSED



Signal Controller Cabinet




Electrical Vault





Electrical Conduit





Electrical Cable (direct burial)



Electrical Duct




Combined Electrical & Telephone Duct



Span Wire



Aerial Interconnect Cable



Transmission Pole (steel w/ conc base)




City Wood Pole

OEPP



City Wood Pole w/ HPS



REF STD SPEC SEC



City of Seattle

NOT TO SCALE


STANDARD SYMBOLS
ELECTRICAL

ITEM



EXISTING

PROPOSED


Light Pole
(metal) w/ HPS



Strain Pole
(metal)



Combined
Lighting Strain
Pole HPS



Luminaire



Mercury Vapor
Luminaire



Double Light
Pole



Utility Wood Pole



Utility Guy Pole



Anchor



Ground



REF STD SPEC SEC



City of Seattle

NOT TO SCALE


STANDARD SYMBOLS
ELECTRICAL

ITEM



EXISTING

PROPOSED



Traffic Signal Mast
Arm Pole




Traffic Signal Mast Arm
Pole w/ Luminaire




Traffic Signal on
Span Wire



Multi-Directional Traffic
Signal on Span Wire





Traffic Signal Conduit




Traffic Signal Cable



Detector Loop, Dipole
(loop schedule)



Detector Loop, Quadrapole
(loop schedule)































REF STD SPEC SEC



City of Seattle

NOT TO SCALE

STANDARD SYMBOLS
ELECTRICAL

ITEM	EXISTING	PROPOSED
Signal Pedestal		
Vehicle Signal		
Vehicle Signal w/ Backplate		
Vehicle Signal (optically programmed)		
Pedestrian Signal		
Pedestrian Signal (optically programmed)		
Pedestrian Push Button Post		
Pedestrian Push Button		
Illuminated Sign		
Junction Box		
Handhole		
Traffic Control Handhole		
Street Light Handhole		
Ground Rod Handhole		
Fire Alarm Handhole		

REF STD SPEC SEC



City of Seattle

NOT TO SCALE

STANDARD SYMBOLS
ELECTRICAL

SIGNALIZATION



Vehicle & Pedestrian Signal Head
(?=Identification Number)



Traffic Sign (=?=Identificaiton Number)



Cable Runs
(?=Run Number per Wiring Schedule)




Removal/Relocation Item
(?=Identification Number per Removal/Relocation Plan)




Construction Item
(?=Identification Number per Signalization Plan)

Signal Poles, Signal Pedestals, Push Button Pedestals &
Push Buttons Identified by Number on Signalization Plan.


CHANNELIZATION & SIGNAGE



Install Channelization/Signage
(?=Channelization / Signage Identified on Plan)



Remove Channelization / Signage
(?=Channelization / Signage Identified on Plan)



Relocate Signage
(?=Signage Identified on Plan)

REF STD SPEC SEC



City of Seattle

NOT TO SCALE



STANDARD SYMBOLS
SIGNALIZATION/CHANNELIZATION
& SIGNAGE

ITEM



EXISTING

PROPOSED



Cement Concrete Pavement



Asphalt Concrete Pavement



Asphalt Concrete Surfacing





Curb




TYPE 410C CURB

Cement Concrete Walk



Pervious Concrete Walk



REF STD SPEC SEC



City of Seattle

NOT TO SCALE



STANDARD SYMBOLS
PAVING

ITEM



EXISTING

PROPOSED


Curb Ramp





Conc Dwy



Pervious Concrete Surface





Cement Concrete Bike Way



Asphalt Concrete Bike Way



Grading



REF STD SPEC SEC



City of Seattle

NOT TO SCALE



STANDARD SYMBOLS
PAVING

ITEM



EXISTING

PROPOSED


Maintenance Holes



Inlet Type 250A



Inlet Type 250B



Inlet Type 252



Inlet Type 268



Catch Basin round inlet top



Private CB & Inlet



Catch Basin Type 151
(pre 1985)



Catch Basin Type 240A



Catch Basin Type 240B



Catch Basin Type 240C



Catch Basin Type 240D



Catch Basin Type 241



Catch Basin Type 242A



Catch Basin Type 242B



Junction Box Type 277A



Junction Box Type 277B



Area Drain



REF STD SPEC SEC



City of Seattle

NOT TO SCALE

STANDARD SYMBOLS
SEWER & DRAINAGE

ITEM

EXISTING

PROPOSED



Sand Box





Clean Out





Concrete Culvert





Pipe Sewer
Combined <1'-0"Dia





Pipe Sewer
Combined ≥1'-0"Dia





Side Sewer Combined





Pipe Sewer Sanitary
<1'-0"Dia




Pipe Sewer Sanitary
≥1'-0"Dia




Side Sewer Sanitary



Pipe Storm Drain
<1'-0"Dia



Pipe Storm Drain
≥1'-0"Dia



REF STD SPEC SEC



City of Seattle

NOT TO SCALE



STANDARD SYMBOLS
SEWER & DRAINAGE

ITEM



EXISTING

PROPOSED

Service Drain





Inlet & CB Connection





Open Ended Pipe



Ditch



Stream



REF STD SPEC SEC



City of Seattle

NOT TO SCALE

STANDARD SYMBOLS
SEWER & DRAINAGE

ITEM

EXISTING

PROPOSED

Bench Mark (found or set)



Brass Plug/Cap (found or set)



Hub/Tack (found or set)




Monument in Case
(found or set)



Conc. Mon. (found or set)




Section Corner (found or set)




Quarter Corner (found or set)



Section Corner (calculated)



Quarter Corner (calculated)



Rebar/Cap, Pipe/Cap Rebar,
Iron Pipe (found or set)



Tack/Lead, Tack PK Nail,
Spike (found or set)



Bench Mark (not found)



Brass Plug/Cap
(not found)



MIC. (not found)



Conc. Mon. (not found)



Rebar/Cap, Pipe/Cap Rebar,
Iron Pipe (not found)



Tack/Lead, Tack PK Nail,
Spike (not found)



Survey Shot Point



REF STD SPEC SEC



City of Seattle

NOT TO SCALE

STANDARD SYMBOLS
TOPOGRAPHIC & MISC

ITEM	EXISTING	PROPOSED
Center Line		
Monument Line		
Survey Line		
Right of Way Line		
Lot & Ownership Line		
Permanent Easement Line		
Temp Const Easement Line		
Vacated Street or Alley		
State Highway Limited Access Line		
Building		
Chain Link Fence		
Wood Fence		
Guardrail		
Rock Facing		
Rock Facing		
Riprap		
Trees		

REF STD SPEC SEC



City of Seattle

NOT TO SCALE

STANDARD SYMBOLS
TOPOGRAPHIC & MISC

ITEM

EXISTING

PROPOSED



Shrub or Bush



Ground, Grade Line



Grade (arrow downhill)



Rail Road Tracks




City Limits



Slope Line

SLOPE LINE

Contours

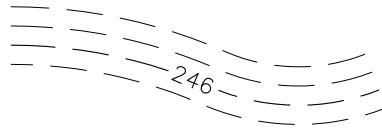


Slope Angle
Horiz:Vert

H:V

Vertical Curve



Depression



Stump



Top of Cut Toe of Fill





Dimension Line



Match Line



Test Hole & Number
(test boring)



Bench Mark



REF STD SPEC SEC



City of Seattle

NOT TO SCALE

STANDARD SYMBOLS
TOPOGRAPHIC & MISC

ITEM

EXISTING

PROPOSED

Monitor Well



Street Name Sign



Traffic Sign



US Mail Box



Private Mail Box



Bollard



Posts



Parking Meter & Pay Station



Rectangular Casting





Circular Casting



Column




Jersey Barrier & Eco Block




Tree Pit



North Arrow horizontal

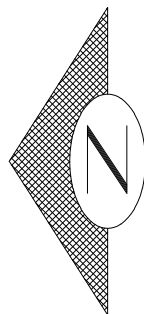

North Arrow vertical

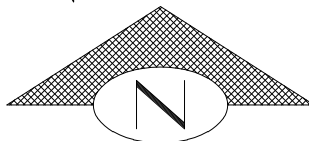

REF STD SPEC SEC



City of Seattle

NOT TO SCALE

STANDARD SYMBOLS
TOPOGRAPHIC & MISC

ITEM	EXISTING	PROPOSED
Telephone Cable (direct burial)		
Telephone Conduit		
Telephone Duct		
Telephone Enclosure		
Telephone Maintenance Hole		
Telephone Pole		
Telephone Handhole		
Television Cable (direct Burial)		
Television Handhole		
Telegraph Maintenance Hole		
Steam Log		
Steam Vault		
Gas Main <1'-0\"/>		
Gas Main ≥1'-0\"/>		
Gas Valve		
Gas Meter		
Gas Regulator		
Petroleum or Oil		
Abandon(ed)		

REF STD SPEC SEC



City of Seattle

NOT TO SCALE

STANDARD SYMBOLS
PRIVATE UTILITIES

ITEM

EXISTING

PROPOSED

90° Bend w/Conc Blocking

Plug w/Conc Blocking

Tee w/Conc Blocking

Watermain
<1'-0"Dia

Watermain ≥1'-0"Dia

11 1/4° Bend

22 1/2° Bend

45° Bend

90° Bend



















Cross

Tee

Pipe Sleeve

Plug

Hydrant



REF STD SPEC SEC



City of Seattle

NOT TO SCALE



STANDARD SYMBOLS
WATER

ITEM

EXISTING

PROPOSED


6" & Larger
Domestic Service



3" & 4" Domestic
Service



4" & Larger Fire
Service



2" & Smaller
Water Service




Valve Box




Gate Valve





Gate Valve
w/ Chamber





Gate Valve
w/ Vault Chamber




Reducer




Air Valve



Blowoff



Fire Standpipe






























REF STD SPEC SEC



City of Seattle

NOT TO SCALE

STANDARD SYMBOLS
WATER

ITEM	EXISTING	PROPOSED
Water Test Station		
Water Chamber		
Sprinkler Head		
Irrigation Valve	 IRRV	 IRRV
Angle Valve		
Butterfly Valve		
Ball Valve		
Check Valve		
Cone Valve		
Globe Valve		
Needle Valve		
Plug Valve		
Resilient Seal Gate Valve		
Vertical Bend		
Concrete Blocking		


REF STD SPEC SEC




City of Seattle

NOT TO SCALE

STANDARD SYMBOLS
WATER

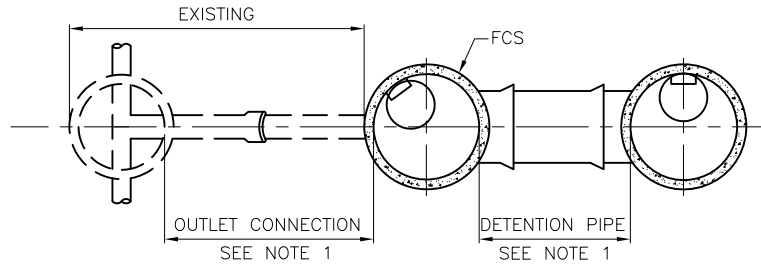

PLAN VIEW

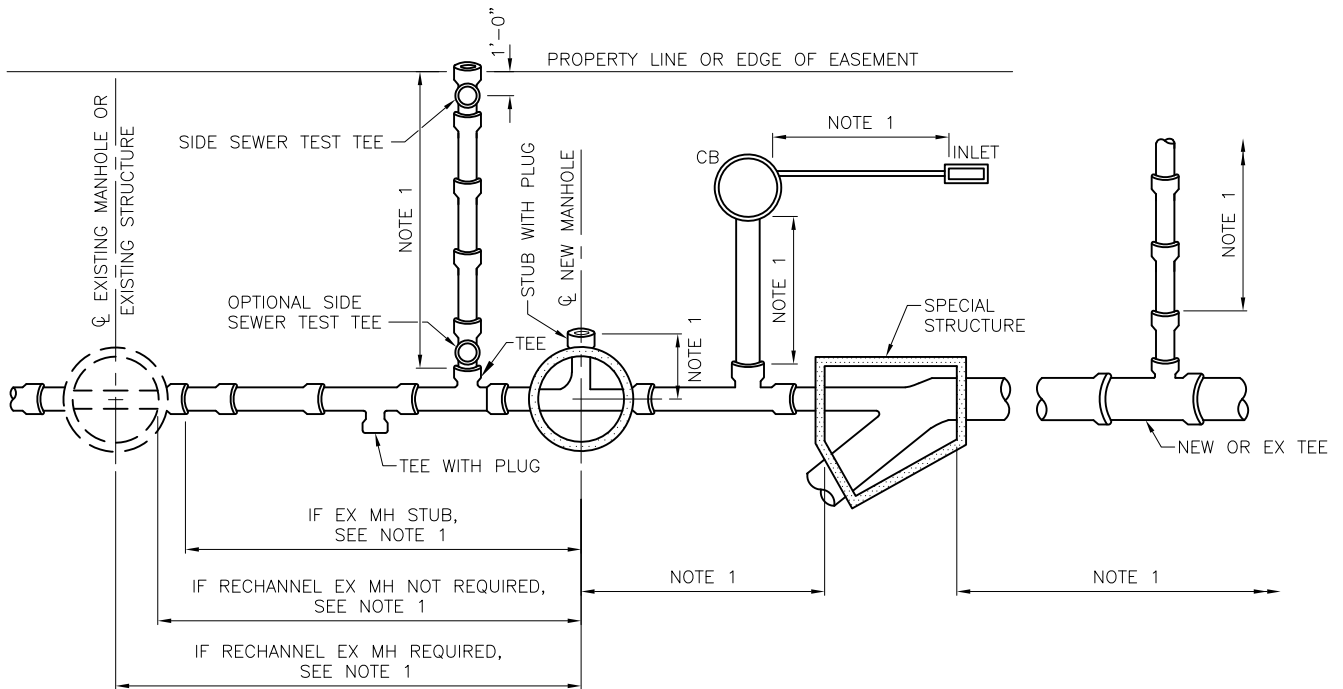

PLAN VIEW

NOTES:

1. MEASUREMENT PER LINEAR FOOT. PIPE ENDING IN STRUCTURE MEASURED TO EITHER INSIDE FACE OR TO CENTERLINE OF STRUCTURE AS INDICATED, OR TO TEE OR WYE AS INDICATED.
2. TEE OR WYE INCLUDING PLUG - UNIT PRICE EACH
3. ALL PIPE MUST BE MEASURED ON THE SLOPE ALONG THE CENTERLINE OF PIPE TO NEAREST 0.10 LF.

REF STD SPEC SEC DIVISION 7




City of Seattle

NOT TO SCALE

**SEWER/DRAINAGE
MEASUREMENT DIAGRAM**


NOTES:

1. MONUMENT CASE TO BE INSTALLED BY CONTRACTOR.
2. BASE TO BE PLACED ON A WELL COMPACTED FOUNDATION.
3. FRAME AND COVER MUST BE TESTED FOR ACCURACY OF FIT AND MUST BE MARKED IN SETS FOR DELIVERY.
4. FRAME AND COVER MUST BE CAST IRON AND HAVE COATING APPLIED TO ALL FACES.
5. CASTINGS IN RIGID PAVEMENT MUST HAVE REINFORCING STEEL IN THE PAVEMENT.
6. USE LOCKING COVER IN R/W. DRILL AND TAP, APPLY ANTI-SEIZE COATING AND BOLT DOWN WITH $\frac{3}{8}$ " S.S. ALLEN-HEAD BOLTS -2 PLACES.

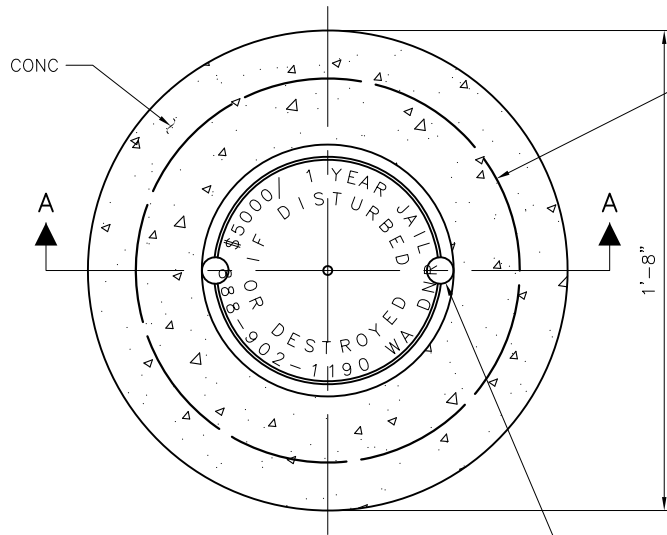


16" #3 BAR SPIRAL, 3" BETWEEN LAYERS (3 LAYERS OF BAR)


RISER RING DIMENSIONS			
A (SIZE)	1 1/2"	2"	3"

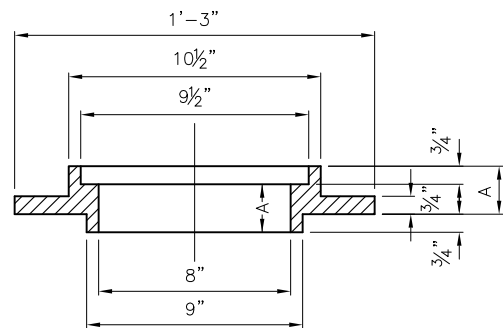

RISER RING SECTION

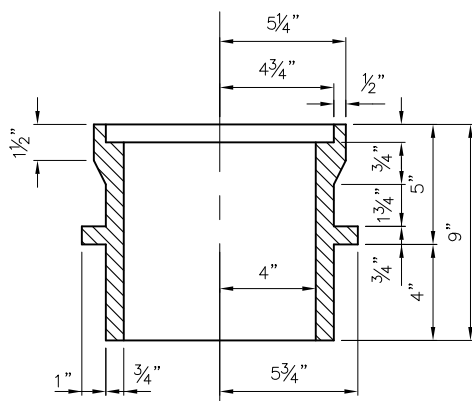

CASE SECTION



COVER SECTION

PLAN
SEE SECTION A-A ON
STD PLAN NO 020c

DRILL & TAP
FOR LOCKING
AS REQUIRED.
SEE NOTE 6.


REF STD SPEC SEC 8-13




City of Seattle

NOT TO SCALE


MONUMENT FRAME & COVER

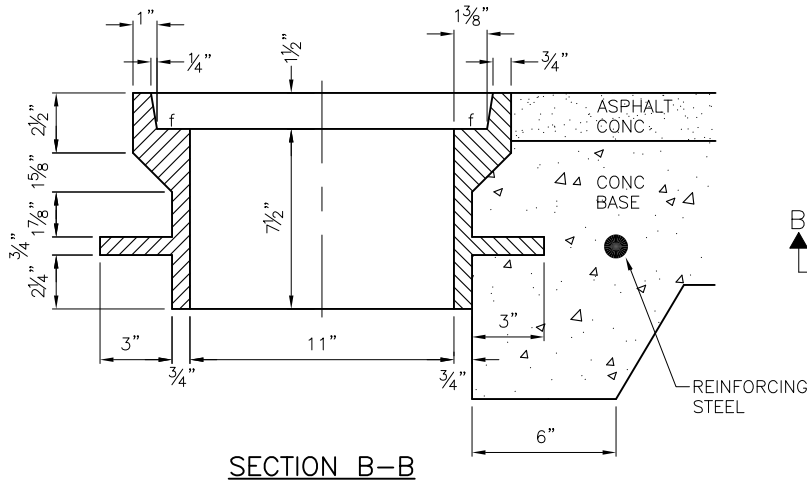

SECTION B-B

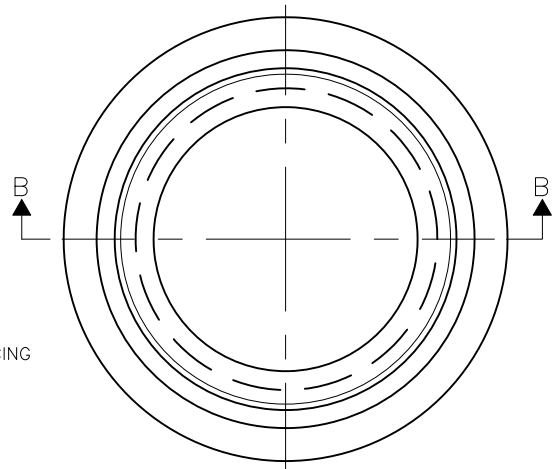


PLAN VIEW

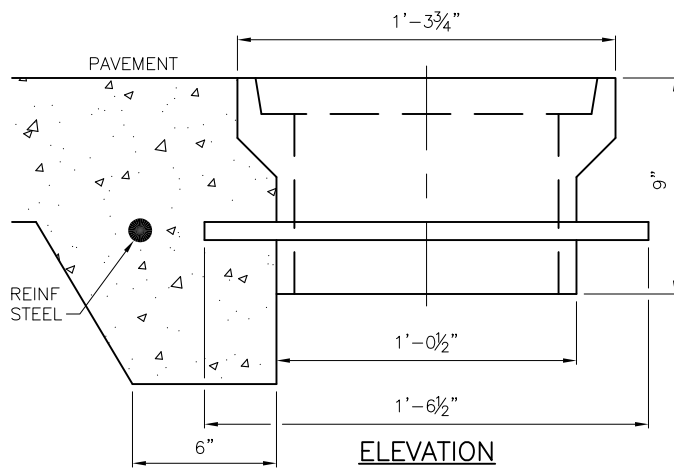

ELEVATION

NOTES:

1. FRAME AND COVER MUST BE TESTED FOR ACCURACY OF FIT AND MUST BE MARKED IN SETS FOR DELIVERY
2. FRAME AND COVER SHALL BE CAST IRON
3. "f"=FINISH
4. CASTINGS IN RIGID PAVEMENT MUST HAVE REINFORCING STEEL IN THE PAVEMENT.

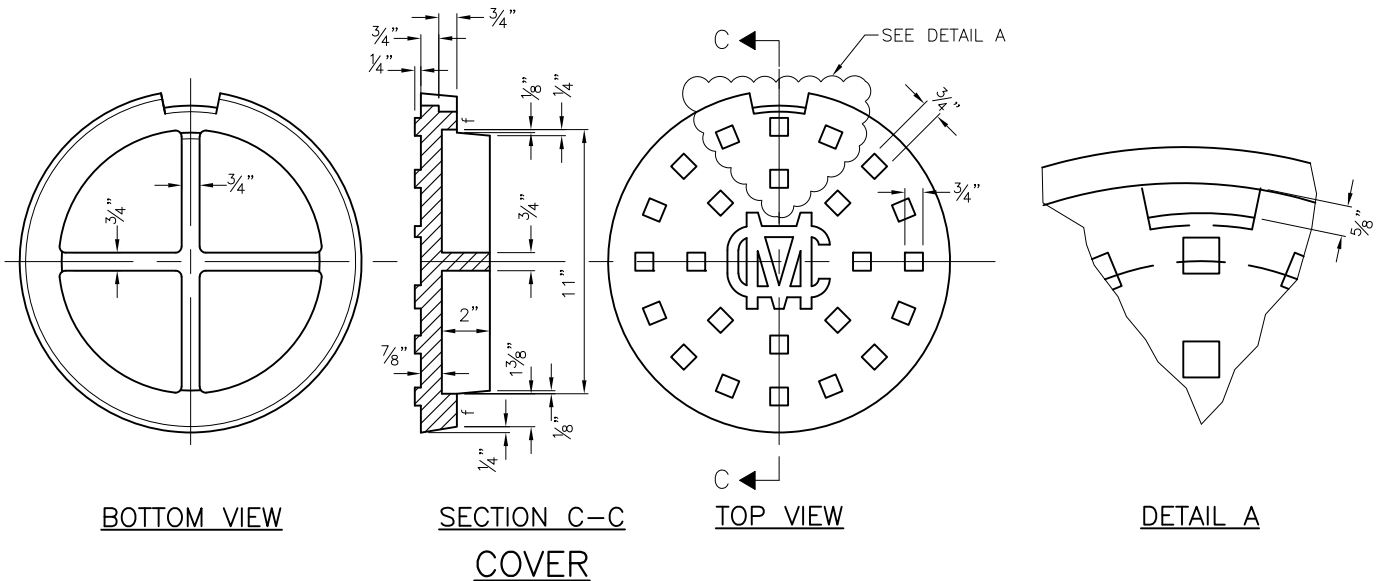

BOTTOM VIEW

SECTION C-C

TOP VIEW

DETAIL A

COVER



REF STD SPEC SEC 8-13




City of Seattle

NOT TO SCALE

MONUMENT FRAME & COVER

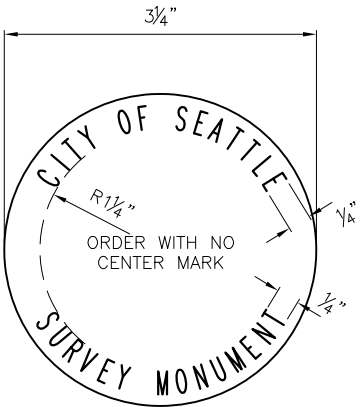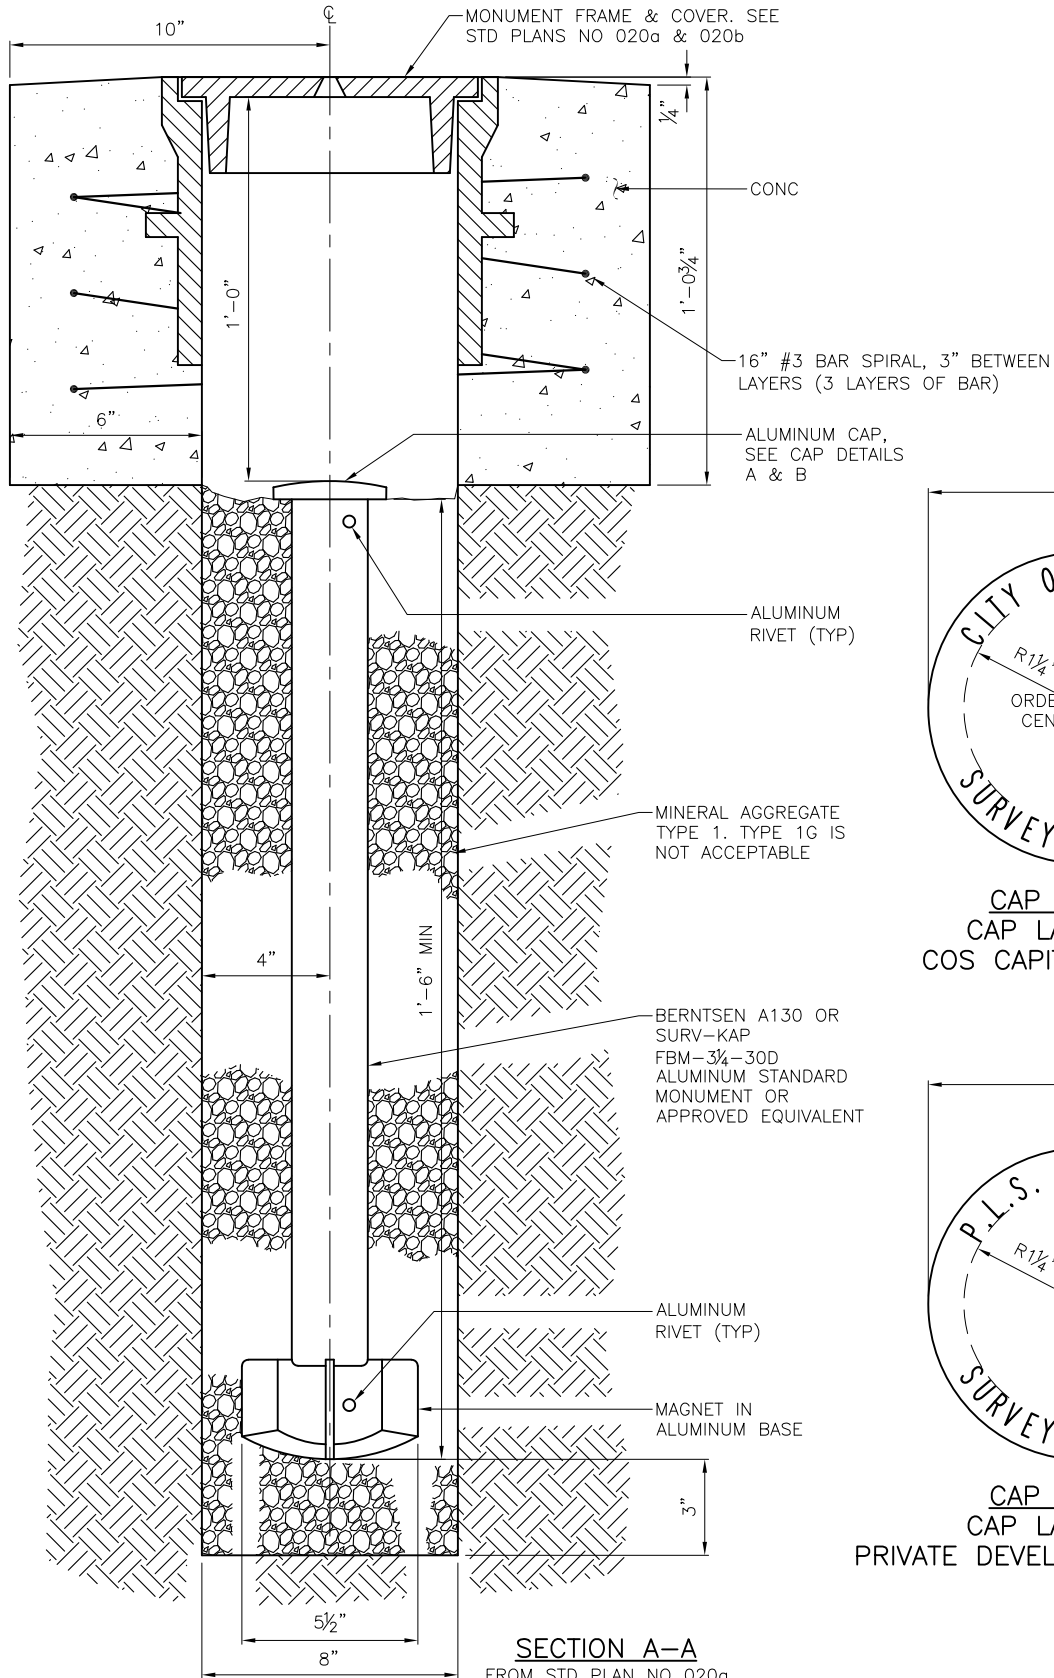

CAP DETAIL A
CAP LAYOUT FOR
COS CAPITAL PROJECTS

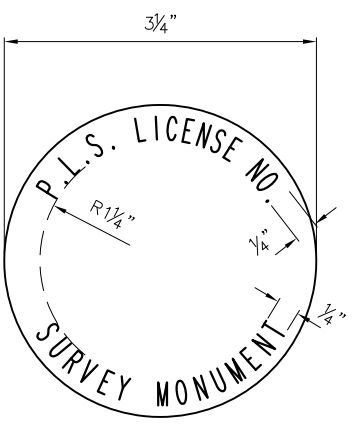

CAP DETAIL B
CAP LAYOUT FOR
PRIVATE DEVELOPMENT PROJECTS

SECTION A-A
FROM STD PLAN NO 020a


REF STD SPEC SEC 8-13



City of Seattle

NOT TO SCALE

SURVEY MONUMENT

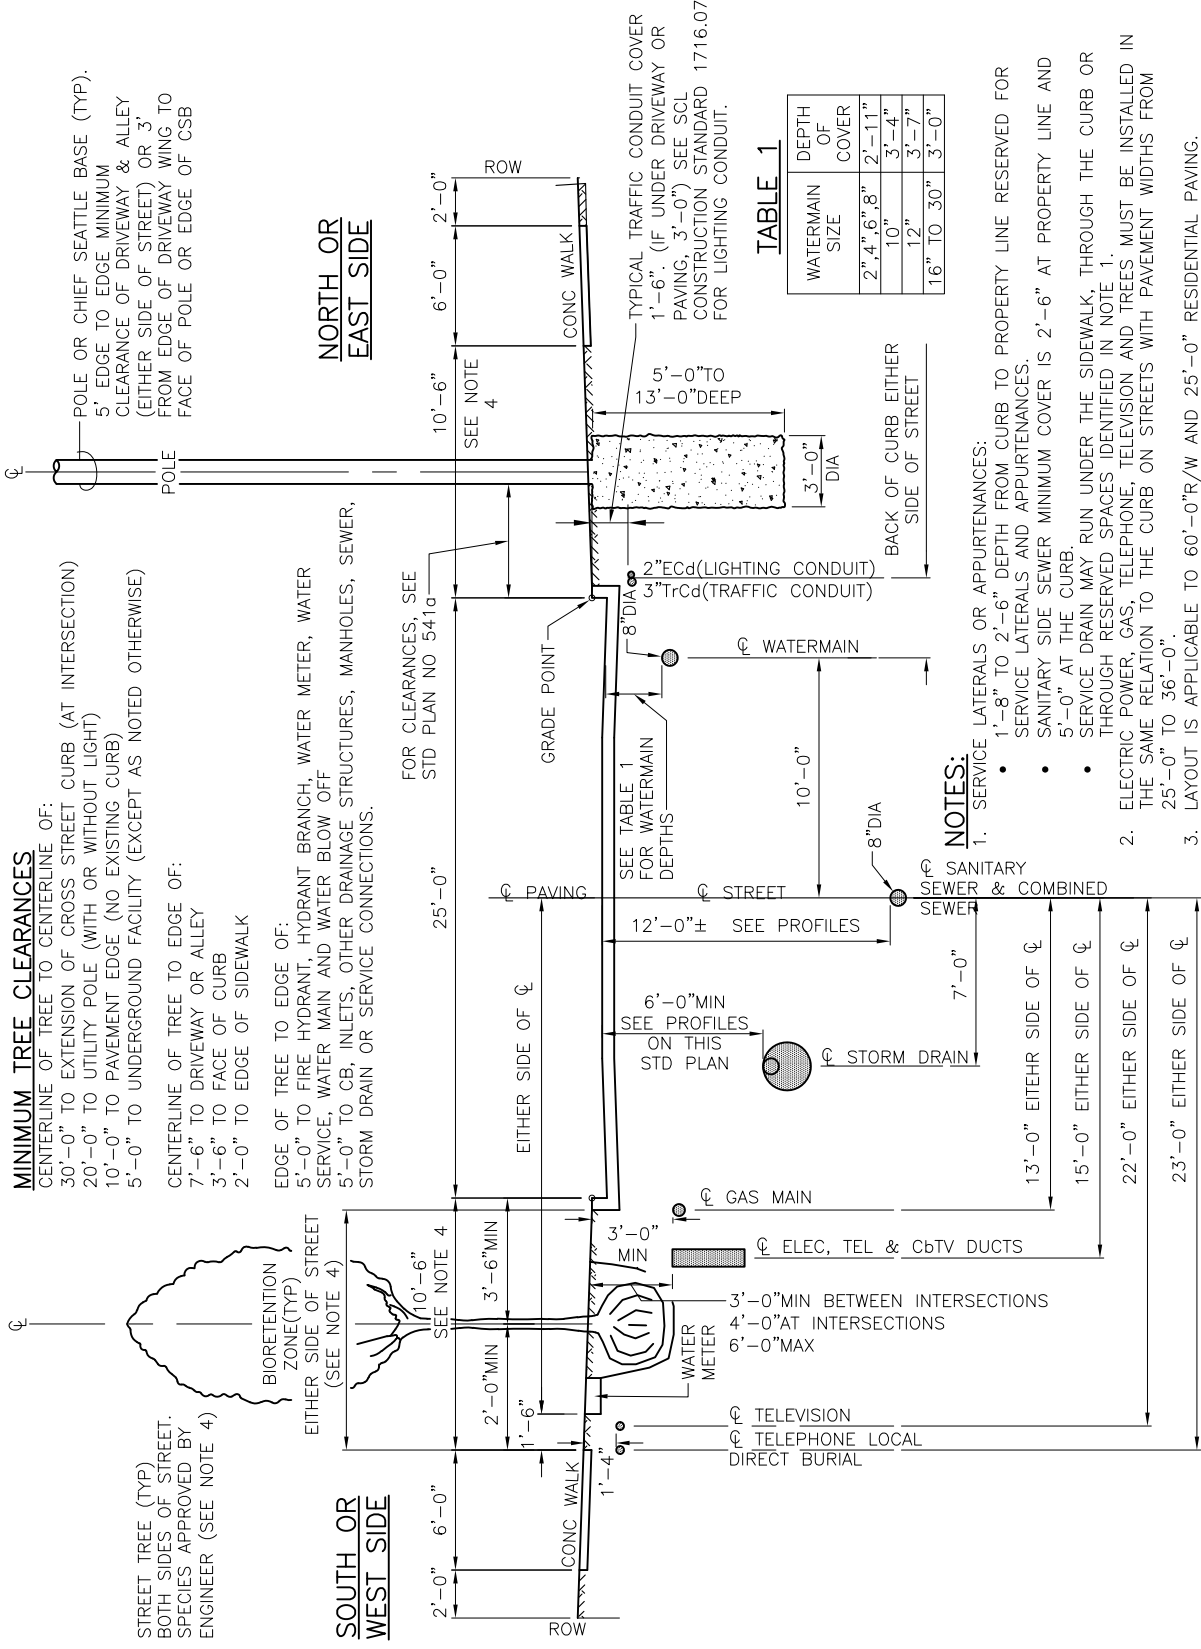


REF STD SPEC SEC 1-07.16, 1-07.17, 1-07.28



City of Seattle

NOT TO SCALE

DESIRABLE LOCATIONS FOR UTILITIES (RESIDENTIAL STREET)

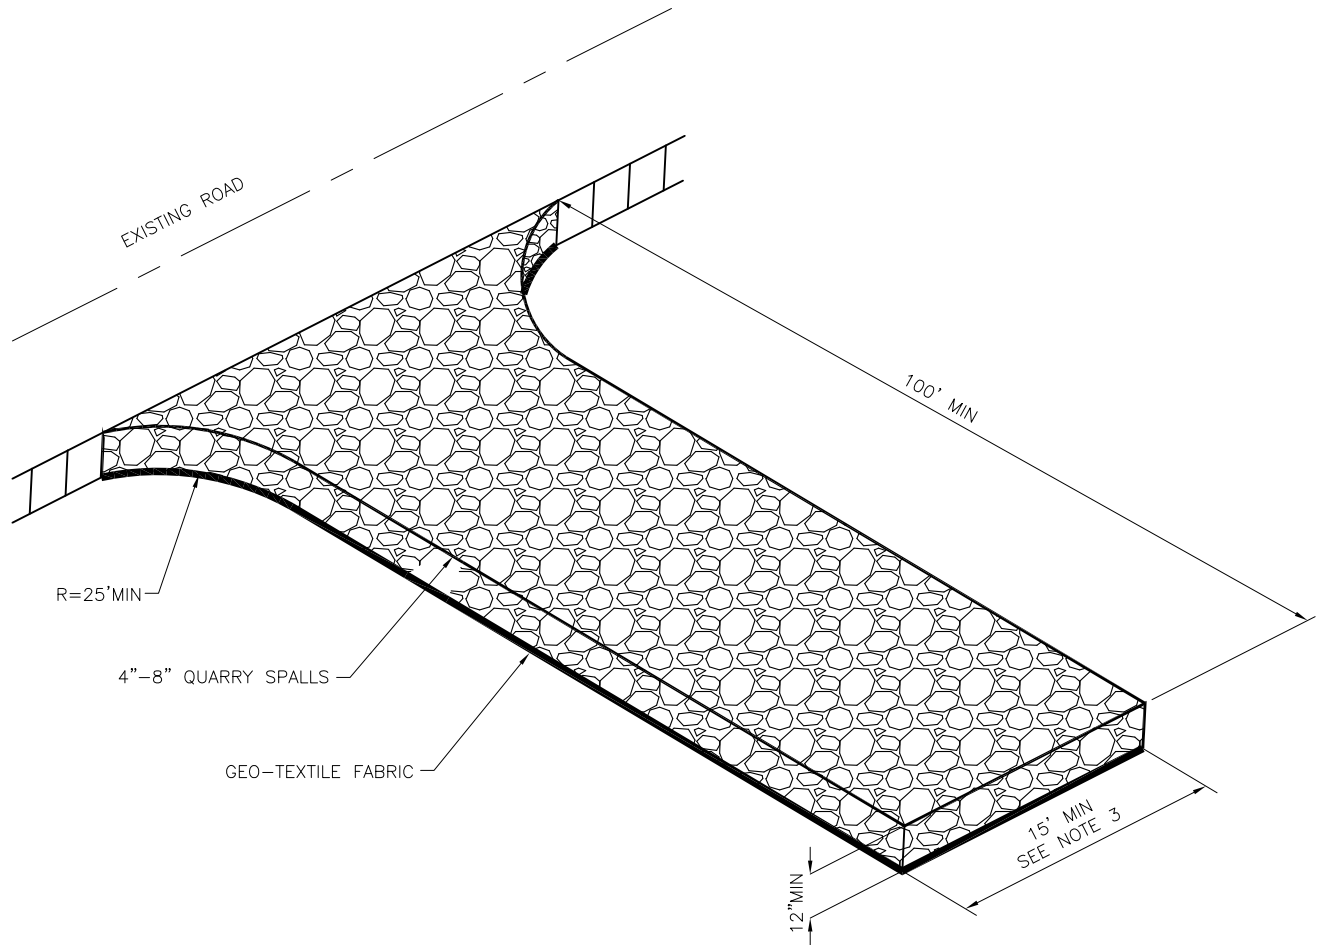

NOTES:

1. STABILIZED ACCESS MUST BE USED IN ALL AREAS OF THE SITE WITH VEHICLE TRAFFIC AND PARKING, INCLUDING PLANTING STRIPS.
2. SEE SECTION 9-37.2 (TABLE 3) FOR GEOTEXTILE REQUIREMENTS. GEOTEXTILE MODIFICATIONS BASED ON SPECIFIC PROJECT SITE CONDITIONS MAY BE APPROVED BY THE ENGINEER.
3. STABILIZED CONSTRUCTION ENTRANCES ON SEATTLE PARKS & RECREATION PROPERTY ARE LIMITED TO A MAXIMUM WIDTH OF 10 FEET UNLESS DIRECTED OTHERWISE.

REF STD SPEC SEC 8-01



City of Seattle

NOT TO SCALE

**STABILIZED CONSTRUCTION
ENTRANCE**

NOTES:

1. REMOVE STAKES ONE YEAR AFTER INSTALLATION.
2. SHAPE SOIL SURFACE TO PROVIDE 4' DIA WATERING RING.
3. TREE CLEARANCE MUST BE PER STD PLAN NO 030.
4. SEE STD PLAN NO 424 FOR TREE PIT DETAIL.
5. ADJUST TREE TIES DURING ESTABLISHMENT TO ALLOW ROOM FOR GROWTH (@1" SLACK).
6. ROOT BARRIER REQUIRED ALONG EDGE OF ROADWAY, CURB, DRIVEWAY, TRAIL, SIDEWALK, OR OTHER STRUCTURES WHERE ROOTBALL IS WITHIN TWO FEET; PLACE VERTICAL ROOTBARRIER AS SHOWN IN STANDARD PLANS NO 424a OR 424b. INSTALL ROOT BARRIERS FOR NEWLY PLANTED TREES ONLY.

STAKE TREE WITH (2) TREATED 2"Ø LODGEPOLE PINE DOWELED TREE STAKES (8'-0" LENGTH) LOOP EACH TIE AROUND HALF TREE LOOSELY TO PROVIDE 1" SLACK FOR TRUNK GROWTH.

"CHAINLOCK" OR EQUAL TREE TIE MATERIAL (1" SIZE) NAIL OR STAPLE TREE TIE MATERIAL TO STAKE TO HOLD VERTICALLY. LOOP EACH TIE AROUND HALF TREE LOOSELY TO PROVIDE 1" SLACK FOR TRUNK GROWTH.

2"-3" MULCH DEPTH (TAPERED AT TRUNK)

MULCH TREE PIT MIN 5'-0" LENGTH X FULL PLANTING STRIP WIDTH BETWEEN CURB AND SIDEWALK (FOR PLANTING STRIPS LESS THAN 6'-0" WIDE) OR PROVIDE 5'-0" DIA MULCH RING FOR PLANTING STRIPS WIDER THAN 6'-0".

SIDEWALK

18" ROOTBARRIER AT SIDEWALK.

ROUGHEN SIDES OF PLANTING HOLE MAXIMIZE EXCAVATED AREA WITHOUT UNDERMINING ADJACENT PAVING/CURB.

ROOTBARRIER; PLACE AT EDGE OF PAVEMENT/SIDEWALK/ETC.; PLACE PRIOR TO PLACEMENT OF NEW SIDEWALK OR CURB TO PREVENT UNDERMINING.

SEE STD SPEC SECTION 8-02.3(6)B, OR AS APPROVED BY ENGINEER.

REMOVE ALL WIRE, STRINGS, AND OTHER NON-BURLAP MATERIAL; AND REMOVE BURLAP FROM TOP 2/3 OF ROOTBALL MINIMUM. REMOVE ENTIRELY WHEN DIRECTED BY THE ENGINEER.

MIN WIDTH OF TREE PIT = 2 TIMES ROOTBALL DIAMETER OR 5'-0", WHICHEVER IS GREATER

MULCH AREA TO BE CLEAR OF GRASS, WEEDS, ETC. TO REDUCE COMPETITION WITH TREE ROOTS

2" TO 2½" CALIPER UNLESS OTHERWISE SPECIFIED

SET TOP OF ROOT CROWN 2" ABOVE ADJACENT CURB & SIDEWALK GRADE.

3" TO 4" HIGH WATERING RING (SEE NOTE 2)


24" ROOTBARRIER AT CURB WHEN SHOWN ON THE DRAWINGS.

TREE PIT DEPTH = ROOTBALL DEPTH (MEASURE BEFORE DIGGING TO AVOID OVEREXCAVATION).

DRIVE STAKES 6" TO 1'-0" INTO UNDISTURBED SOIL BELOW ROOTBALL.

DRIVE STAKE AT ROOTBALL EDGE (TYP)(SEE NOTE 1)

UNDISTURBED SUBGRADE (PROVIDES FIRM BASE SO THAT ROOTBALL WILL NOT SINK).

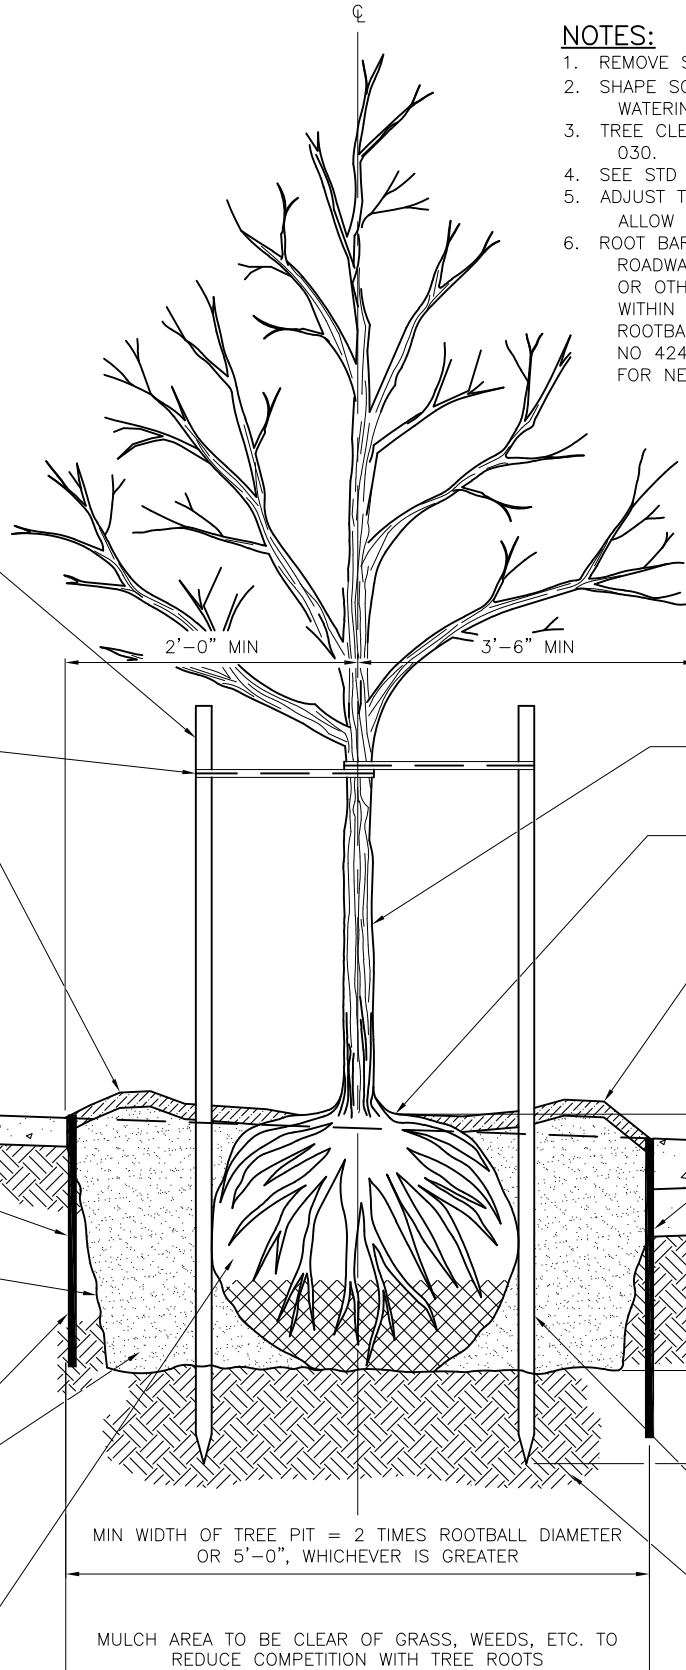


REF STD SPEC SEC 8-02



City of Seattle

NOT TO SCALE

**DECIDUOUS TREE PLANTING
IN PLANTING STRIP**

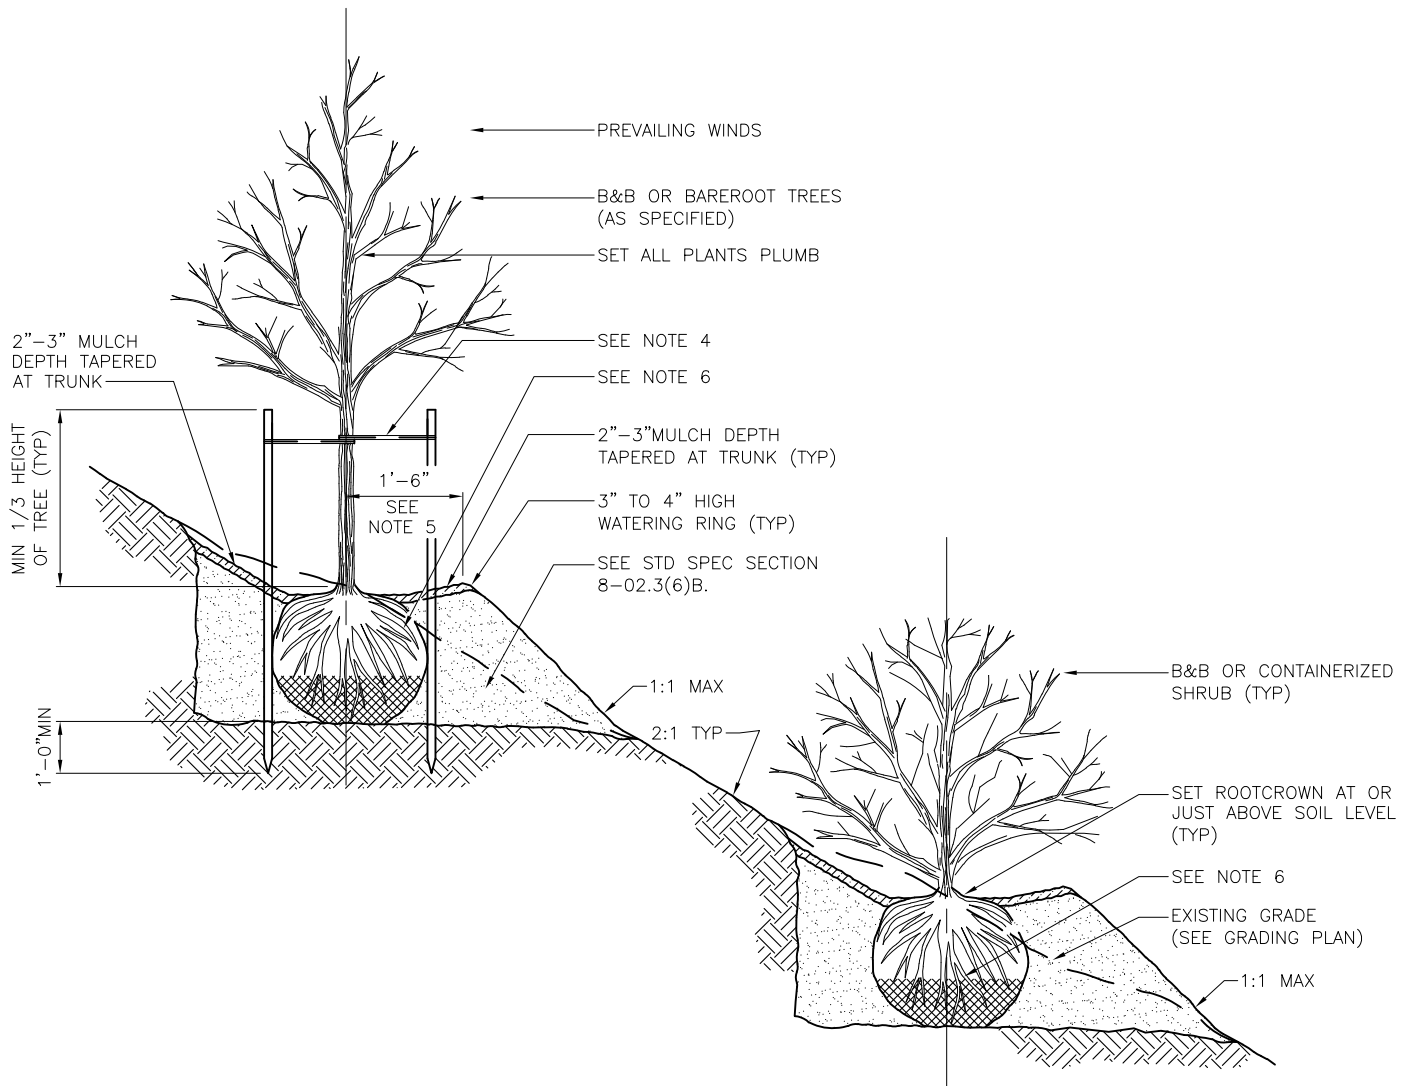

NOTES:

1. STAKE TREES PER STD PLAN NO 100a.
2. ONE STAKE PER TREE ON WINDWARD SIDE; SECOND STAKE ON LEEWARD SIDE.
3. SLOPES STEEPER THAN 2:1 MAY REQUIRE AN APPROVED EMBANKMENT STABILIZATION SYSTEM TO CREATE A LEVEL TREE PIT SUCH AS:
 - ROCK FACING
 - PRECAST CONCRETE WALL UNITS
 - TIMBER WALL
 - MANUFACTURED SLOPE RETENTION UNITS
4. CHAINLOCK TREE TIE. LOOP EACH TIE AROUND TREE LOOSELY TO PROVIDE 1" SLACK FOR DIAMETER GROWTH.
5. SHAPE SOIL TO PROVIDE 3' DIAMETER OR ROOTBALL DIAMETER, WHICHEVER IS GREATER, WATERING RING.
6. REMOVE AL WIRE, STRINGS AND OTHER NON-BURLAP MATERIAL; AND REMOVE BURLAP FROM TOP 2/3 OF ROOTBALL.



REF STD SPEC SEC 8-02



City of Seattle

NOT TO SCALE

TREE & SHRUB PLANTING
ON SLOPES

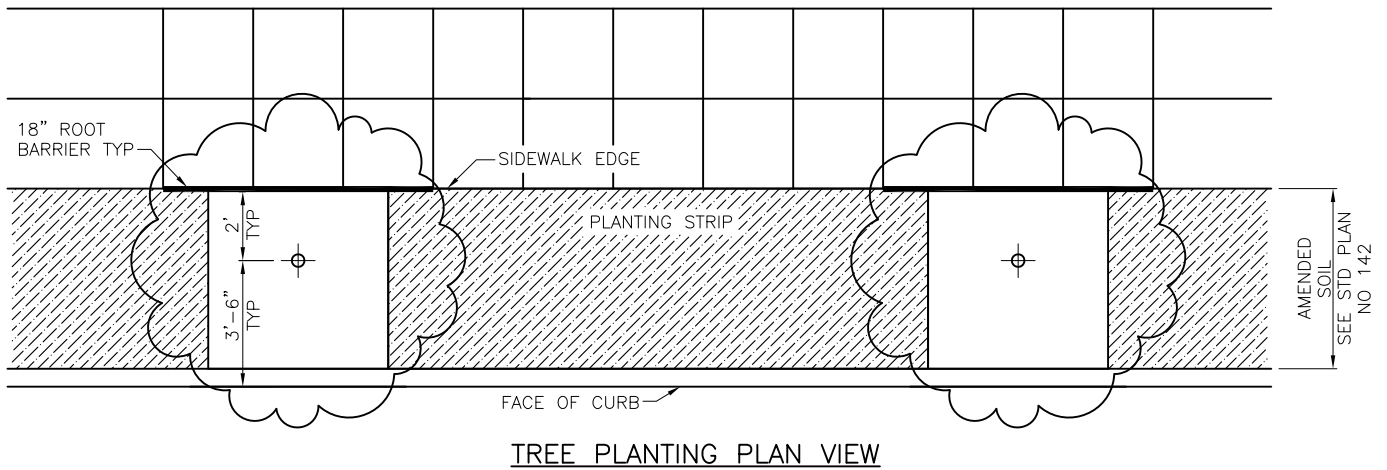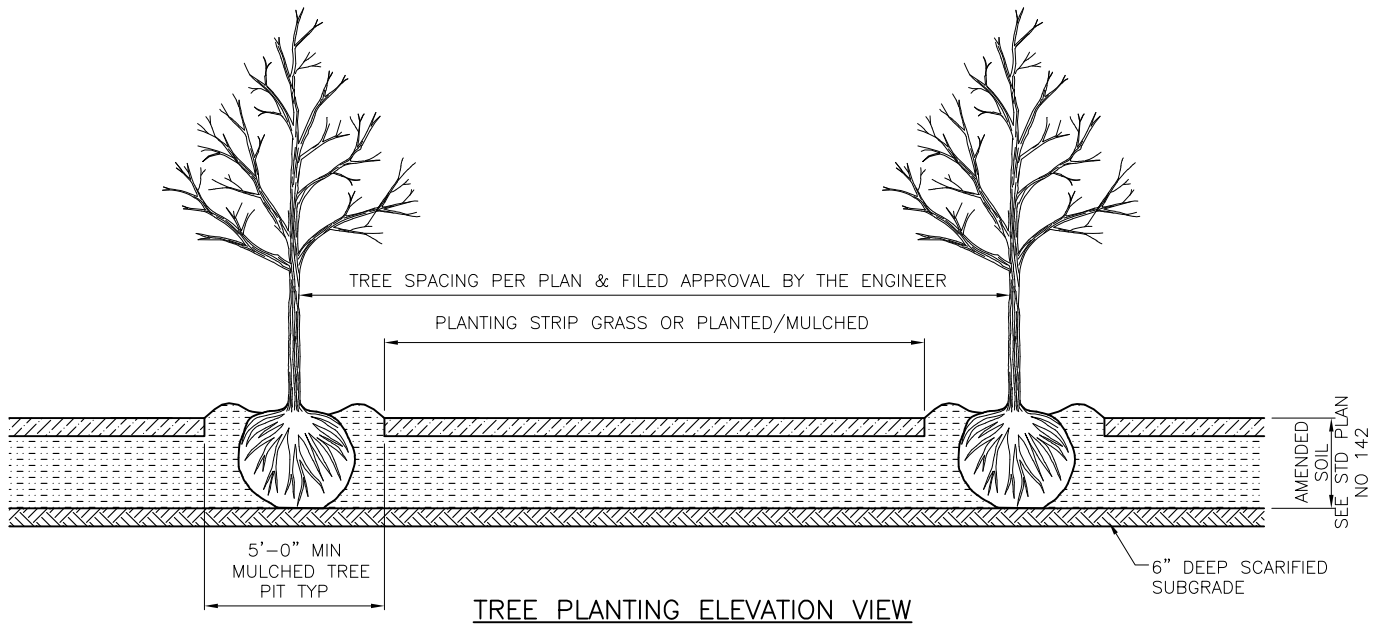


REF STD SPEC SEC 8-02



City of Seattle

NOT TO SCALE

TREE PLANTING IN AMENDED TRENCH

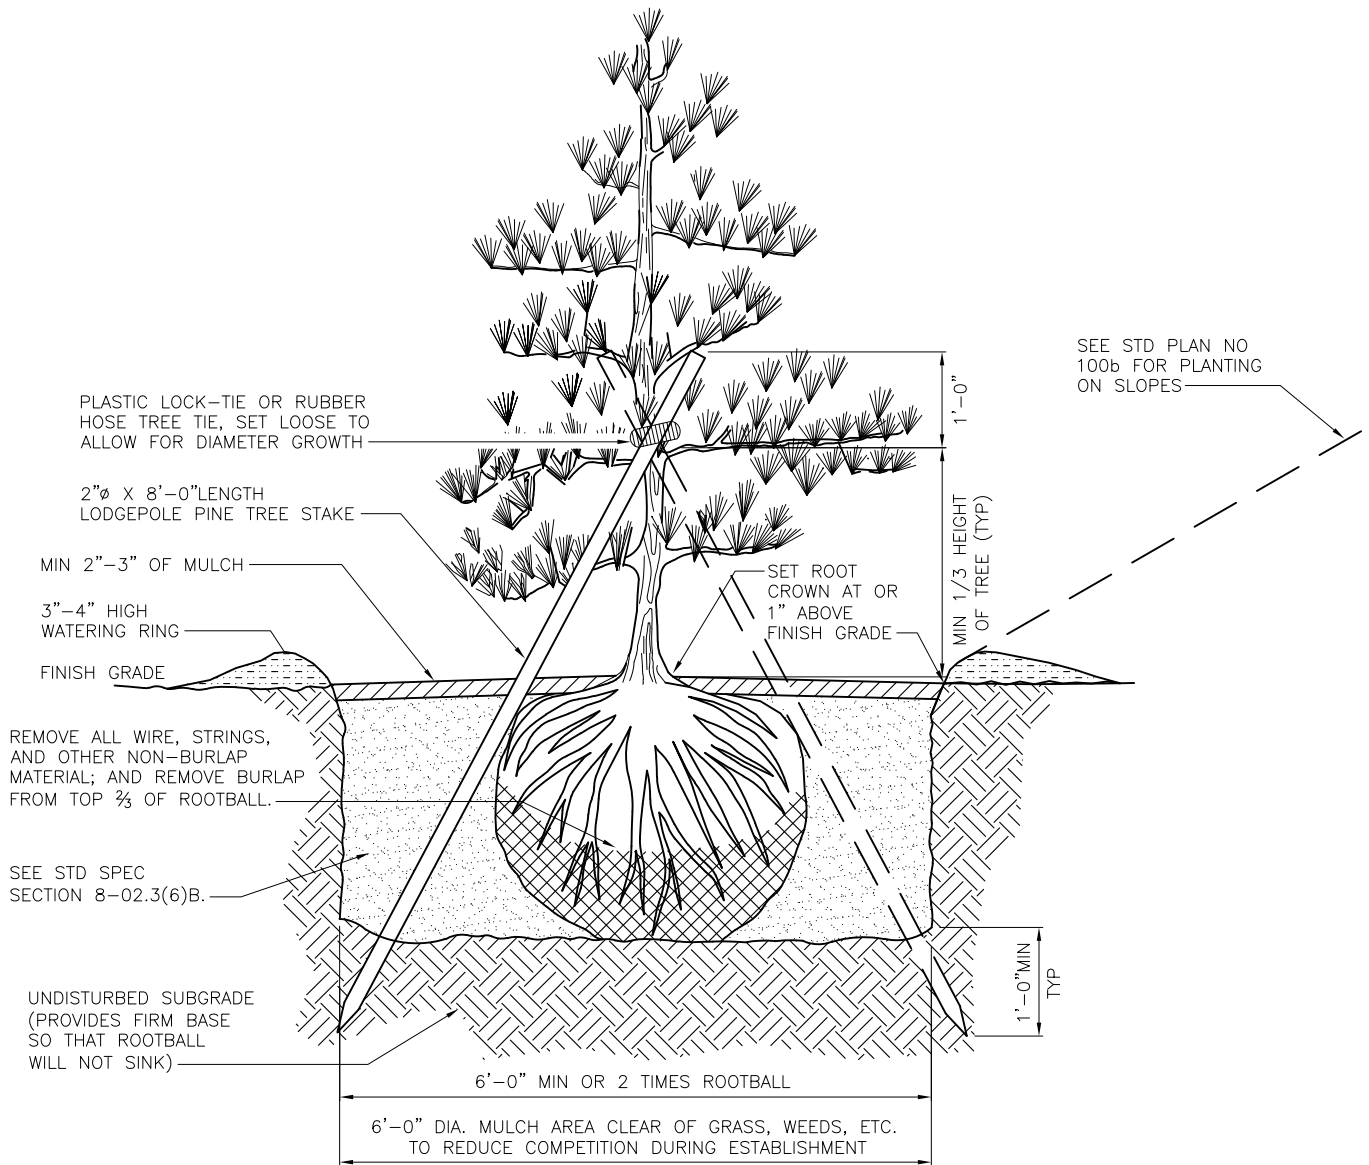


REF STD SPEC SEC 8-02



City of Seattle

NOT TO SCALE

CONIFEROUS TREE PLANTING

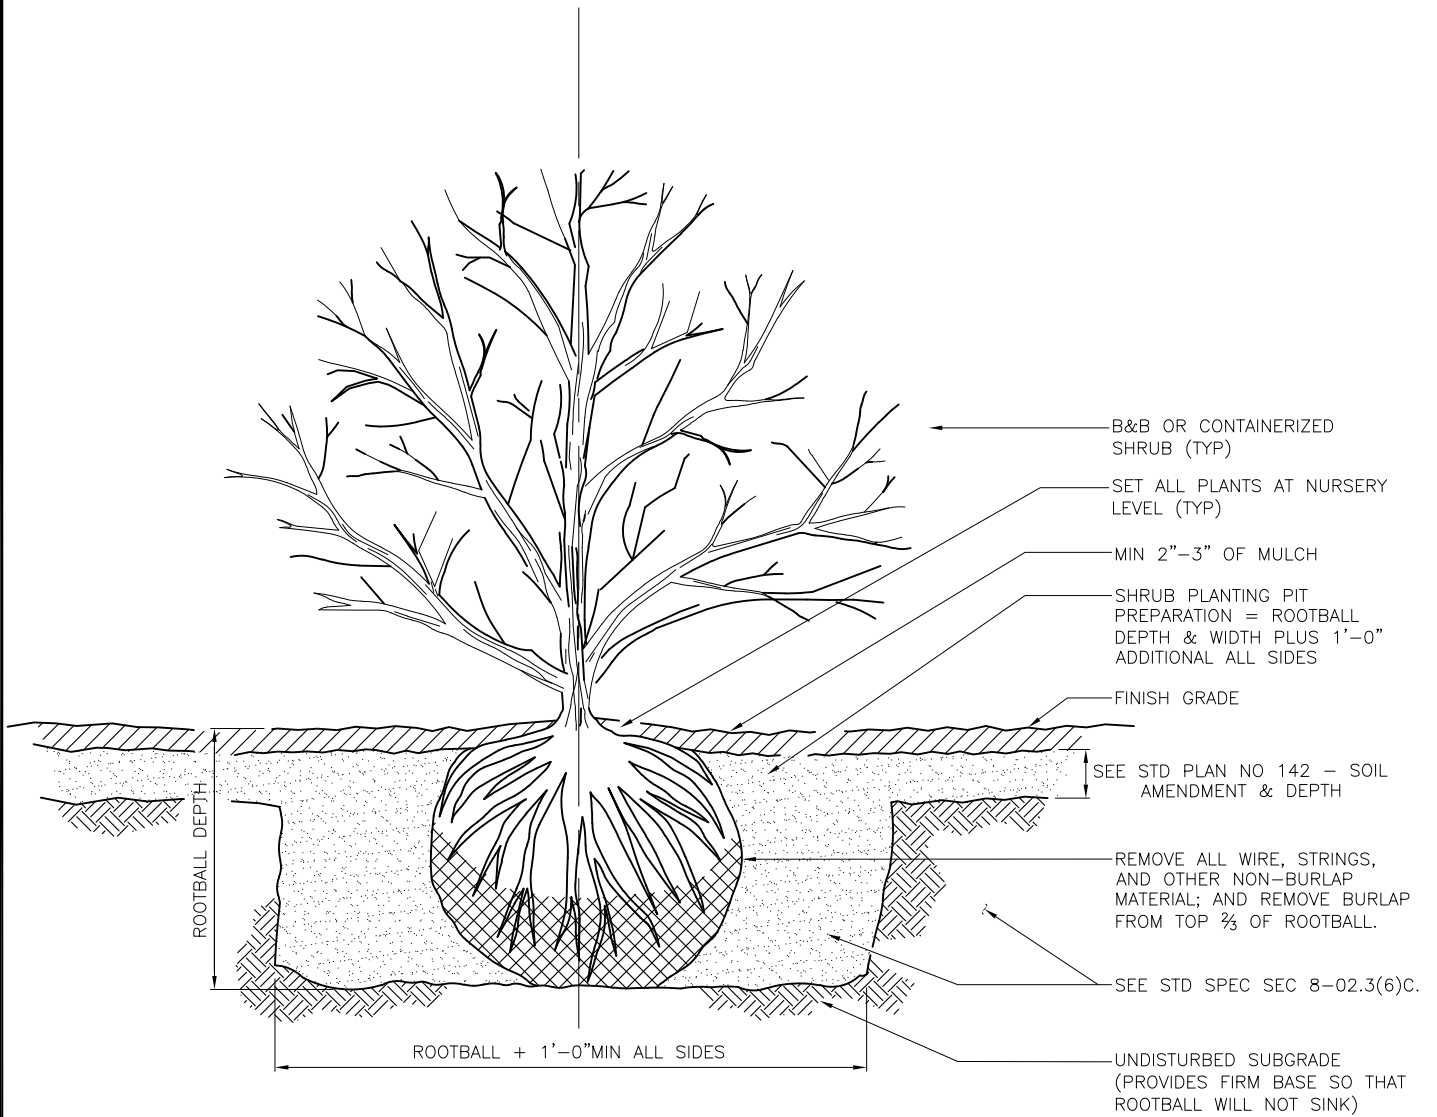


REF STD SPEC SEC 8-02



City of Seattle

NOT TO SCALE

SHRUB PLANTING

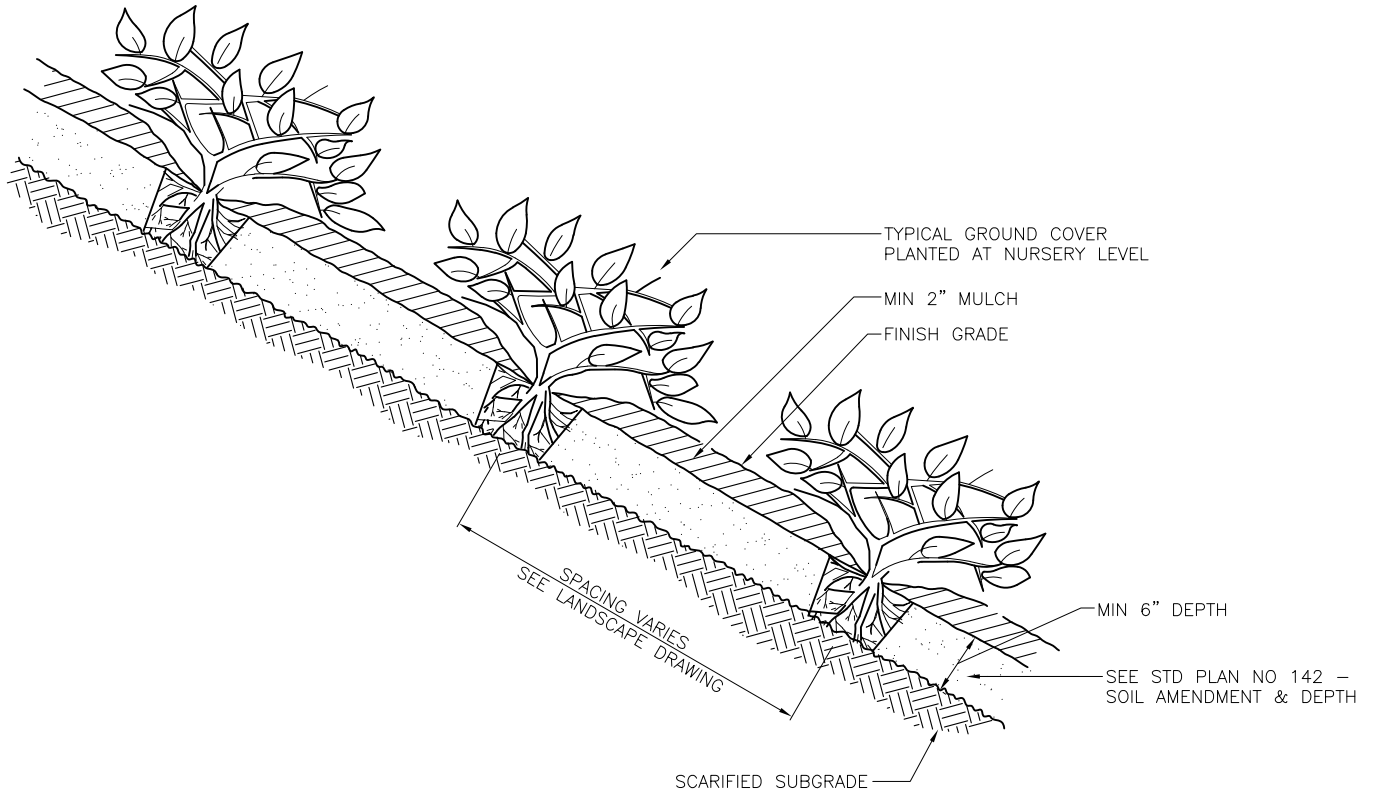


REF STD SPEC SEC 8-02



City of Seattle

NOT TO SCALE

GROUND COVER PLANTING

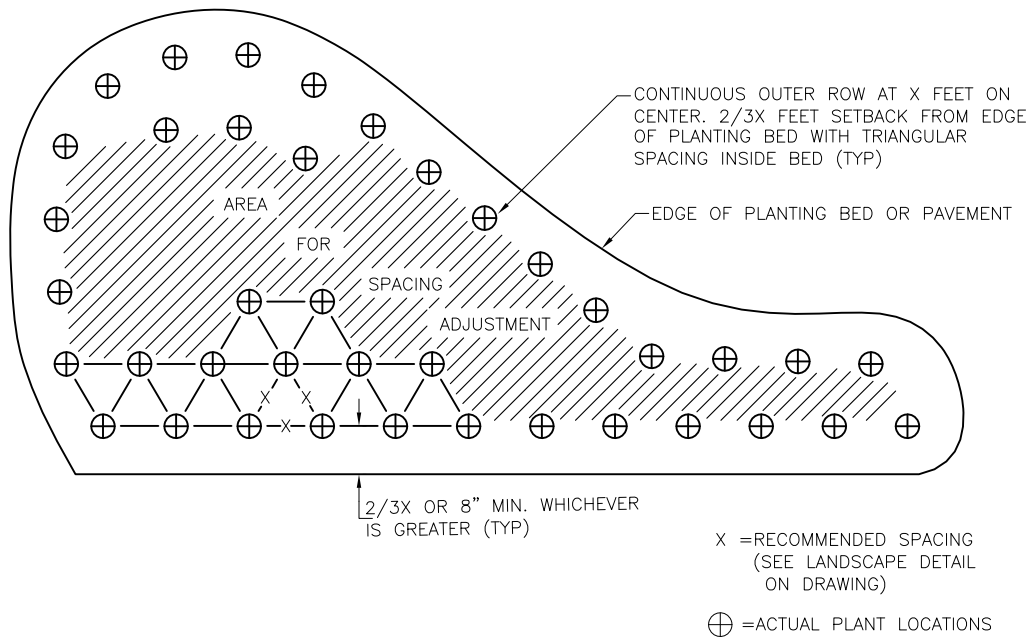


REF STD SPEC SEC 8-02



City of Seattle

NOT TO SCALE

PLANTING PATTERN

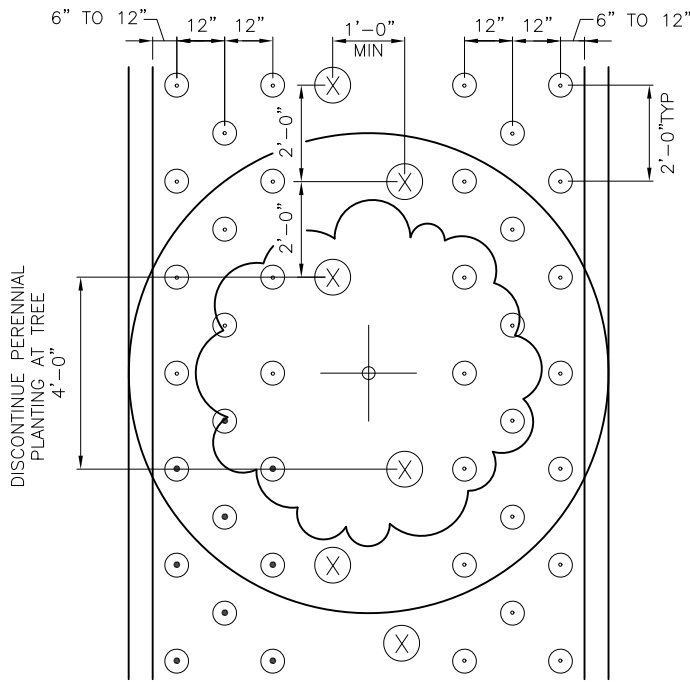


DISCONTINUE PERENNIAL PLANTING AT TREE 4'-0"

QUANT PER 10'-0" LF MEDIAN

⊙ GROUNDCOVER	30
⊗ SHRUB	5

DETAIL AT TREE PLAN

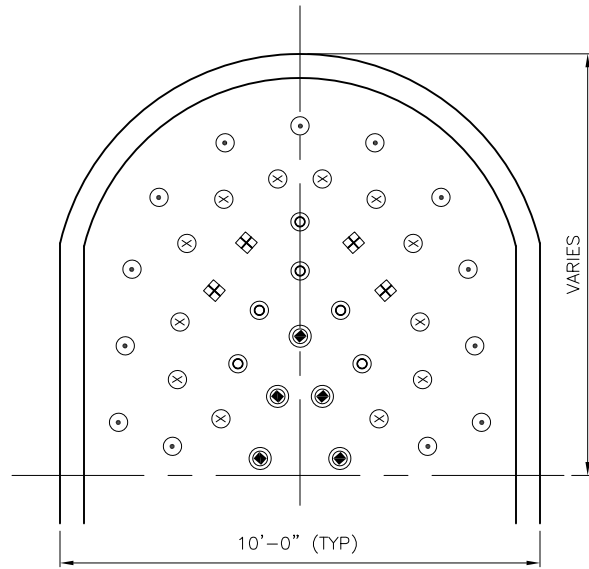

QUANT PER END CAP

⊠ PERENNIAL TYPE 1	4
⊙ PERENNIAL TYPE 2	6
⊗ PERENNIAL TYPE 3	5
⊙ EVERGREEN GROUNDCOVER TYPE 1	13
⊗ EVERGREEN GROUNDCOVER TYPE 2	12


END CAP DETAIL

TYP STREET TREE
2"-2 1/2" CALIPER
@ 30'-0" OC

CHAINLOCK TREE TIE.
LOOP EACH TIE AROUND
TREE LOOSELY TO
PROVIDE 1" SLACK FOR
DIAMETER GROWTH

(2) 2" Ø LODGEPOLE
PINE DOWELED TREE
STAKES (8'-0" LENGTH)

SEE STD PLAN NO 100
FOR SUPPLEMENTAL TREE
PLANTING INFORMATION

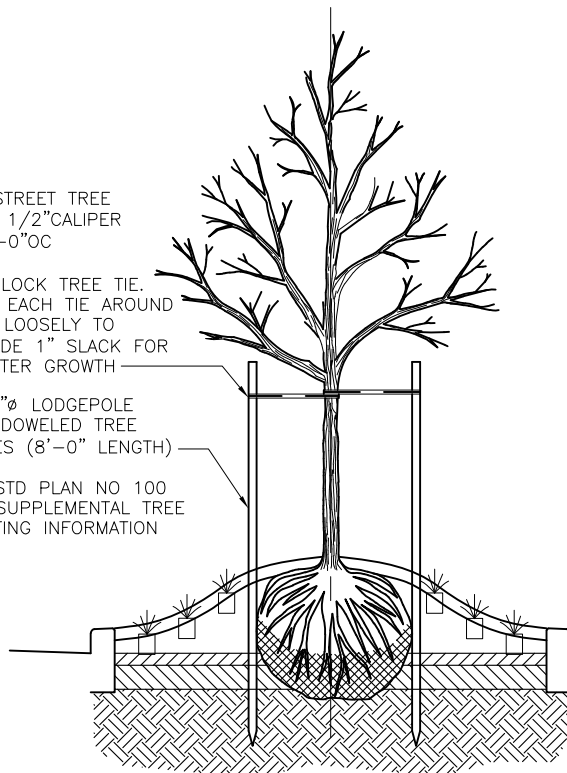

ELEVATION


PLACE 3" OF PLANTING
SOIL & MIX WITH
SUBSOIL BEFORE ADDING

SUBSEQUENT QUANTITIES
OF PLANTING SOIL (IN 6"
LIFTS) COMPACTED TO 85%

NATIVE SUBGRADE TO BE
SCARIFIED TO A DEPTH OF
6" PRIOR TO PLACEMENT
OF FILL. CALL FOR
INSPECTION BEFORE FILLING

2"-3" ARBORIST WOOD
CHIP MULCH

SEE STD PLANS NO 110 &
111 FOR SUPPLEMENTAL
SHRUB AND GROUNDCOVER
PLANTING INFORMATION

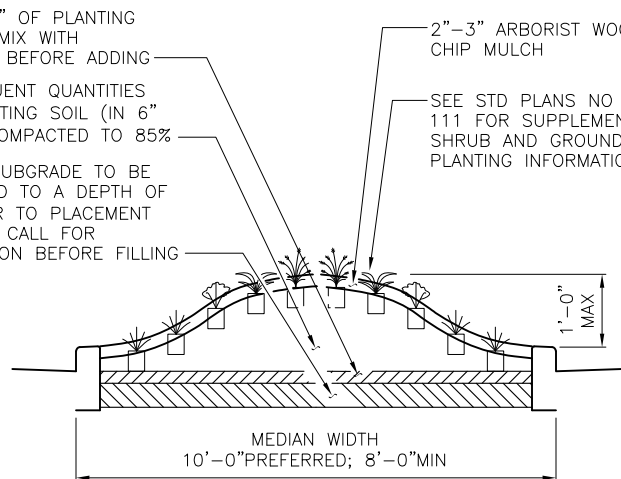

SOIL PREPARATION DETAIL


REF STD SPEC SEC 8-02




City of Seattle

NOT TO SCALE


MEDIAN PLANTING

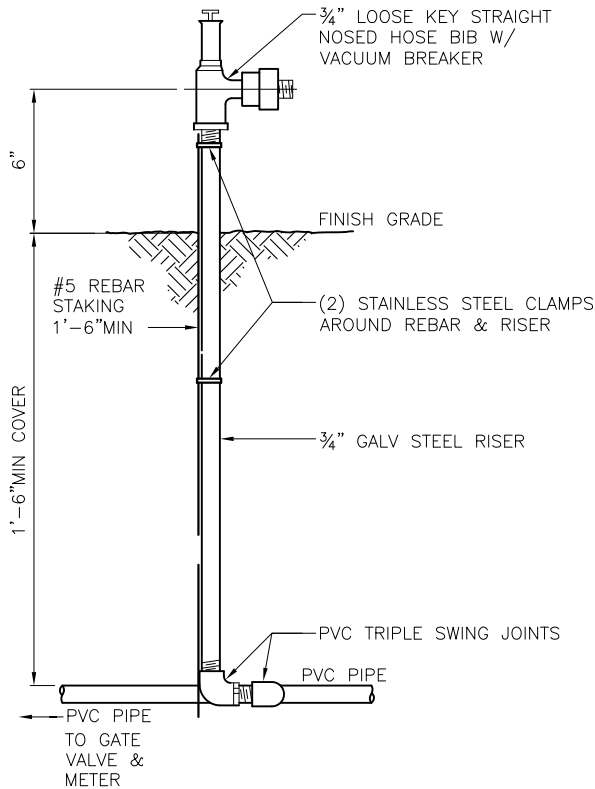


ABOVE GROUND HOSE BIB

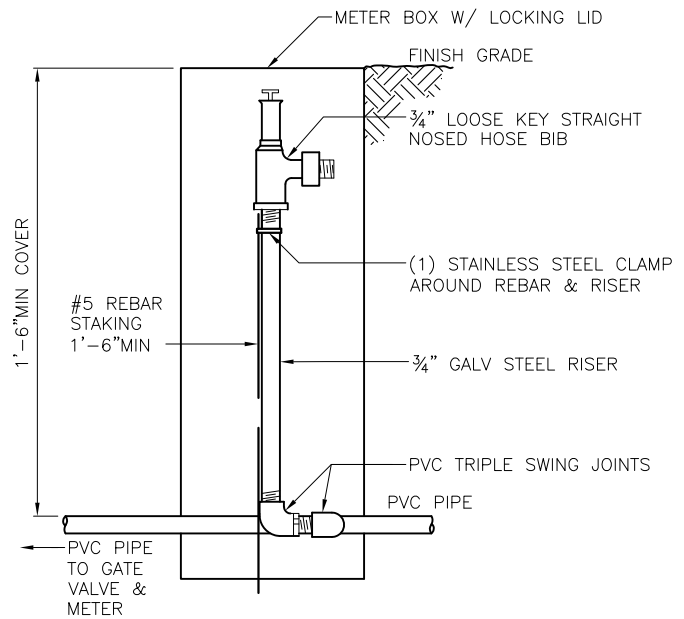

BELOW GROUND HOSE BIB



BRACE DETAIL - PLAN VIEW

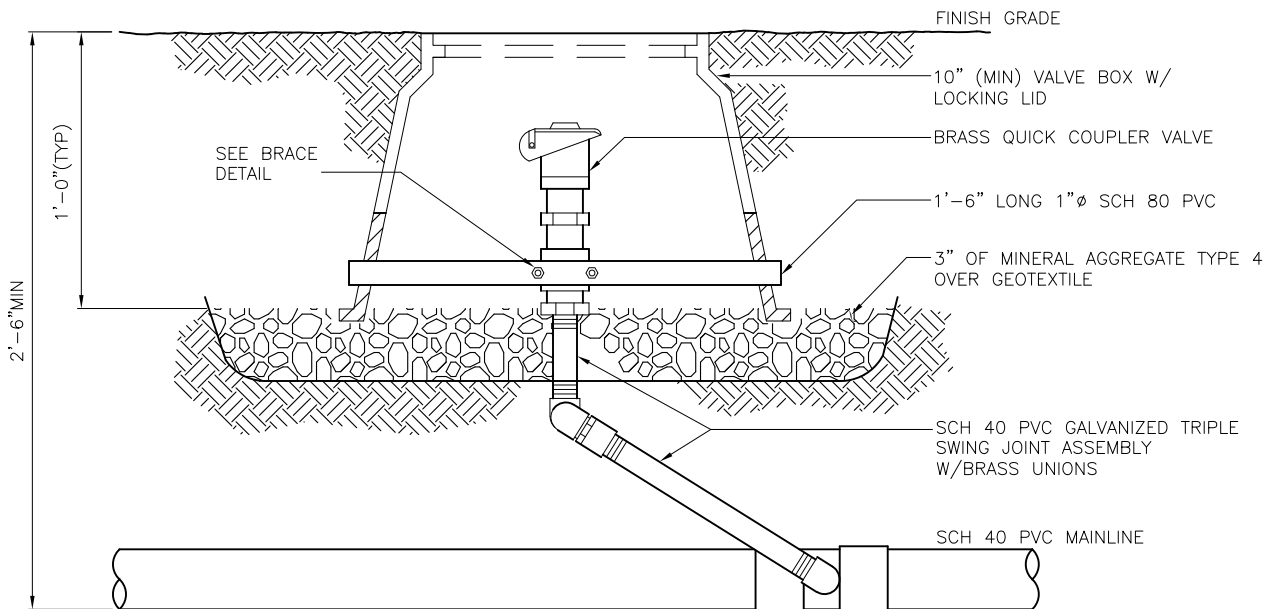

ELEVATION VIEW

QUICK COUPLER VALVE
TURF OR BED AREAS


REF STD SPEC SEC 8-03



City of Seattle

NOT TO SCALE


HOSE BIB ASSEMBLY AND
QUICK COUPLER VALVE

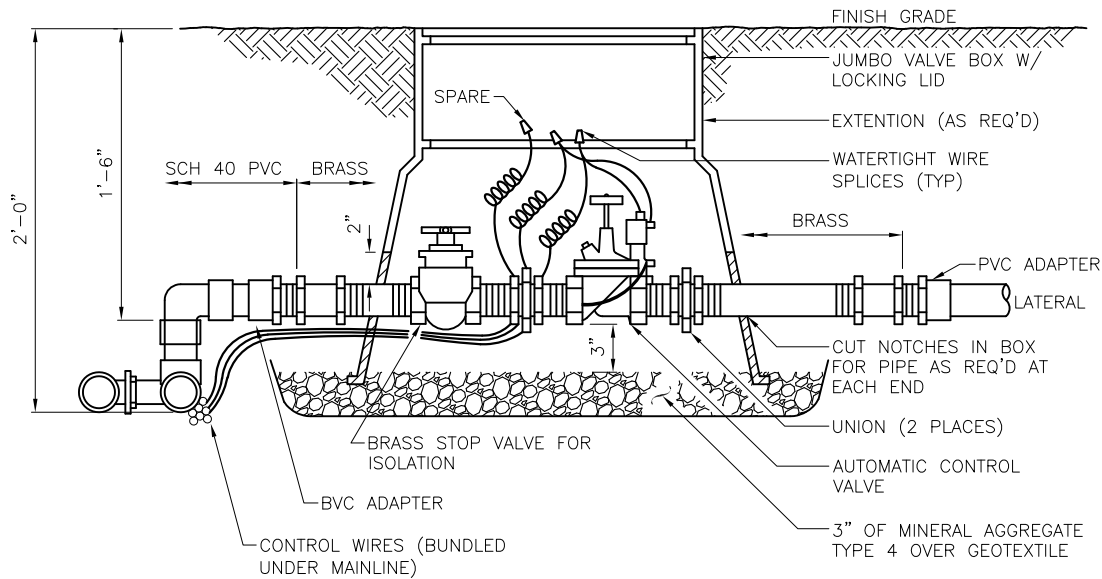

NOTE:

"U" SHAPED CUT-OUT IN VALVE BOX THAT ALLOWS 2" CLEARANCE FROM TOP OF PIPE TO TOP OF "U"

AUTOMATIC CONTROL VALVE

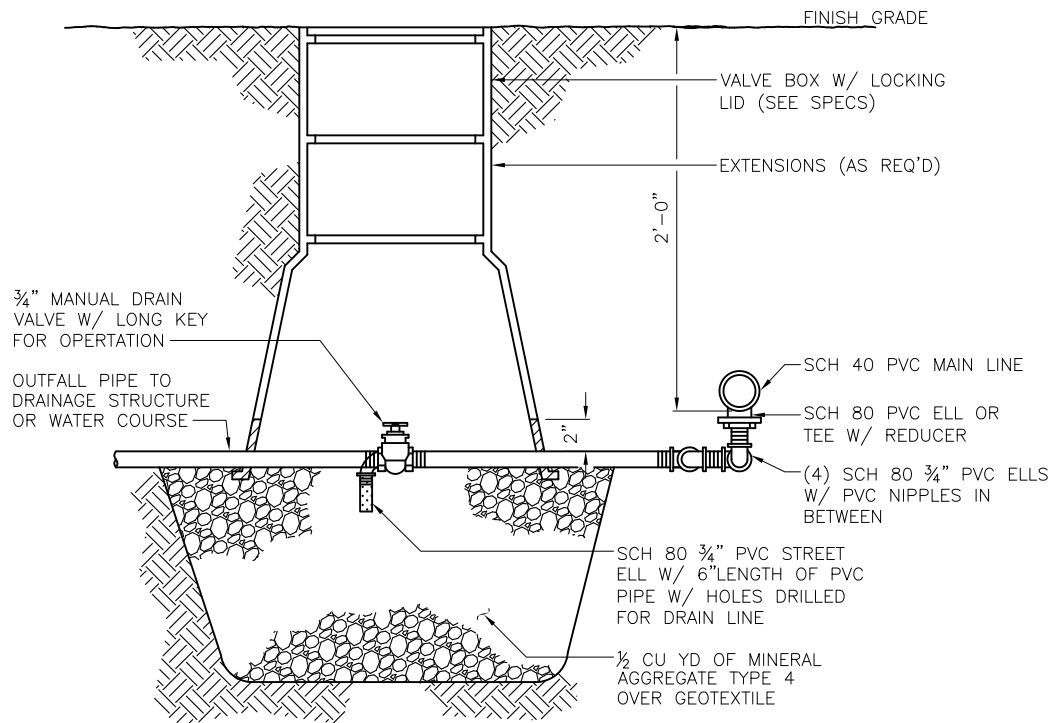

MANUAL DRAIN VALVE


REF STD SPEC SEC 8-03



City of Seattle

NOT TO SCALE

IRRIGATION VALVES

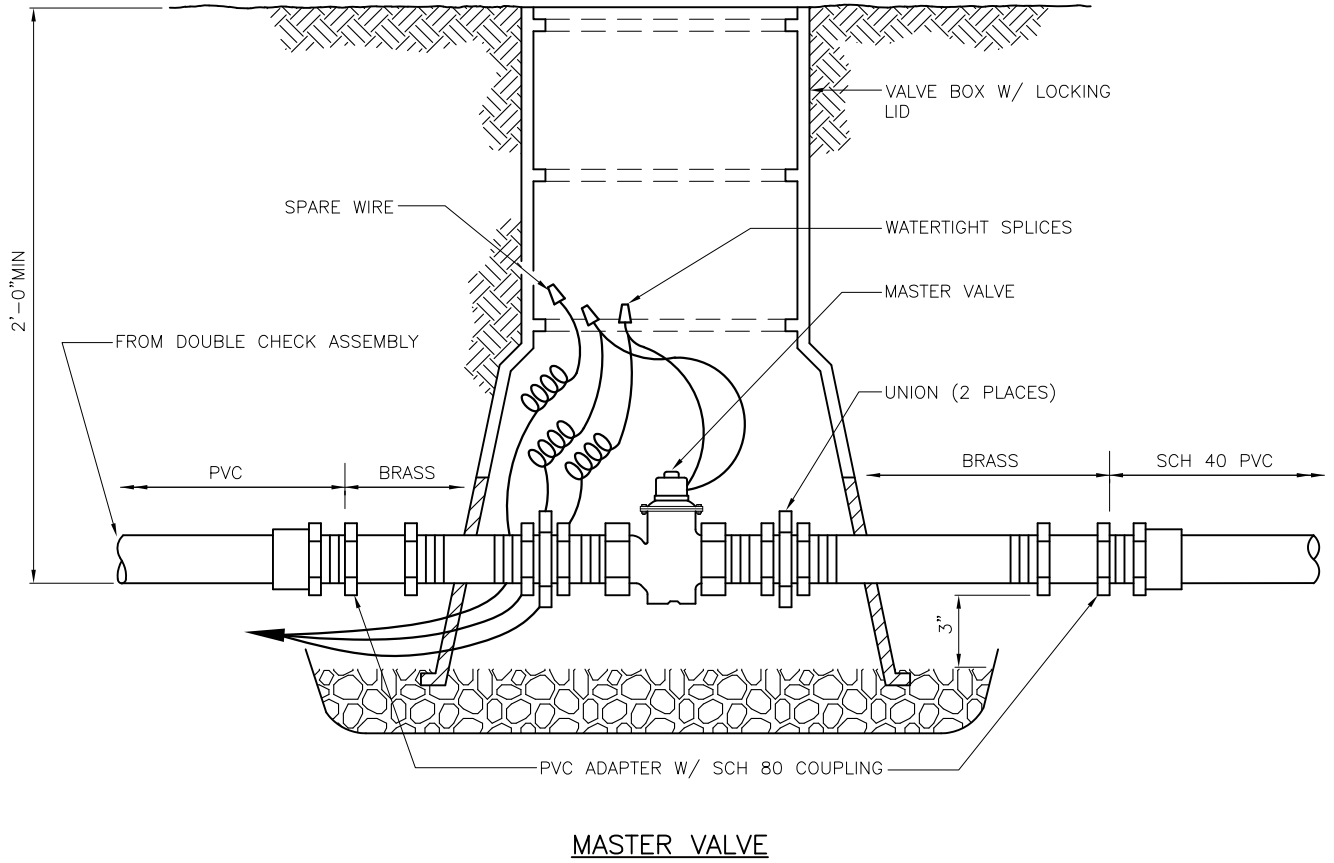


REF STD SPEC SEC 8-03



City of Seattle

NOT TO SCALE

IRRIGATION VALVES

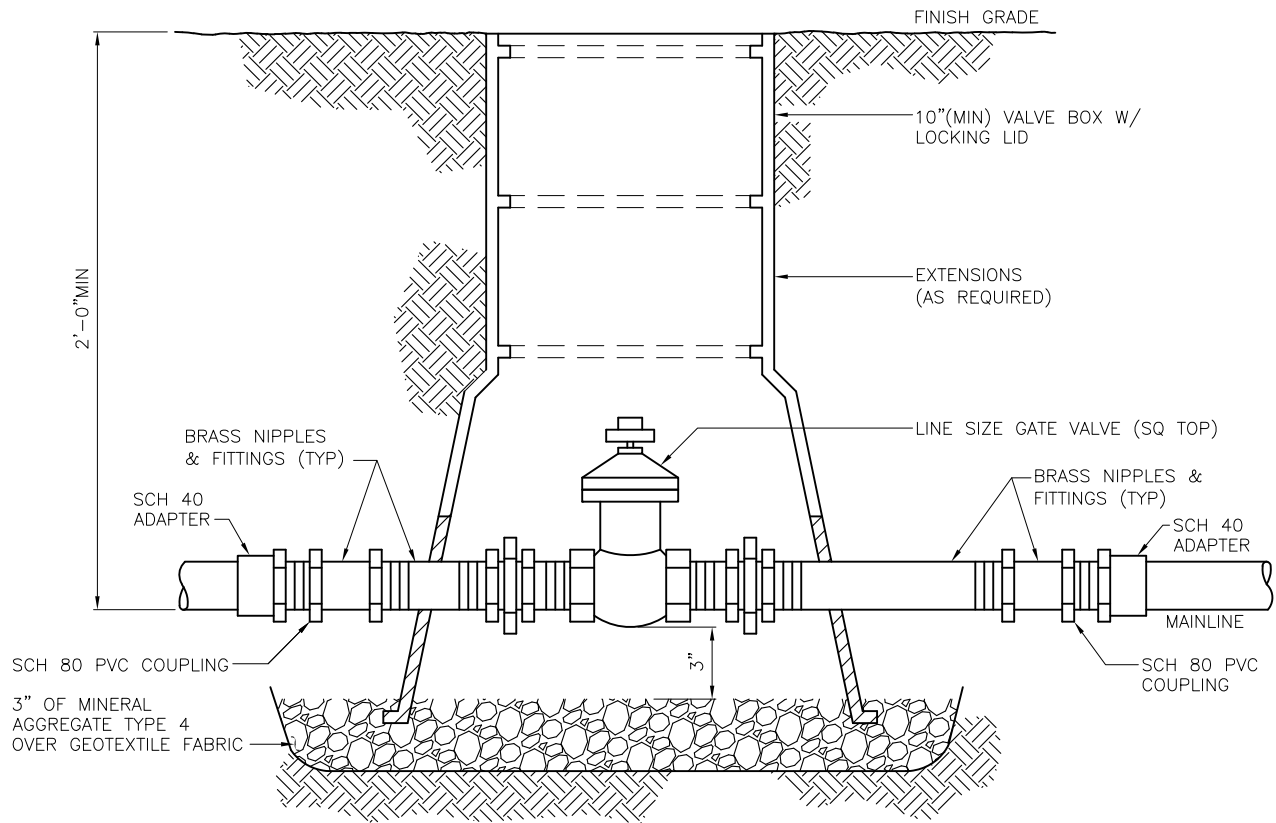

GATE VALVE - 2 1/2" & LARGER

NOTES:
USE TEFLON TAPE ON ALL THREADED FITTINGS



REF STD SPEC SEC 8-03



City of Seattle

NOT TO SCALE

IRRIGATION VALVES

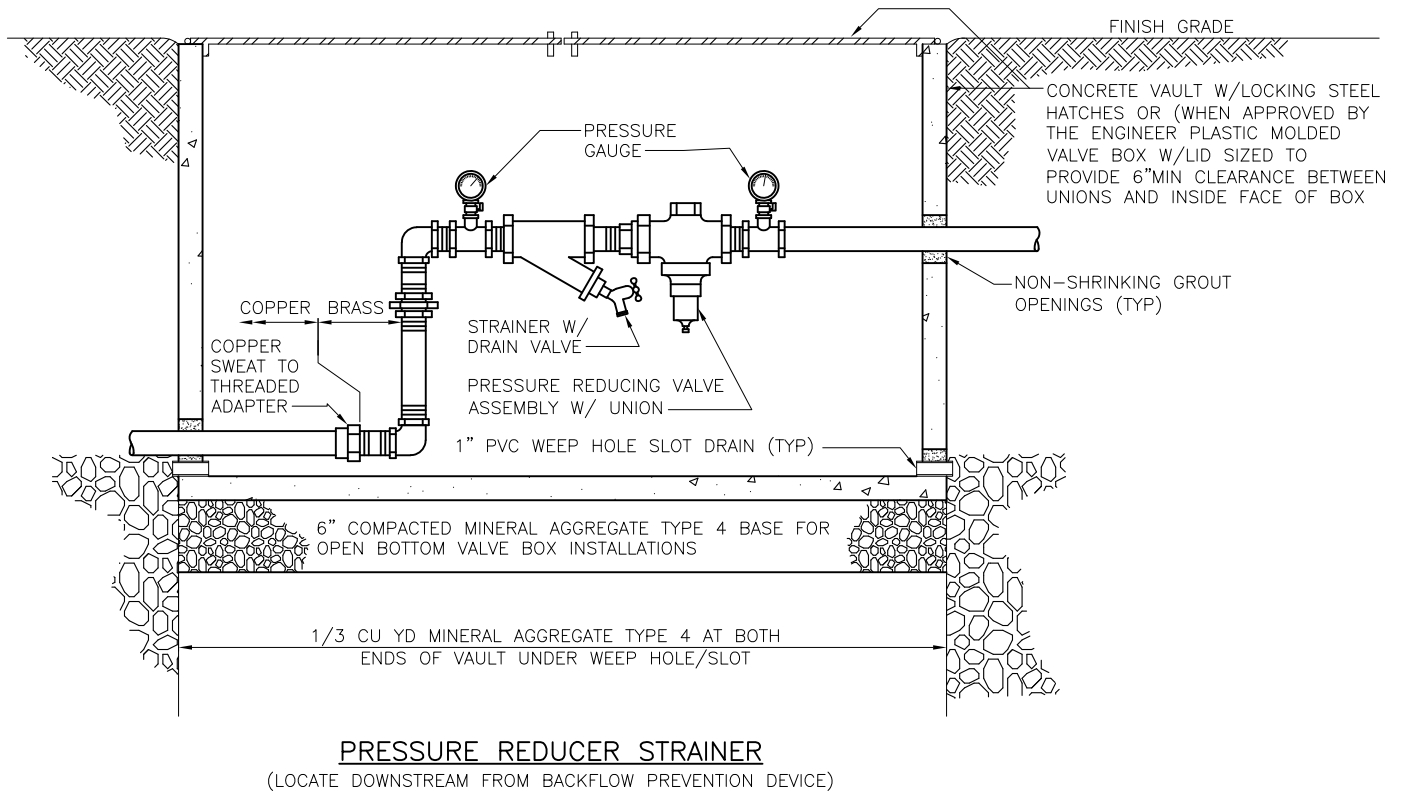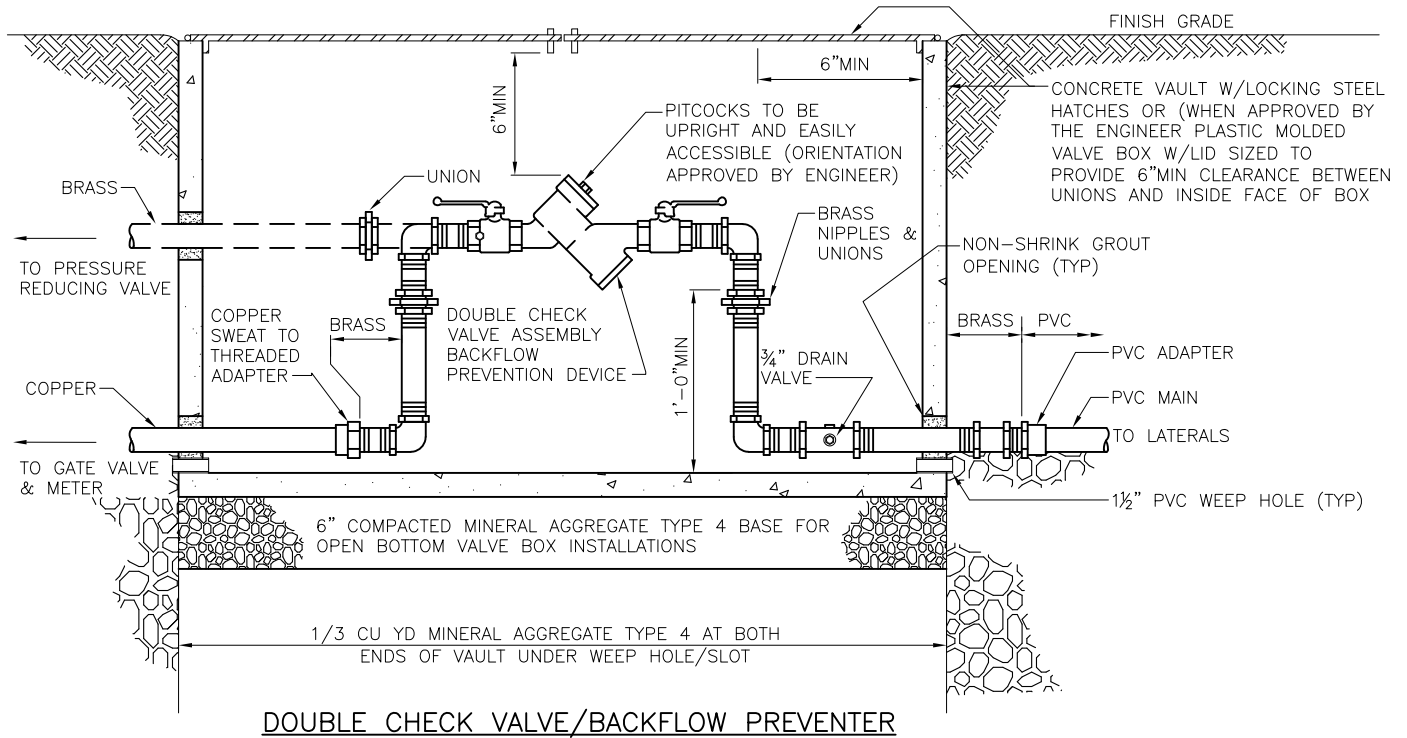


REF STD SPEC SEC 8-03



City of Seattle

NOT TO SCALE


IRRIGATION VALVES

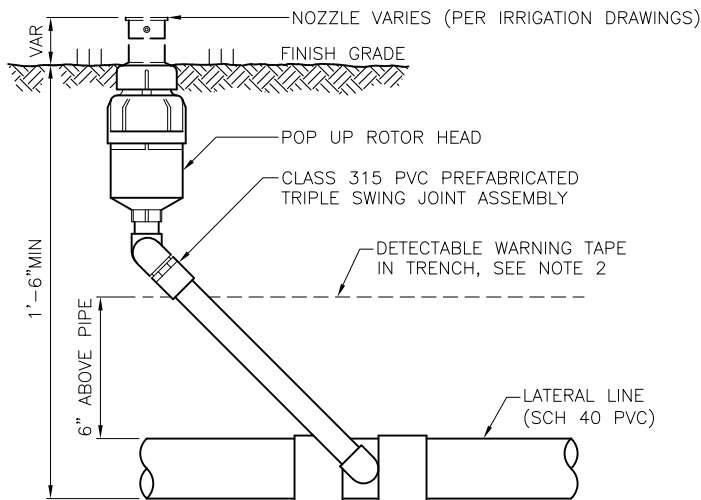


POP UP ROTOR HEAD
TURF AREAS

NOTE:

1. USE TEFLON TAPE ON ALL THREADED FITTINGS
2. DETECTABLE MARKING TAPE COLOR PER STANDARD SPECIFICATIONS SECTION 9-15.11 FOR POTABLE OR NON-POTABLE WATER

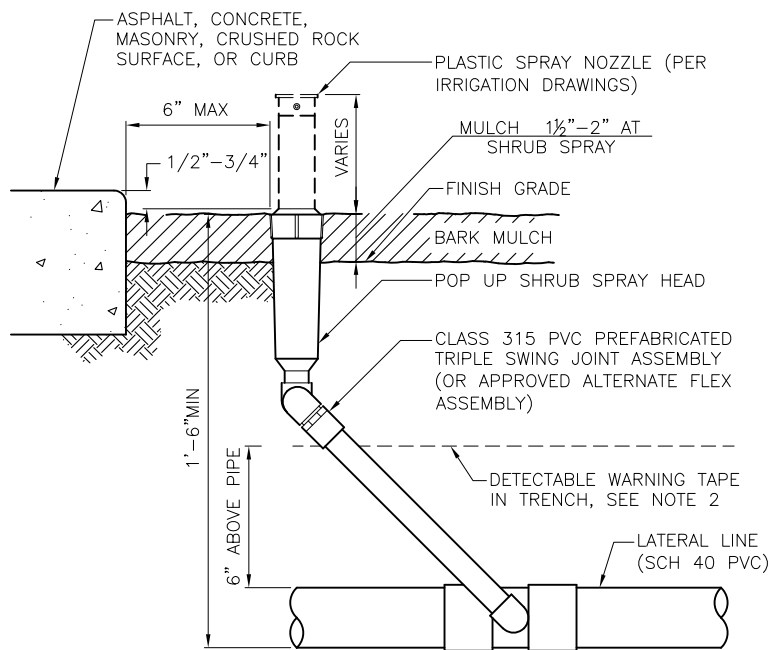

POP UP ROTOR HEAD
(SHRUB BED AREAS)
AT EDGE OF PAVEMENT

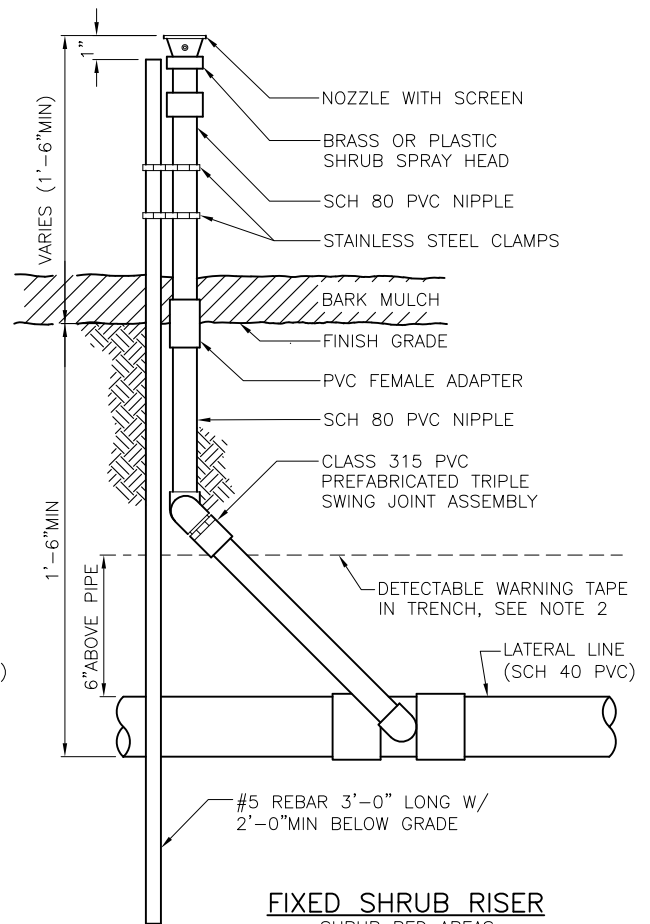

FIXED SHRUB RISER
SHRUB BED AREAS


REF STD SPEC SEC 8-03



City of Seattle

NOT TO SCALE


POP UP & FIXED
IRRIGATION HEADS

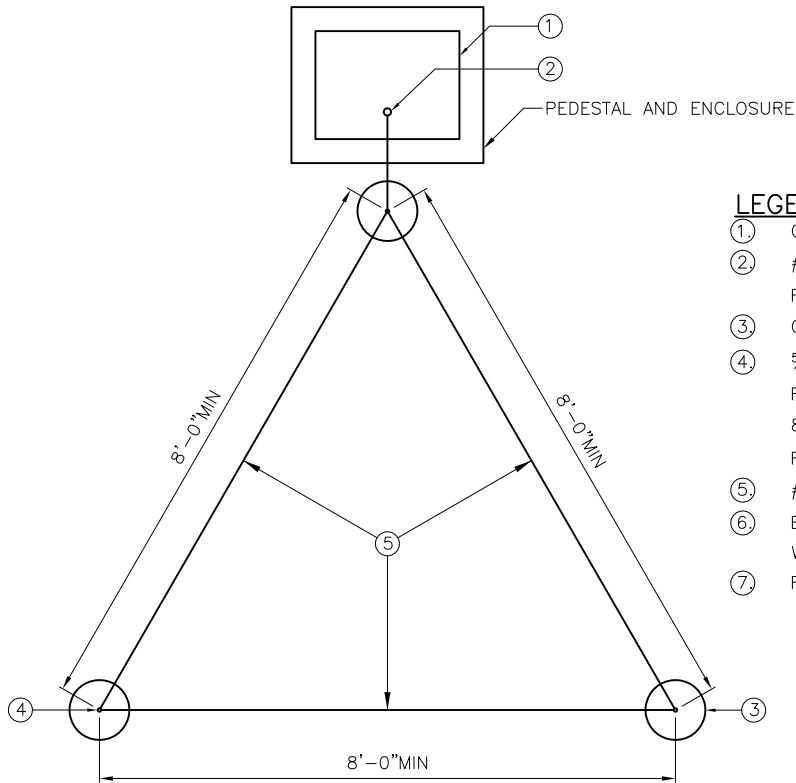

LEGEND

- ① CONTROLLER
- ② #10 AWG SOLID BARE COPPER WIRE FROM GROUNDING ROD TO CONTROLLER MAKE WIRE AS SHORT AS POSSIBLE
- ③ COVER GROUNDING ROD WITH 10" ROUND VALVE BOX
- ④ 5/8" X 10'-0" COPPER CLAD GROUNDING ROD. INSTALL 3 RODS IN SOIL IN A TRIANGULAR PATTERN, SPACES 8'-0" MIN APART. GROUNDING GRID TO HAVE A RESISTANCE OF 10 OHMS OR LESS
- ⑤ #10 AWG BARE COPPER WIRE BETWEEN GROUNDING RODS
- ⑥ BRASS WIRE CLAMP. USE SEPARATE CLAMP FOR EACH WIRE
- ⑦ FINISH GRADE

GROUND ROD LAYOUT

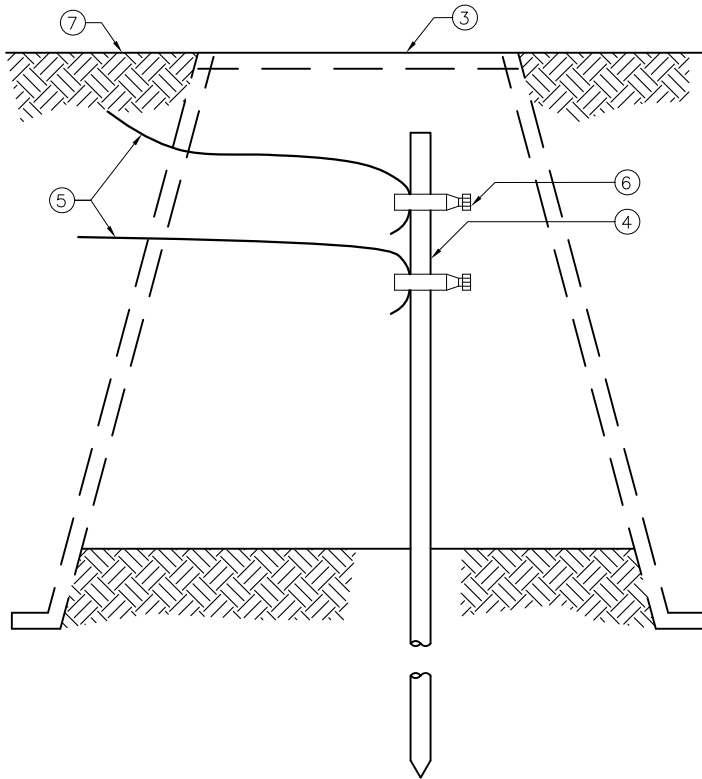

GROUND ROD ASSEMBLY


REF STD SPEC SEC 8-03




City of Seattle

NOT TO SCALE


**IRRIGATION CONTROLLER
PEDESTAL AND ENCLOSURE
GROUNDING**

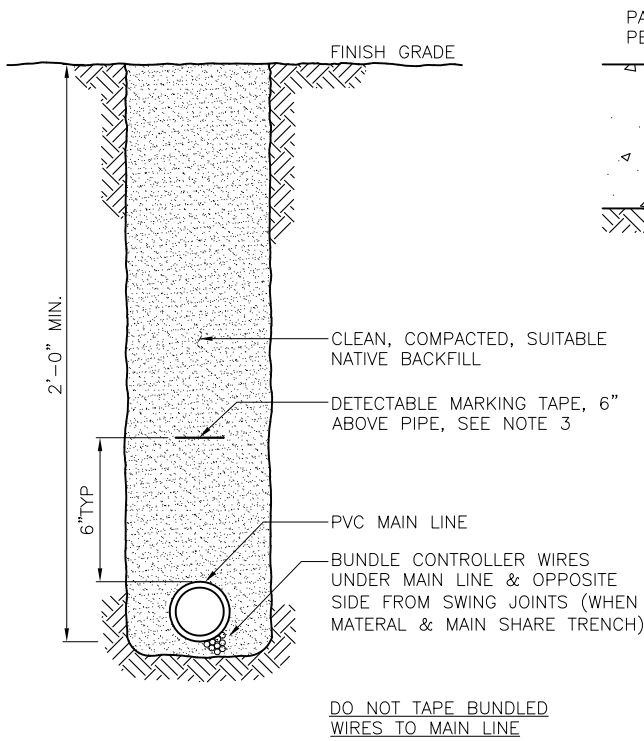


MAIN LINE

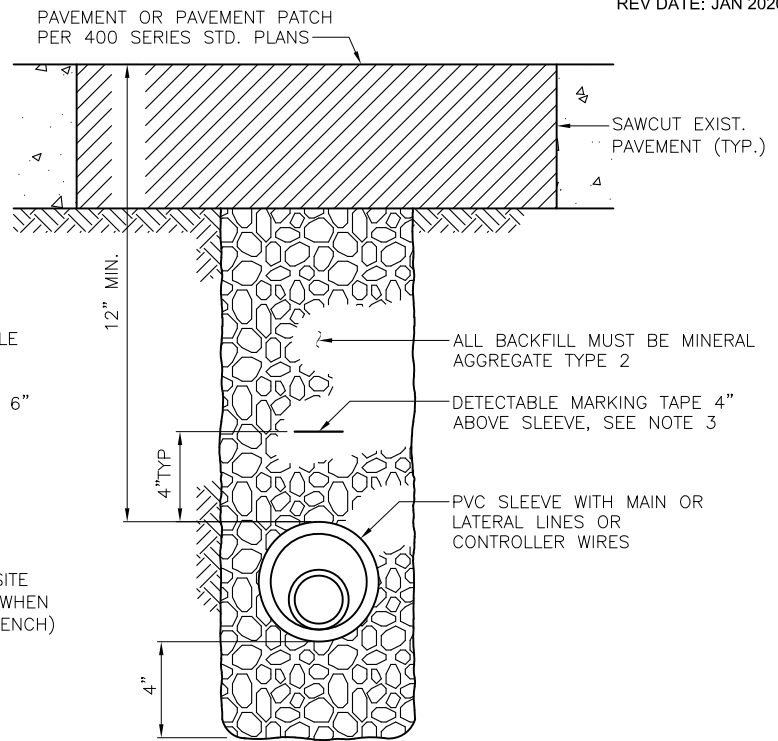

SLEEVE TRENCHING

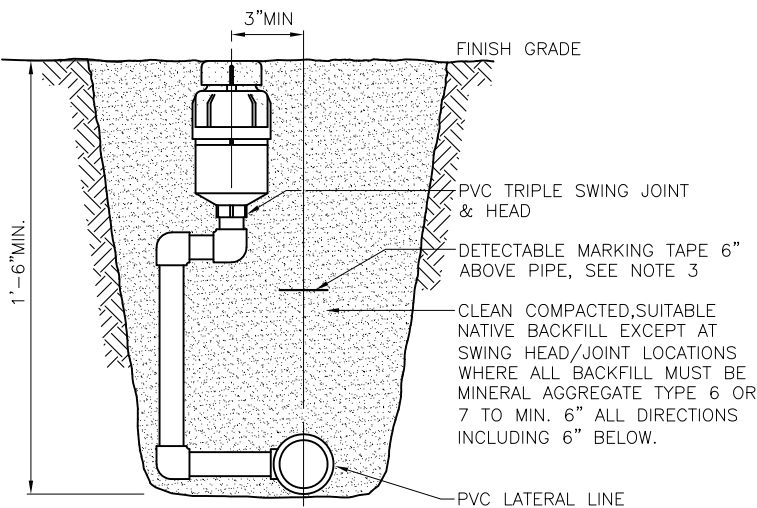

LATERAL LINE

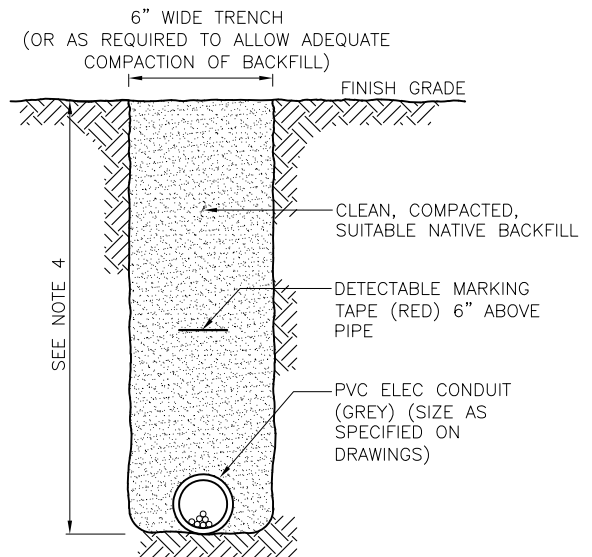

ELECTRICAL SUPPLY TRENCH

NOTES:

1. SLEEVE SIZE AS SHOWN ON DRAWINGS OR ID OF SLEEVE TO BE 1" GREATER THAN OD OF PIPE
2. SLEEVES REQUIRED UNDER ALL PAVED AREAS
3. DETECTABLE MARKING TAPE COLOR PER STANDARD SPECIFICATIONS SECTION 9-15.11 FOR POTABLE OR NON-POTABLE WATER
4. CONDUIT DEPTH MUST BE PER SCL CONSTRUCTION STANDARD 1716.07

REF STD SPEC SEC 8-03




City of Seattle

NOT TO SCALE

IRRIGATION TRENCHES

NOTES:

1. NEMA 3R RAINPROOF CABINET
2. NO 12 GA PREGALVANIZED STEEL WELDED SEAM CONSTRUCTION
3. TWO SCREENED, GASKETED LOUVERED VENTS
4. REMOVABLE EQUIPMENT MOUNTING PAN
5. VANDALPROOF LOCKABLE SLIDE BAR ACROSS FRONT DOOR
6. PADMOUNT DESIGN WITH 2" INSIDE FLANGE ON BOTTOM
7. DOOR:
 - 3 POINT LATCH
 - CONCEALED HINGE
 - LIFT-OFF TYPE (UPON OPENING)
 - CLOSED CELL NEOPRENE GASKET
8. PAINT:
 - OVEN BAKED ENAMEL
 - DARK GREEN OUTSIDE
 - WHITE INSIDE
 - PREGALVANIZED METAL TREATED WITH COPPER SULFATE PRIOR TO PAINTING
9. ACTUAL CABINET DIMENSIONS ARE PROJECT SPECIFIC AND WILL BE SPECIFIED ON THE DRAWINGS.

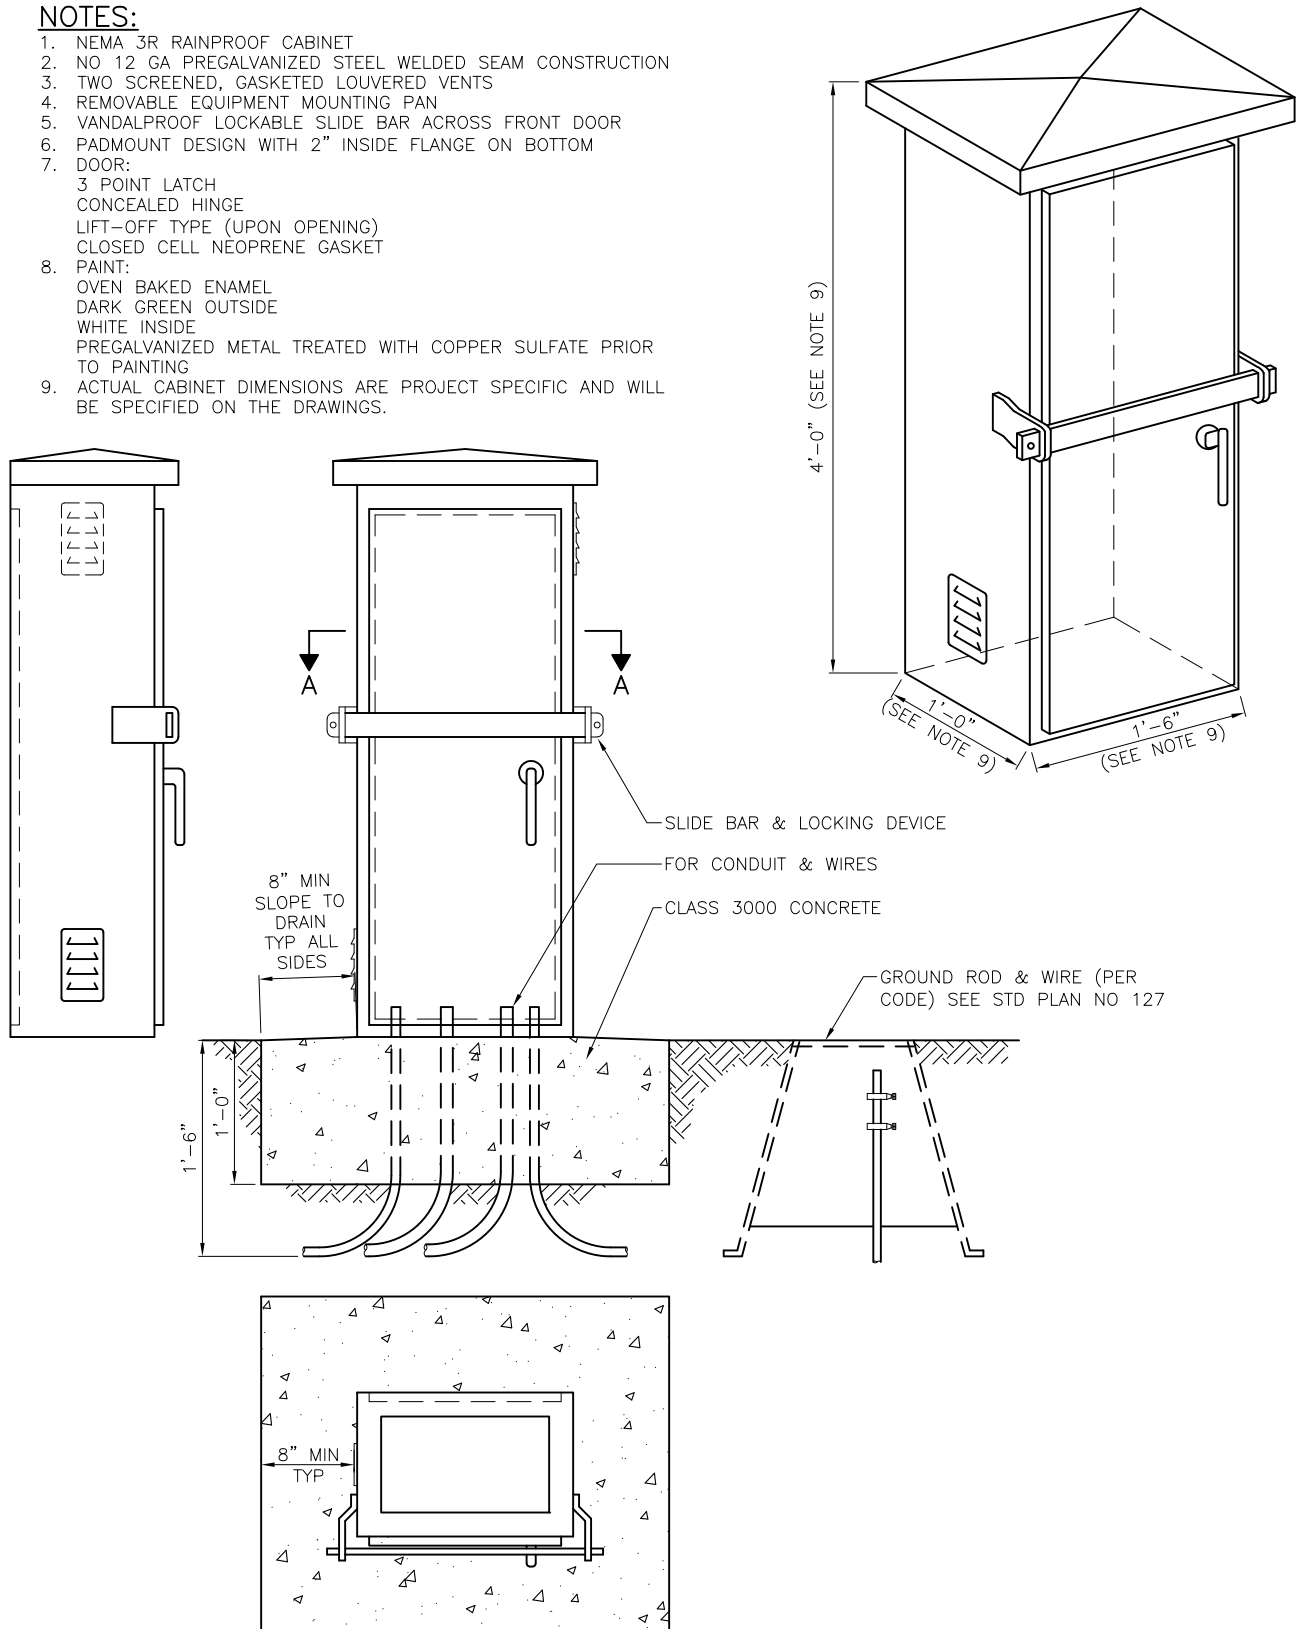

SECTION A-A

REF STD SPEC SEC 8-03






City of Seattle

NOT TO SCALE

IRRIGATION
CONTROLLER CABINET

NOTE:

CONSIDER TRAFFIC TURNING VISIBILITY AND PEDESTRIAN VISIBILITY WHEN SELECTING FENCE HEIGHT; TYPICALLY SHORTER FENCING AROUND TREE PITS BETWEEN SIDEWALK AND ROADWAY IS DESIRED.

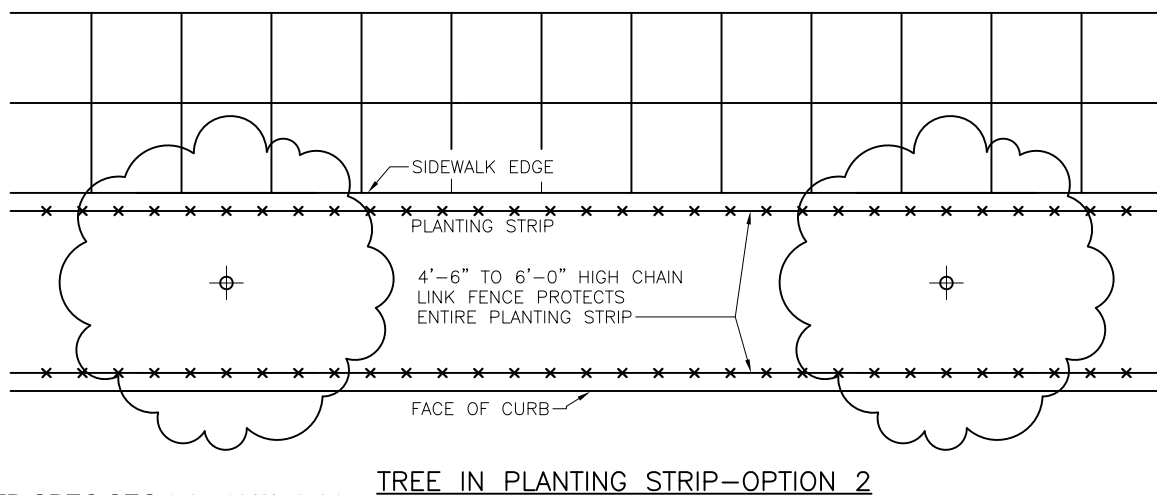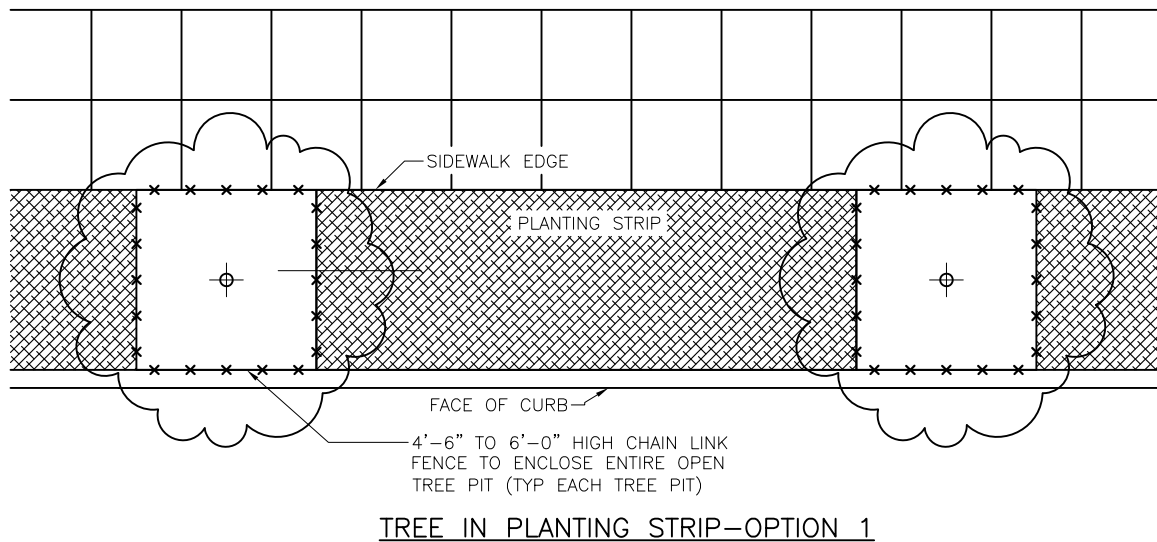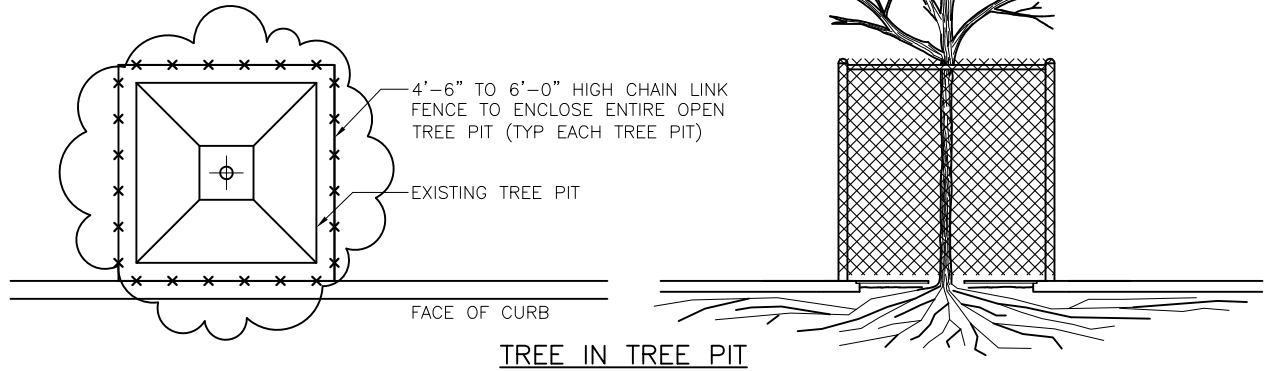


REF STD SPEC SEC 1-07.16(2), 8-01




City of Seattle

NOT TO SCALE


**TREE PROTECTION
DURING CONSTRUCTION**

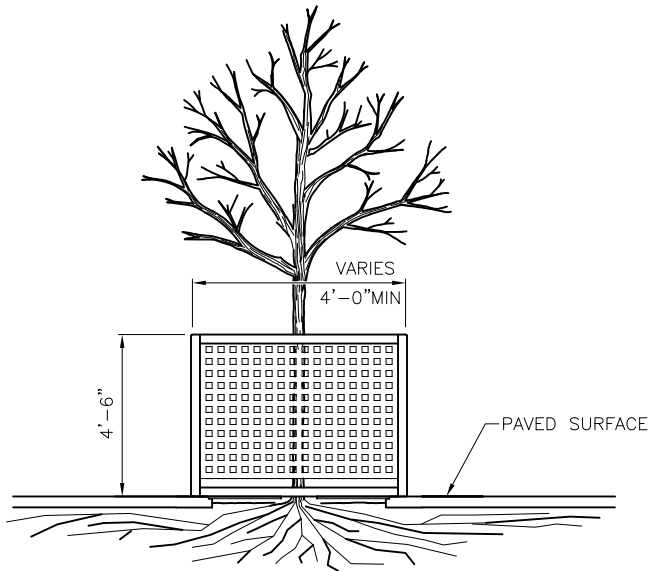


TYPICAL TREE GUARD RAIL

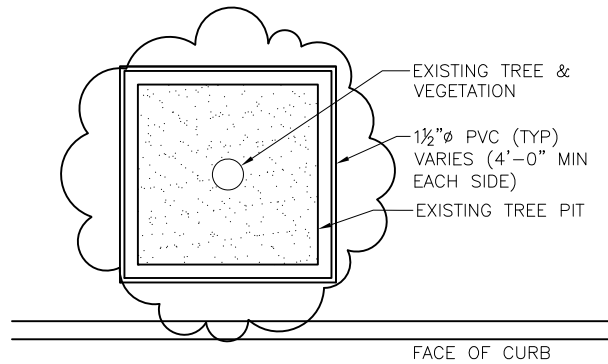

PLAN VIEW

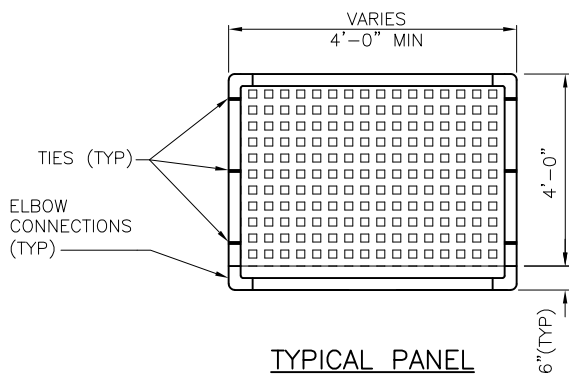

TYPICAL PANEL

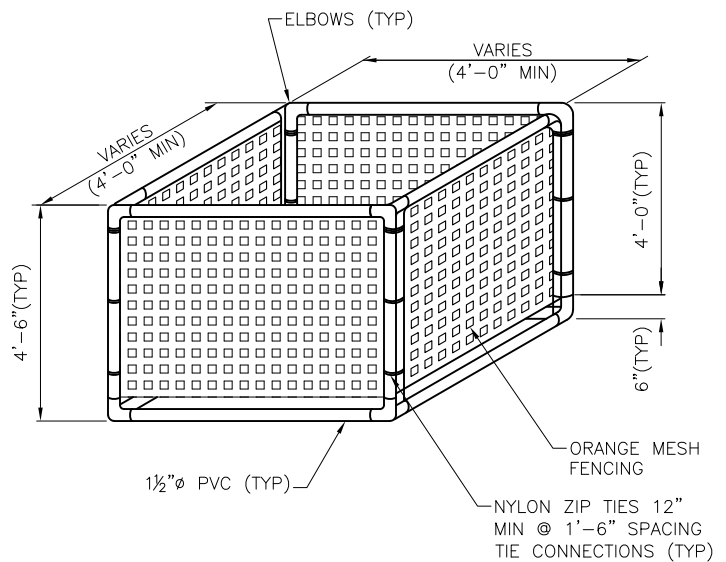

NOTES:

1. REUSABLE TEMPORARY PROTECTION FENCING USED TO PROTECT TREES IN TREE PITS MUST SURROUND THE ENTIRE UNPAVED TREE PIT AREA AND BE ANCHORED AND MAINTAINED IN A STABLE UPRIGHT CONDITION. SEE SECTION 8-01.3(2)B.


REF STD SPEC SEC 1-07.16(2), 8-01



City of Seattle

NOT TO SCALE

REUSABLE TEMPORARY PROTECTION FENCE

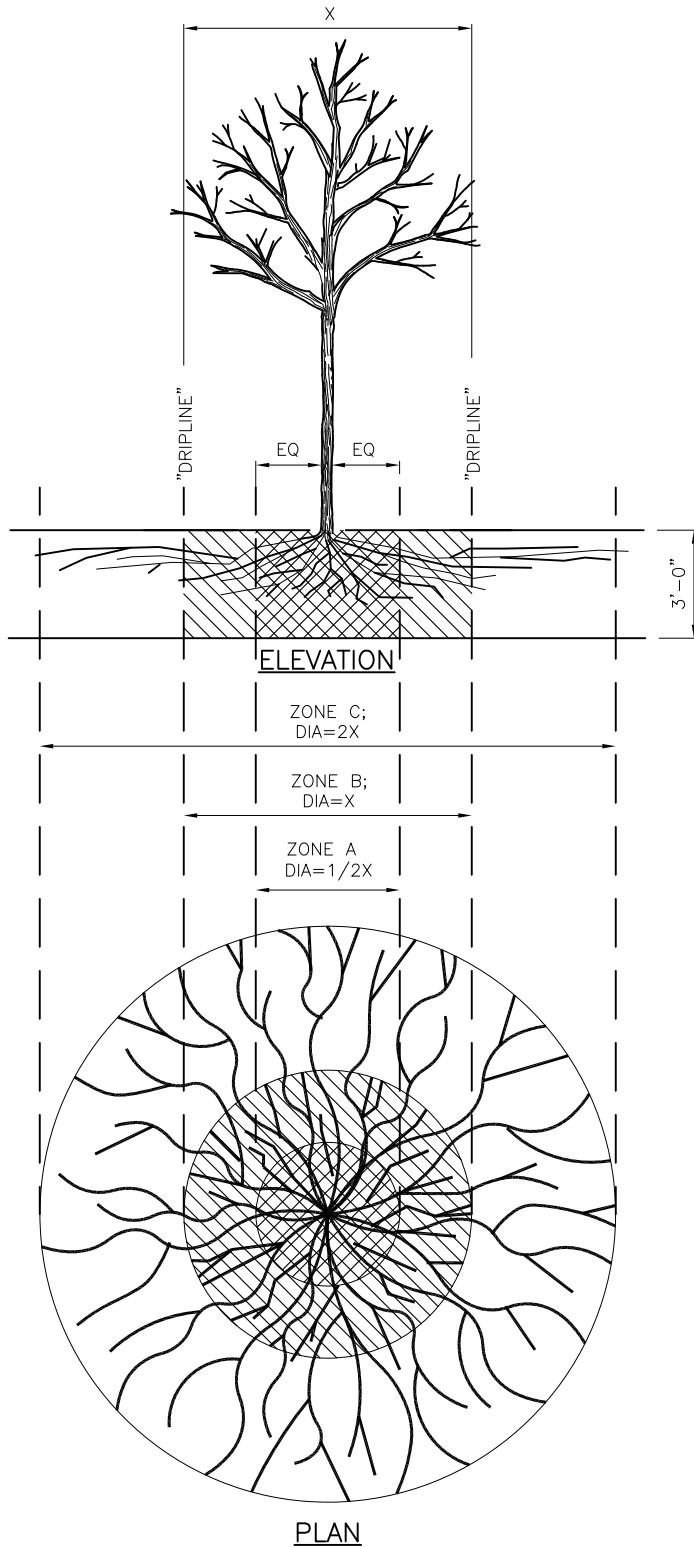

TRENCHING/EXCAVATION

ZONE A (CRITICAL ROOT ZONE)

1. NO DISTURBANCE ALLOWED WITHOUT SITE-SPECIFIC INSPECTION AND APPROVAL OF METHODS TO MINIMIZE ROOT DAMAGE
2. SEVERANCE OF ROOTS LARGER THAN 2" DIA REQUIRES ENGINEER'S APPROVAL
3. TUNNELING REQUIRED TO INSTALL LINES 3'-0" BELOW GRADE OR DEEPER

ZONE B (DRIFLINE)

1. ZONE B FOR ASYMMETRICAL COLUMNAR AND NARROW CONICAL TREE FORMS. ZONE B = 1' RADIUS FOR EVERY 1" OF TRUNK DIAMETER.
2. TUNNELING MAY BE REQUIRED FOR TRENCHES DEEPER THAN 3'-0".

NOTE:

A TREE, VEGETATION, AND SOIL PROTECTION PLAN (TVSPP) IS REQUIRED FOR ALL PROJECTS. APPROVAL OF PLAN REQUIRED PRIOR TO MOBILIZATION. SEE SECTION 8-01.


REF STD SPEC SEC 1-07.16(2), 8-01



City of Seattle

NOT TO SCALE

**TREE PROTECTION DURING
TRENCHING, TUNNELING OR
EXCAVATION**

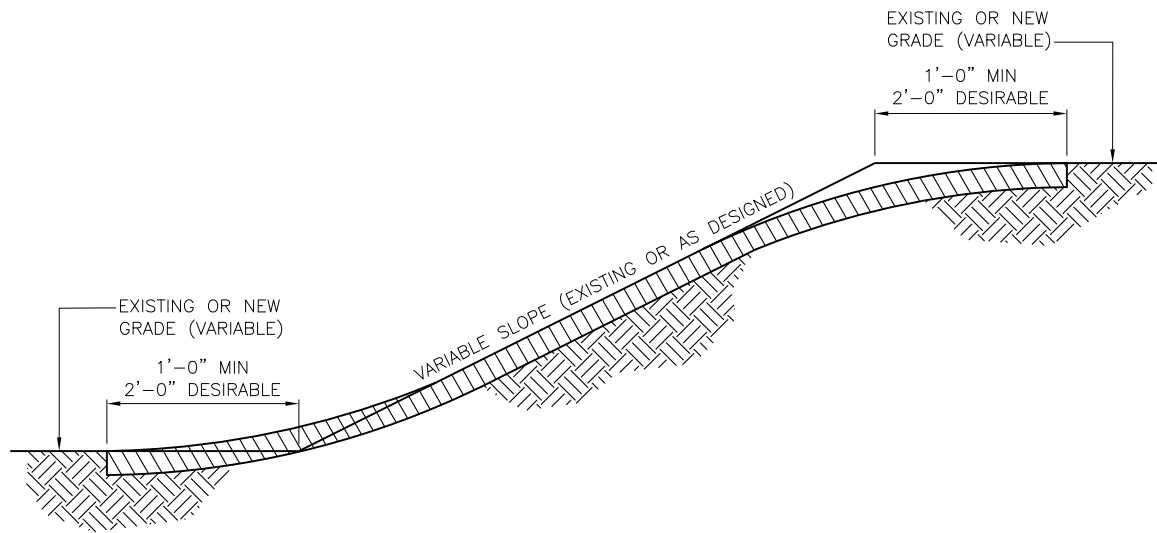


REF STD SPEC SEC 2-04




City of Seattle

NOT TO SCALE

SLOPE ROUNDING

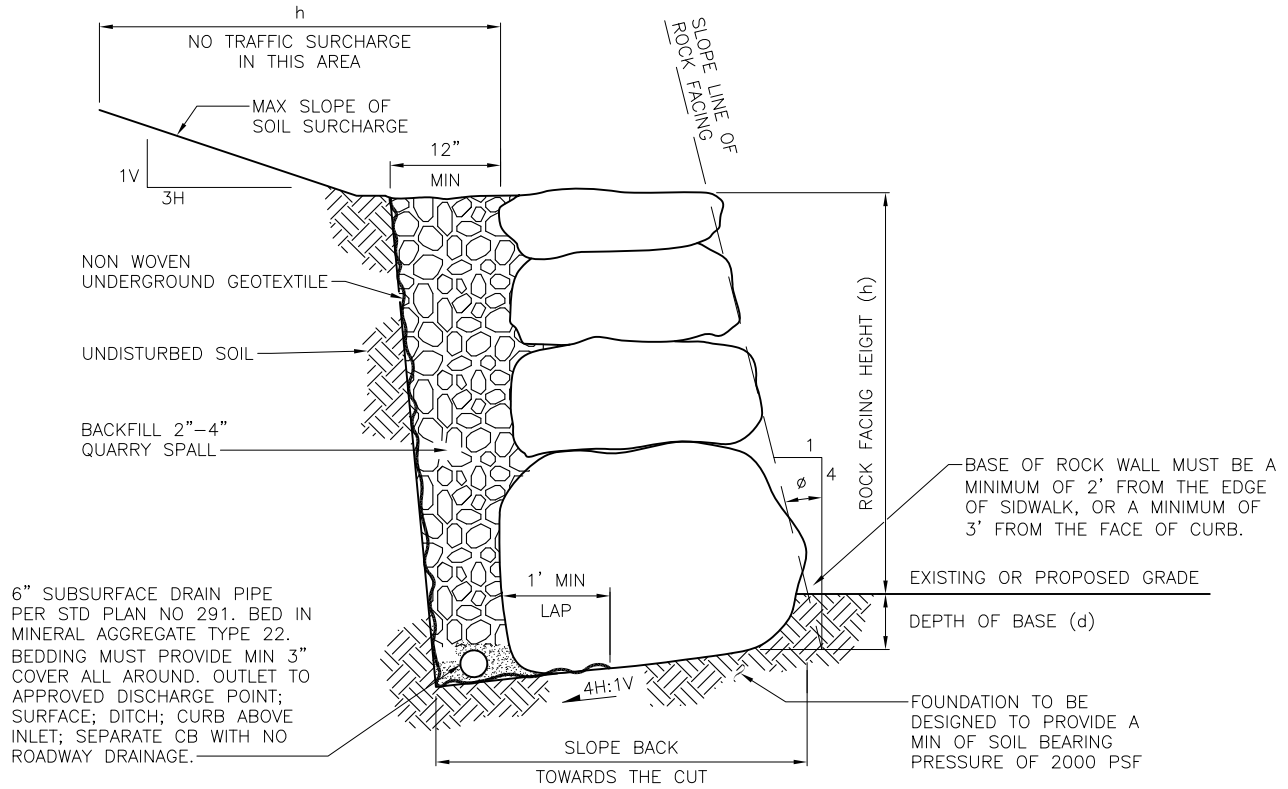

SECTION

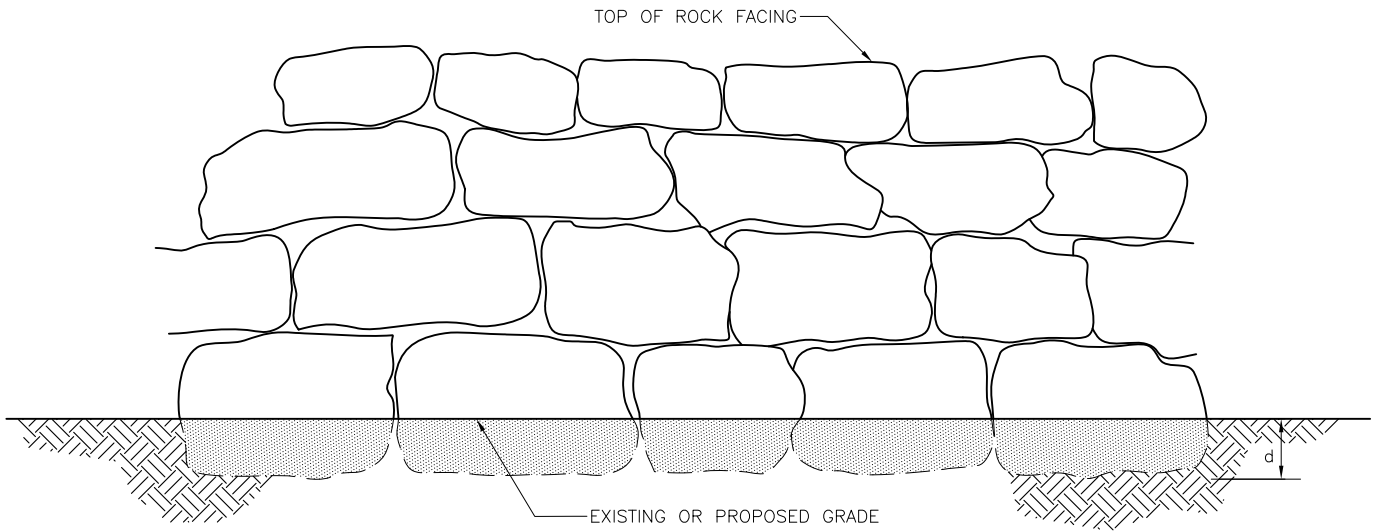

ELEVATION

		MINIMUM ROCK	
(h)	(d)	SIZE(BASE)	SIZE(TOP)
2 FEET	3 INCHES	2-MAN	1-MAN
4 FEET	6 INCHES	3-MAN	2-MAN
6 FEET	9 INCHES	4-MAN	2-MAN
8 FEET	12 INCHES	5-MAN	2-MAN

∅ = 14' ±1'


REF STD SPEC SEC 2-13



City of Seattle

NOT TO SCALE

ROCK FACING

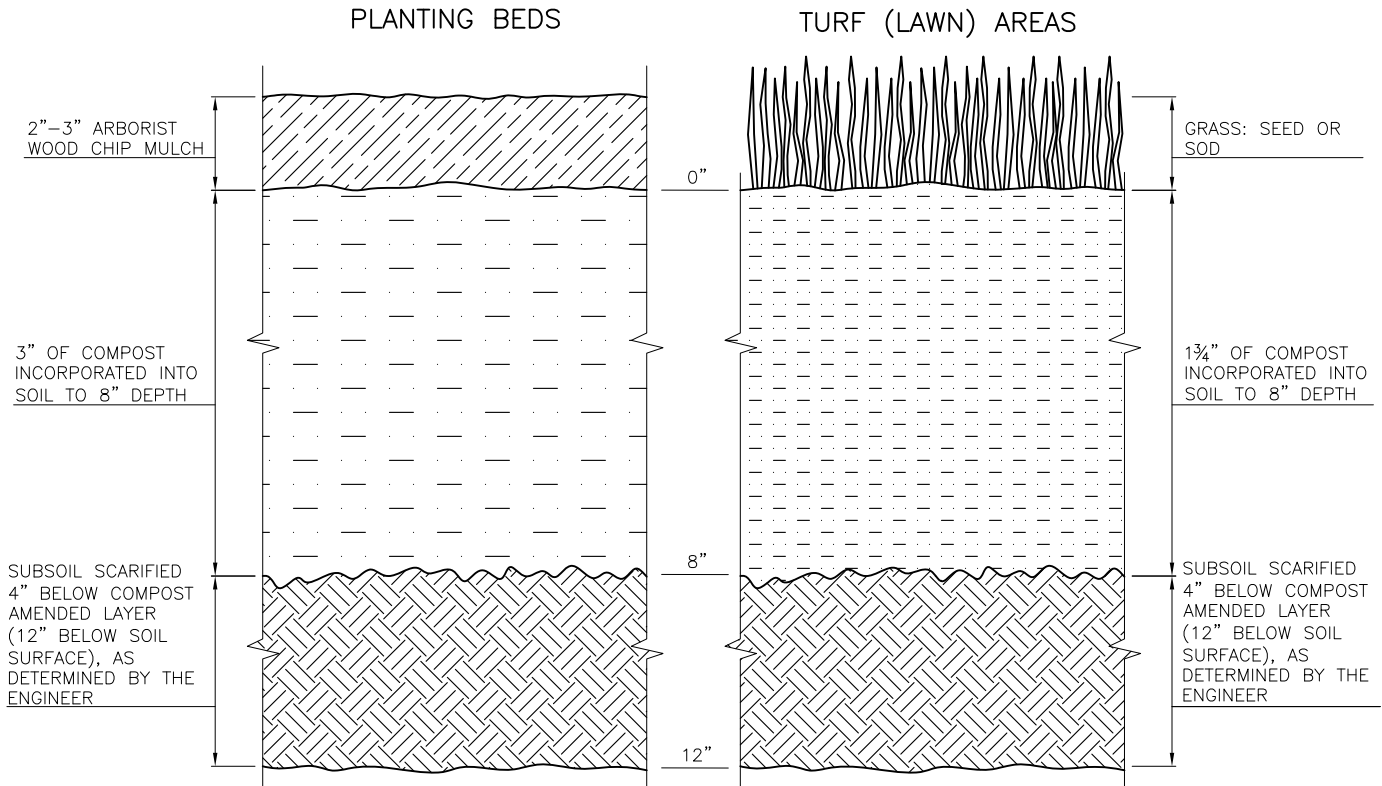

NOTES:

1. ALL SOIL AREAS DISTURBED OR COMPACTED DURING CONSTRUCTION, AND NOT COVERED BY BUILDINGS OR PAVEMENT, MUST BE AMENDED WITH COMPOST AS DESCRIBED BELOW.
2. SUBSOIL SHOULD BE SCARIFIED (LOOSENE) 4 INCHES BELOW AMENDED LAYER, TO PRODUCE 12-INCH DEPTH OF UN-COMPACTED SOIL, EXCEPT WHERE SCARIFICATION WOULD DAMAGE TREE ROOTS OR AS DETERMINED BY THE ENGINEER.
3. COMPOST MUST BE TILLED IN TO 8 INCH DEPTH INTO EXISTING SOIL, OR PLACE 8 INCHES OF COMPOST-AMENDED SOIL, PER SOIL SPECIFICATION.
4. TURF AREAS MUST RECEIVE 1.75 INCHES OF COMPOST TILLED IN TO 8-INCH DEPTH, OR MAY SUBSTITUTE 8" OF IMPORTED SOIL CONTAINING 20-25% COMPOST BY VOLUME. THEN PLANT GRASS SEED OR SOD PER SPECIFICATION.
5. PLANTING BEDS MUST RECEIVE 3 INCHES OF COMPOST TILLED IN TO 8-INCH DEPTH, OR MAY SUBSTITUTE 8" OF IMPORTED SOIL CONTAINING 35-40% COMPOST BY VOLUME. MULCH AFTER PLANTING, WITH 2-3 INCHES OF ARBORIST WOOD CHIP MULCH OR APPROVED EQUAL.
6. SETBACKS: TO PREVENT UNEVEN SETTLING, DO NOT COMPOST-AMEND SOILS WITHIN 3 FEET OF UTILITY INFRASTRUCTURES (POLES, VAULTS, METERS ETC.). WITHIN ONE FOOT OF PAVEMENT EDGE, CURBS AND SIDEWALKS SOIL SHOULD BE COMPACTED TO APPROXIMATELY 90% PROCTOR TO ENSURE A FIRM SURFACE.


REF STD SPEC SEC 8-01, 8-02, 9-14



City of Seattle


NOT TO SCALE

SOIL AMENDMENT AND DEPTH

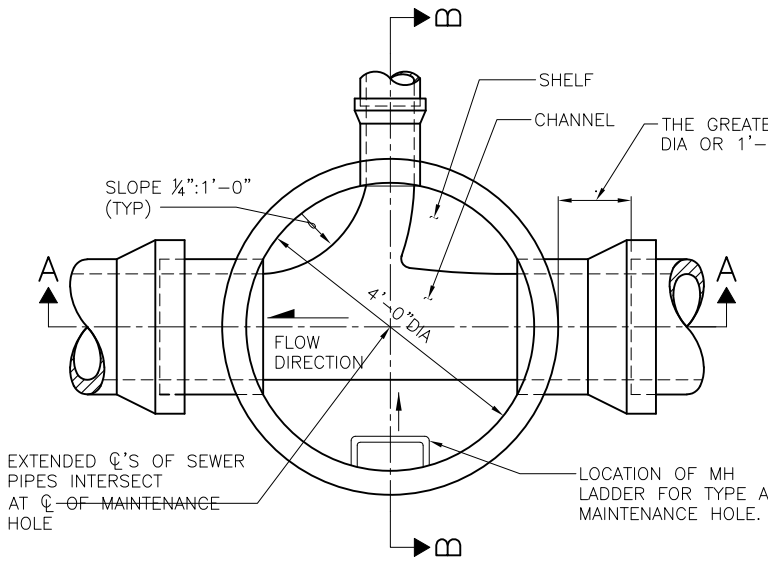


"H"	REINFORCING STEEL "A"	
	MIN. SQ IN/FT, TOP FACE, IN EACH DIRECTION	
	PRECAST BASE	CAST-IN-PLACE BASE
20' MAX	0.25	0.17
30' MAX	0.31	0.22
40' MAX	0.36	0.25

PLAN VIEW
(TOP REMOVED)

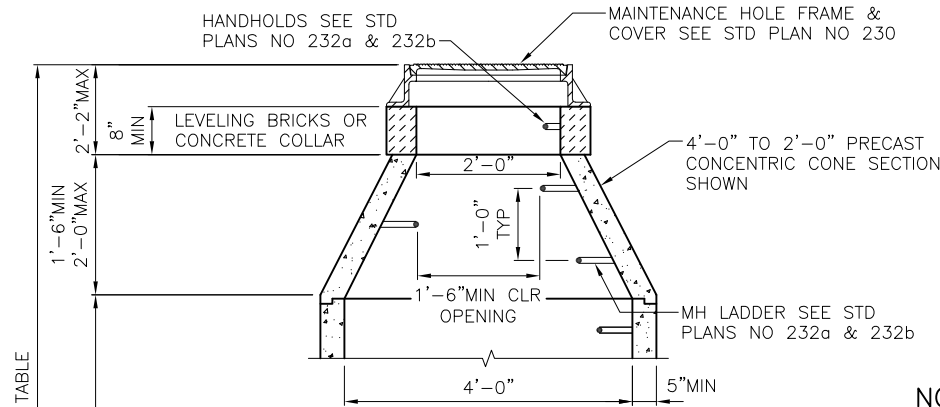

SECTION B-B

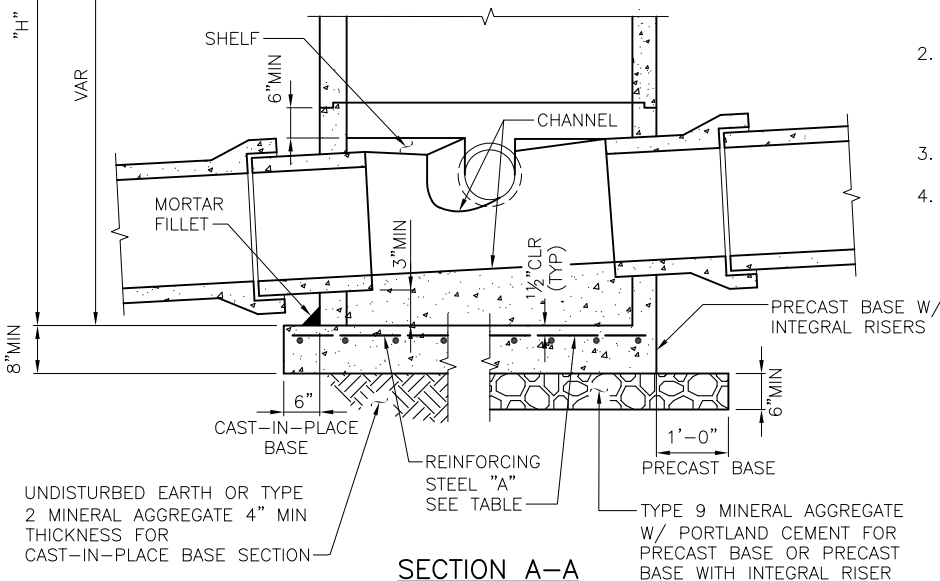

SECTION A-A

NOTES:

1. MATERIALS: CONCRETE—CLASS 4000; REINFORCING STEEL—ASTM A615 GRADE 60 MIN; CHANNEL AND SHELF MATERIAL — CONCRETE CLASS 3000.
2. PRECAST MAINTENANCE HOLE COMPONENTS MUST CONFORM TO ASTM C 478. JOINTS BETWEEN PRECAST COMPONENTS MUST BE RUBBER GASKETED CONFORMING TO ASTM C 443.
3. MINIMUM REQUIRED SOIL BEARING = 3,000 LBS/SQ FT
4. MAX HOLE SIZE MUST BE OD OF PIPE PLUS 5 IN. MIN HOLE SIZE MUST BE OD OF PIPE PLUS 3 IN. MIN CLEAR DISTANCE BETWEEN HOLES IS 8 IN.


REF STD SPEC SEC 7-05






City of Seattle

NOT TO SCALE

TYPE 204a MAINTENANCE HOLE

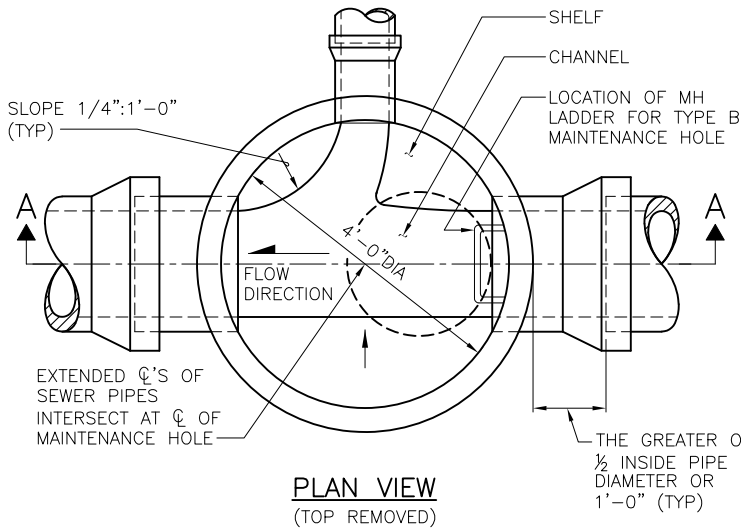

"H"	REINFORCING STEEL "A"	
	MIN. SQ IN/FT, TOP FACE, IN EACH DIRECTION	
	PRECAST BASE	CAST-IN-PLACE BASE
20' MAX	0.25	0.17
30' MAX	0.31	0.22
40' MAX	0.36	0.25

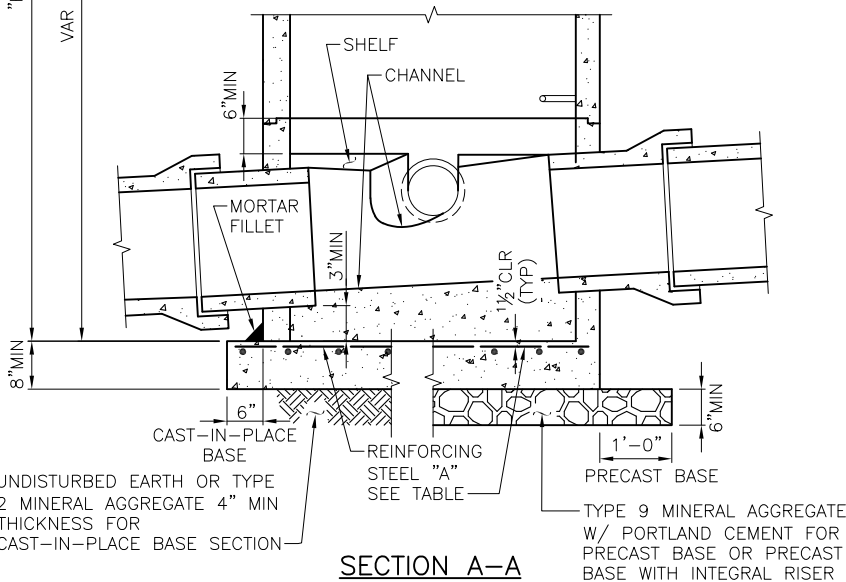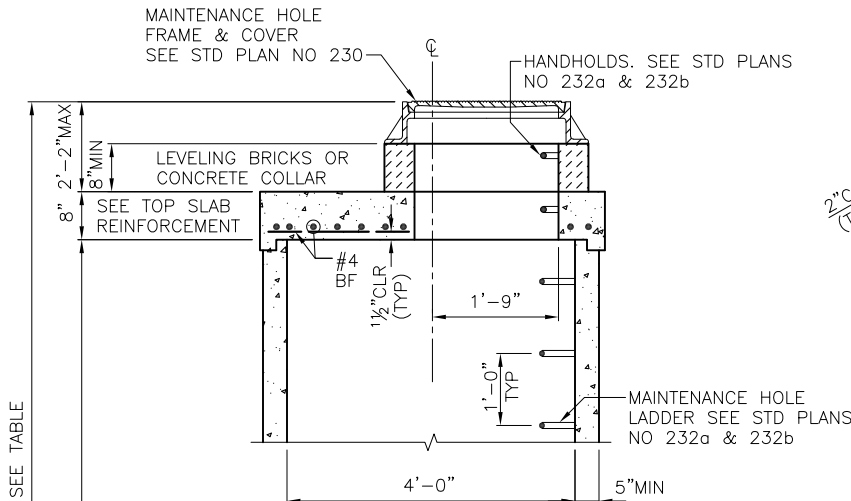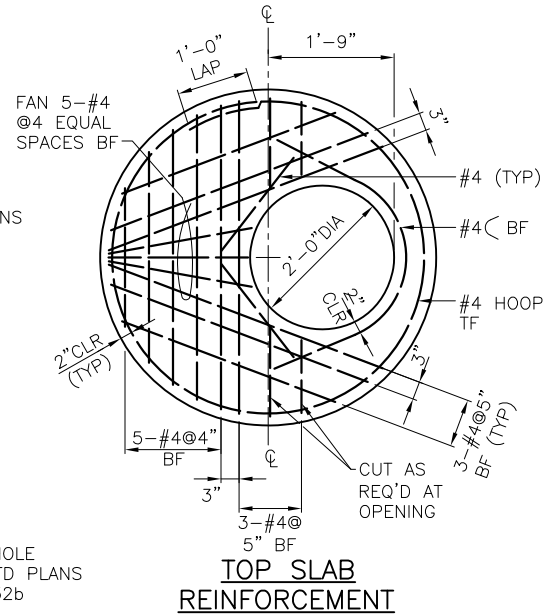

NOTES:

1. MATERIALS: CONCRETE—CLASS 4000; REINFORCING STEEL—ASTM A615 GRADE 60 MIN; CHANNEL AND SHELF MATERIAL — CONCRETE CLASS 3000.
2. PRECAST MAINTENANCE HOLE COMPONENTS MUST CONFORM TO ASTM C 478. JOINTS BETWEEN PRECAST COMPONENTS MUST BE RUBBER GASKETED CONFORMING TO ASTM C 443.
3. MINIMUM REQUIRED SOIL BEARING = 3,000 LBS/SQ FT
4. MAX HOLE SIZE MUST BE OD OF PIPE PLUS 5 IN. MIN HOLE SIZE MUST BE OD OF PIPE PLUS 3 IN. MIN CLEAR DISTANCE BETWEEN HOLES IS 8 IN.


REF STD SPEC SEC 7-05



City of Seattle


NOT TO SCALE

TYPE 204b MAINTENANCE HOLE

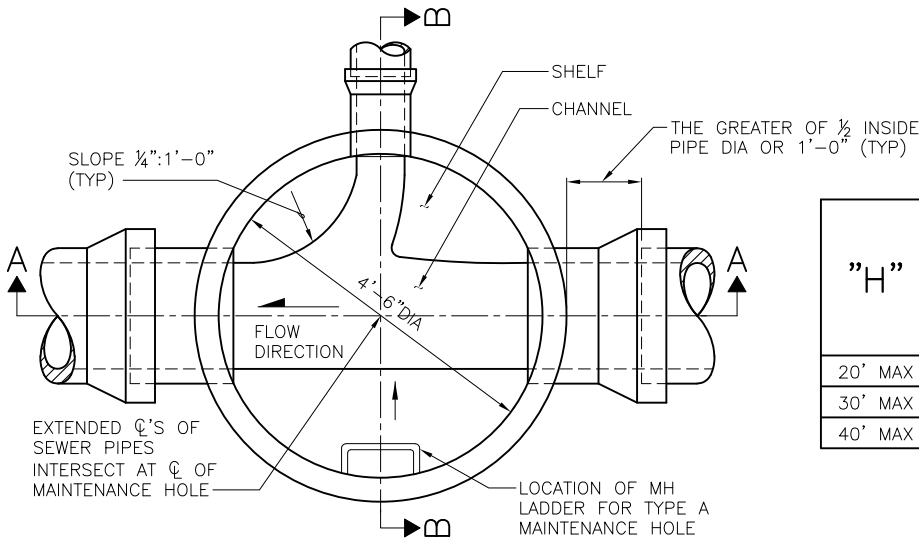


PLAN VIEW
(TOP REMOVED)

"H"	REINFORCING STEEL "A"	
	MIN. SQ IN/FT, TOP FACE, IN EACH DIRECTION	
	PRECAST BASE	CAST-IN-PLACE BASE
20' MAX	0.29	0.21
30' MAX	0.36	0.26
40' MAX	0.42	0.31

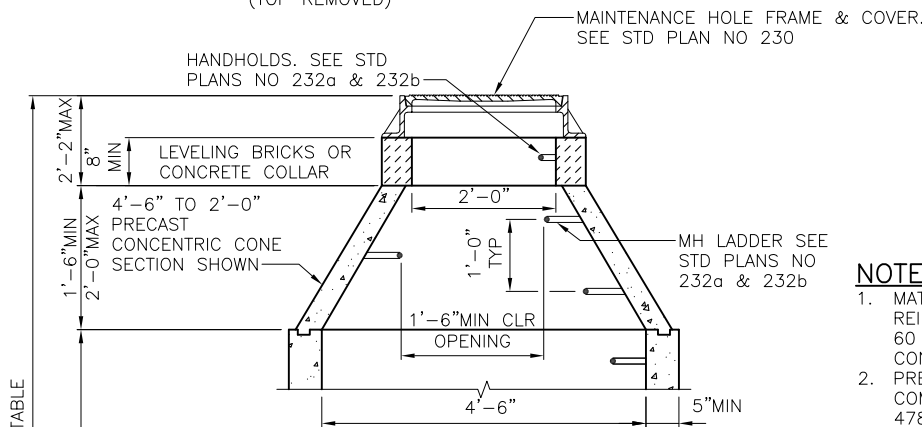

SECTION B-B

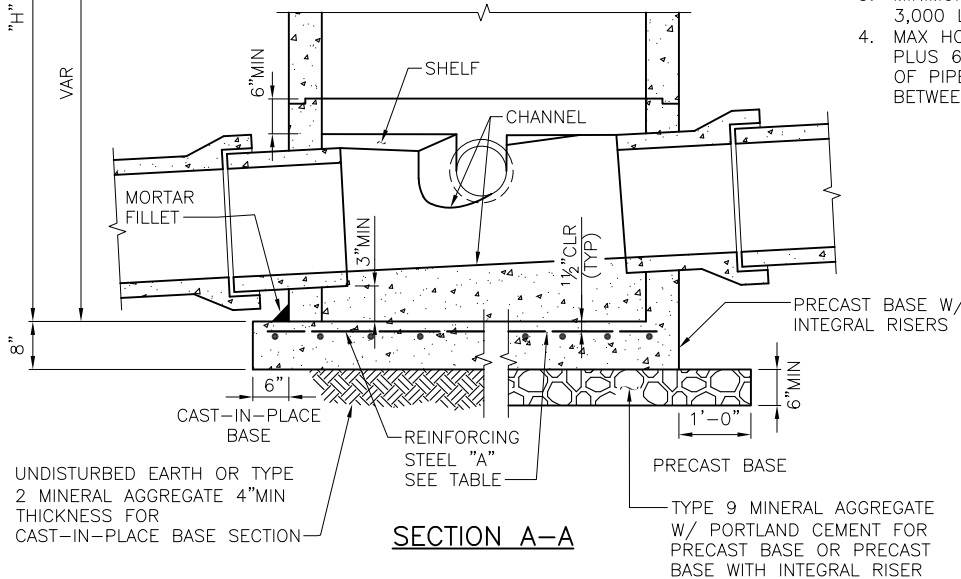

SECTION A-A

NOTES:

1. MATERIALS: CONCRETE—CLASS 4000; REINFORCING STEEL—ASTM A615 GRADE 60 MIN; CHANNEL AND SHELF MATERIAL — CONCRETE CLASS 3000.
2. PRECAST MAINTENANCE HOLE COMPONENTS MUST CONFORM TO ASTM C 478. JOINTS BETWEEN PRECAST COMPONENTS MUST BE RUBBER GASKETED CONFORMING TO ASTM C 443.
3. MINIMUM REQUIRED SOIL BEARING = 3,000 LBS/SQ FT
4. MAX HOLE SIZE MUST BE OD OF PIPE PLUS 6 IN. MIN HOLE SIZE MUST BE OD OF PIPE PLUS 3 IN. MIN CLEAR DISTANCE BETWEEN HOLES IS 8 IN.


REF STD SPEC SEC 7-05






City of Seattle

NOT TO SCALE

TYPE 204.5a MAINTENANCE HOLE

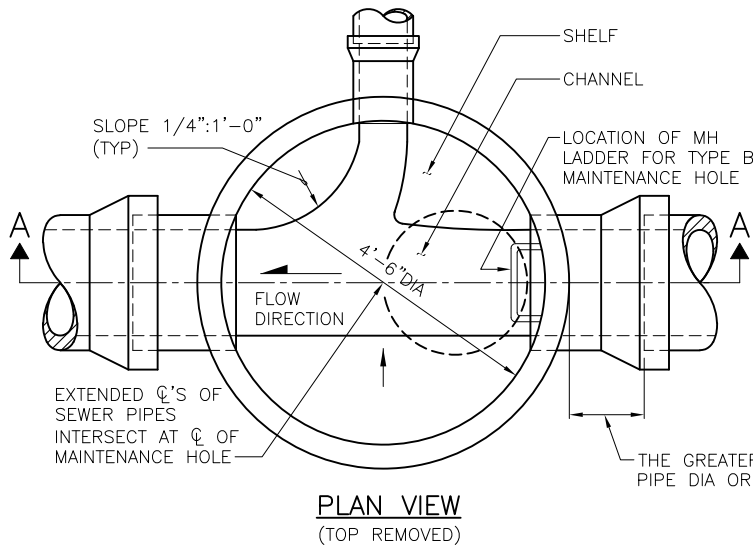

"H"	REINFORCING STEEL "A"	
	MIN. SQ IN/FT, TOP FACE, IN EACH DIRECTION	
	PRECAST BASE	CAST-IN-PLACE BASE
20' MAX	0.29	0.21
30' MAX	0.36	0.26
40' MAX	0.42	0.31

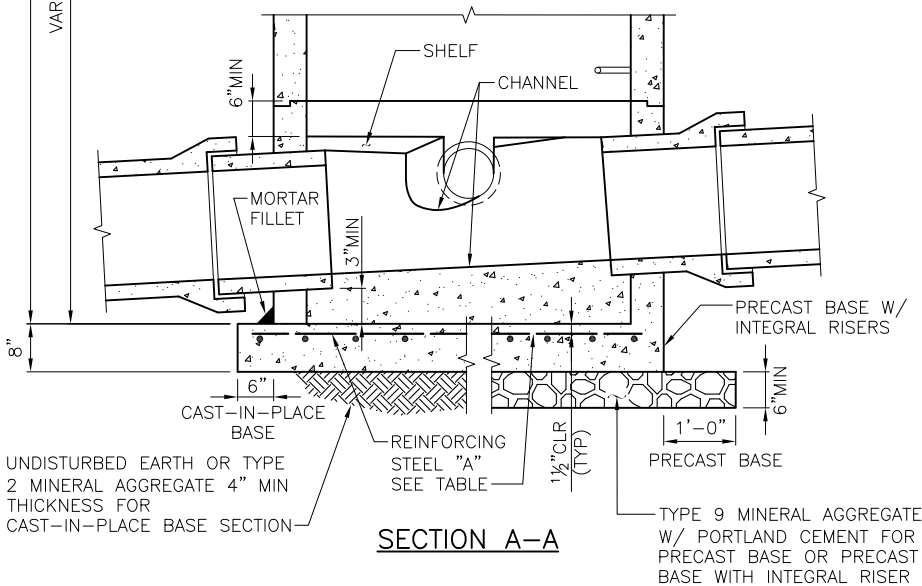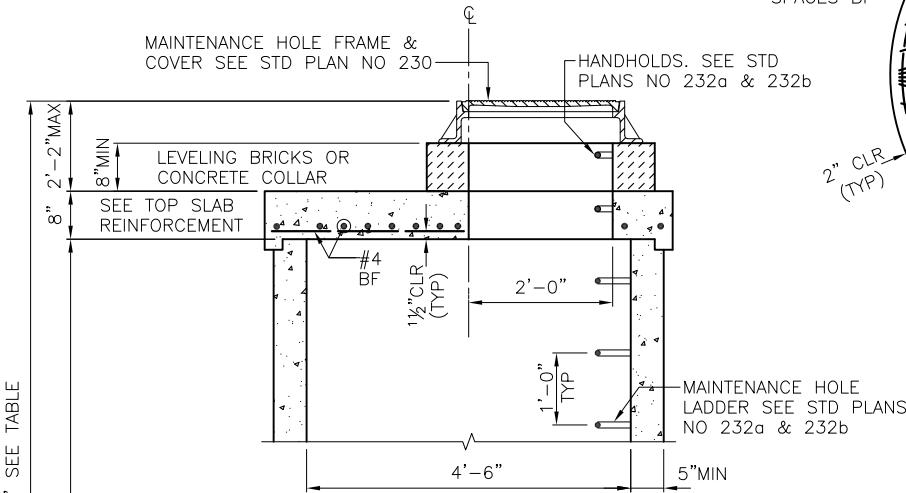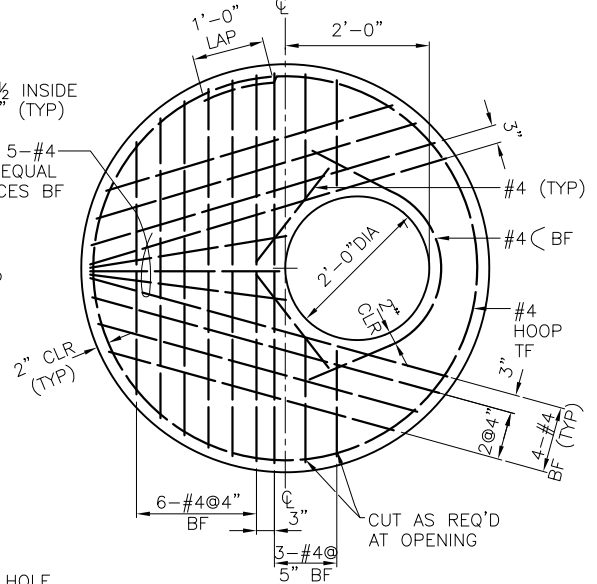

NOTES:

1. MATERIALS: CONCRETE—CLASS 4000; REINFORCING STEEL—ASTM A615 GRADE 60 MIN; CHANNEL AND SHELF MATERIAL — CONCRETE CLASS 3000.
2. PRECAST MAINTENANCE HOLE COMPONENTS MUST CONFORM TO ASTM C 478. JOINTS BETWEEN PRECAST COMPONENTS MUST BE RUBBER GASKETED CONFORMING TO ASTM C 443.
3. MINIMUM REQUIRED SOIL BEARING = 3,000 LBS/SQ FT
4. MAX HOLE SIZE MUST BE OD OF PIPE PLUS 6 IN. MIN HOLE SIZE MUST BE OD OF PIPE PLUS 3 IN. MIN CLEAR DISTANCE BETWEEN HOLES IS 8 IN.


REF STD SPEC SEC 7-05




City of Seattle

NOT TO SCALE

TYPE 204.5b MAINTENANCE HOLE

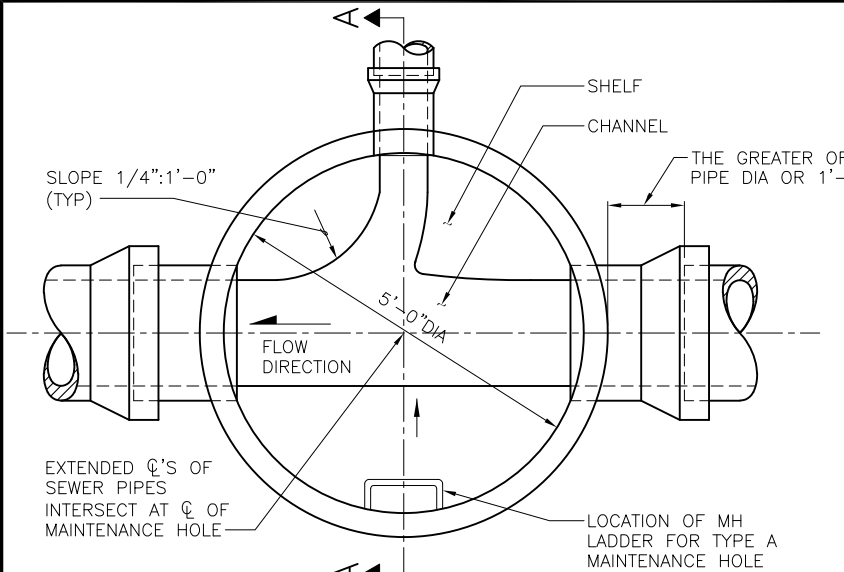

"H"	REINFORCING STEEL "A"	
	MIN. SQ IN/FT, TOP FACE, IN EACH DIRECTION	
	PRECAST BASE	CAST-IN-PLACE BASE
20' MAX	0.33	0.25
30' MAX	0.41	0.31
40' MAX	0.49	0.37

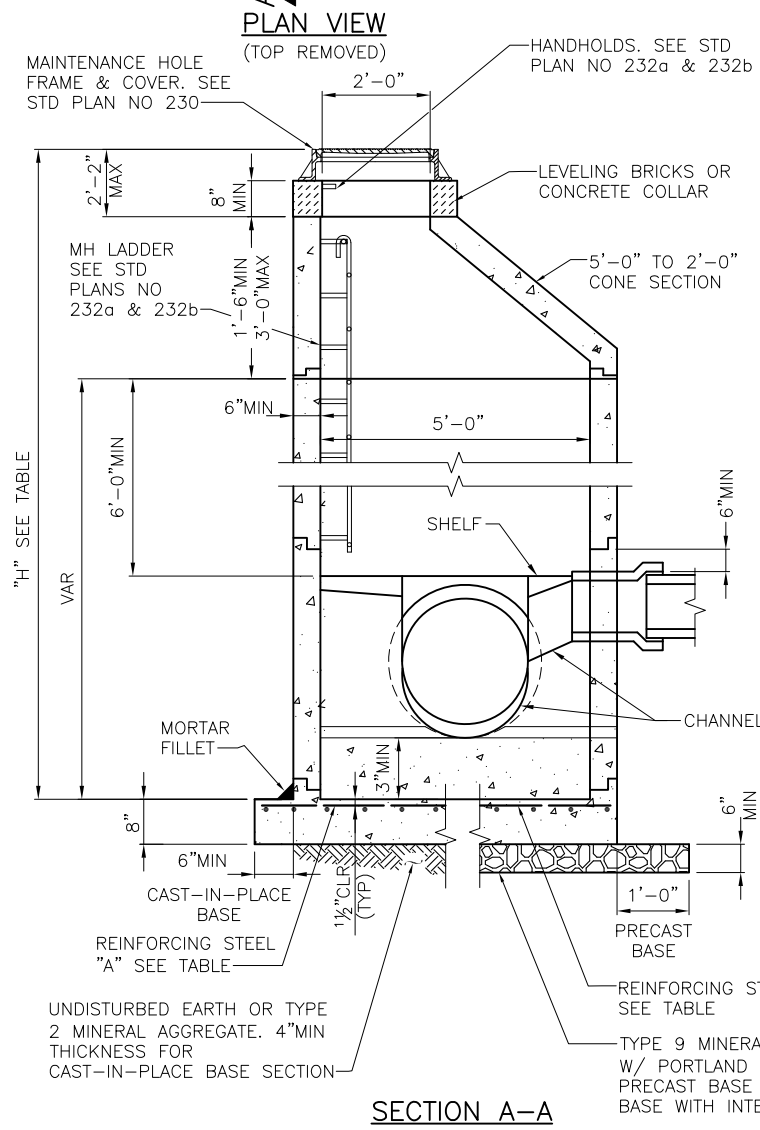

- NOTES:**
1. MATERIALS: CONCRETE—CLASS 4000; REINFORCING STEEL—ASTM A615 GRADE 60 MIN; CHANNEL AND SHELF MATERIAL — CONCRETE CLASS 3000.
 2. PRECAST MAINTENANCE HOLE COMPONENTS MUST CONFORM TO ASTM C 478. JOINTS BETWEEN PRECAST COMPONENTS MUST BE RUBBER GASKETED CONFORMING TO ASTM C 443.
 3. MINIMUM REQUIRED SOIL BEARING = 3,000 LBS/SQ FT
 4. MAX HOLE SIZE MUST BE OD OF PIPE PLUS 6 IN. MIN HOLE SIZE MUST BE OD OF PIPE PLUS 3 IN. MIN CLEAR DISTANCE BETWEEN HOLES IS 8 IN.


REF STD SPEC SEC 7-05



City of Seattle


NOT TO SCALE

TYPE 205a MAINTENANCE HOLE


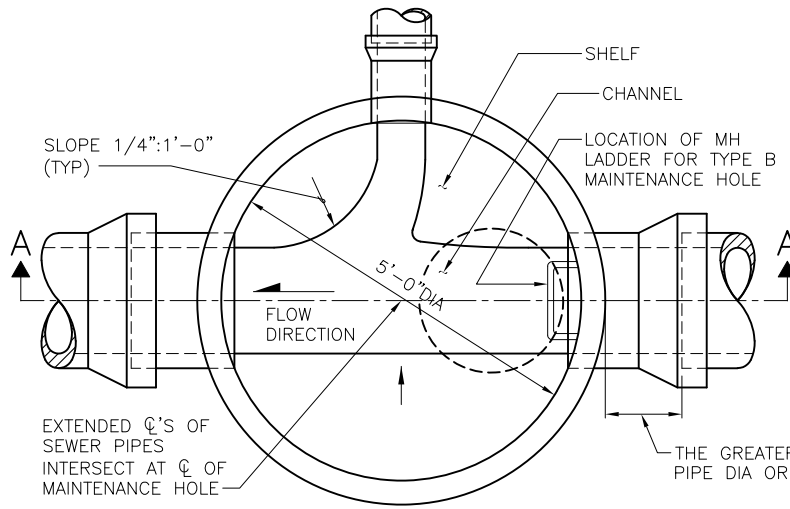


PLAN VIEW
(TOP REMOVED)

"H"	REINFORCING STEEL "A"	
	MIN. SQ IN/FT, TOP FACE, IN EACH DIRECTION	
	PRECAST BASE	CAST-IN-PLACE BASE
20' MAX	0.33	0.25
30' MAX	0.41	0.31
40' MAX	0.49	0.37

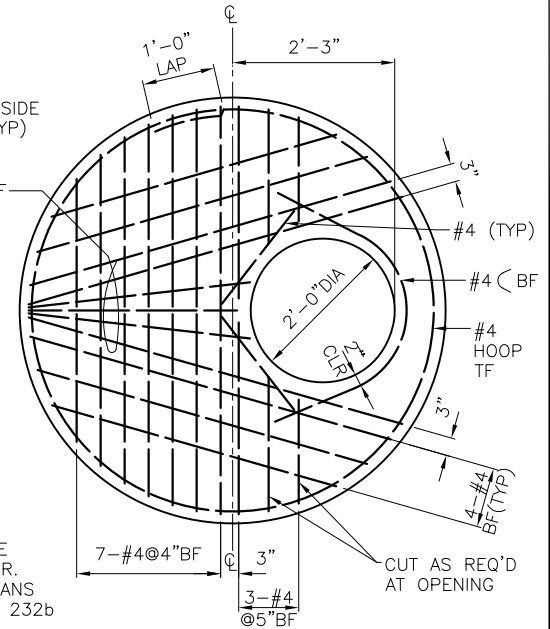

TOP SLAB REINFORCEMENT

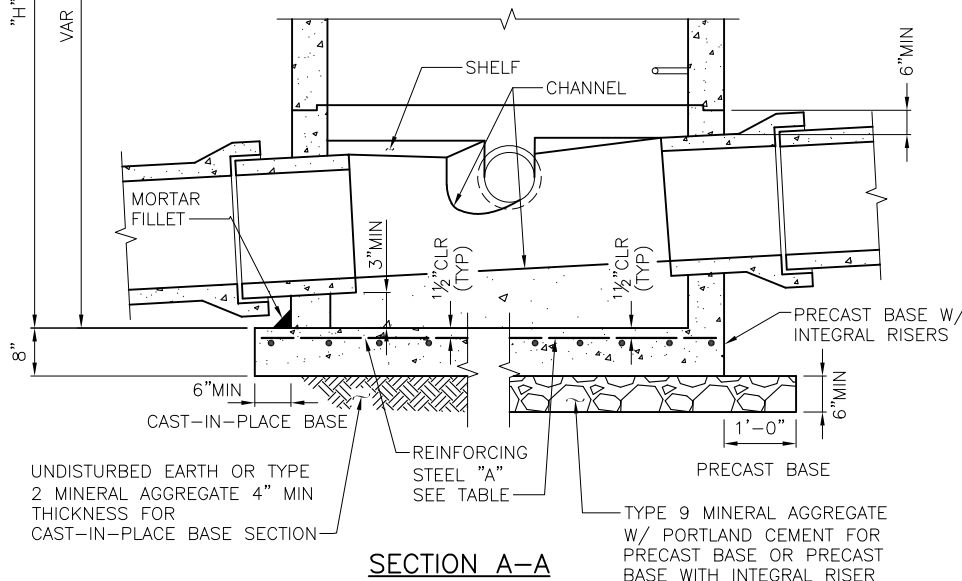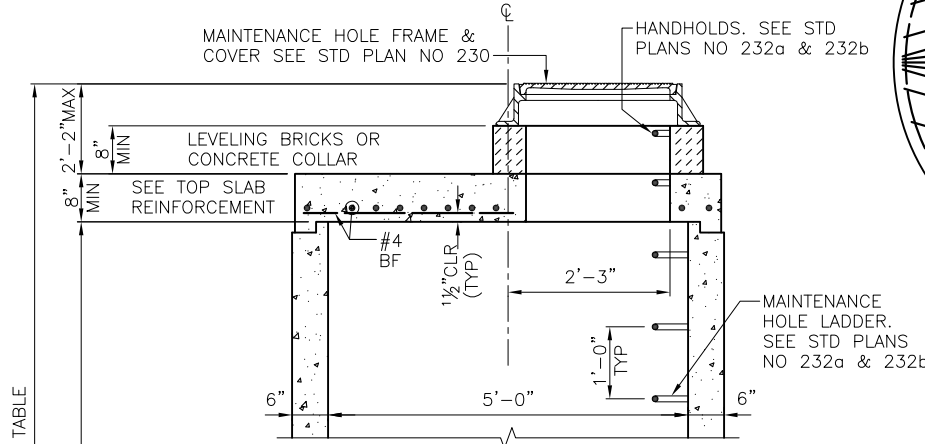

SECTION A-A

NOTES:

1. MATERIALS: CONCRETE—CLASS 4000; REINFORCING STEEL—ASTM A615 GRADE 60 MIN; CHANNEL AND SHELF MATERIAL — CONCRETE CLASS 3000.
2. PRECAST MAINTENANCE HOLE COMPONENTS MUST CONFORM TO ASTM C 478. JOINTS BETWEEN PRECAST COMPONENTS MUST BE RUBBER GASKETED CONFORMING TO ASTM C 443.
3. MINIMUM REQUIRED SOIL BEARING = 3,000 LBS/SQ FT
4. MAX HOLE SIZE MUST BE OD OF PIPE PLUS 6 IN. MIN HOLE SIZE MUST BE OD OF PIPE PLUS 3 IN. MIN CLEAR DISTANCE BETWEEN HOLES IS 8 IN.


REF STD SPEC SEC 7-05





City of Seattle

NOT TO SCALE

TYPE 205b MAINTENANCE HOLE

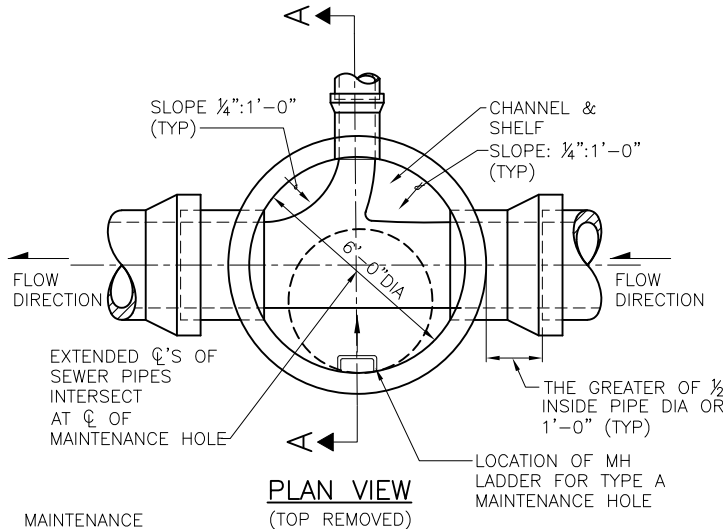

"H"	REINFORCING STEEL "A"	
	MIN. SQ IN/FT, TOP FACE, IN EACH DIRECTION	
	PRECAST BASE	CAST-IN-PLACE BASE
20' MAX	0.39	0.30
30' MAX	0.47	0.37
40' MAX	0.56	0.46

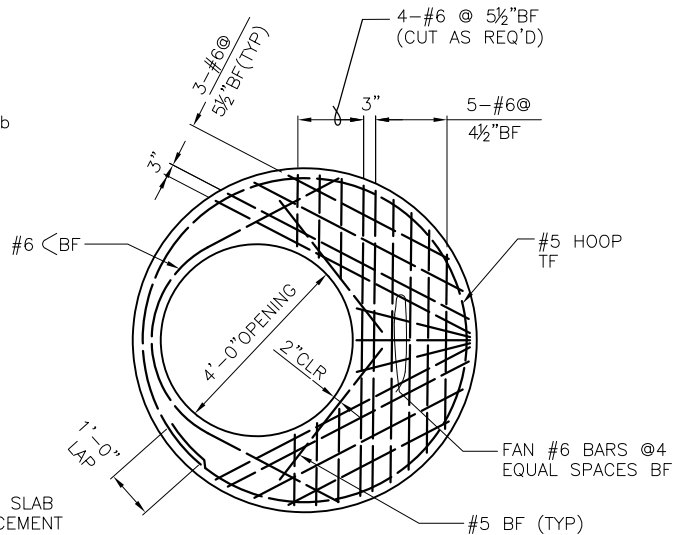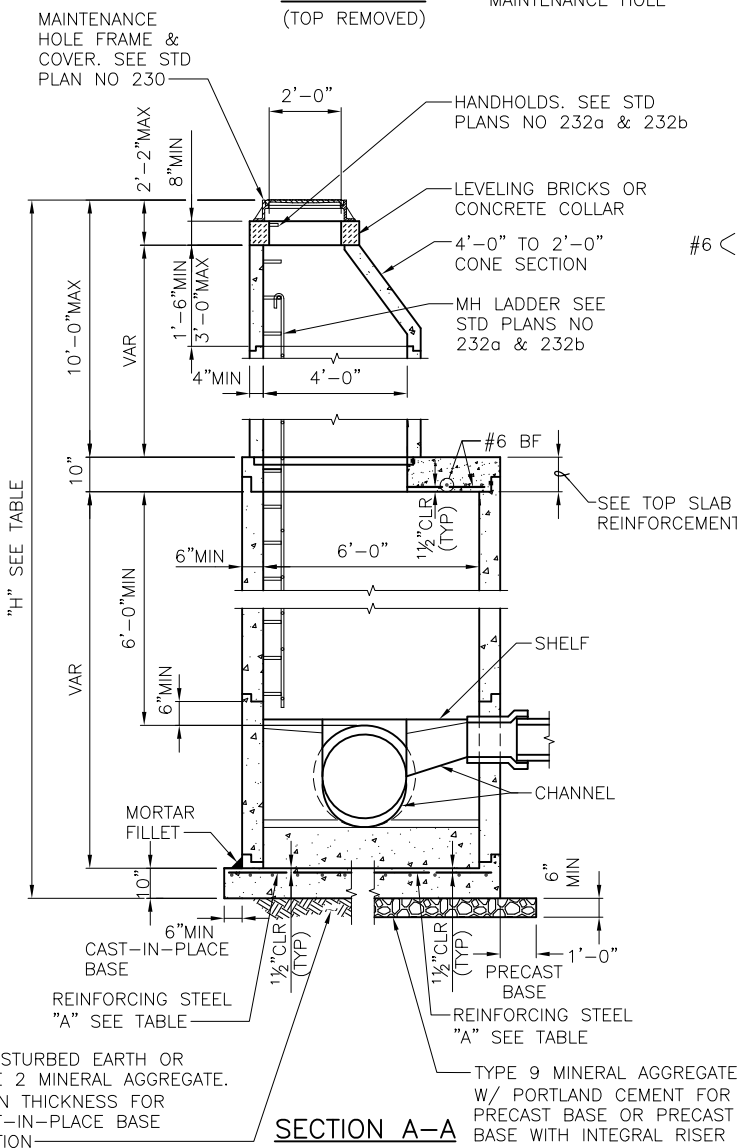

NOTES:

1. MATERIALS: CONCRETE—CLASS 4000; REINFORCING STEEL—ASTM A615 GRADE 60 MIN; CHANNEL AND SHELF MATERIAL — CONCRETE CLASS 3000.
2. PRECAST MAINTENANCE HOLE COMPONENTS MUST CONFORM TO ASTM C 478. JOINTS BETWEEN PRECAST COMPONENTS MUST BE RUBBER GASKETED CONFORMING TO ASTM C 443.
3. MINIMUM REQUIRED SOIL BEARING = 3,000 LBS/SQ FT
4. MAX HOLE SIZE MUST BE OD OF PIPE PLUS 7 IN. MIN HOLE SIZE MUST BE OD OF PIPE PLUS 3 IN. MIN CLEAR DISTANCE BETWEEN HOLES IS 12 IN.


REF STD SPEC SEC 7-05





City of Seattle

NOT TO SCALE

TYPE 206a MAINTENANCE HOLE

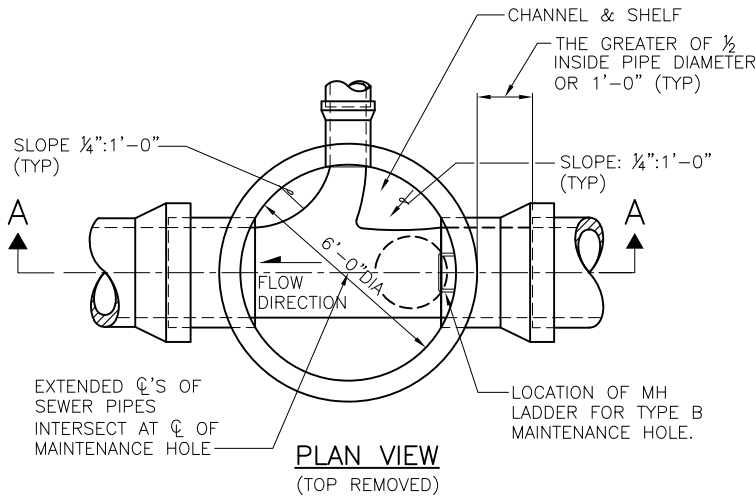

"H"	REINFORCING STEEL "A"	
	MIN. SQ IN/FT, TOP FACE, IN EACH DIRECTION	
	PRECAST BASE	CAST-IN-PLACE BASE
20' MAX	0.29	0.24
30' MAX	0.41	0.32
40' MAX	0.49	0.41

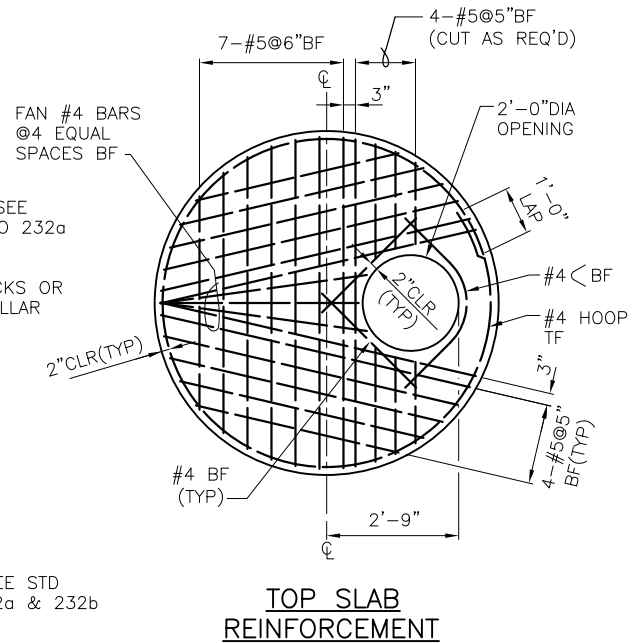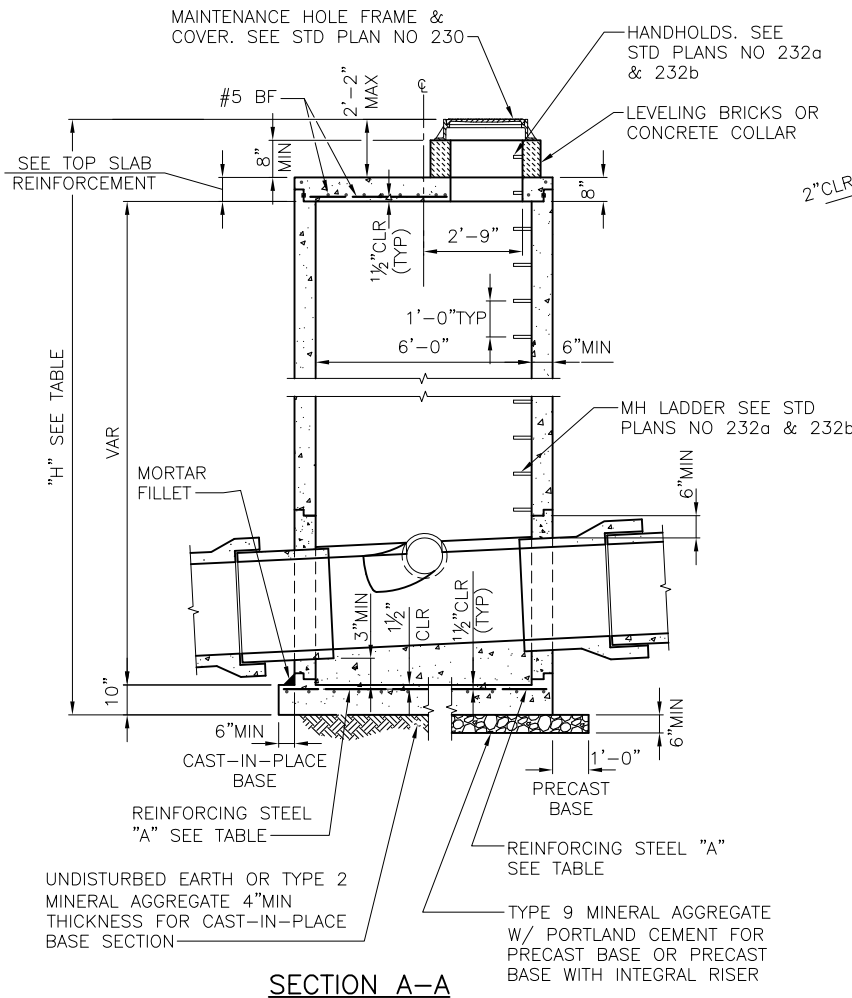

NOTES:

1. MATERIALS: CONCRETE—CLASS 4000; REINFORCING STEEL—ASTM A615 GRADE 60 MIN; CHANNEL AND SHELF MATERIAL — CONCRETE CLASS 3000.
2. PRECAST MAINTENANCE HOLE COMPONENTS MUST CONFORM TO ASTM C 478. JOINTS BETWEEN PRECAST COMPONENTS MUST BE RUBBER GASKETED CONFORMING TO ASTM C 443.
3. MINIMUM REQUIRED SOIL BEARING = 3,000 LBS/SQ FT
4. MAX HOLE SIZE MUST BE OD OF PIPE PLUS 7 IN. MIN HOLE SIZE MUST BE OD OF PIPE PLUS 3 IN. MIN CLEAR DISTANCE BETWEEN HOLES IS 12 IN.


REF STD SPEC SEC 7-05





City of Seattle

NOT TO SCALE

TYPE 206b MAINTENANCE HOLE

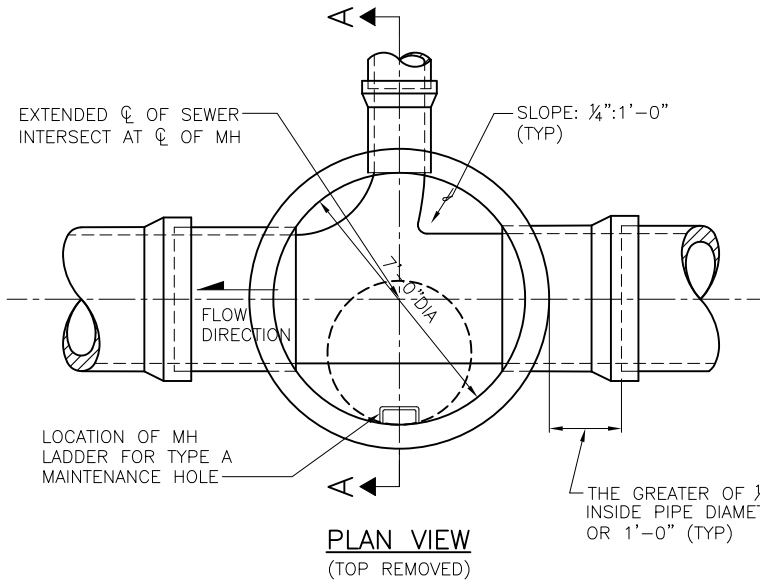

"H"	REINFORCING STEEL "A"	
	MIN. SQ IN/FT, TOP FACE, IN EACH DIRECTION	
	PRECAST BASE	CAST-IN-PLACE BASE
20' MAX	0.42	0.34
30' MAX	0.51	0.41
40' MAX	0.60	0.48

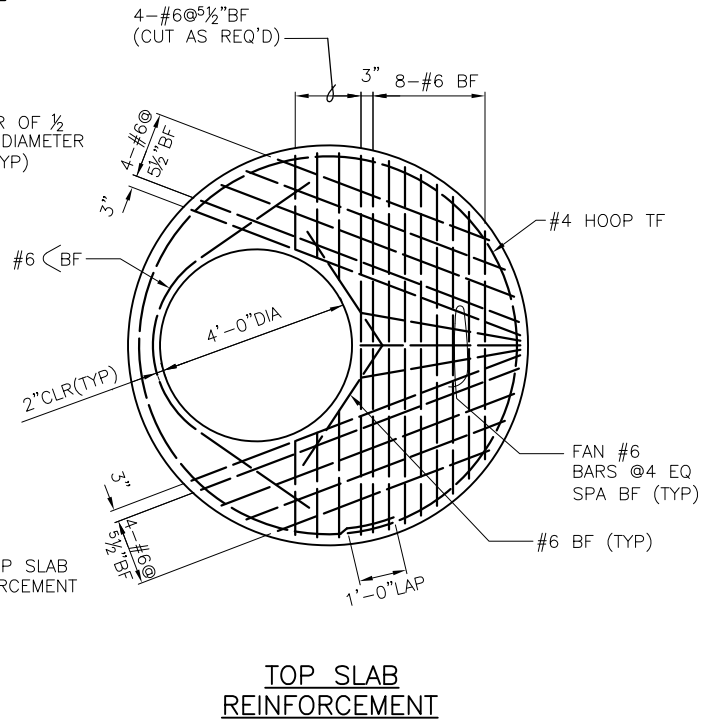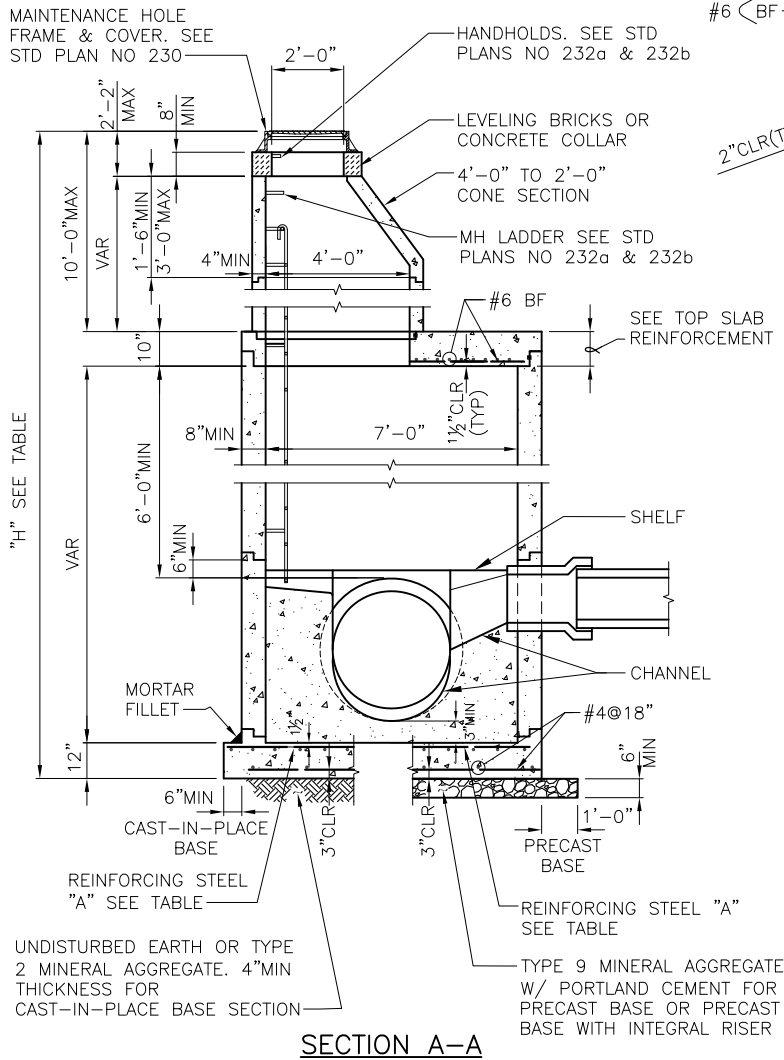

NOTES:

1. MATERIALS: CONCRETE-CLASS 4000; REINFORCING STEEL-ASTM A615 GRADE 60 MIN; CHANNEL AND SHELF MATERIAL - CONCRETE CLASS 3000.
2. PRECAST MAINTENANCE HOLE COMPONENTS MUST CONFORM TO ASTM C 478. JOINTS BETWEEN PRECAST COMPONENTS MUST BE RUBBER GASKETED CONFORMING TO ASTM C 443.
3. MINIMUM REQUIRED SOIL BEARING = 3,000 LBS/SQ FT
4. MAX HOLE SIZE MUST BE OD OF PIPE PLUS 8 IN. MIN HOLE SIZE MUST BE OD OF PIPE PLUS 3 IN. MIN CLEAR DISTANCE BETWEEN HOLES IS 12 IN.


REF STD SPEC SEC 7-05





City of Seattle

NOT TO SCALE

TYPE 207a MAINTENANCE HOLE

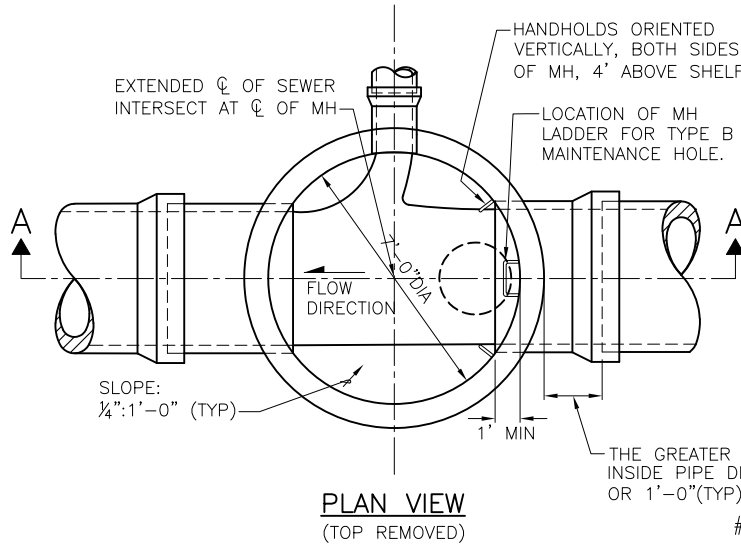

"H"	REINFORCING STEEL "A"	
	MIN. SQ IN/FT, TOP FACE, IN EACH DIRECTION	
	PRECAST BASE	CAST-IN-PLACE BASE
20' MAX	0.34	0.27
30' MAX	0.43	0.35
40' MAX	0.52	0.42

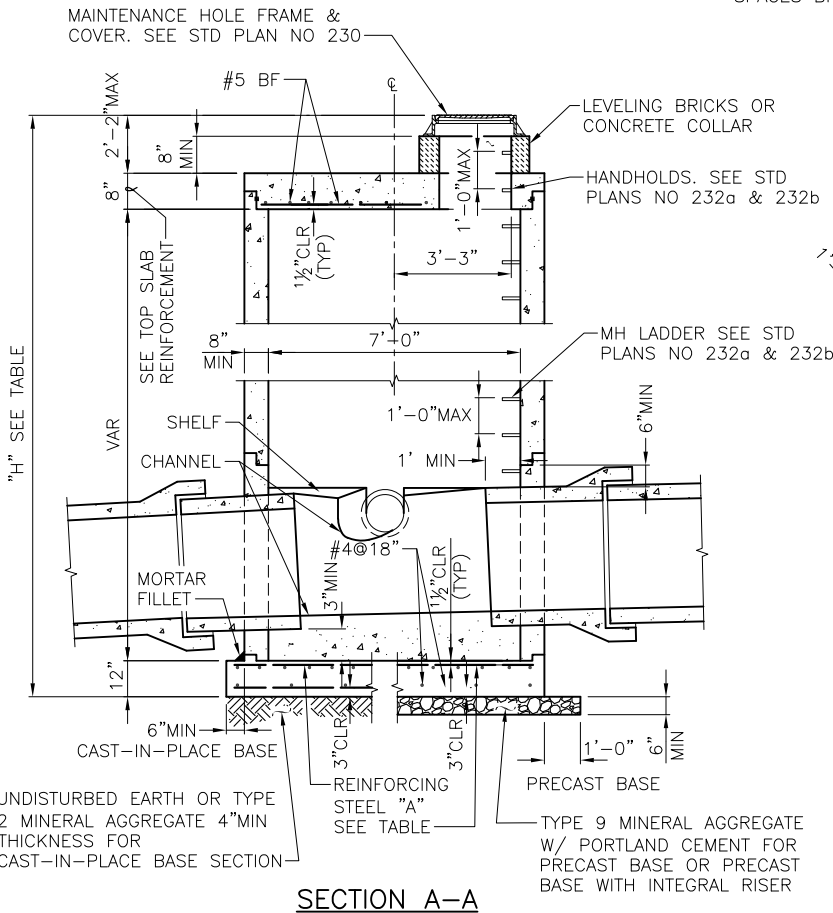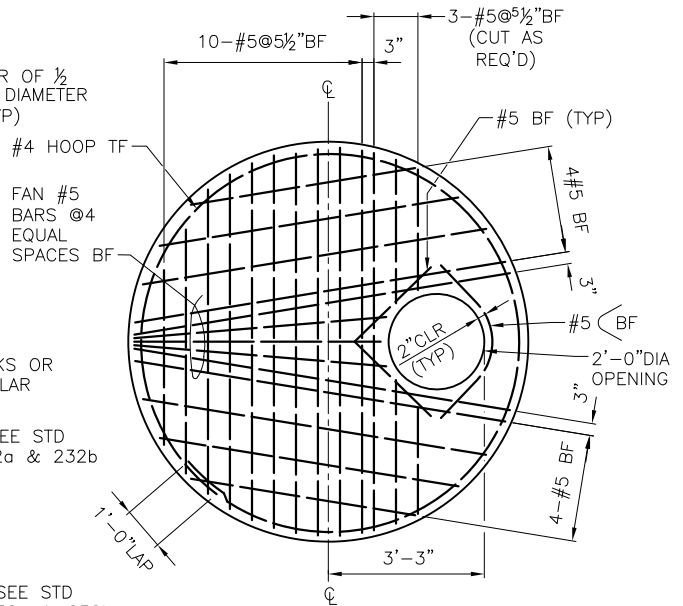

- NOTES:**
1. MATERIAL: CONCRETE-CLASS 4000; REINFORCING STEEL-ASTM A615 GRADE 60 MIN; CHANNEL AND SHELF MATERIAL-CONCRETE CLASS 3000.
 2. PRECAST MAINTENANCE HOLE COMPONENTS MUST CONFORM TO ASTM C 478. JOINTS BETWEEN PRECAST COMPONENTS MUST BE RUBBER GASKETED CONFORMING TO ASTM C 443.
 3. MINIMUM REQUIRED SOIL BEARING = 3,000 LBS/SQ FT
 4. MAX HOLE SIZE MUST BE OD OF PIPE PLUS 8 IN. MIN HOLE SIZE MUST BE OD OF PIPE PLUS 3 IN. MIN CLEAR DISTANCE BETWEEN HOLES IS 12 IN.


REF STD SPEC SEC 7-05





City of Seattle

NOT TO SCALE

TYPE 207b MAINTENANCE HOLE

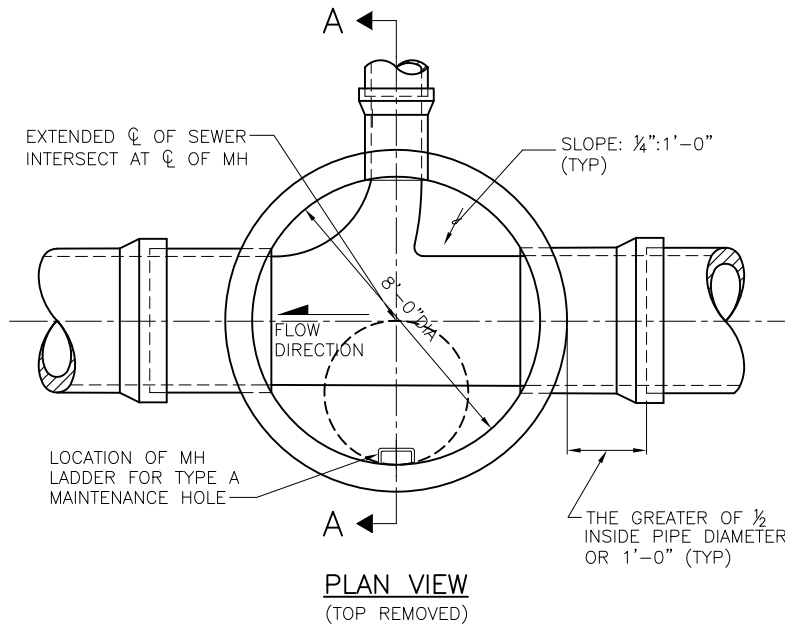

"H"	REINFORCING STEEL "A"	
	MIN. SQ IN/FT, TOP FACE, IN EACH DIRECTION	
	PRECAST BASE	CAST-IN-PLACE BASE
20' MAX	0.54	0.45
30' MAX	0.66	0.55
40' MAX	0.78	0.64

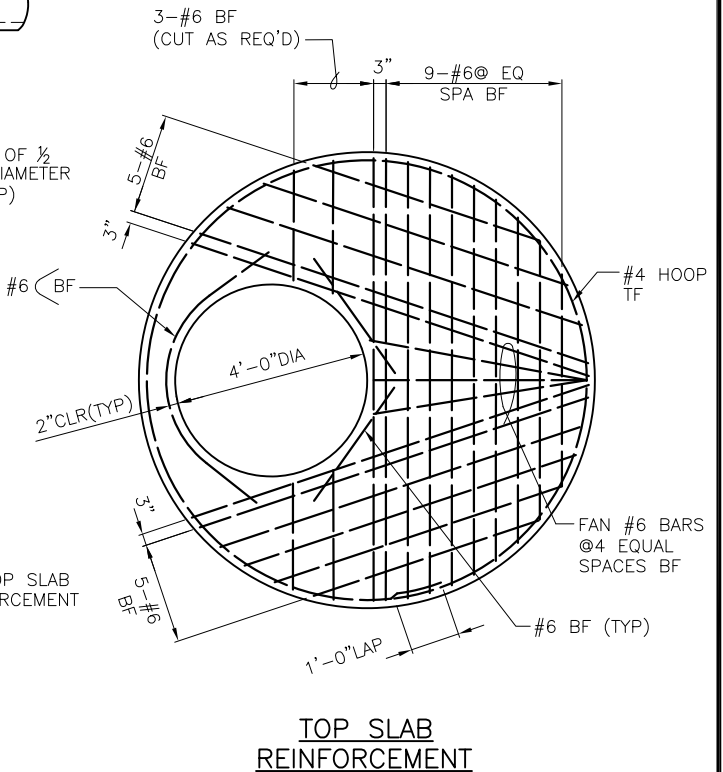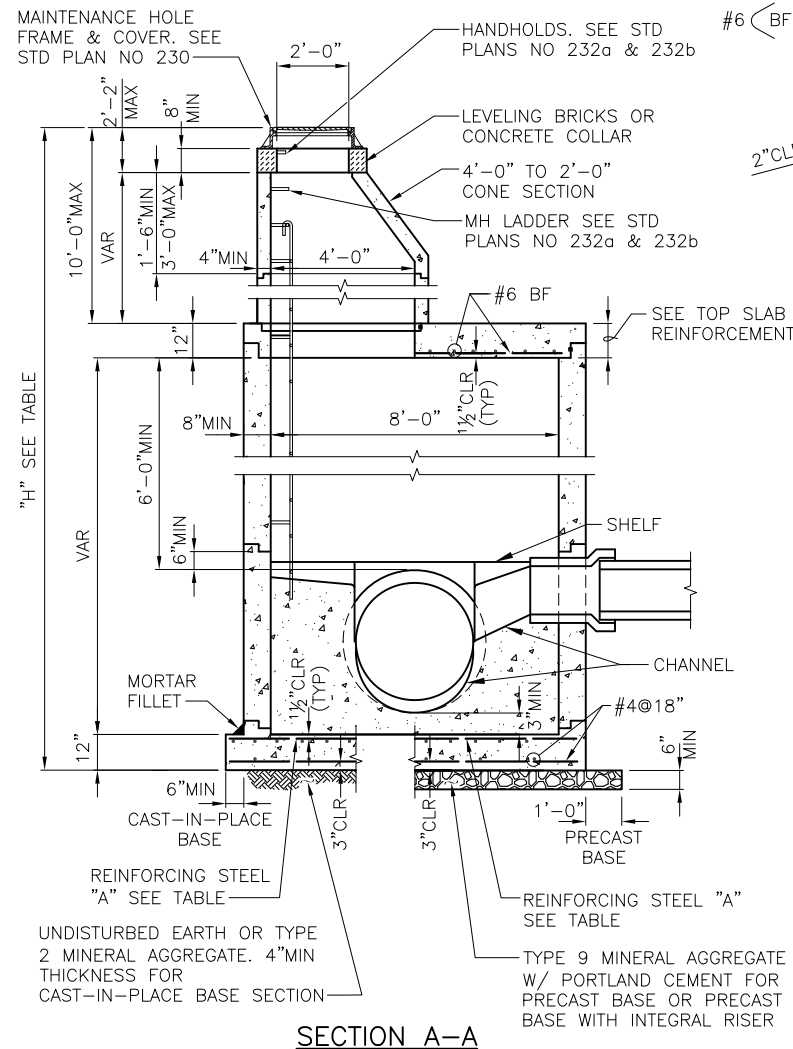

NOTES:

1. MATERIAL; CONCRETE—CLASS 4000
REINFORCING STEEL—ASTM A615 GRADE 60 MIN
CHANNEL AND SHELF MATERIAL; CONCRETE
CLASS 3000.
2. PRECAST MAINTENANCE HOLE COMPONENTS
MUST CONFORM TO ASTM C 478. JOINTS
BETWEEN PRECAST COMPONENTS MUST BE
RUBBER GASKETED CONFORMING TO ASTM C
443.
3. MINIMUM REQUIRED SOIL BEARING = 3,000
LBS/SQ FT
4. MAX HOLE SIZE MUST BE OD OF PIPE PLUS 9".
MIN HOLE SIZE MUST BE OD OF PIPE PLUS 3".
MIN DISTANCE BETWEEN HOLES IS 12".


REF STD SPEC SEC 7-05





City of Seattle

NOT TO SCALE

TYPE 208a MAINTENANCE HOLE

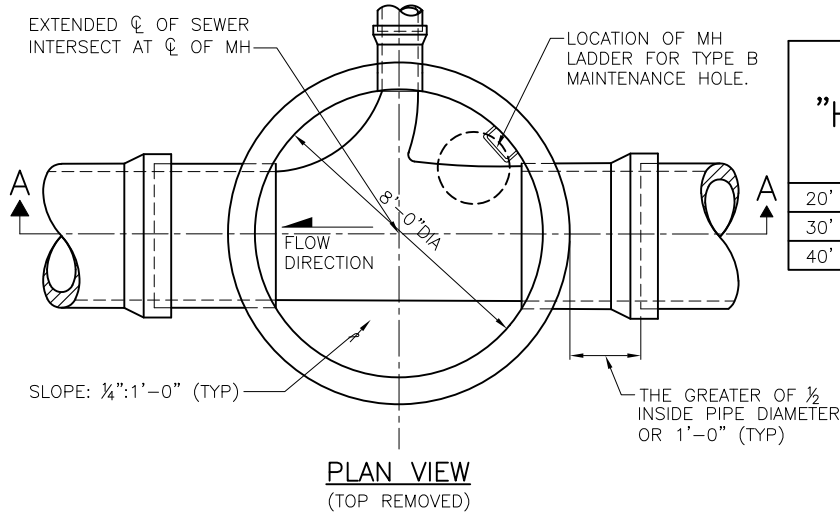

"H"	REINFORCING STEEL "A"	
	MIN. SQ IN/FT, TOP FACE, IN EACH DIRECTION	
	PRECAST BASE	CAST-IN-PLACE BASE
20' MAX	0.42	0.35
30' MAX	0.53	0.45
40' MAX	0.65	0.54

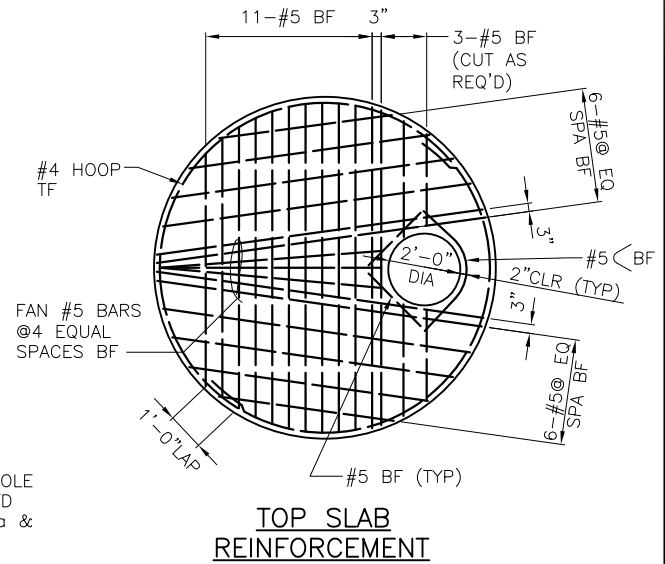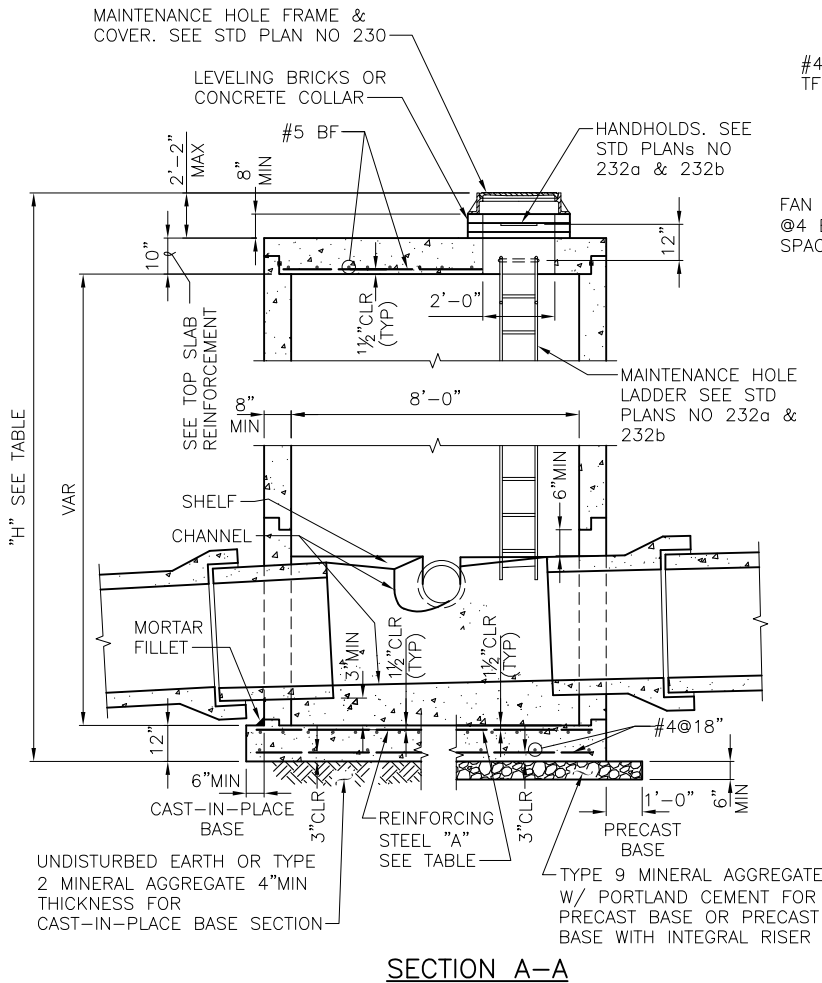

NOTES:

1. MATERIAL; CONCRETE-CLASS 4000
REINFORCING STEEL-ASTM A615 GRADE 60 MIN
CHANNEL AND SHELF MATERIAL; CONCRETE
CLASS 3000.
2. PRECAST MAINTENANCE HOLE COMPONENTS MUST
CONFORM TO ASTM C 478. JOINTS BETWEEN
PRECAST COMPONENTS MUST BE RUBBER
GASKETED CONFORMING TO ASTM C 443.
3. MINIMUM REQUIRED SOIL BEARING = 3,000
LBS/SQ FT
4. MAX HOLE SIZE MUST BE OD OF PIPE PLUS 9".
MIN HOLE SIZE MUST BE OD OF PIPE PLUS 3".
MIN DISTANCE BETWEEN HOLES IS 12".


REF STD SPEC SEC 7-05





City of Seattle

NOT TO SCALE

TYPE 208b MAINTENANCE HOLE

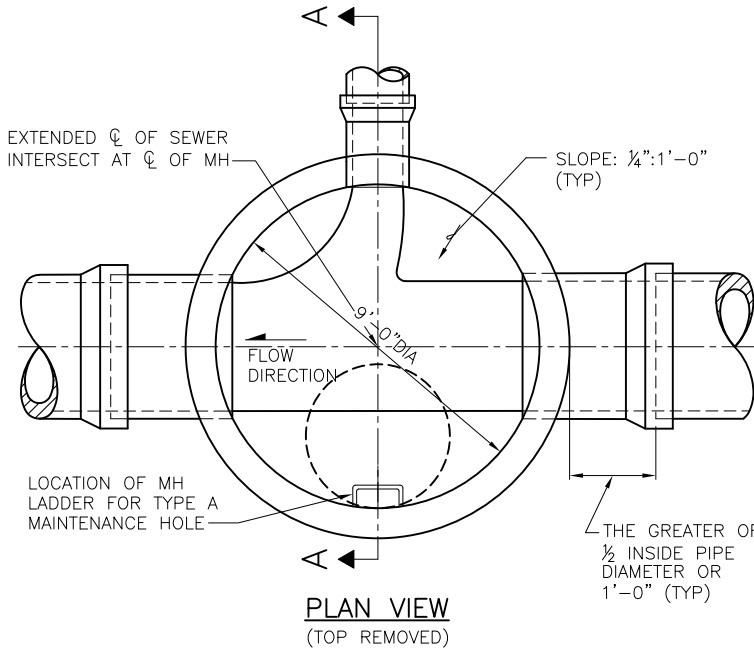

"H"	REINFORCING STEEL "A"	
	MIN. SQ IN/FT, TOP FACE, IN EACH DIRECTION	
	PRECAST BASE	CAST-IN-PLACE BASE
20' MAX	0.57	0.49
30' MAX	0.70	0.59
40' MAX	0.81	0.69

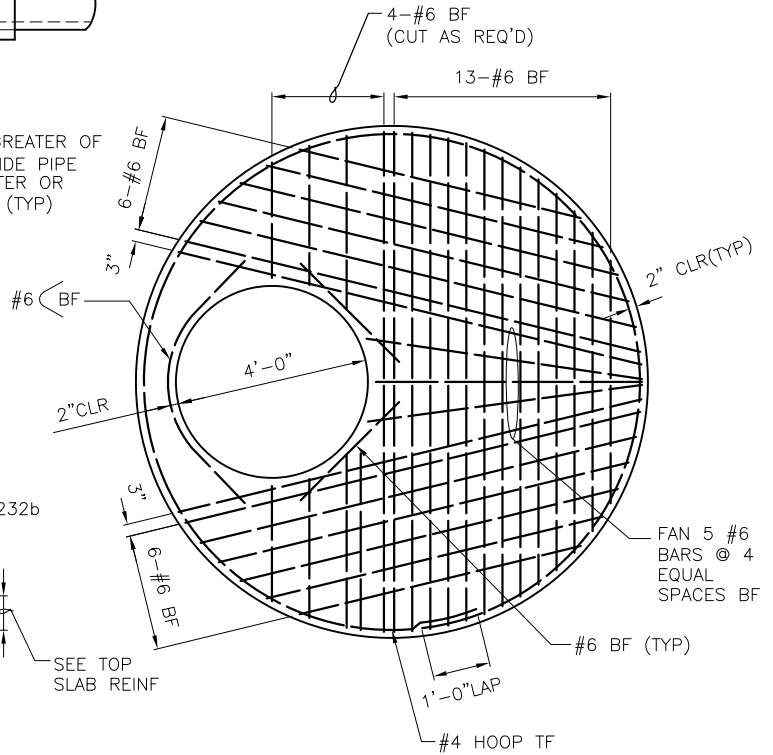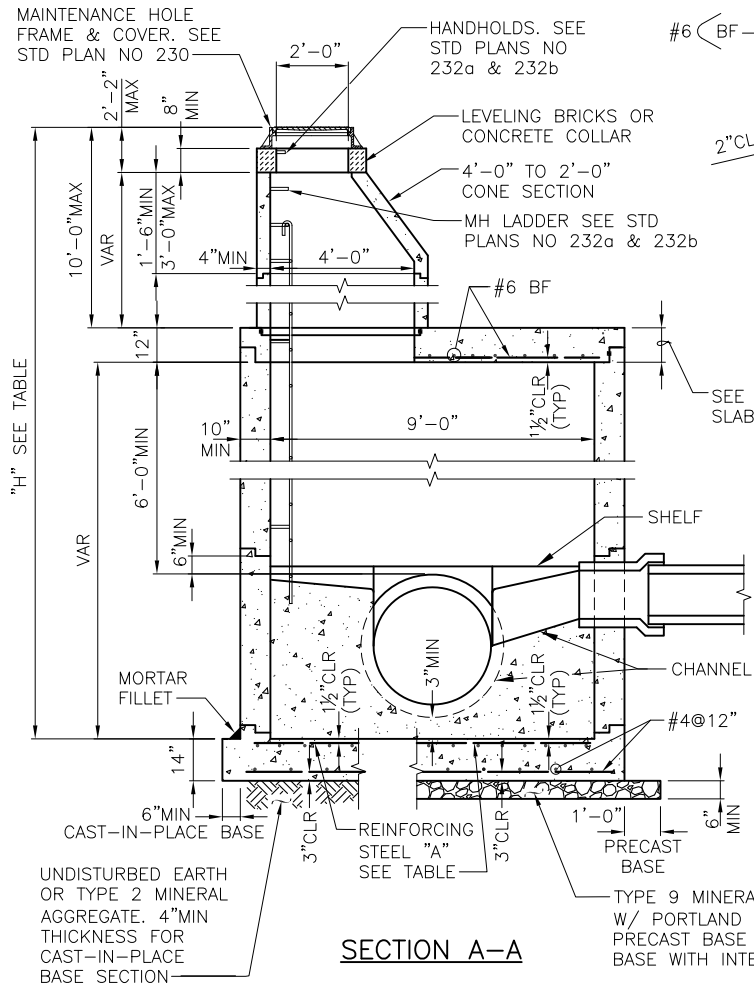

TOP SLAB REINFORCEMENT

NOTES:

1. MATERIAL; CONCRETE—CLASS 4000 REINFORCING STEEL—ASTM A615 GRADE 60 MIN CHANNEL AND SHELF MATERIAL; CONCRETE CLASS 3000.
2. PRECAST MAINTENANCE HOLE COMPONENTS MUST CONFORM TO ASTM C 478. JOINTS BETWEEN PRECAST COMPONENTS MUST BE RUBBER GASKETED CONFORMING TO ASTM C 443.
3. MINIMUM REQUIRED SOIL BEARING = 3,000 LBS/SQ FT
4. MAX HOLE SIZE MUST BE OD OF PIPE PLUS 10". MIN HOLE SIZE MUST BE OD OF PIPE PLUS 3". MIN DISTANCE BETWEEN HOLES IS 12".


REF STD SPEC SEC 7-05



City of Seattle


NOT TO SCALE

TYPE 209a MAINTENANCE HOLE

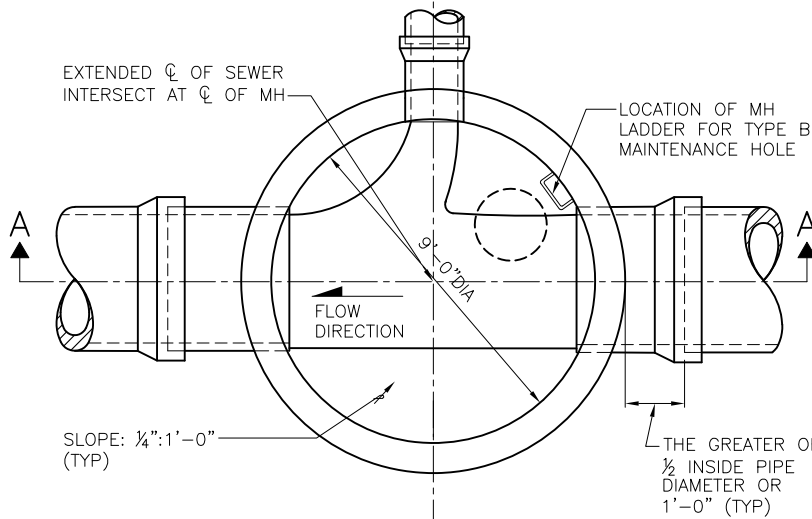


PLAN VIEW
(TOP REMOVED)

"H"	REINFORCING STEEL "A"	
	MIN. SQ IN/FT, TOP FACE, IN EACH DIRECTION	
	PRECAST BASE	CAST-IN-PLACE BASE
20' MAX	0.44	0.37
30' MAX	0.56	0.48
40' MAX	0.68	0.58

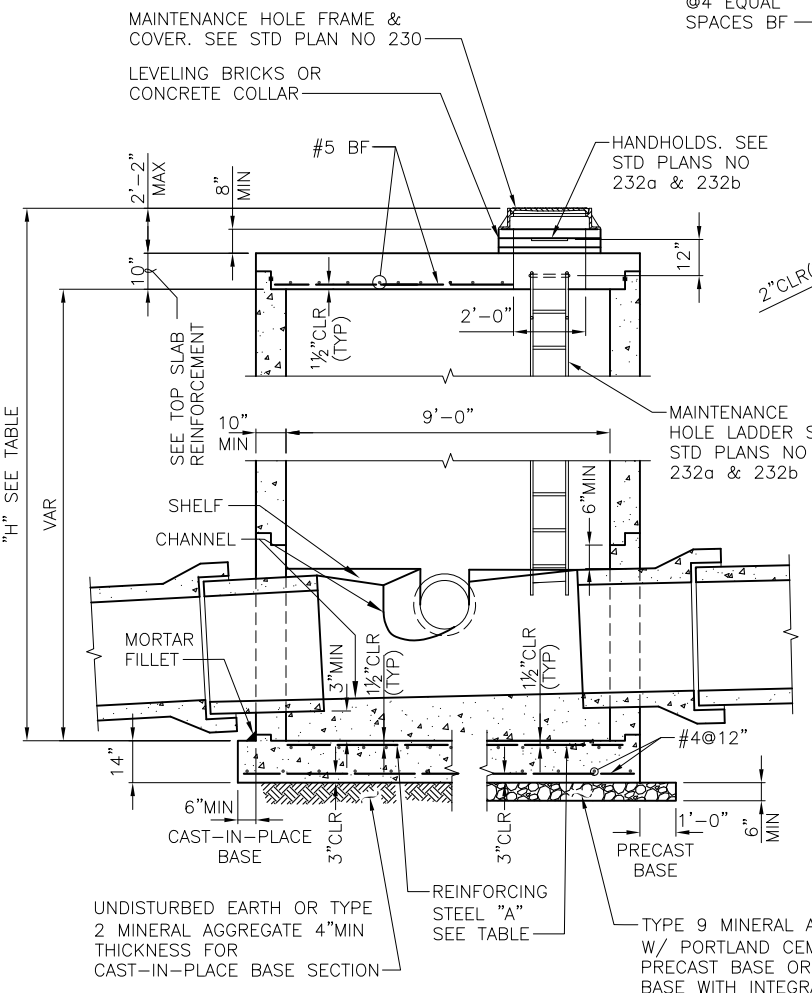

SECTION A-A

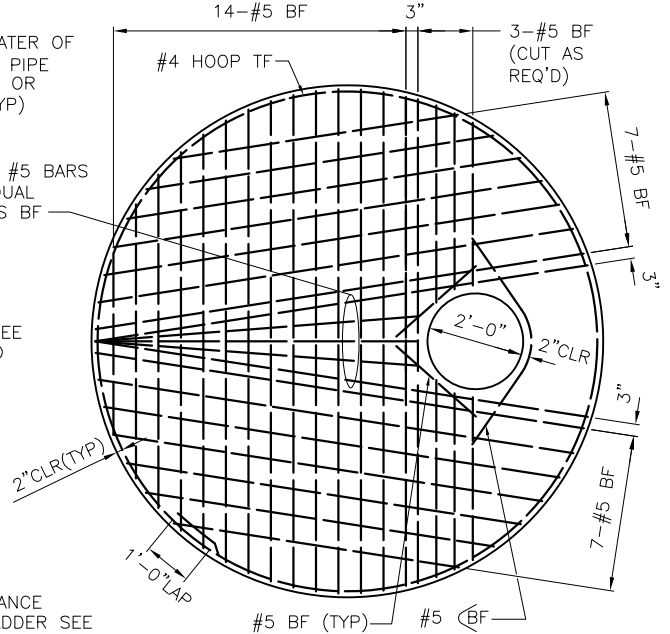

TOP SLAB REINFORCEMENT

NOTES:

1. MATERIAL; CONCRETE-CLASS 4000 REINFORCING STEEL-ASTM A615 GRADE 60 MIN CHANNEL AND SHELF MATERIAL; CONCRETE CLASS 3000.
2. PRECAST MAINTENANCE HOLE COMPONENTS MUST CONFORM TO ASTM C 478. JOINTS BETWEEN PRECAST COMPONENTS MUST BE RUBBER GASKETED CONFORMING TO ASTM C 443.
3. MINIMUM REQUIRED SOIL BEARING = 3,000 LBS/SQ FT
4. MAX HOLE SIZE MUST BE OD OF PIPE PLUS 10". MIN HOLE SIZE MUST BE OD OF PIPE PLUS 3". MIN DISTANCE BETWEEN HOLES IS 12".


REF STD SPEC SEC 7-05



City of Seattle


NOT TO SCALE

TYPE 209b MAINTENANCE HOLE

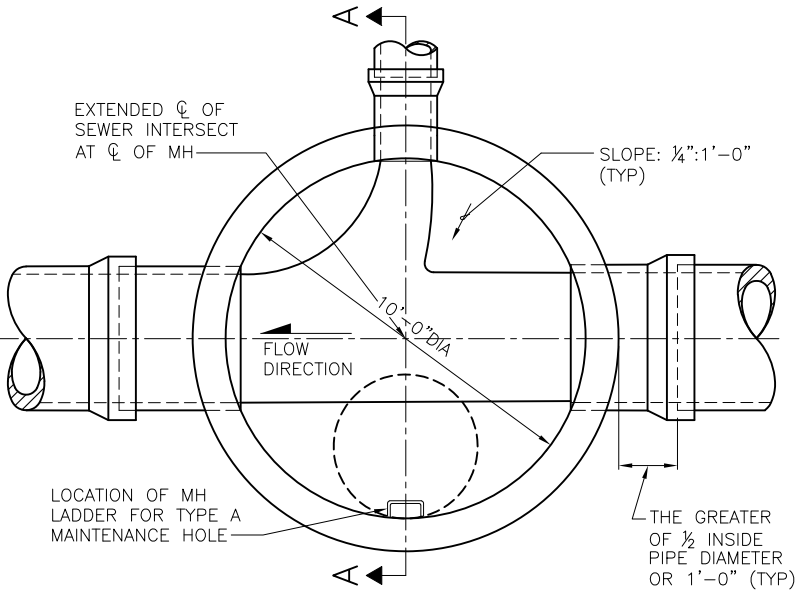


PLAN VIEW
(TOP REMOVED)

"H"	REINFORCING STEEL "A"	
	MIN. SQ IN/FT, TOP FACE, IN EACH DIRECTION	
	PRECAST BASE	CAST-IN-PLACE BASE
20' MAX	0.70	0.60
30' MAX	0.85	0.73
40' MAX	1.00	0.86

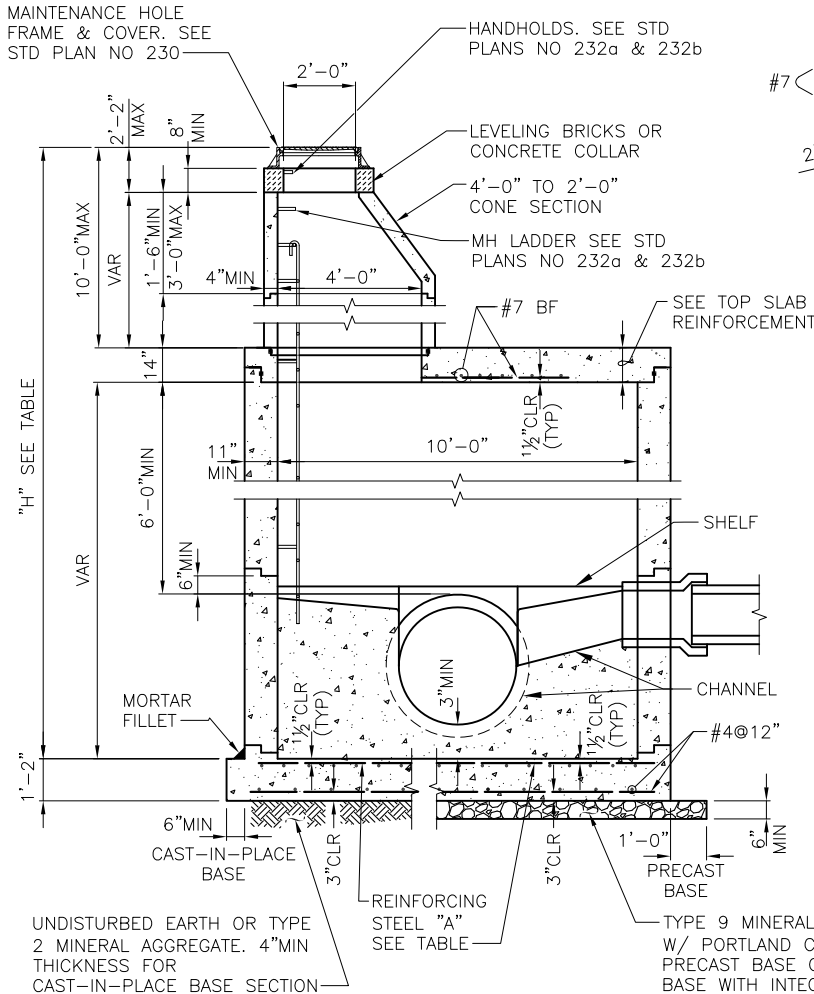

SECTION A-A

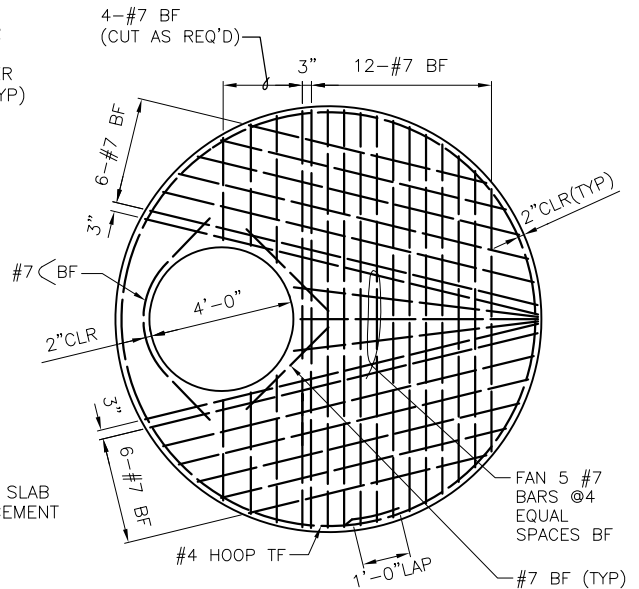

TOP SLAB REINFORCEMENT

NOTES:

1. MATERIAL; CONCRETE—CLASS 4000 REINFORCING STEEL—ASTM A615 GRADE 60 MIN CHANNEL AND SHELF MATERIAL; CONCRETE CLASS 3000.
2. PRECAST MAINTENANCE HOLE COMPONENTS MUST CONFORM TO ASTM C 478. JOINTS BETWEEN PRECAST COMPONENTS MUST BE RUBBER GASKETED CONFORMING TO ASTM C 443.
3. MINIMUM REQUIRED SOIL BEARING = 3,000 LBS/SQ FT
4. MAX HOLE SIZE MUST BE OD OF PIPE PLUS 11". MIN HOLE SIZE MUST BE OD OF PIPE PLUS 3". MIN DISTANCE BETWEEN HOLES IS 12".


REF STD SPEC SEC 7-05





City of Seattle

NOT TO SCALE

TYPE 210a MAINTENANCE HOLE

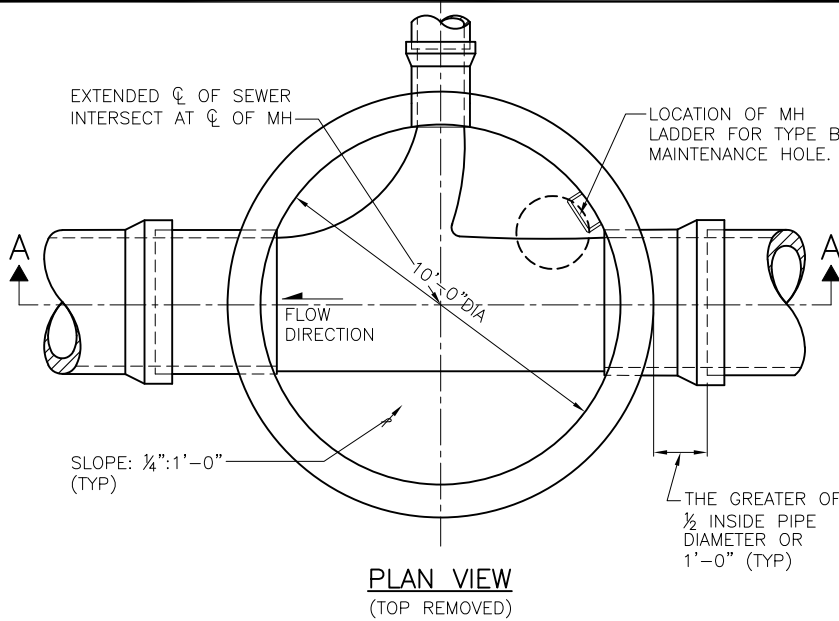

"H"	REINFORCING STEEL "A"	
	MIN. SQ IN/FT, TOP FACE, IN EACH DIRECTION	
	PRECAST BASE	CAST-IN-PLACE BASE
20' MAX	0.52	0.45
30' MAX	0.66	0.57
40' MAX	0.81	0.70

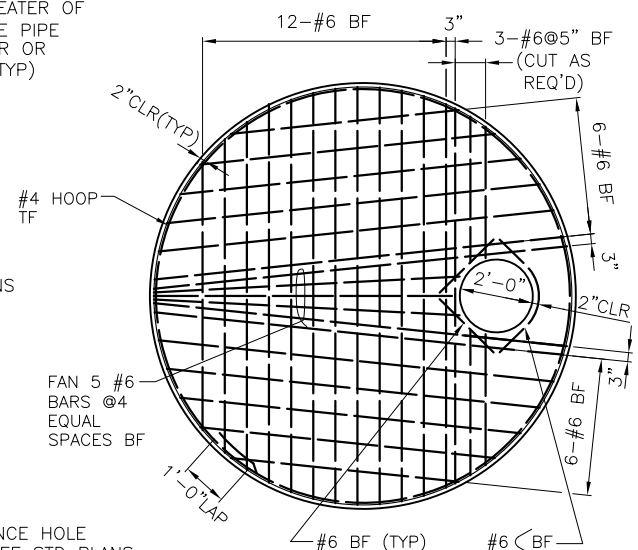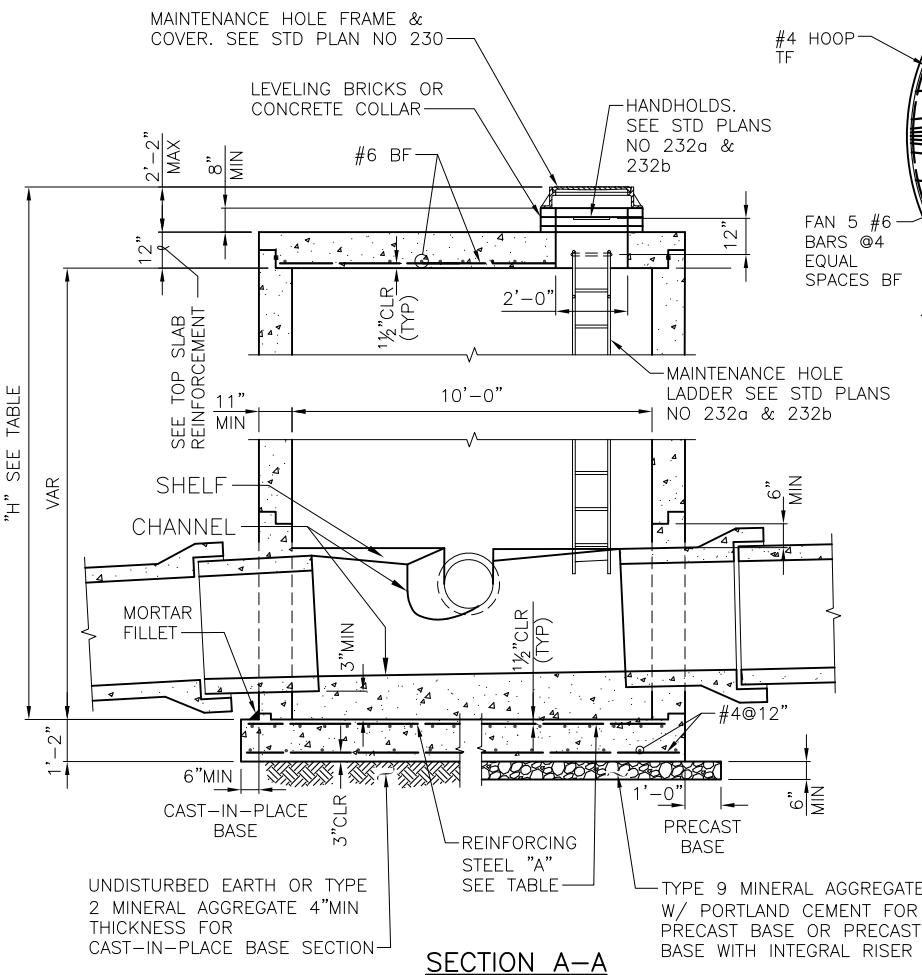

NOTES:

1. MATERIAL; CONCRETE—CLASS 4000 REINFORCING STEEL—ASTM A615 GRADE 60 MIN CHANNEL AND SHELF MATERIAL; CONCRETE CLASS 3000.
2. PRECAST MAINTENANCE HOLE COMPONENTS MUST CONFORM TO ASTM C 478. JOINTS BETWEEN PRECAST COMPONENTS MUST BE RUBBER GASKETED CONFORMING TO ASTM C 443.
3. MINIMUM REQUIRED SOIL BEARING = 3,000 LBS/SQ FT
4. MAX HOLE SIZE MUST BE OD OF PIPE PLUS 11". MIN HOLE SIZE MUST BE OD OF PIPE PLUS 3". MIN DISTANCE BETWEEN HOLES IS 12".


REF STD SPEC SEC 7-05



City of Seattle


NOT TO SCALE

TYPE 210b MAINTENANCE HOLE

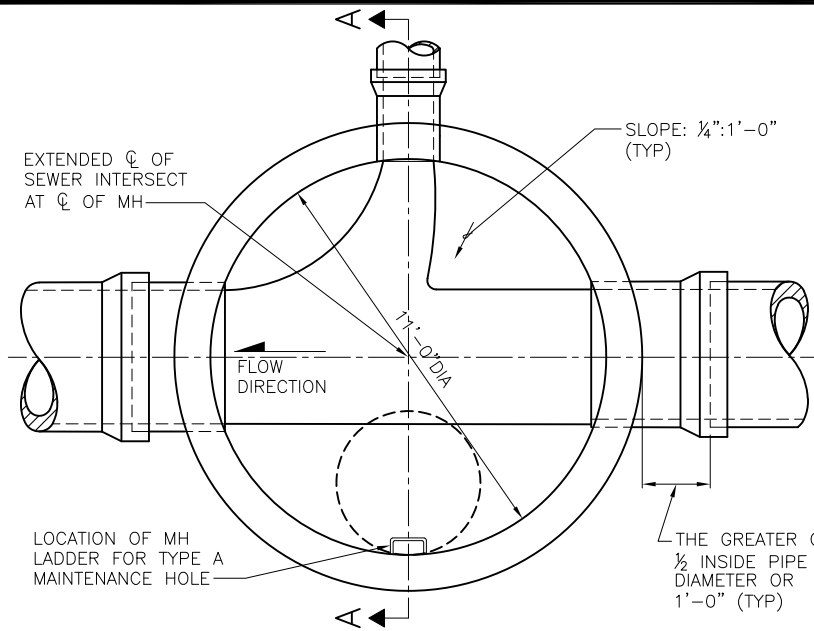


PLAN VIEW
(TOP REMOVED)

"H"	REINFORCING STEEL "A"	
	MIN. SQ IN/FT, TOP FACE, IN EACH DIRECTION	
	PRECAST BASE	CAST-IN-PLACE BASE
20' MAX	0.85	0.74
30' MAX	1.02	0.89
40' MAX	1.20	1.05

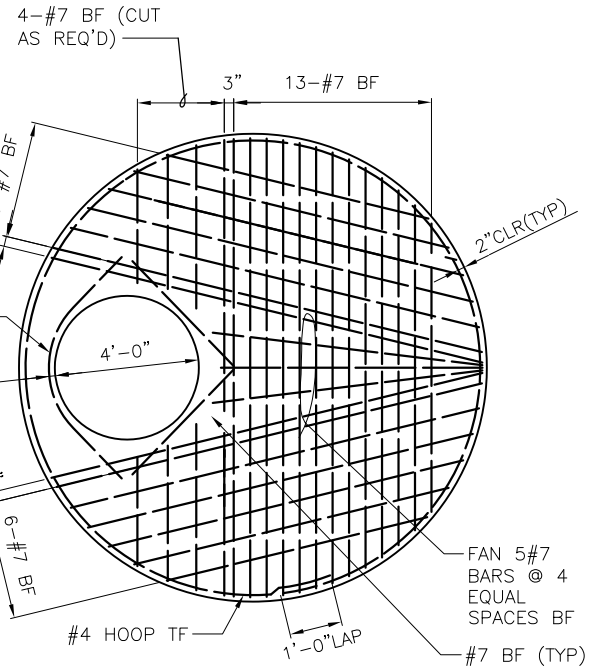

TOP SLAB REINFORCEMENT

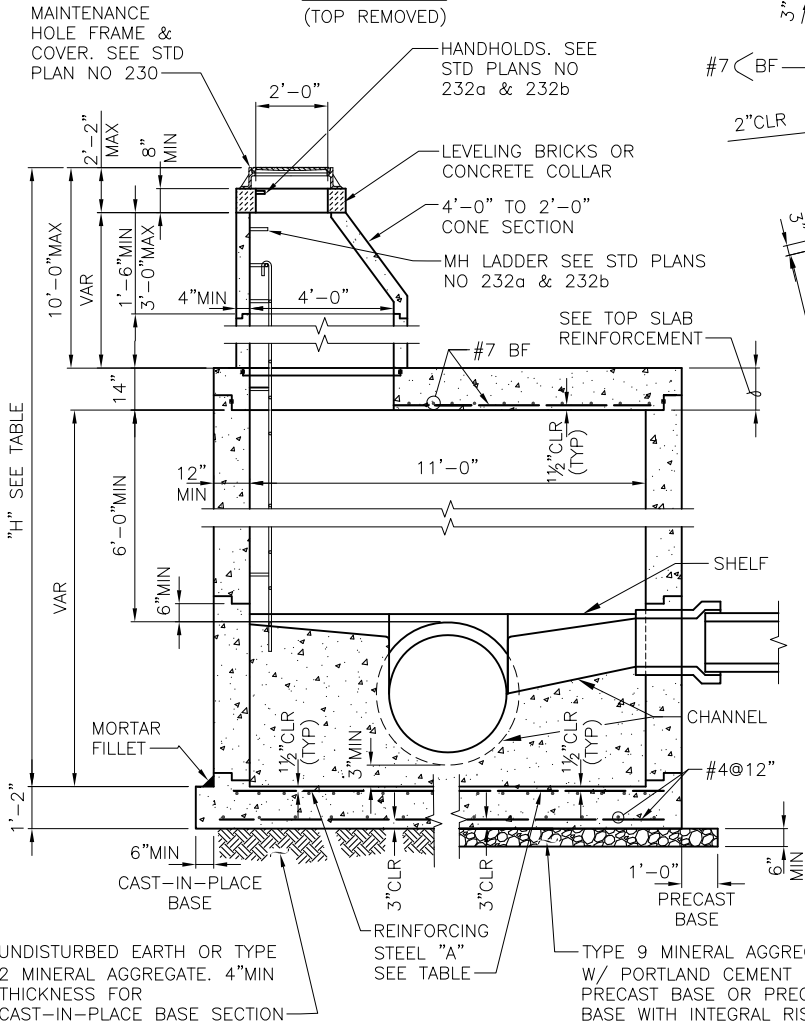

SECTION A-A

NOTES:

1. MATERIAL; CONCRETE—CLASS 4000 REINFORCING STEEL—ASTM A615 GRADE 60 MIN CHANNEL AND SHELF MATERIAL; CONCRETE CLASS 3000.
2. PRECAST MAINTENANCE HOLE COMPONENTS MUST CONFORM TO ASTM C 478. JOINTS BETWEEN PRECAST COMPONENTS MUST BE RUBBER GASKETED CONFORMING TO ASTM C 443.
3. MINIMUM REQUIRED SOIL BEARING = 3,000 LBS/SQ FT
4. MAX HOLE SIZE MUST BE OD OF PIPE PLUS 12". MIN HOLE SIZE MUST BE OD OF PIPE PLUS 3". MIN DISTANCE BETWEEN HOLES IS 12".


REF STD SPEC SEC 7-05



City of Seattle


NOT TO SCALE

TYPE 211a MAINTENANCE HOLE

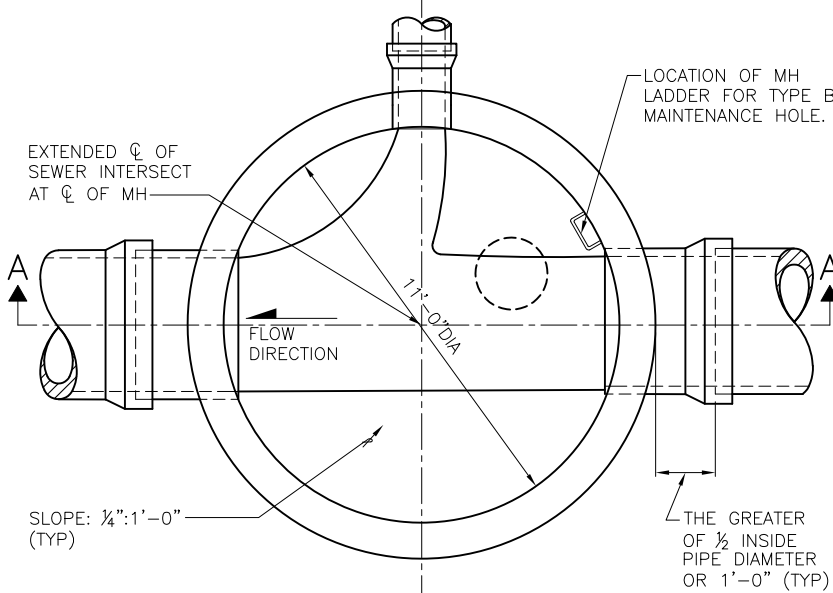


"H"	REINFORCING STEEL "A"	
	MIN. SQ IN/FT, TOP FACE, IN EACH DIRECTION	
	PRECAST BASE	CAST-IN-PLACE BASE
20' MAX	0.62	0.54
30' MAX	0.79	0.69
40' MAX	0.97	0.85

PLAN VIEW
(TOP REMOVED)

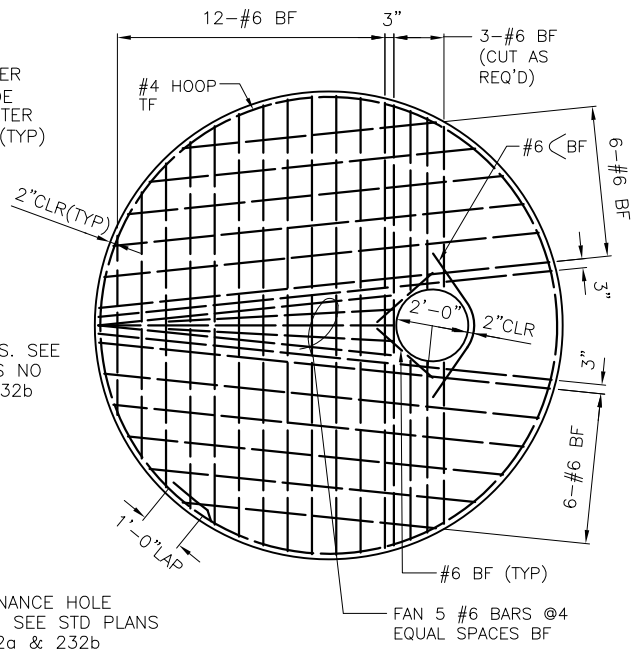

TOP SLAB
REINFORCEMENT

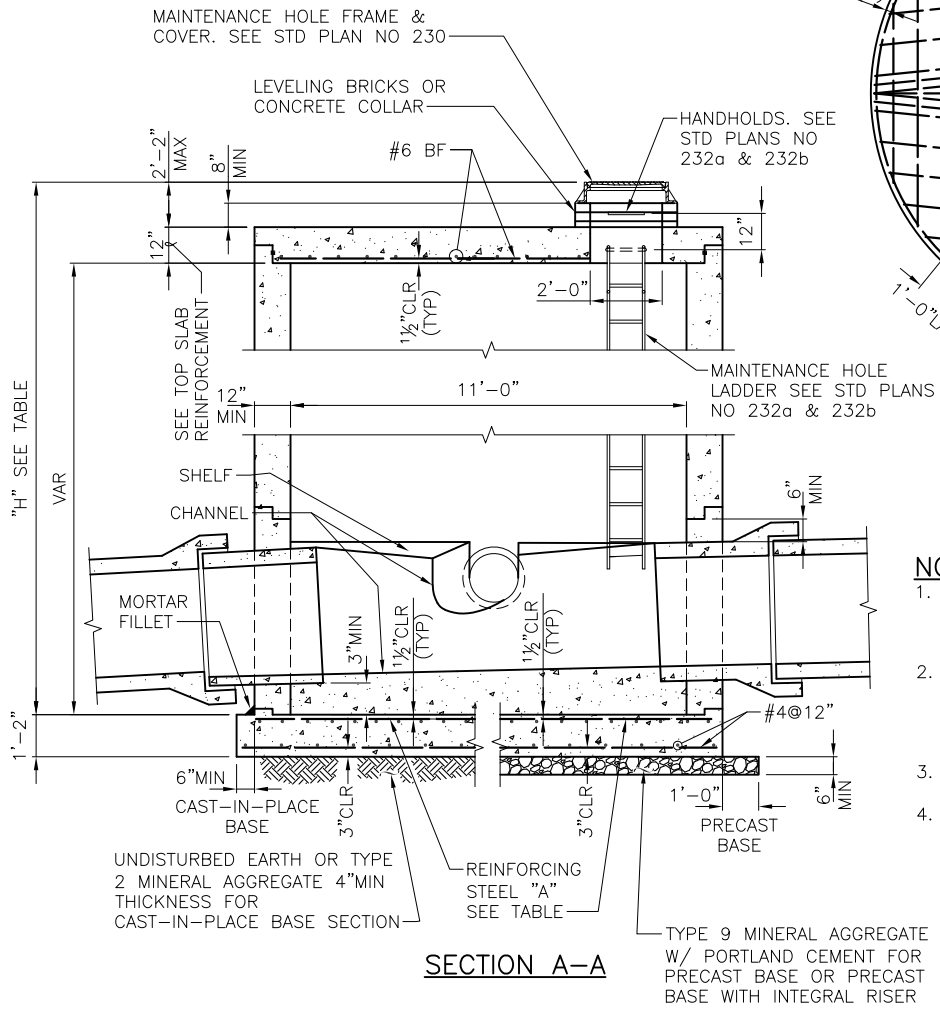

SECTION A-A

- NOTES:**
1. MATERIAL; CONCRETE—CLASS 4000
REINFORCING STEEL—ASTM A615 GRADE 60 MIN CHANNEL AND SHELF MATERIAL; CONCRETE CLASS 3000.
 2. PRECAST MAINTENANCE HOLE COMPONENTS MUST CONFORM TO ASTM C 478. JOINTS BETWEEN PRECAST COMPONENTS MUST BE RUBBER GASKETED CONFORMING TO ASTM C 443.
 3. MINIMUM REQUIRED SOIL BEARING = 3,000 LBS/SQ FT
 4. MAX HOLE SIZE MUST BE OD OF PIPE PLUS 12". MIN HOLE SIZE MUST BE OD OF PIPE PLUS 3". MIN DISTANCE BETWEEN HOLES IS 12".

REF STD SPEC SEC 7-05






City of Seattle

NOT TO SCALE

TYPE 211b MAINTENANCE HOLE

"H"	REINFORCING STEEL "A"	
	MIN. SQ IN/FT, TOP FACE, IN EACH DIRECTION	
	PRECAST BASE	CAST-IN-PLACE BASE
20' MAX	1.01	0.89
30' MAX	1.28	1.13
40' MAX	1.56	1.37

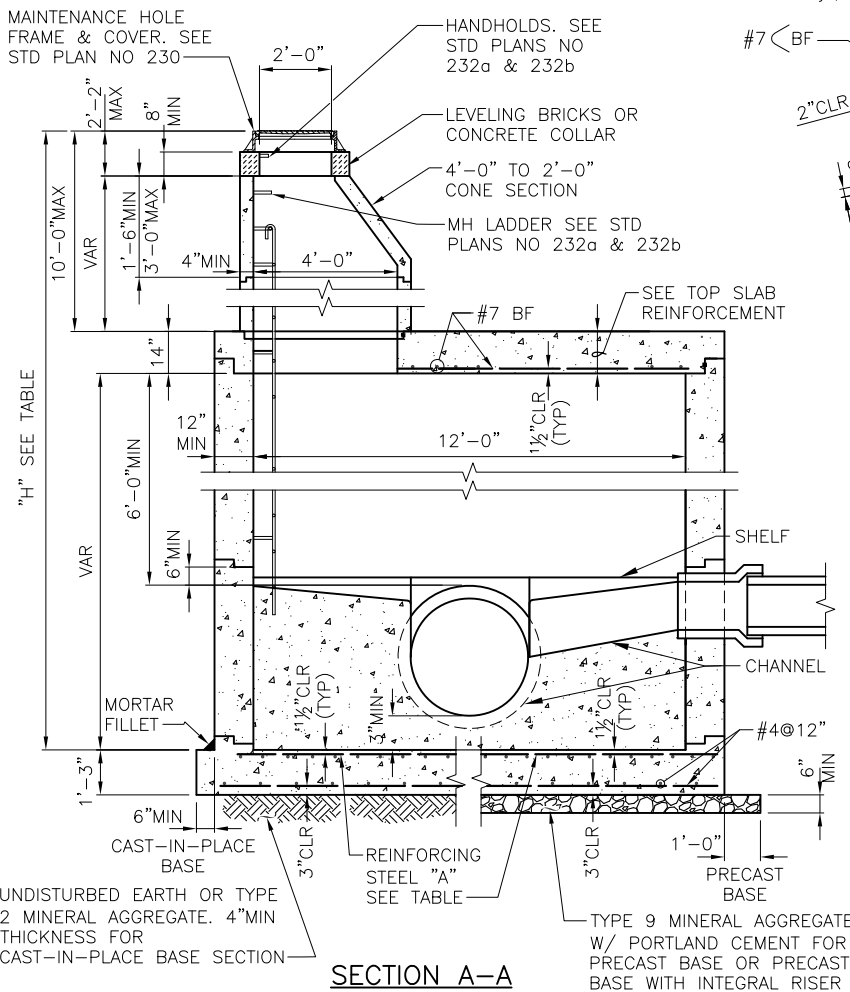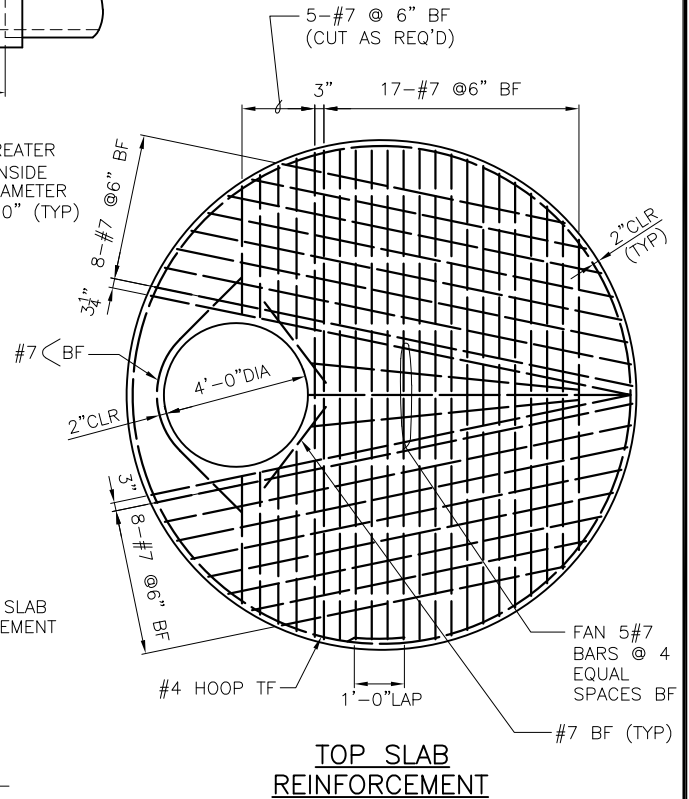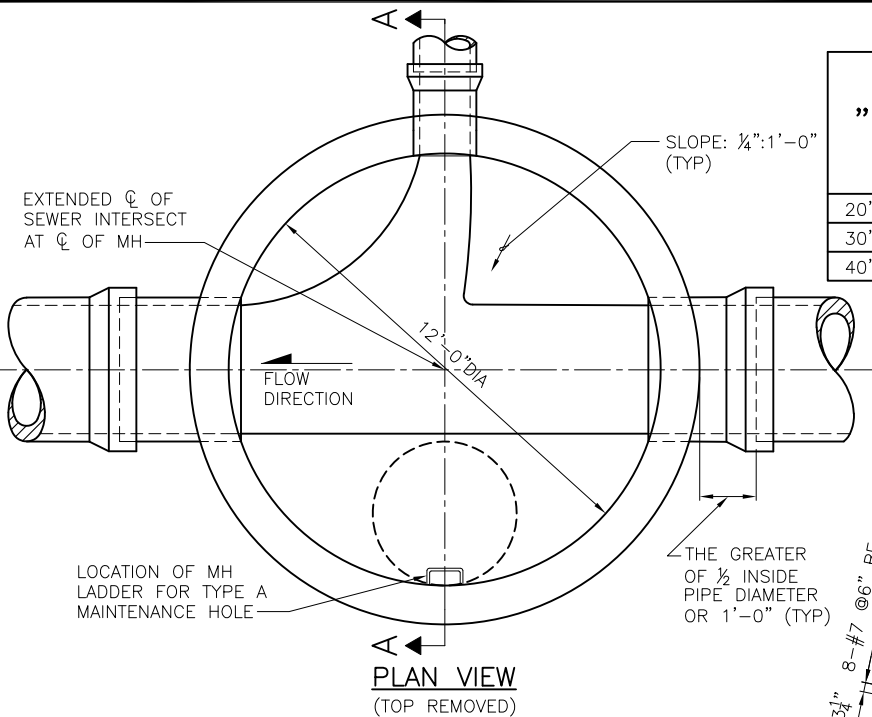

- NOTES:**
1. MATERIAL; CONCRETE-CLASS 4000
REINFORCING STEEL-ASTM A615 GRADE 60 MIN CHANNEL AND SHELF MATERIAL; CONCRETE CLASS 3000.
 2. PRECAST MAINTENANCE HOLE COMPONENTS MUST CONFORM TO ASTM C 478. JOINTS BETWEEN PRECAST COMPONENTS MUST BE RUBBER GASKETED CONFORMING TO ASTM C 443.
 3. MINIMUM REQUIRED SOIL BEARING = 3,000 LBS/SQ FT
 4. MAX HOLE SIZE MUST BE OD OF PIPE PLUS 13". MIN HOLE SIZE MUST BE OD OF PIPE PLUS 3". MIN DISTANCE BETWEEN HOLES IS 12".


REF STD SPEC SEC 7-05



City of Seattle


NOT TO SCALE

TYPE 212a MAINTENANCE HOLE

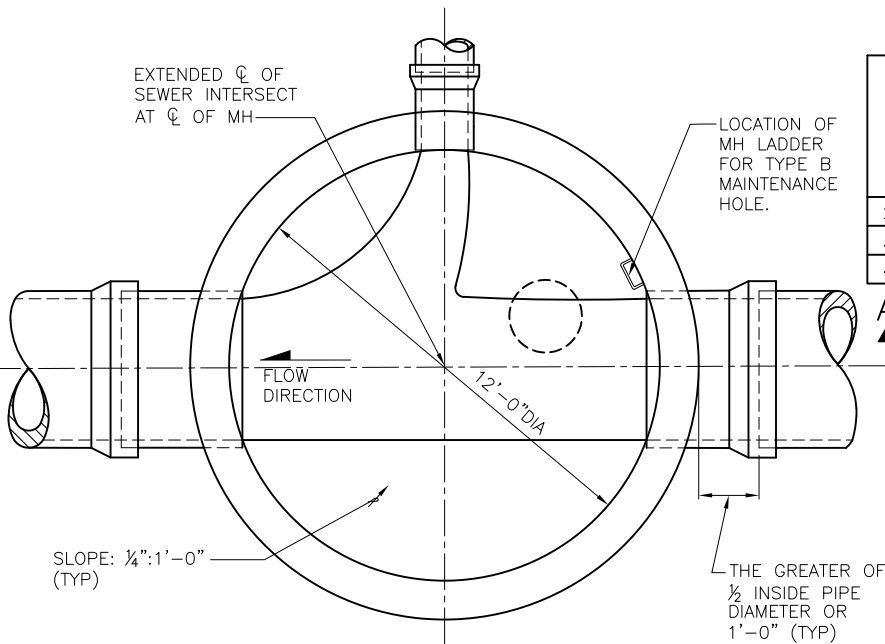


PLAN VIEW
(TOP REMOVED)

"H"	REINFORCING STEEL "A"	
	MIN. SQ IN/FT, TOP FACE, IN EACH DIRECTION	
	PRECAST BASE	CAST-IN-PLACE BASE
20' MAX	0.81	0.72
30' MAX	1.09	0.96
40' MAX	1.36	1.20

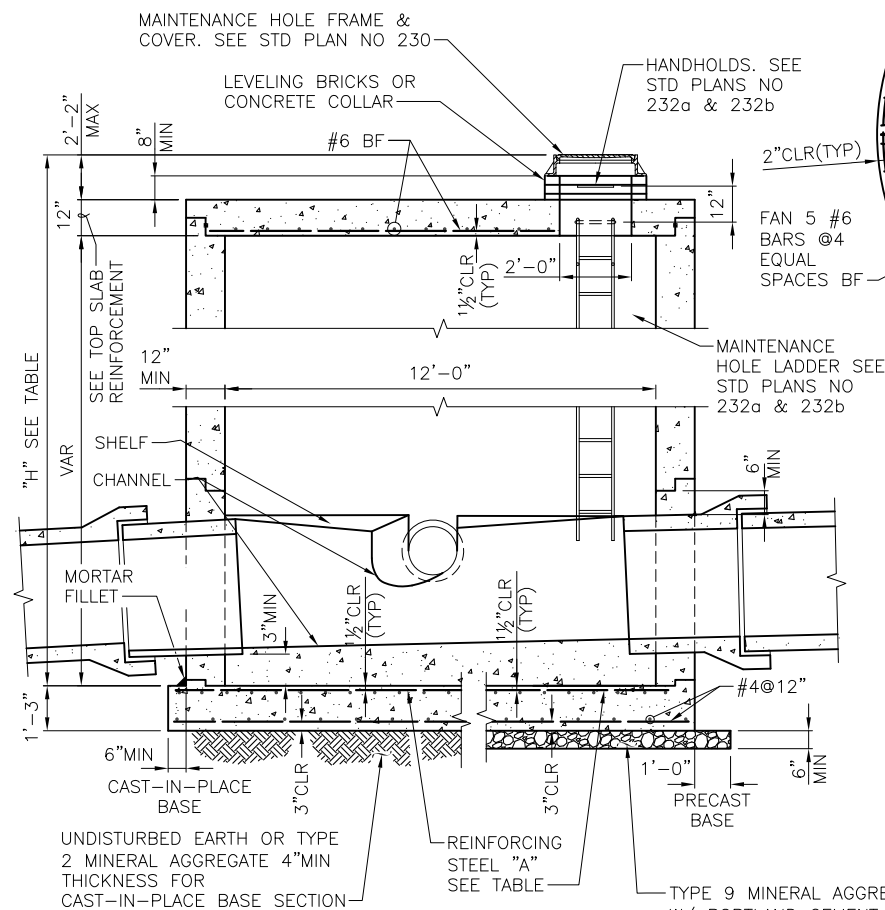

SECTION A-A

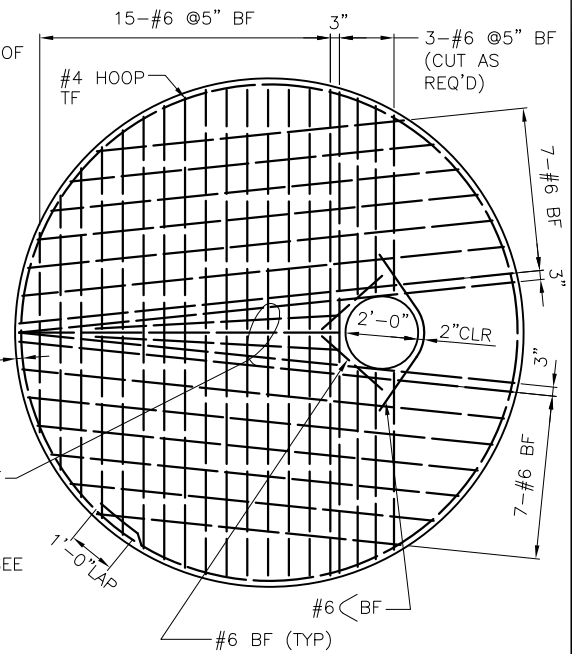

TOP SLAB
REINFORCEMENT

NOTES:

1. MATERIAL; CONCRETE—CLASS 4000
REINFORCING STEEL—ASTM A615 GRADE 60 MIN
CHANNEL AND SHELF MATERIAL; CONCRETE
CLASS 3000.
2. PRECAST MAINTENANCE HOLE COMPONENTS
MUST CONFORM TO ASTM C 478. JOINTS
BETWEEN PRECAST COMPONENTS MUST BE
RUBBER GASKETED CONFORMING TO ASTM C
443.
3. MINIMUM REQUIRED SOIL BEARING = 3,000
LBS/SQ FT
4. MAX HOLE SIZE MUST BE OD OF PIPE PLUS
13". MIN HOLE SIZE MUST BE OD OF PIPE
PLUS 3". MIN DISTANCE BETWEEN HOLES IS 12".


REF STD SPEC SEC 7-05




City of Seattle

NOT TO SCALE

TYPE 212b MAINTENANCE HOLE

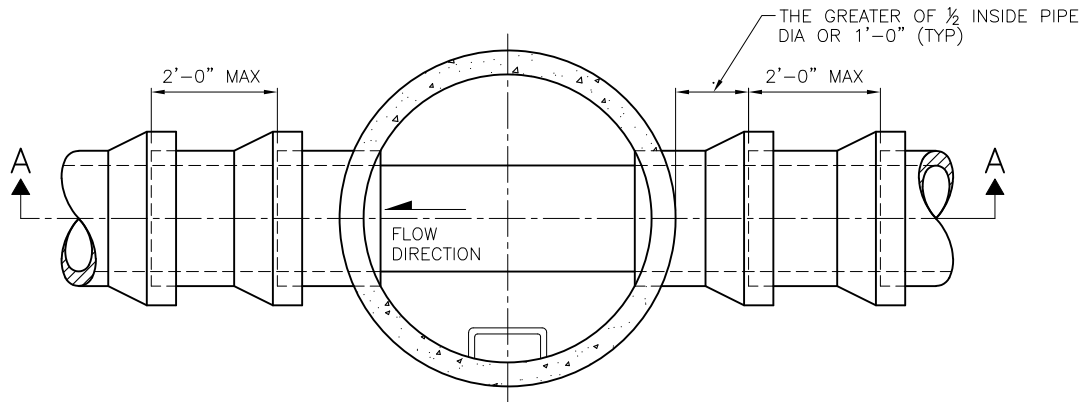

PLAN VIEW
(TOP REMOVED)

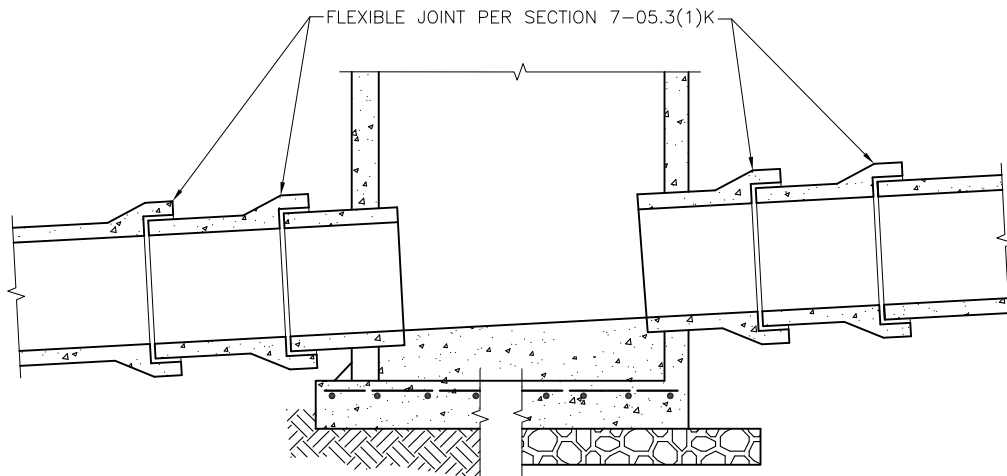

SECTION A-A

NOTES:

1. SEE STANDARD PLANS NO 204a THROUGH 212b FOR MAINTENANCE HOLE REQUIREMENTS.



REF STD SPEC SEC 7-05



City of Seattle

NOT TO SCALE

**FLEXIBLE JOINT FOR VCP
CONNECTION TO
MAINTENANCE HOLES**

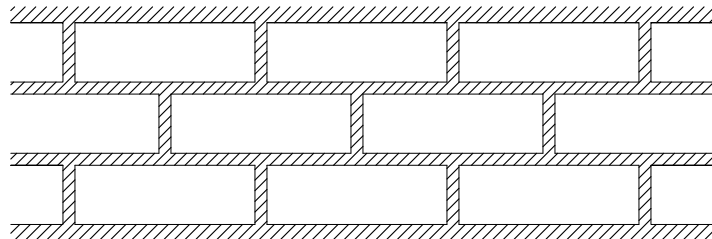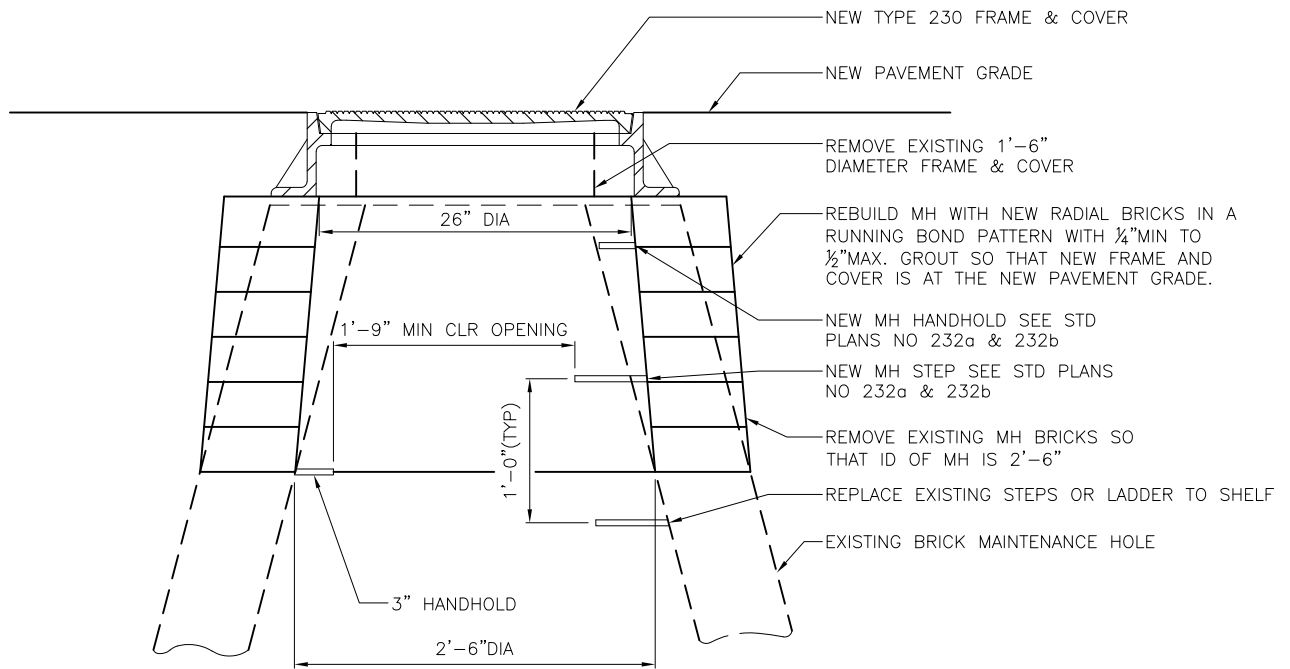

RUNNING BOND PATTERN
GROUT BETWEEN ALL BRICKS




REF STD SPEC SEC 7-05



City of Seattle

NOT TO SCALE

**REBUILD EXISTING
BRICK MAINTENANCE HOLE**

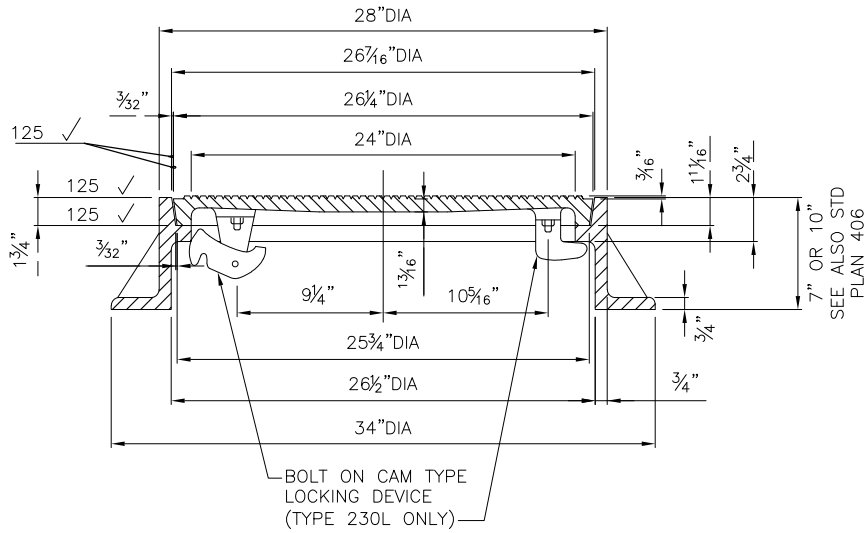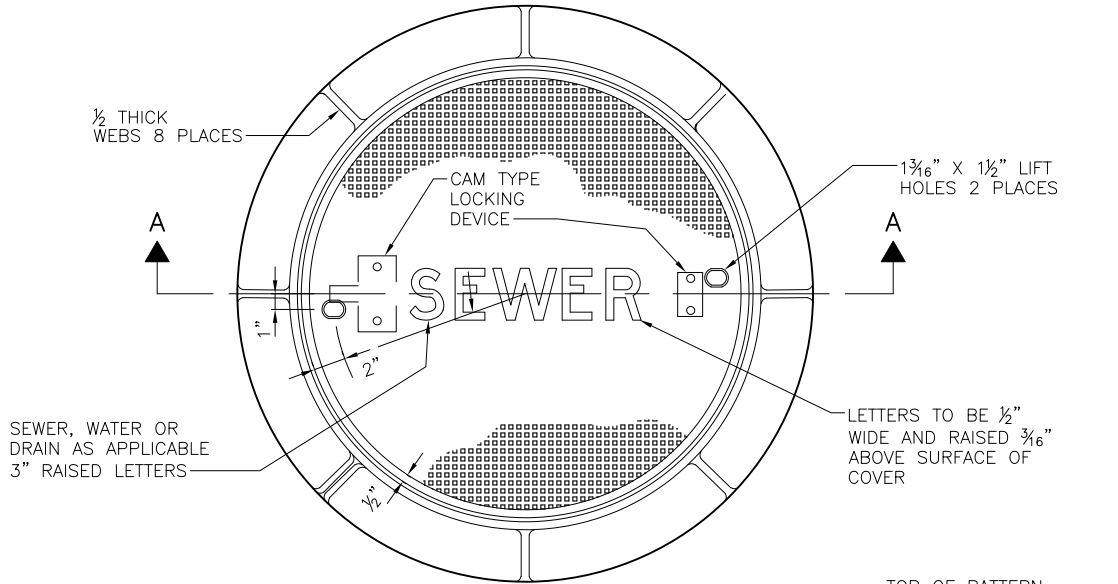

SECTION A-A

NOTES:

1. DESIGNATE LOCKING COVER AS TYPE 230L FOR USE IN NON-VEHICULAR TRAFFIC AREAS.
2. COVER THICKNESS IS MEASURED FROM THE BOTTOM OF THE PATTERN.
3. FRAMES MUST BE MANUFACTURED FROM CAST IRON OR DUCTILE IRON.
4. COVERS MUST BE MANUFACTURED FROM DUCTILE IRON.


REF STD SPEC SEC 7-05, 9-12




City of Seattle

NOT TO SCALE



**2'-0" DIAMETER
FRAME & COVER**

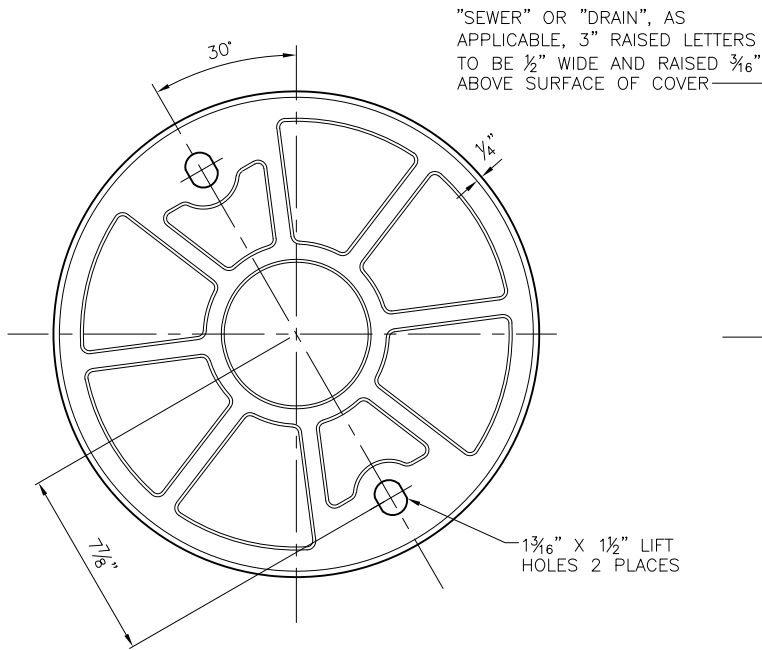

BOTTOM VIEW

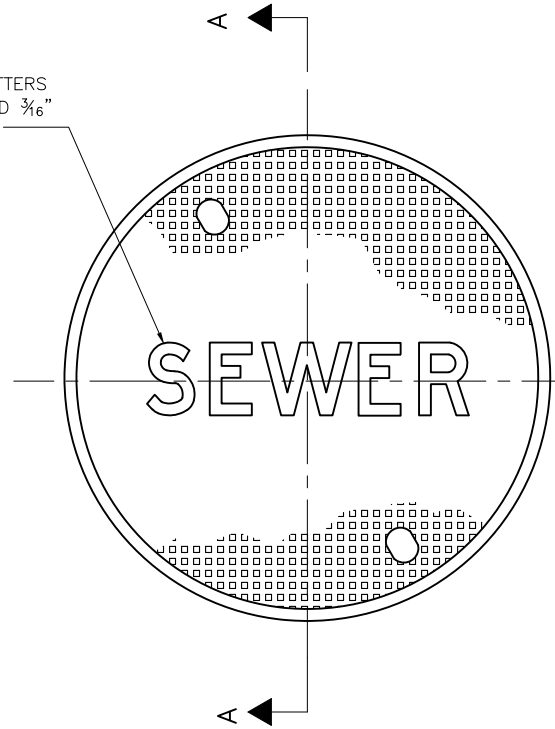

TOP VIEW

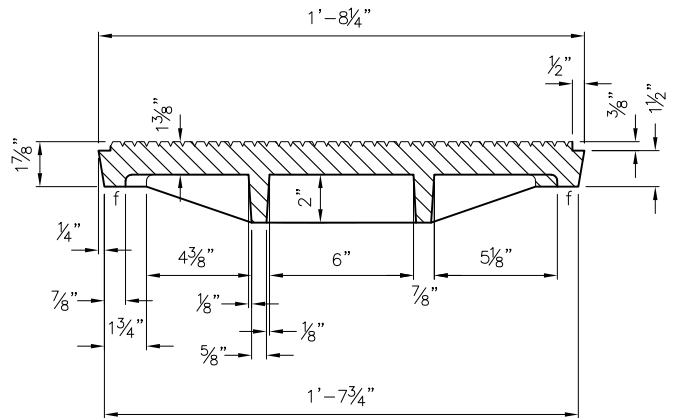

SECTION A-A

f=MACHINED FINISH



REF STD SPEC SEC 7-05, 7-20



City of Seattle

NOT TO SCALE

SEWER
REPLACEMENT COVER

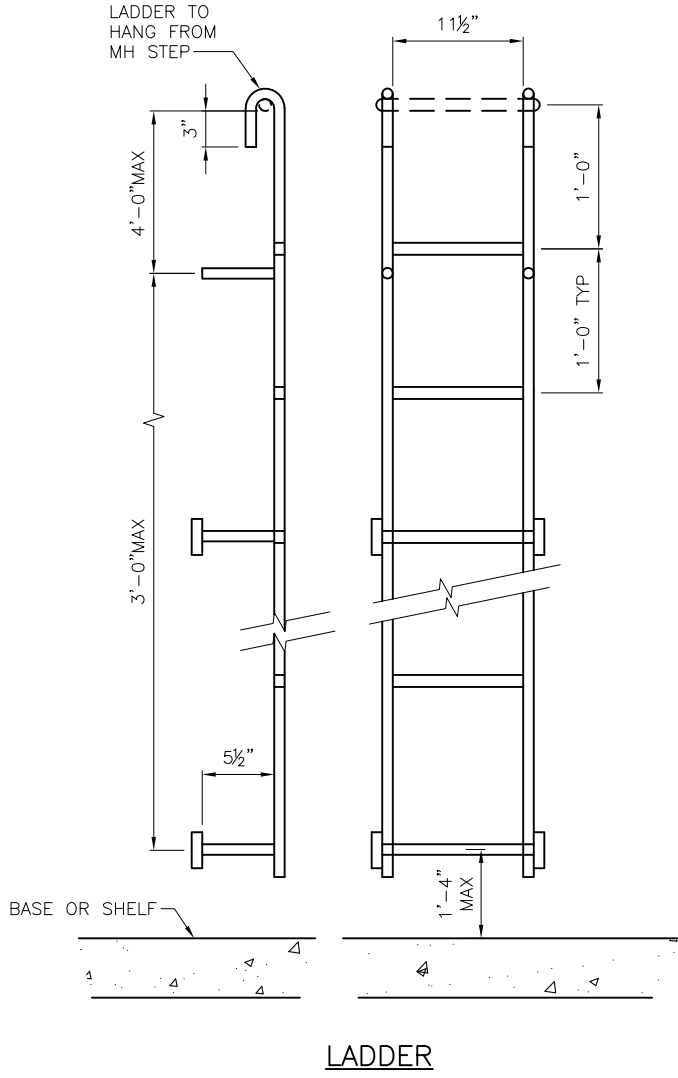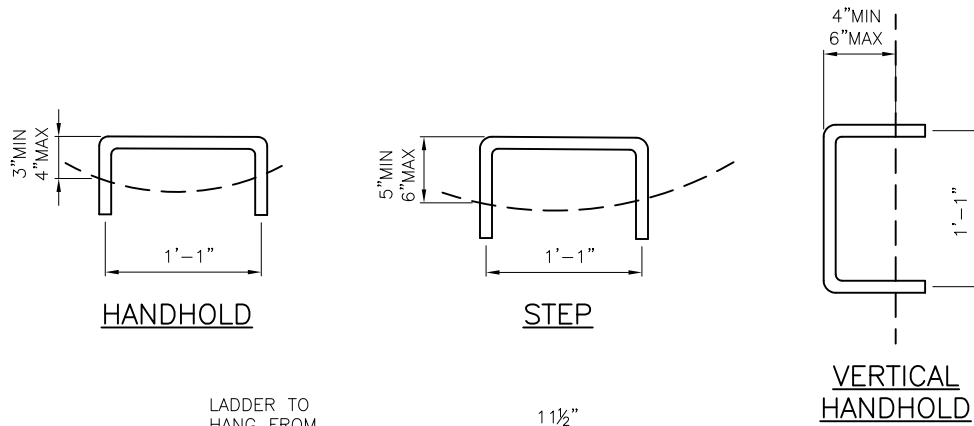

NOTES:

1. MATERIAL – STEEL REINFORCED POLYPROPYLENE
2. DIMENSIONS FOR THE MH LADDER AND STEP ARE MINIMUM REQUIREMENTS ONLY.
3. WHEN THE DISTANCE FROM THE LAST (HIGHEST) STEP OR HANDHOLD TO THE TOP OF THE MH FRAME EXCEEDS 1'-6", A HANDHOLD MUST BE INSTALLED MID-WAY IN THE LEVELING BRICK OR COLLAR.
4. EITHER STEPS, LADDERS OR A COMBINATION OF THE TWO CAN BE USED. IF BOTH STEPS AND LADDERS ARE USED IN ANY MH, THEY MUST BE FROM THE SAME MANUFACTURER.
5. A VERTICAL HANDHOLD MUST BE INSTALLED 4'-0" ABOVE THE SHELF WHEN INDICATED IN MH PLAN VIEW.


REF STD SPEC SEC 7-05




City of Seattle

NOT TO SCALE


MAINTENANCE HOLE LADDER,
STEP AND HANDHOLD

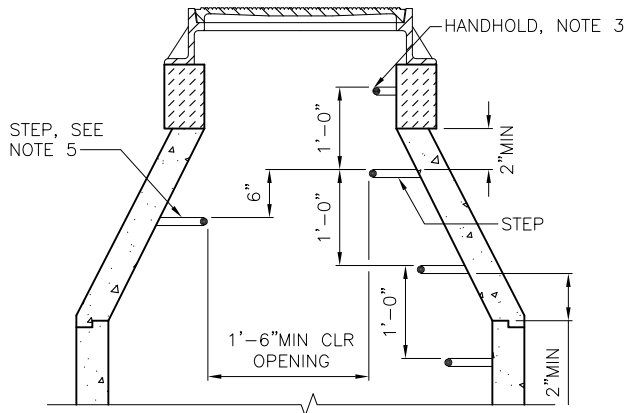

24" HIGH CONCENTRIC CONE

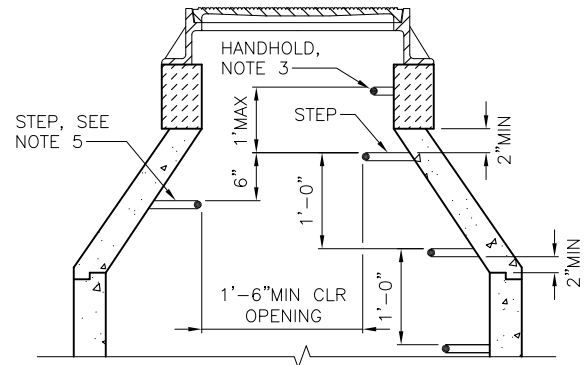

18" HIGH CONCENTRIC CONE

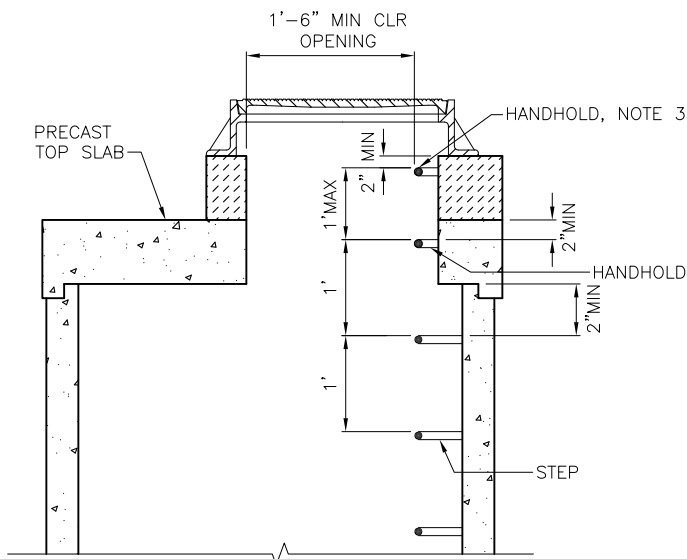

MH WITH PRECAST TOP SLAB

NOTES:

1. MATERIAL - STEEL REINFORCED POLYPROPYLENE.
2. DIMENSIONS FOR THE MH LADDER AND STEP ARE MINIMUM REQUIREMENTS ONLY.
3. WHEN THE DISTANCE FROM THE LAST (HIGHEST) STEP OR HANDHOLD TO THE TOP OF THE MH FRAME EXCEEDS 1'-6", A HANDHOLD MUST BE INSTALLED MID-WAY IN THE LEVELING BRICK OR COLLAR.
4. EITHER STEPS, LADDERS OR A COMBINATION OF THE TWO CAN BE USED. IF BOTH STEPS AND LADDERS ARE USED IN ANY MH, THEY MUST BE FROM THE SAME MANUFACTURER.
5. STEP ON OPPOSITE SIDE OF MH MUST BE PLACED MID WAY BETWEEN STEPS ON OPPOSING SIDE.


REF STD SPEC SEC 7-05



City of Seattle

NOT TO SCALE

**MAINTENANCE HOLE LADDER,
STEP AND HANDHOLD**

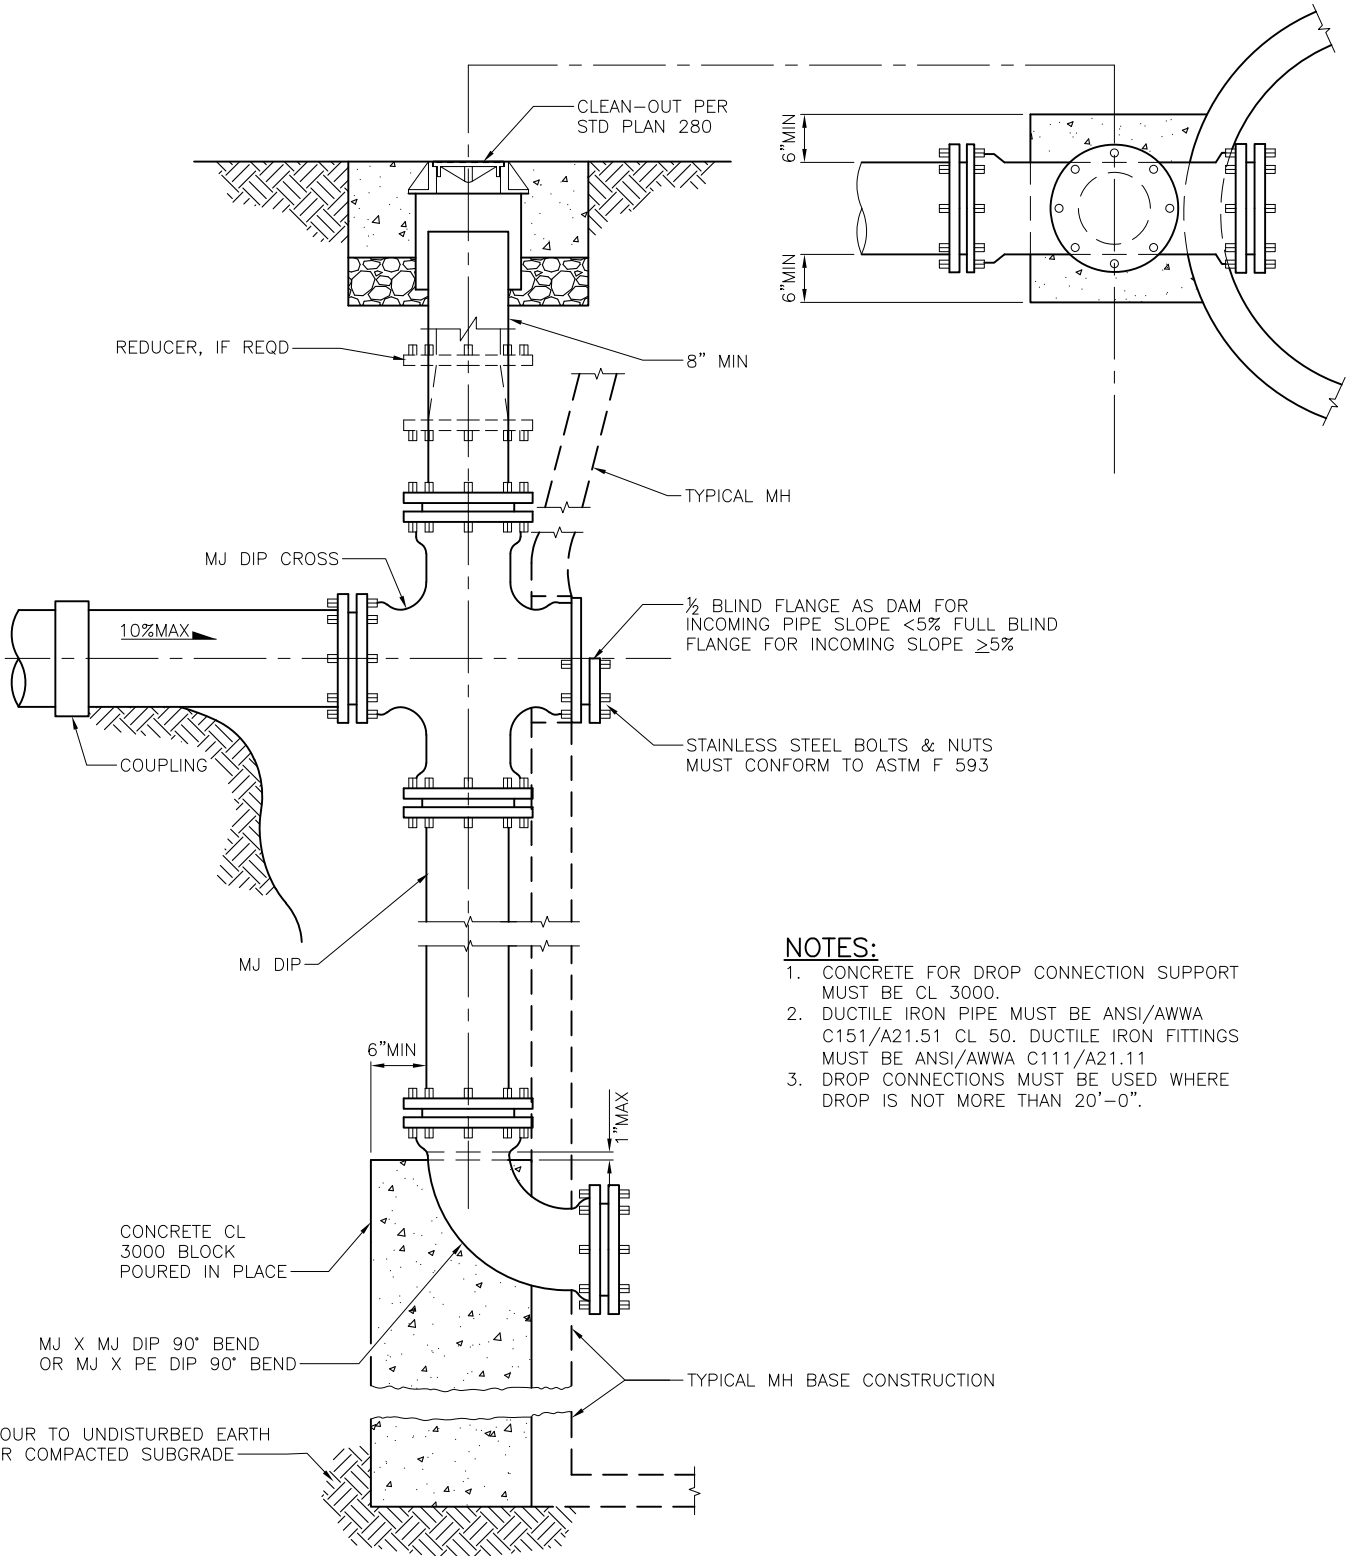

- NOTES:**
1. CONCRETE FOR DROP CONNECTION SUPPORT MUST BE CL 3000.
 2. DUCTILE IRON PIPE MUST BE ANSI/AWWA C151/A21.51 CL 50. DUCTILE IRON FITTINGS MUST BE ANSI/AWWA C111/A21.11
 3. DROP CONNECTIONS MUST BE USED WHERE DROP IS NOT MORE THAN 20'-0".

DUCTILE IRON OUTSIDE DROP CONNECTION


REF STD SPEC SEC 7-08



City of Seattle

NOT TO SCALE

OUTSIDE DROP CONNECTION

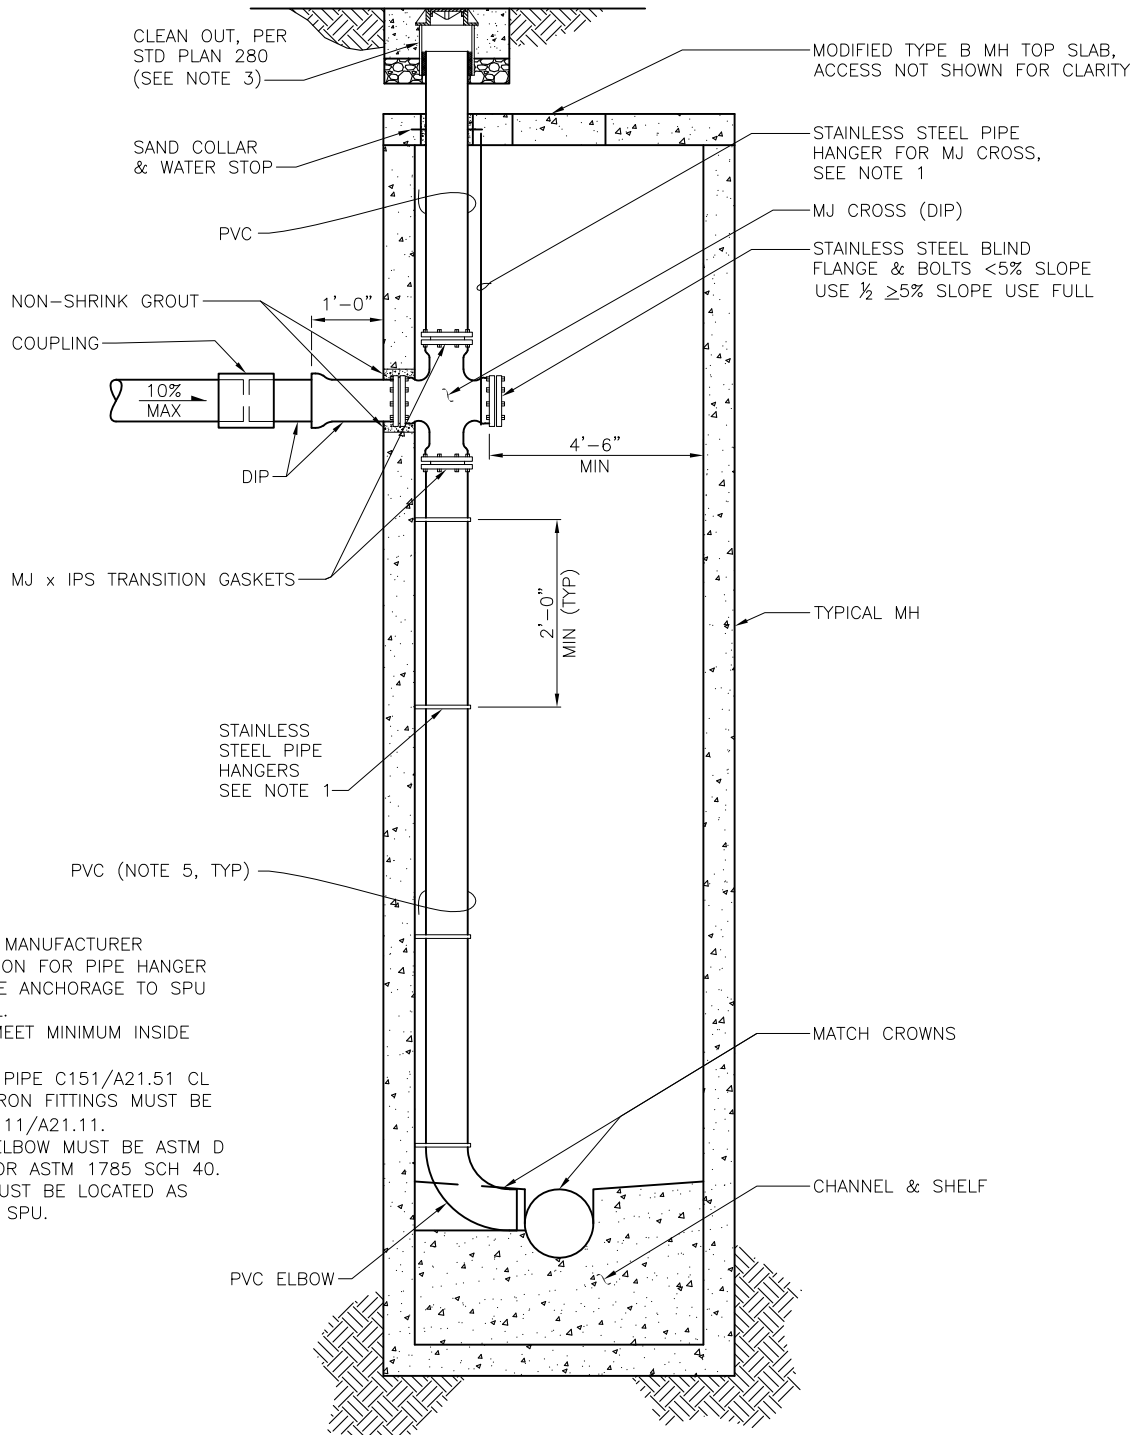

NOTES:

1. PROVIDE PIPE MANUFACTURER RECOMMENDATION FOR PIPE HANGER AND CONCRETE ANCHORAGE TO SPU FOR APPROVAL.
2. SIZE MH TO MEET MINIMUM INSIDE CLEARANCE.
3. DUCTILE IRON PIPE C151/A21.51 CL 50, DUCTILE IRON FITTINGS MUST BE ANSI/AWWA 6111/A21.11.
4. PVC PIPE & ELBOW MUST BE ASTM D 2241 CL200 OR ASTM 1785 SCH 40.
5. CLEAN-OUT MUST BE LOCATED AS APPROVED BY SPU.

INSIDE DROP
(18" DIAMETER PIPE MAXIMUM)


REF STD SPEC SEC 7-08



City of Seattle

NOT TO SCALE

INSIDE DROP CONNECTION

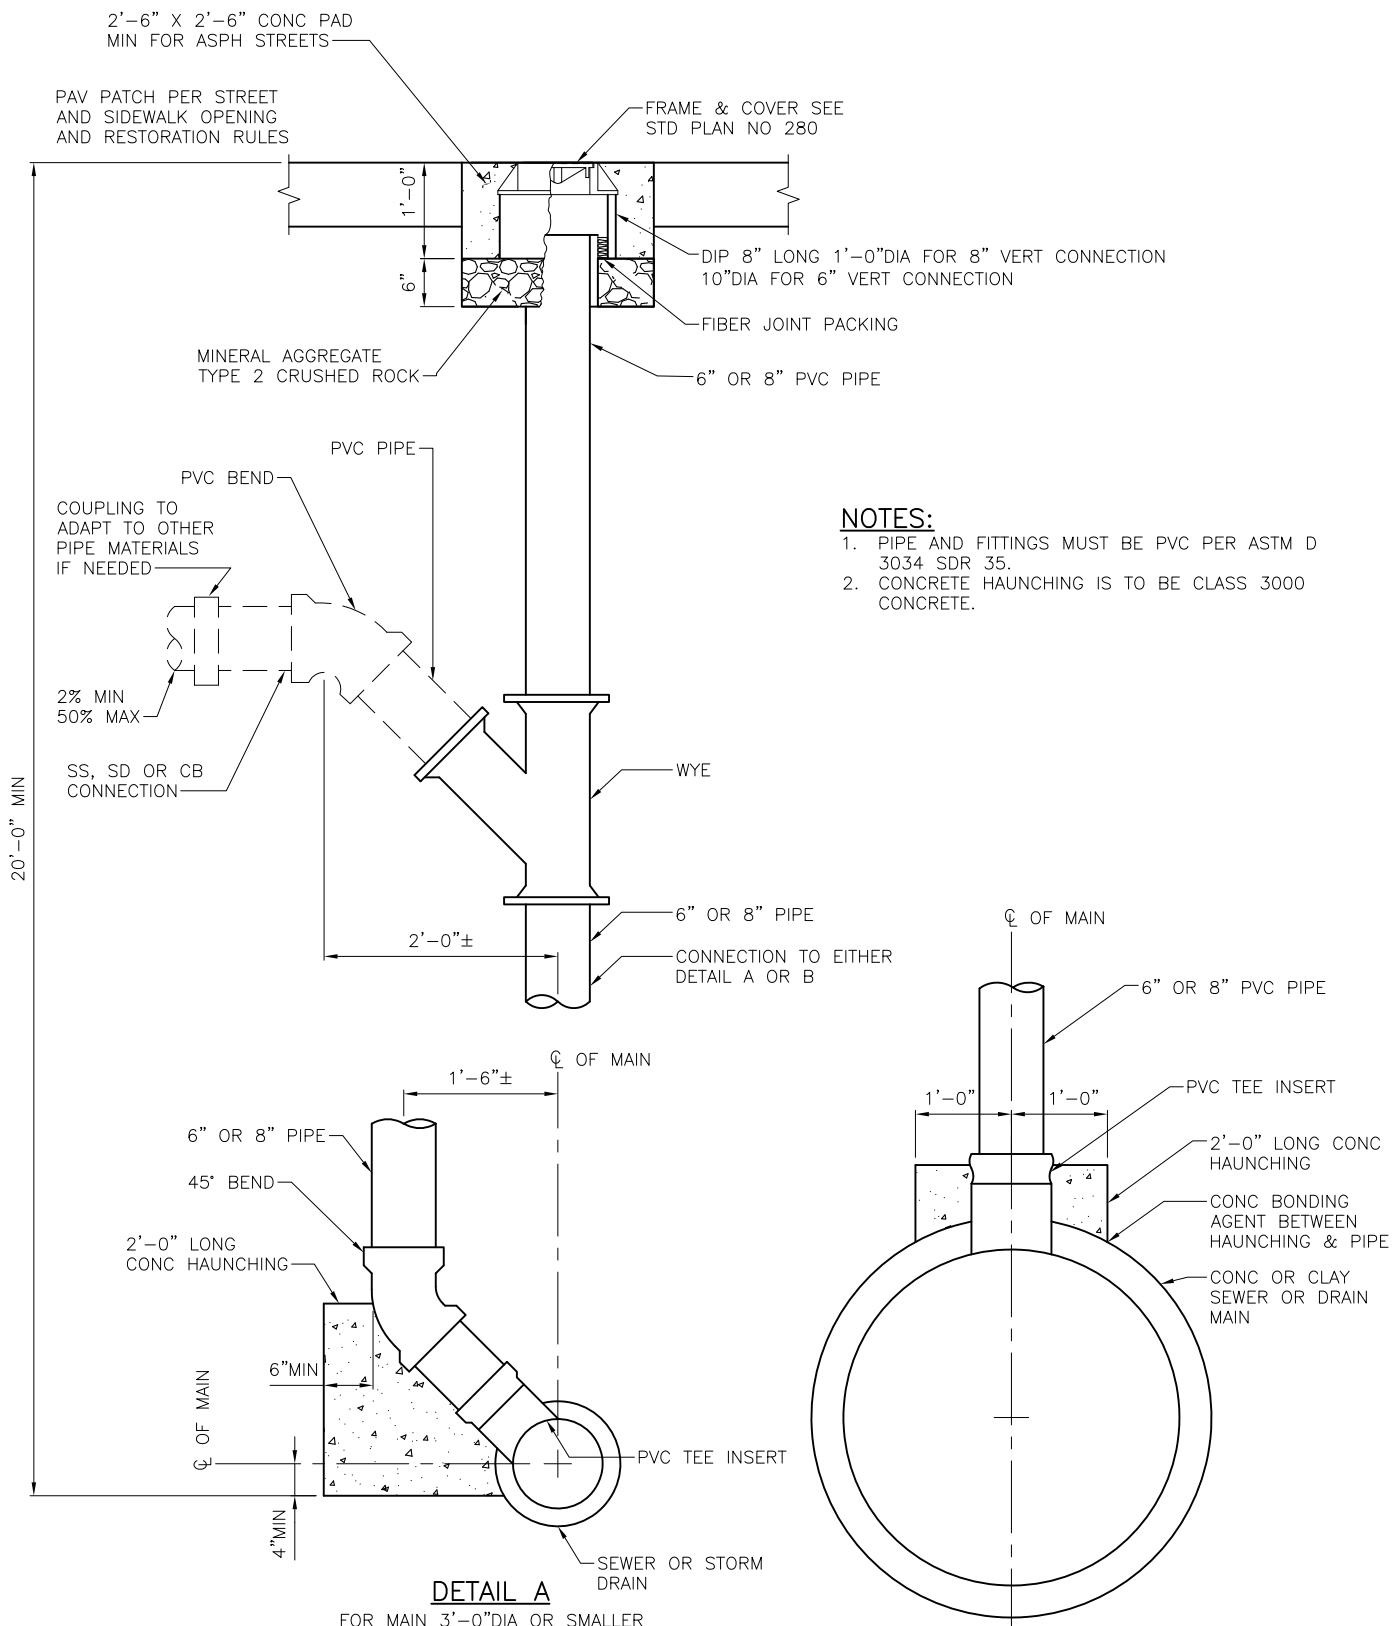

NOTES:

- 1. PIPE AND FITTINGS MUST BE PVC PER ASTM D 3034 SDR 35.
- 2. CONCRETE HAUNCHING IS TO BE CLASS 3000 CONCRETE.


REF STD SPEC SEC 7-08, 7-17



City of Seattle



NOT TO SCALE

**6" OR 8" VERTICAL CONNECTION
TO CONCRETE OR CLAY PIPE**

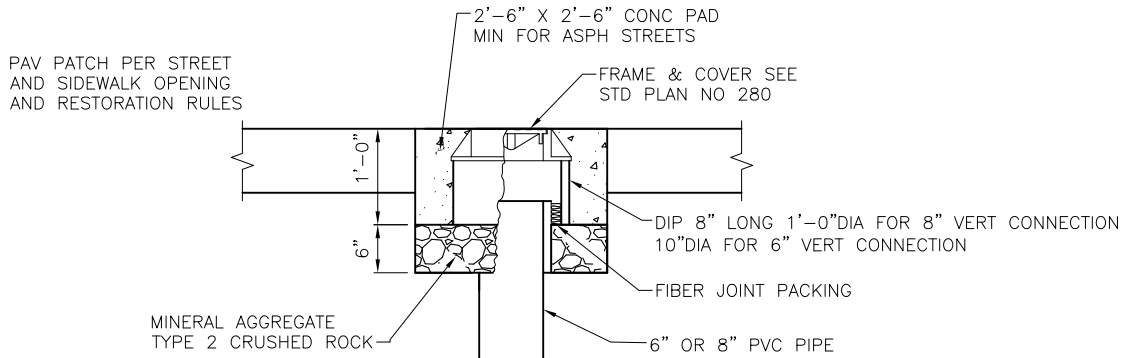


NOTES:

1. DI PIPE & FITTING MUST BE CEMENT LINED CL 50 (MIN). JOINTS MUST BE RUBBER GASKETED PUSH-ON OR MECHANICAL.
2. FABRICATED STEEL TAPPING SLEEVE MUST BE MANUFACTURED FOR USE WITH DI PIPE AND APPROVED BY SPU
3. FABRICATED STEEL TAPPING SLEEVE USE IS RESTRICTED WITHIN THE RIGHT OF WAY. SPU AND SDOT APPROVAL IS REQUIRED.

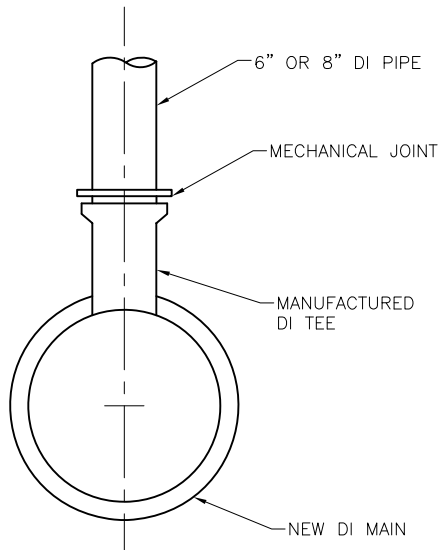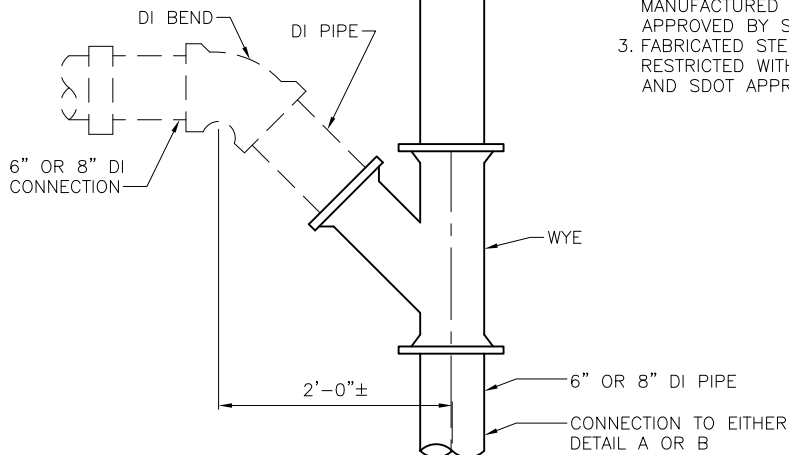

DETAIL A
FOR VERTICAL CONNECTIONS TO NEW DI MAIN

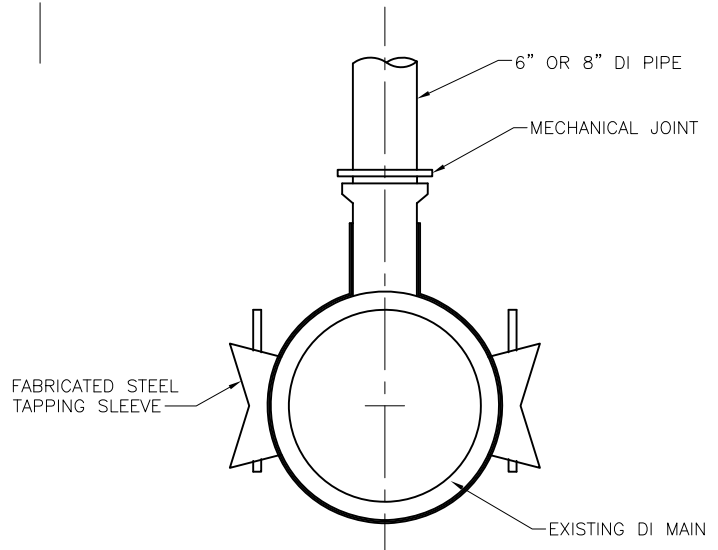

DETAIL B
FOR VERTICAL CONNECTIONS TO EXISTING DI MAIN


REF STD SPEC SEC 7-08, 7-17



City of Seattle

NOT TO SCALE


6" OR 8" VERTICAL CONNECTION TO DUCTILE IRON PIPE

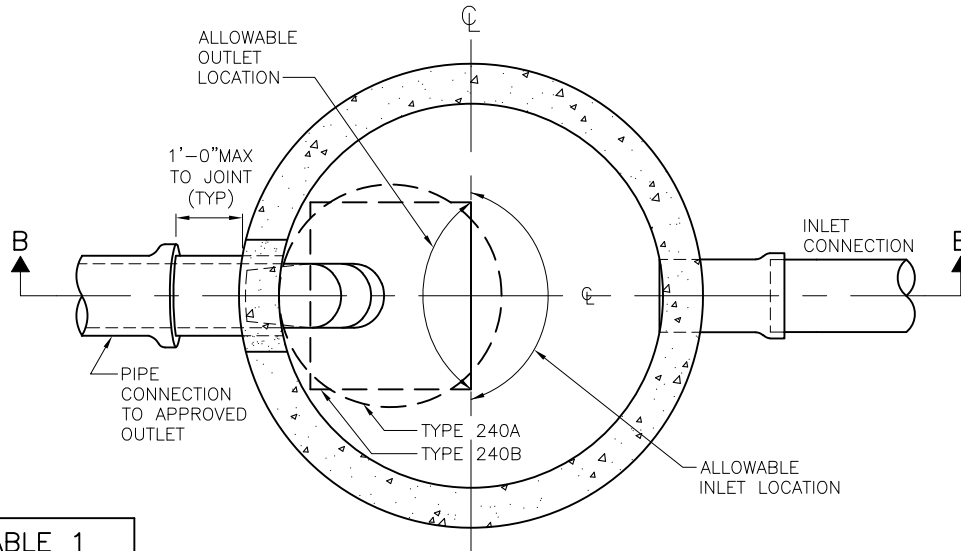

SECTION A-A

TABLE 1

6" ϕ	8" MIN 1'-4" MAX
8" ϕ	10" MIN 1'-4" MAX
12" ϕ	1'-3" MIN 2'-0" MAX

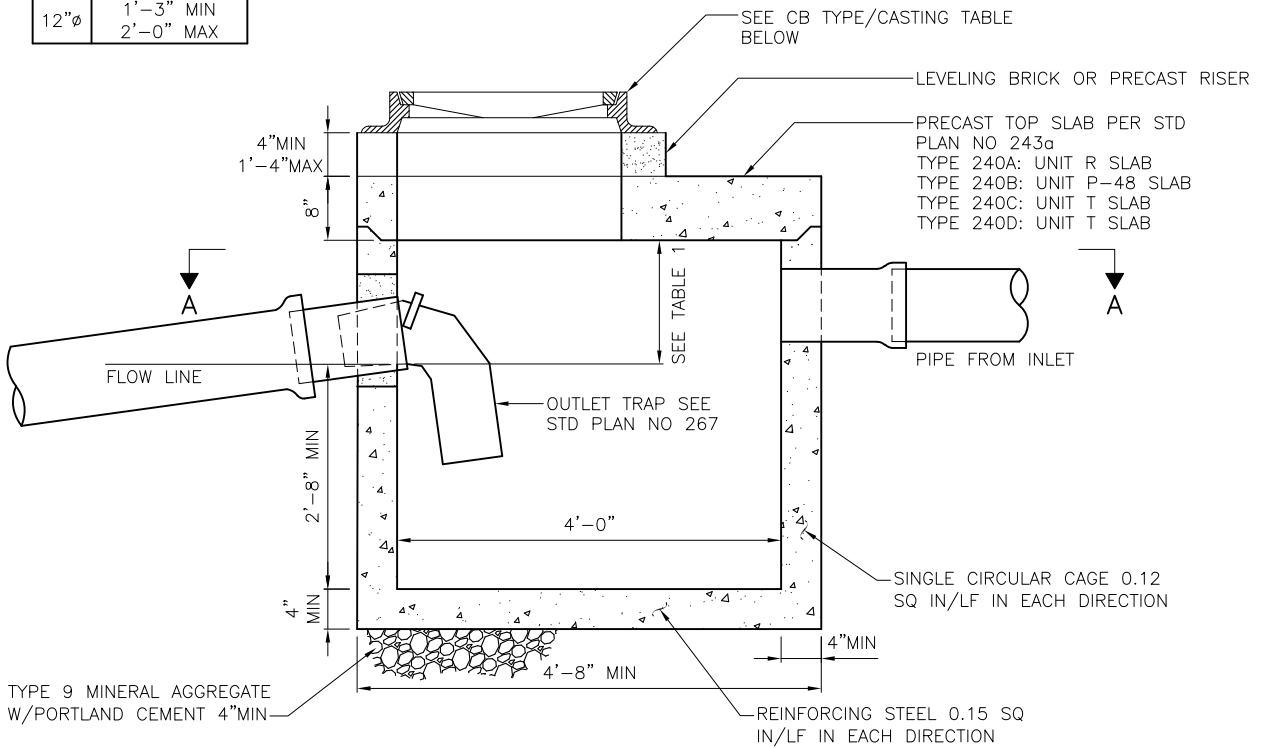

SECTION B-B

NOTES:

1. FRAME & GRATE OR FRAME & COVER MUST BE LOCATED OVER TRAP.
2. INVERT OF INLET PIPE MUST BE 2" MIN ABOVE INVERT OF OUTLET PIPE.
3. SEE STD PLAN 261 FOR ALLOWABLE OUTLET LOCATIONS.

CB TYPE	CASTING	
	FRAME	COVER
240A	PER STD PLAN 230	PER STD PLAN 230
240B	PER STD PLAN 264	PER STD PLAN 264
240C	PER STD PLAN 262	PER STD PLAN 265
240D	PER STD PLAN 263A	PER STD PLAN 265


REF STD SPEC SEC 7-05



City of Seattle

NOT TO SCALE


TYPE 240 CATCH BASIN

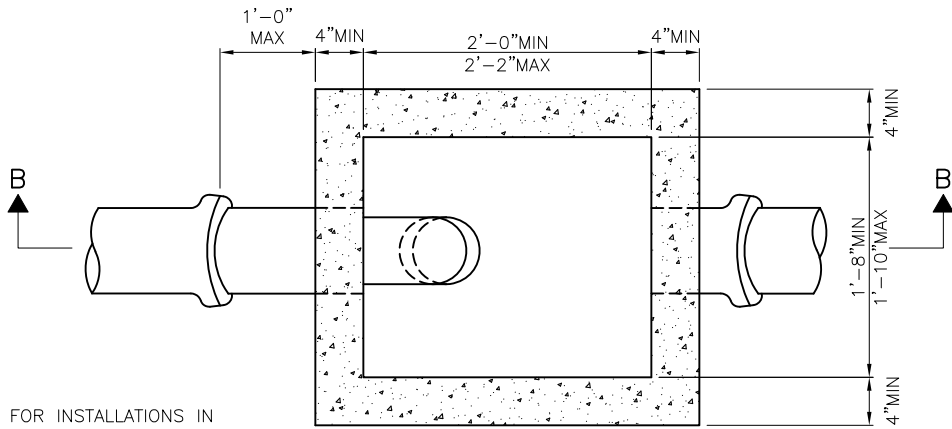

SECTION A-A

NOTES:

1. THIS CATCH BASIN IS FOR INSTALLATIONS IN ALLEYS AND UNPAVED AREAS IN THE RIGHT-OF-WAY. ANY OTHER USE IN THE R/W WILL REQUIRE THE APPROVAL OF SPU.
2. FOR CURB DISCHARGE INSTALLATION SEE STD PLAN NO 241b.
3. INSTALL PER STD PLAN NO 261.
4. MATERIAL: CONCRETE CLASS 4000 REINFORCING STEEL ASTM A615 GR60.
5. INLET INVERT EL. TO BE HIGHER THAN OUTLET INVERT EL.
6. USE OF LEVELING BRICKS MUST BE RUNNING BOND PATTERN WITH ¼ TO ½ GROUT IN BETWEEN BRICKS.

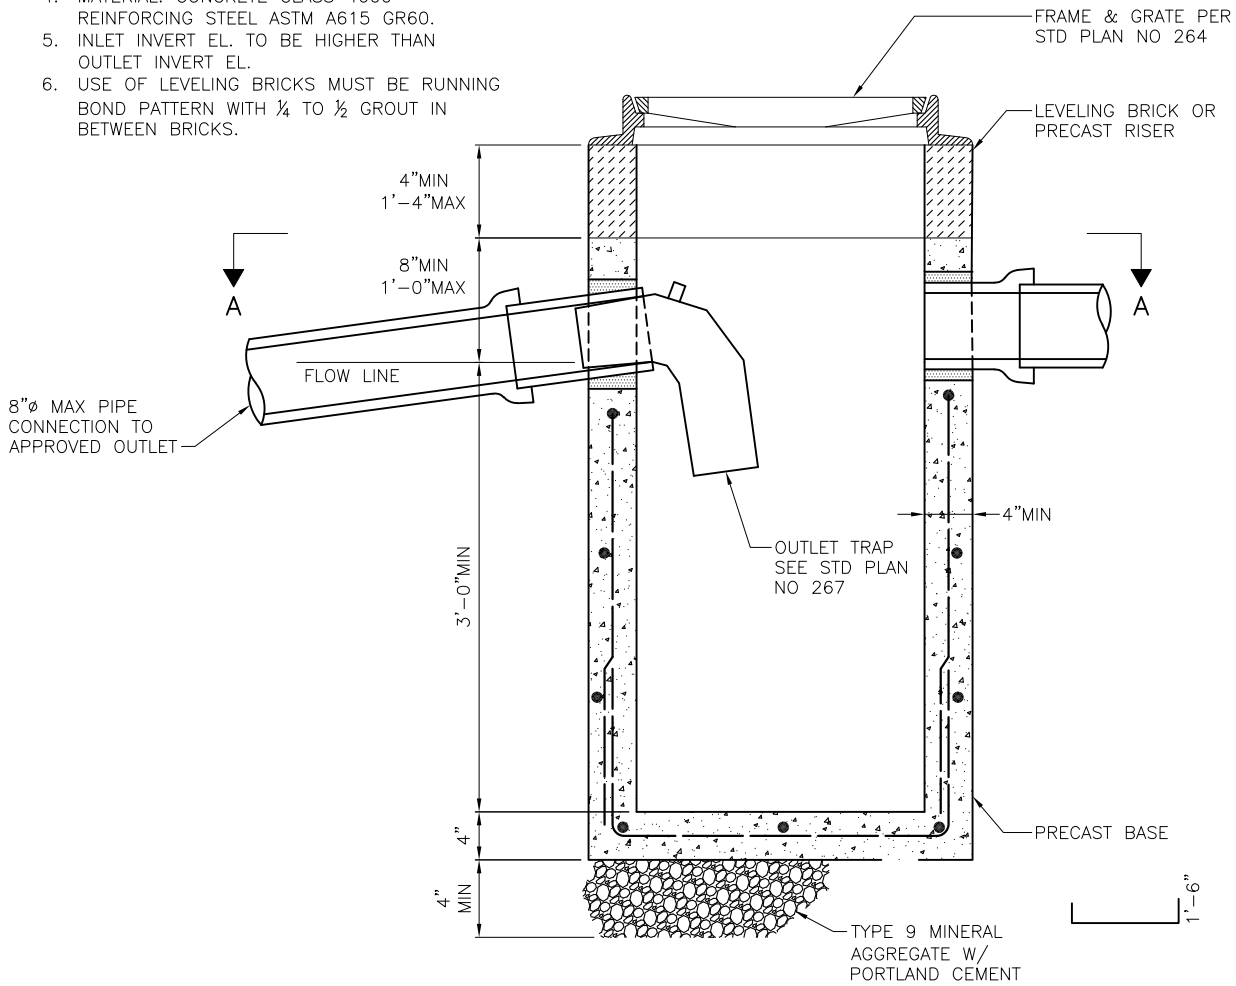

SECTION B-B


REF STD SPEC SEC 7-05




City of Seattle

NOT TO SCALE


TYPE 241 CATCH BASIN

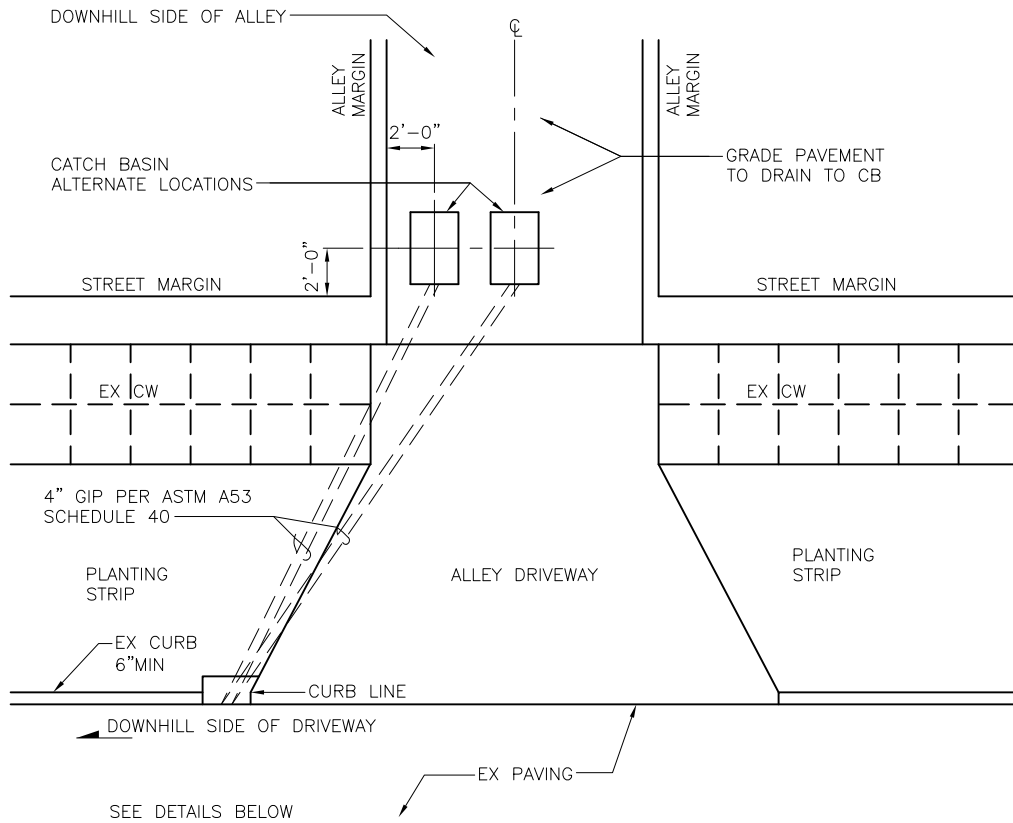


PLAN

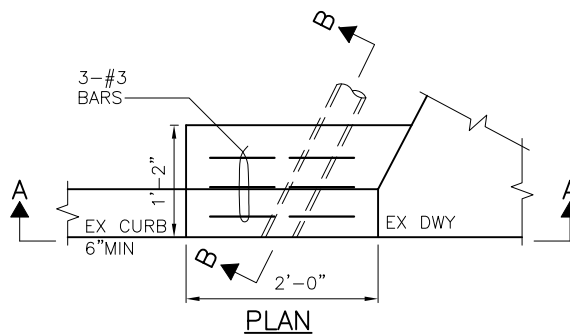

PLAN

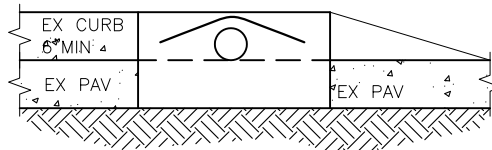

SECTION A-A

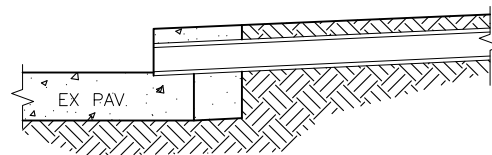

SECTION B-B


REF STD SPEC SEC 7-05, 7-08



City of Seattle

NOT TO SCALE

TYPE 241 CATCH BASIN INSTALLATIONS

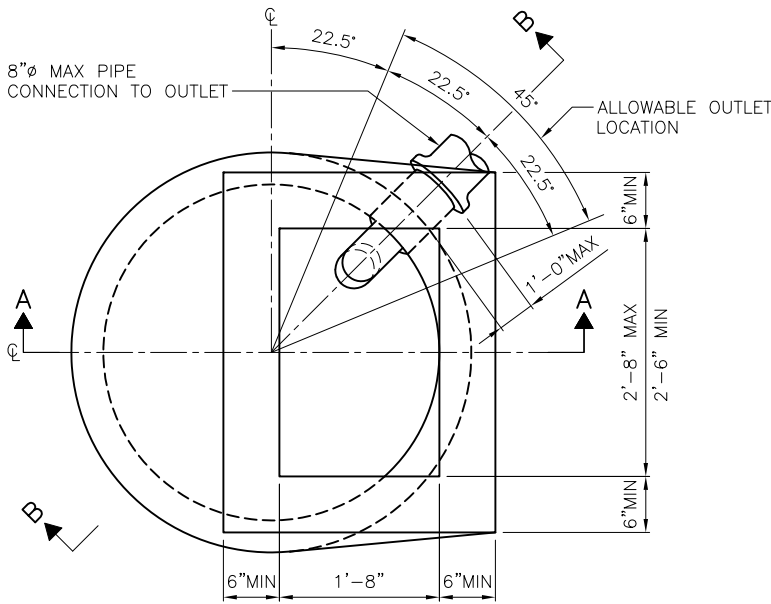


CB TYPE	CASTING		
	FRAME	GRATE	HOOD
A	NO 262	NO 265	NONE
B	NO 263A	NO 265	NO 263A
C	NO 263A	NO 265	NO 263B


NOTES:

1. MATERIAL: CONCRETE: CLASS 4000
REINFORCING STEEL: ASTM A 615 GR 60
2. INSTALL & LOCATE PER STD PLANS NO 260 & 261
3. OUTLET TRAP TO BE LOCATED DIRECTLY BELOW FRAME AND GRATE
4. USE OF LEVELING BRICKS TO BE RUNNING BOND PATTERN WITH 1/4 TO 1/2 GROUT IN BETWEEN BRICKS.


PLAN VIEW

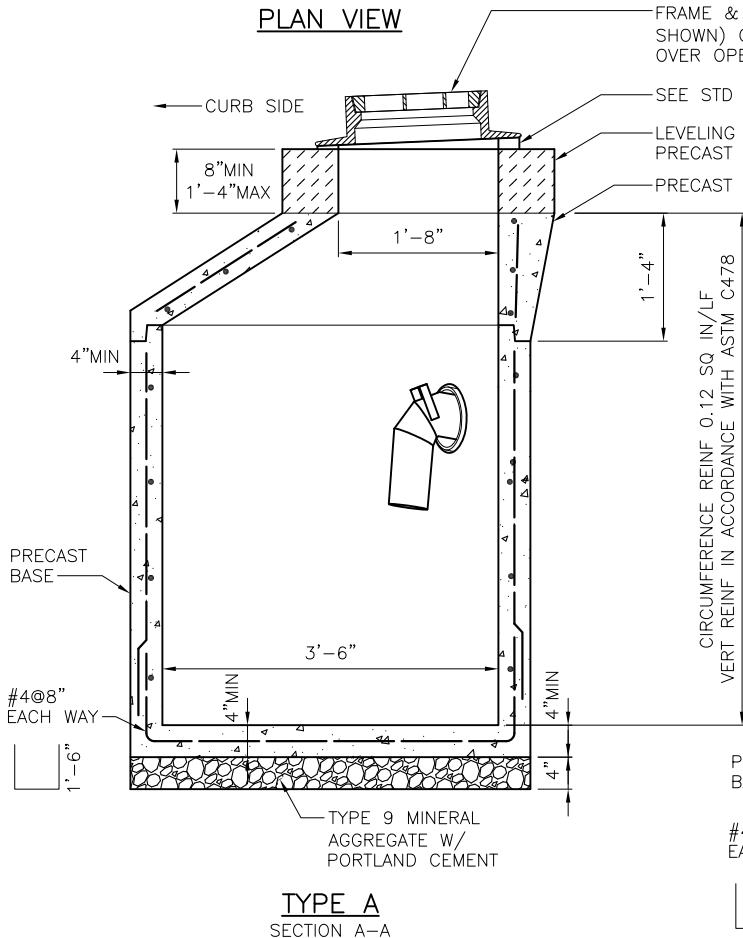

TYPE A
SECTION A-A

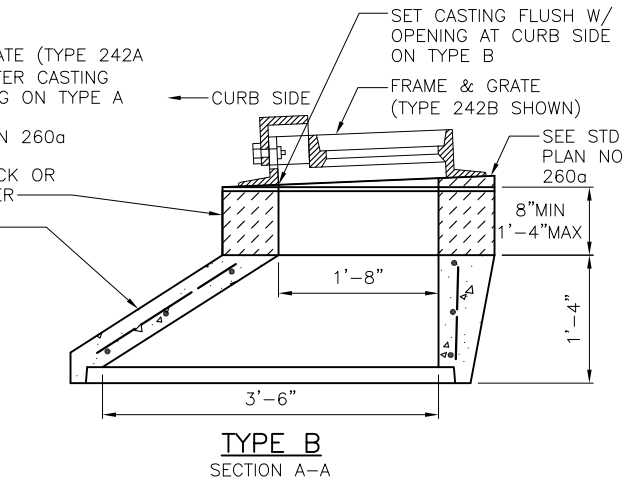

TYPE B
SECTION A-A

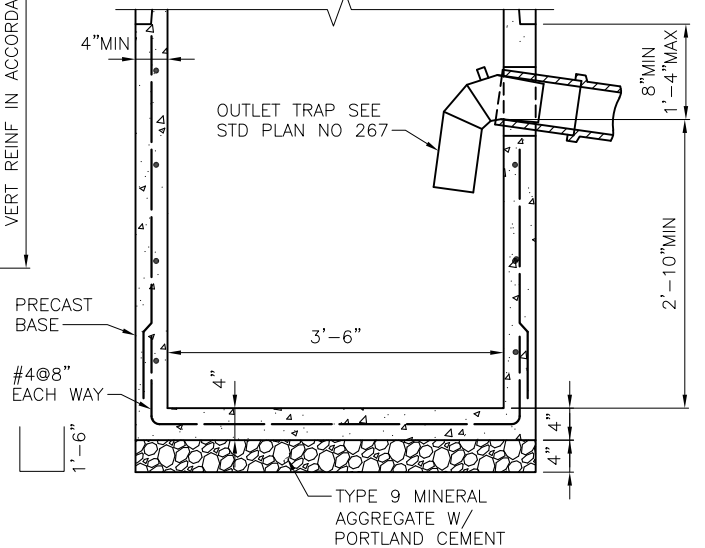

TYPE A & B
SECTION B-B


REF STD SPEC SEC 7-05




City of Seattle

NOT TO SCALE


TYPE 242 CATCH BASIN

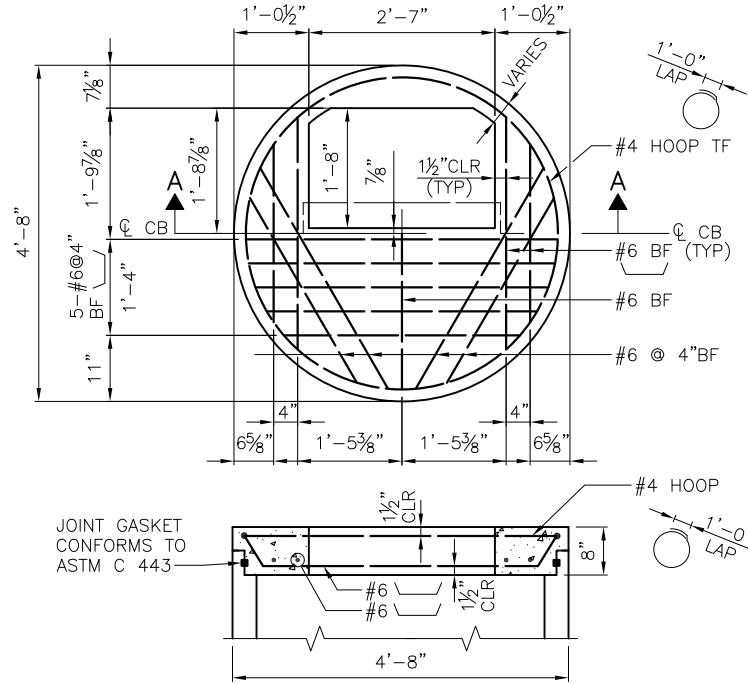

UNIT T
SECTION A-A

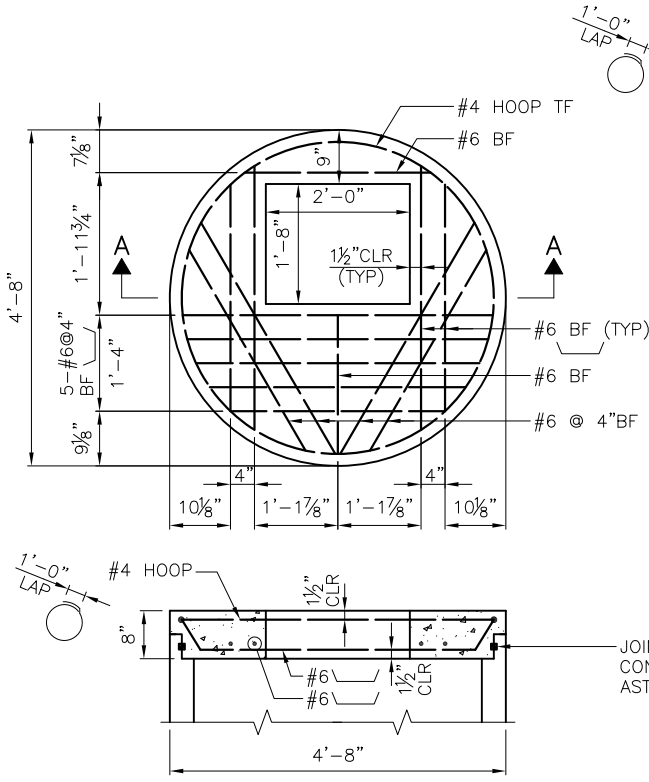

UNIT P-48
SECTION A-A

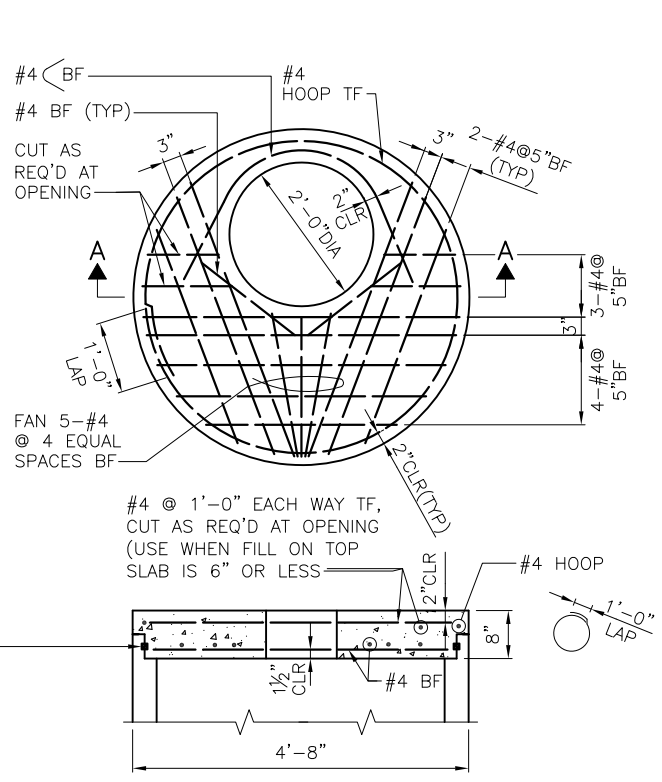

UNIT R
SECTION A-A



REF STD SPEC SEC 7-05



City of Seattle

NOT TO SCALE

PRECAST CATCH BASIN
TOP SLAB

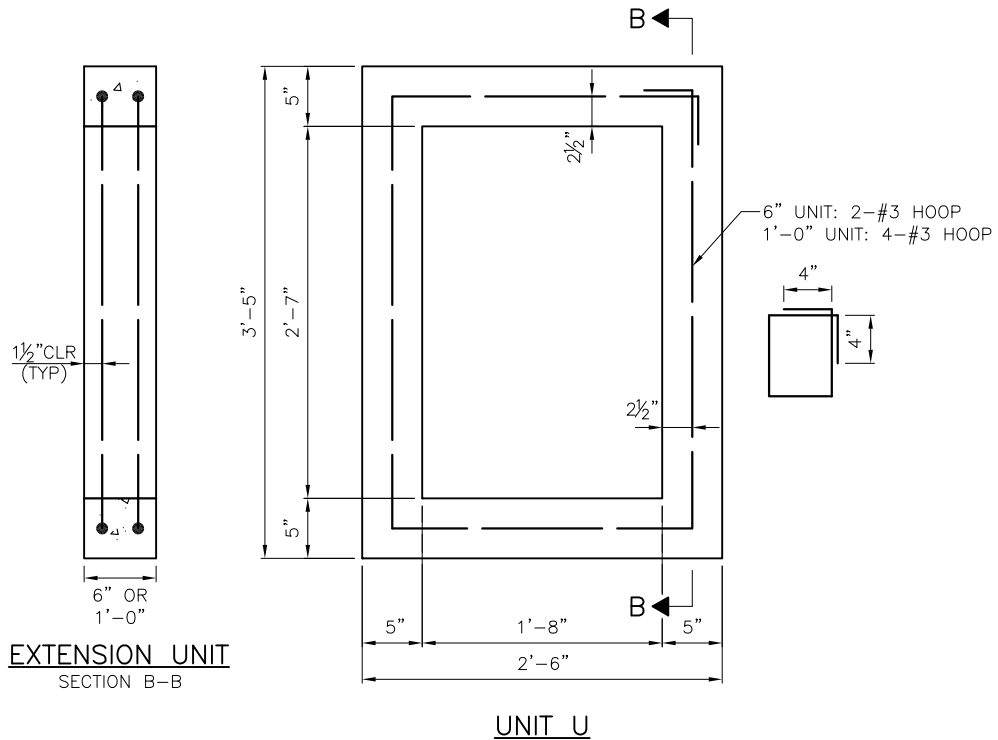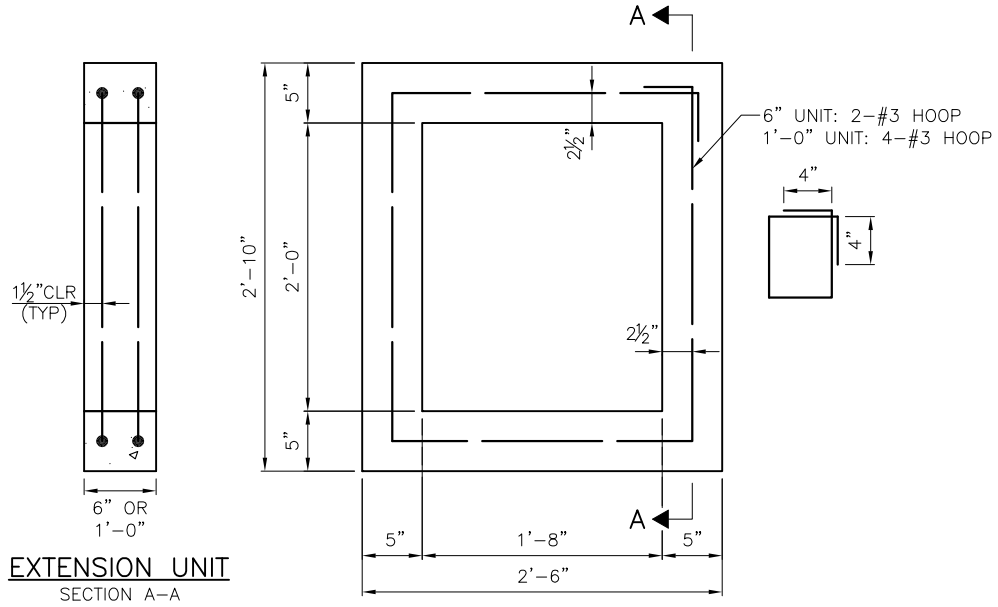

- NOTES:**
1. CONCRETE: CLASS 4000
 2. REINFORCING STEEL: ASTM A615 GR 60


REF STD SPEC SEC 7-05



City of Seattle


NOT TO SCALE

PRECAST CATCH BASIN
EXTENSION RISERS

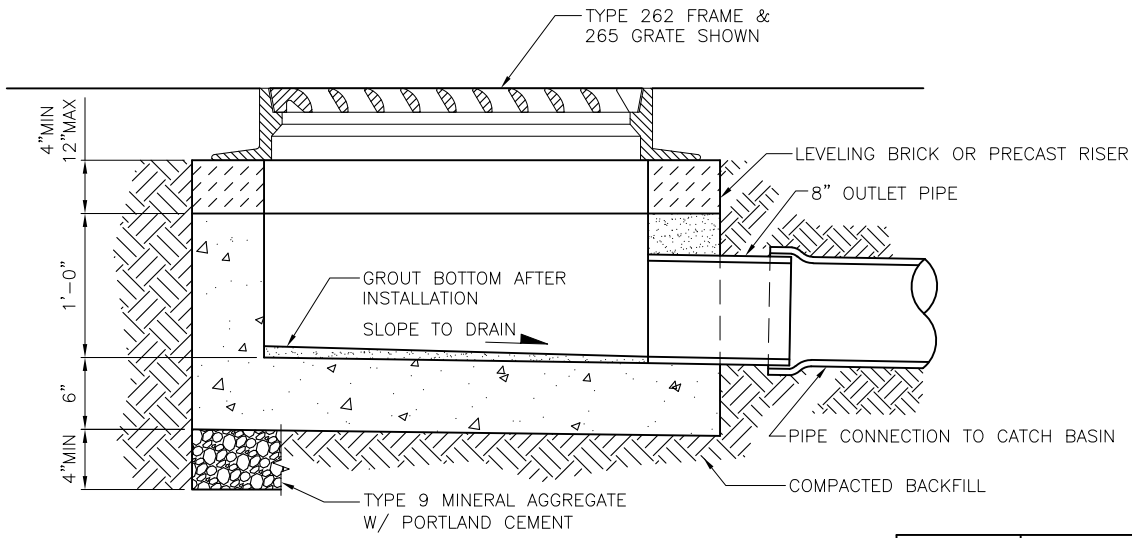


SECTION A-A

INLET TYPE	CASTING		
	FRAME	GRATE	HOOD
250A	NO 262	NO 265	NONE
250B	NO 263A	NO 265	NO 263A
250C	NO 263A	NO 265	NO 263B

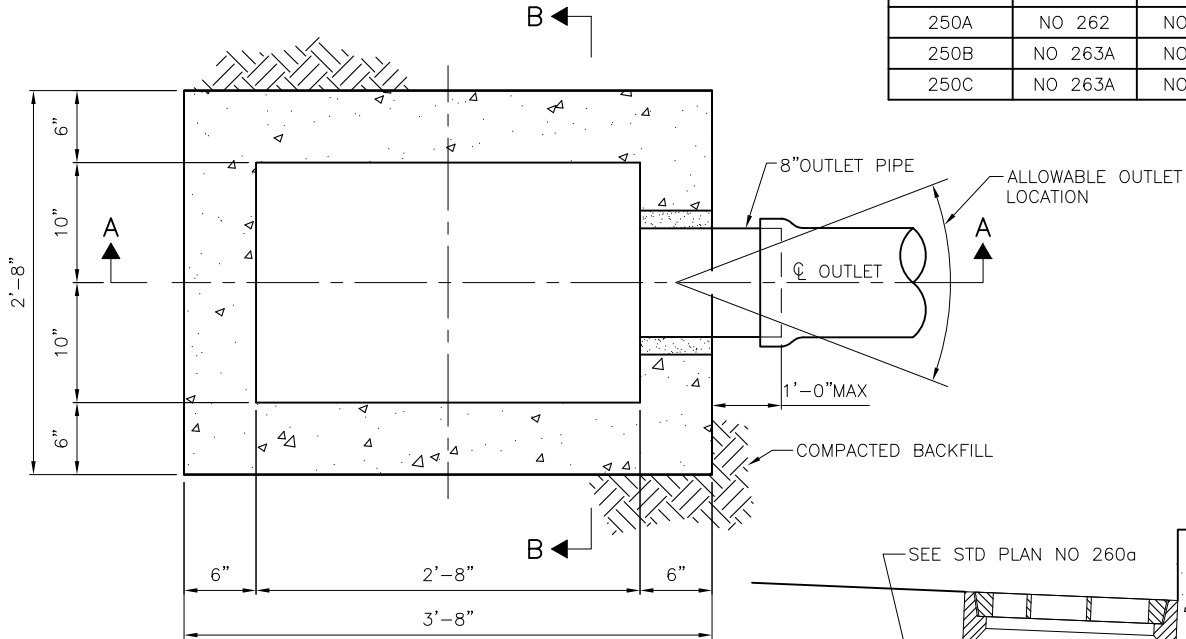

PLAN VIEW

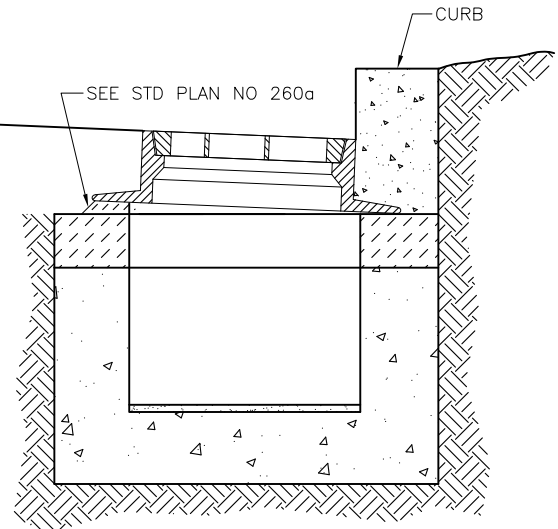

SECTION B-B
TYPE A ONLY


REF STD SPEC SEC 7-05




City of Seattle

NOT TO SCALE

TYPE 250 INLET

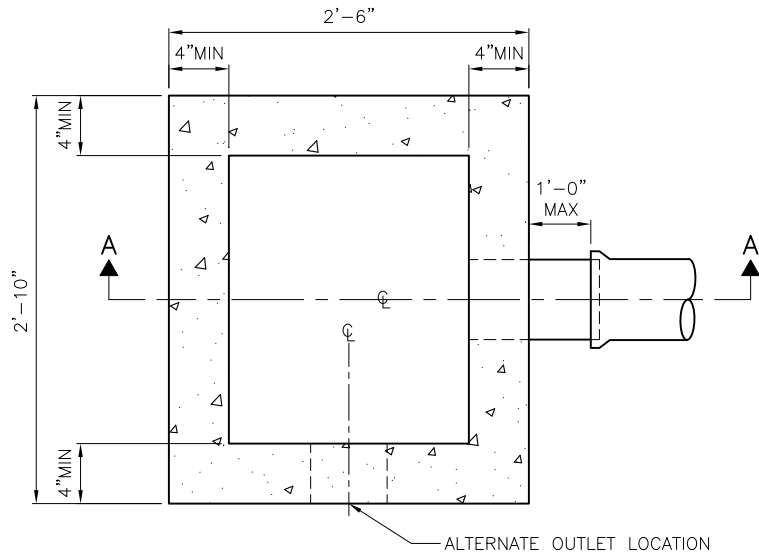

PLAN

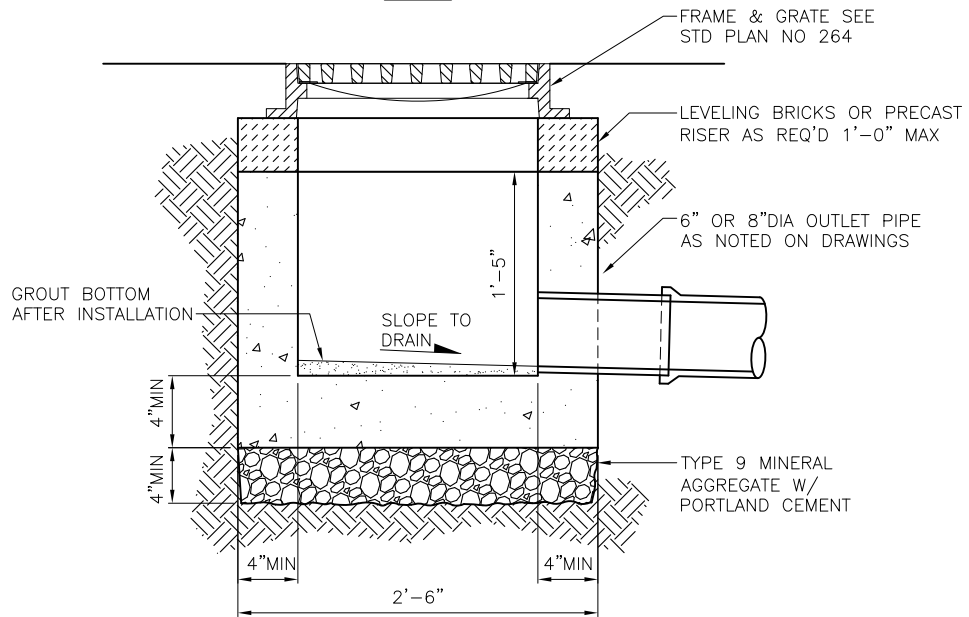

SECTION A-A


REF STD SPEC SEC 7-05



City of Seattle


NOT TO SCALE

TYPE 252 INLET

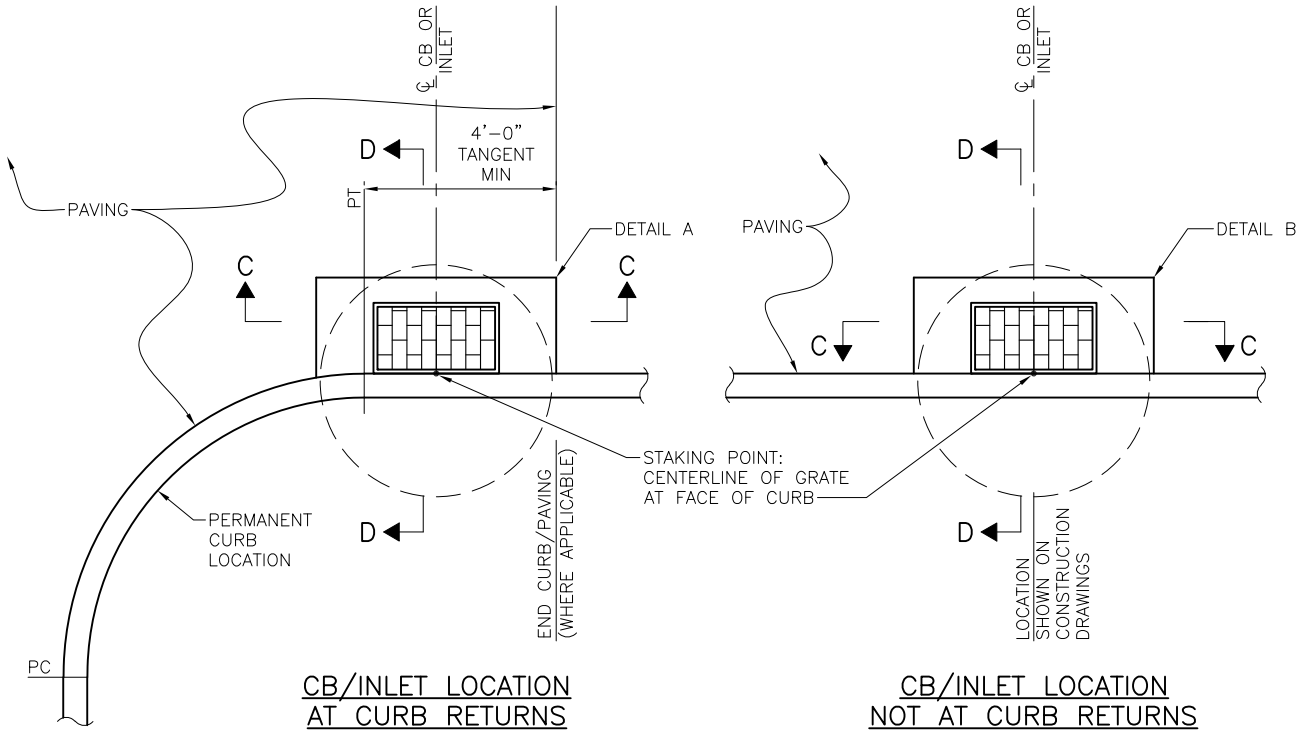


CB/INLET LOCATION AT CURB RETURNS

CB/INLET LOCATION NOT AT CURB RETURNS

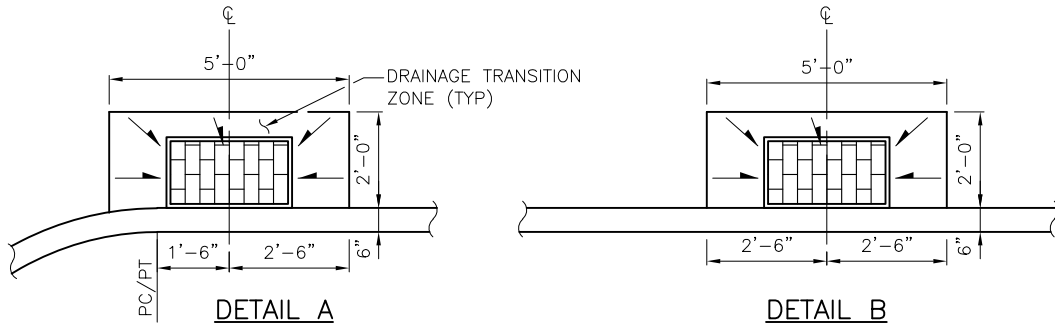

DETAIL A

DETAIL B

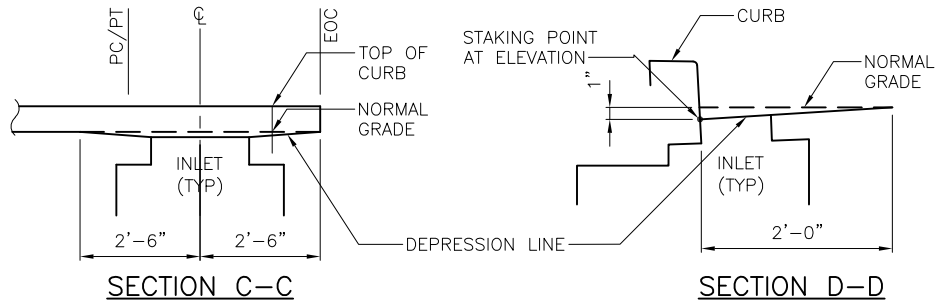

SECTION C-C

SECTION D-D

NOTES:

1. CB INLET GRATES MUST NOT BE PLACED IN CROSSWALKS.
2. CB INLETS MUST NOT BE PLACED IN CURB RAMP LANDINGS.

REF STD SPEC SEC 7-05




City of Seattle


NOT TO SCALE

INLET / CATCH BASIN LOCATION & INSTALLATION


REV DATE: SEP 2015

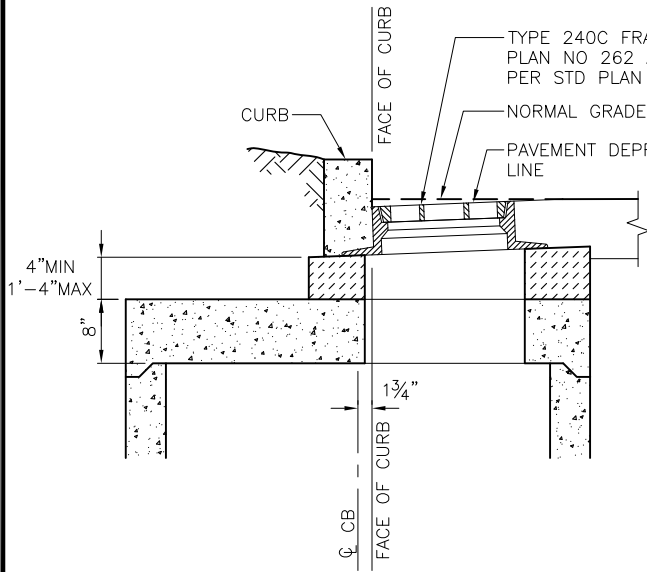


TYPE 240C CB

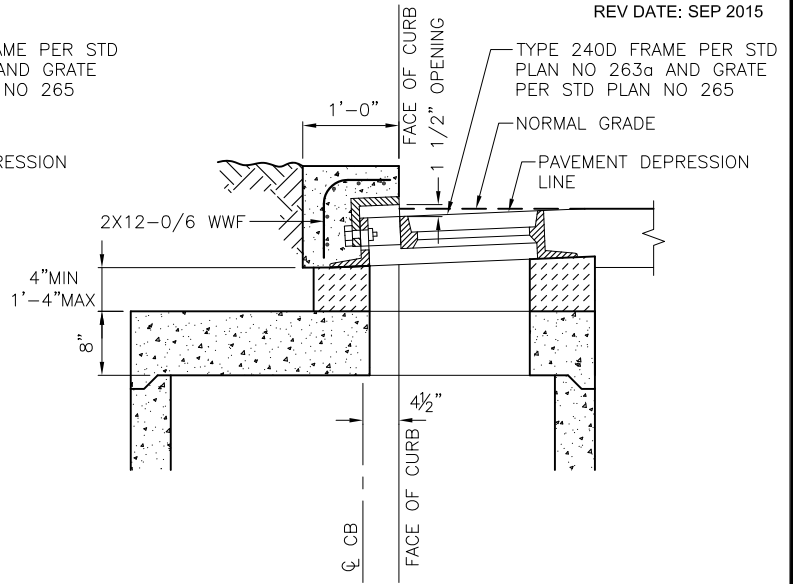


TYPE 240D CB

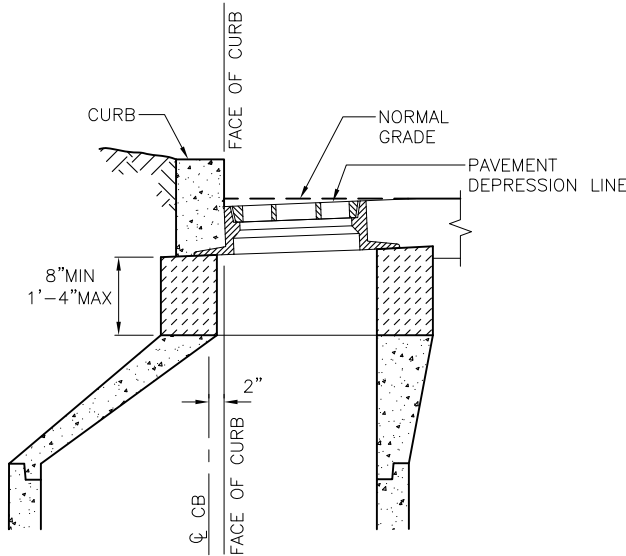

TYPE 242A CB
(TYPE 250A INLET SIMILAR)

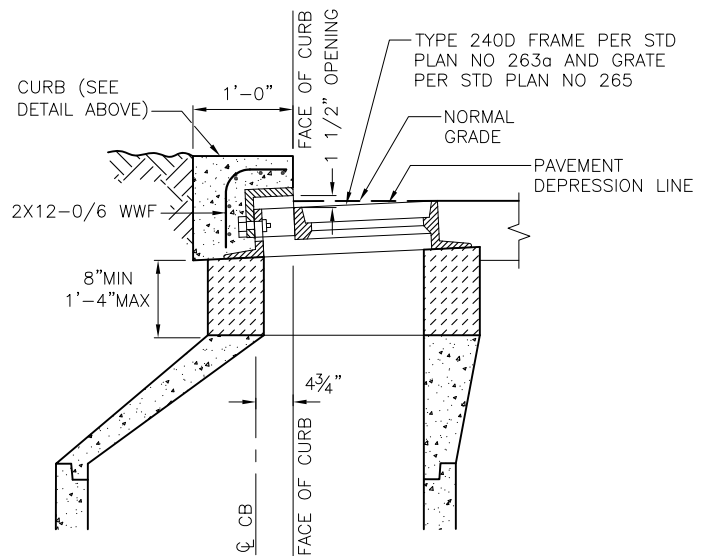

TYPE 242B CB
(TYPE 250B INLET SIMILAR)

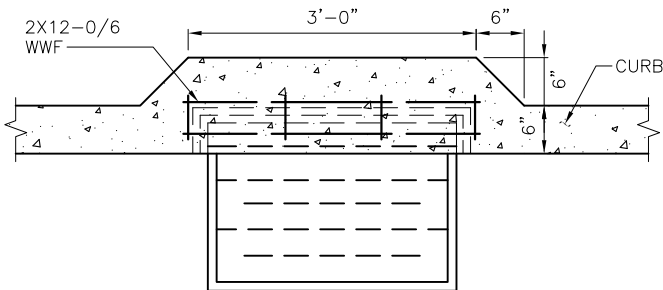

CURB DETAIL (PLAN VIEW) FOR
TYPE 240D & 242B CB & TYPE 250B INLET


REF STD SPEC SEC 7-05




City of Seattle

NOT TO SCALE


CATCH BASIN &
INLET INSTALLATION

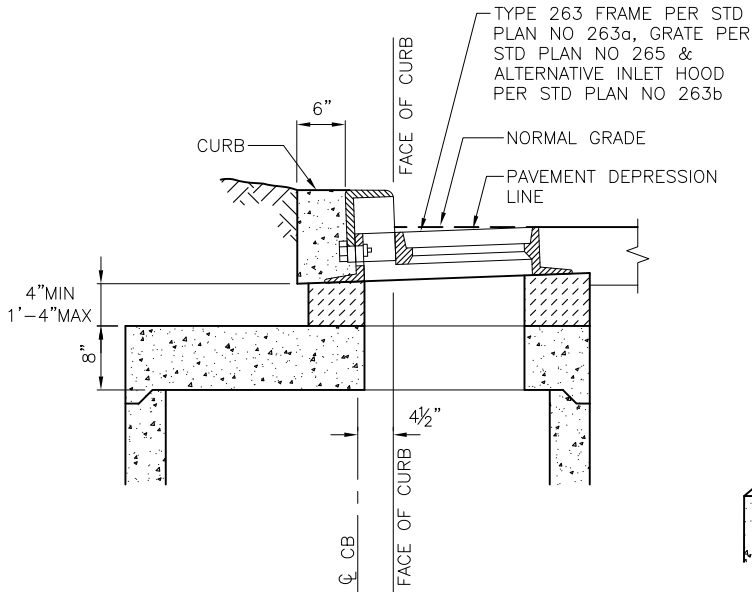

TYPE 240C CB

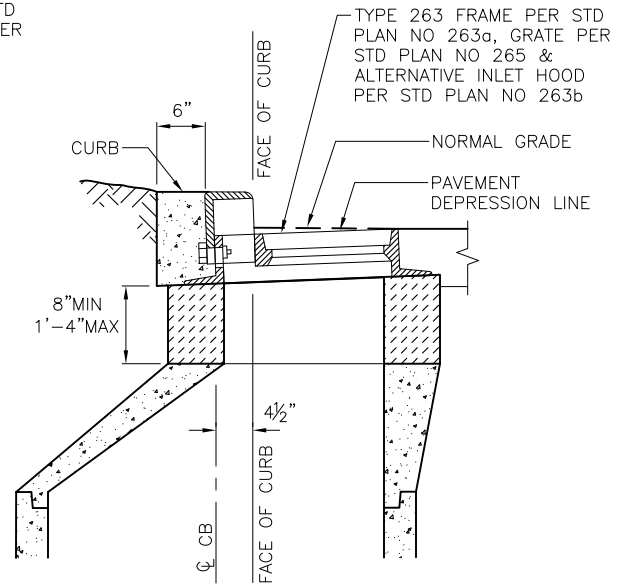

TYPE 242A CB

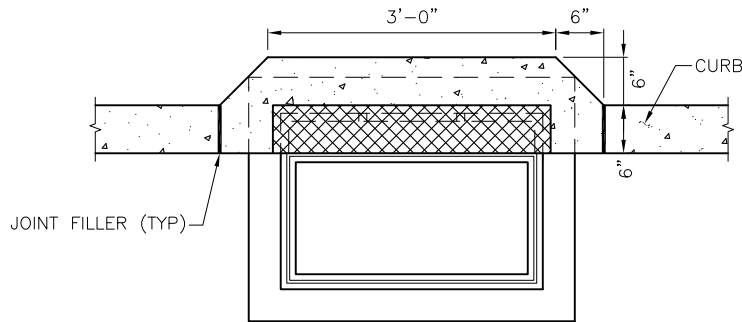

CURB DETAIL (PLAN VIEW) FOR
TYPE 240D & 242C CB & TYPE 250B INLET


REF STD SPEC SEC 7-05



City of Seattle

NOT TO SCALE

CATCH BASIN & INLET
INSTALLATION WITH STANDARD
PLAN 263B ALTERNATIVE HOOD

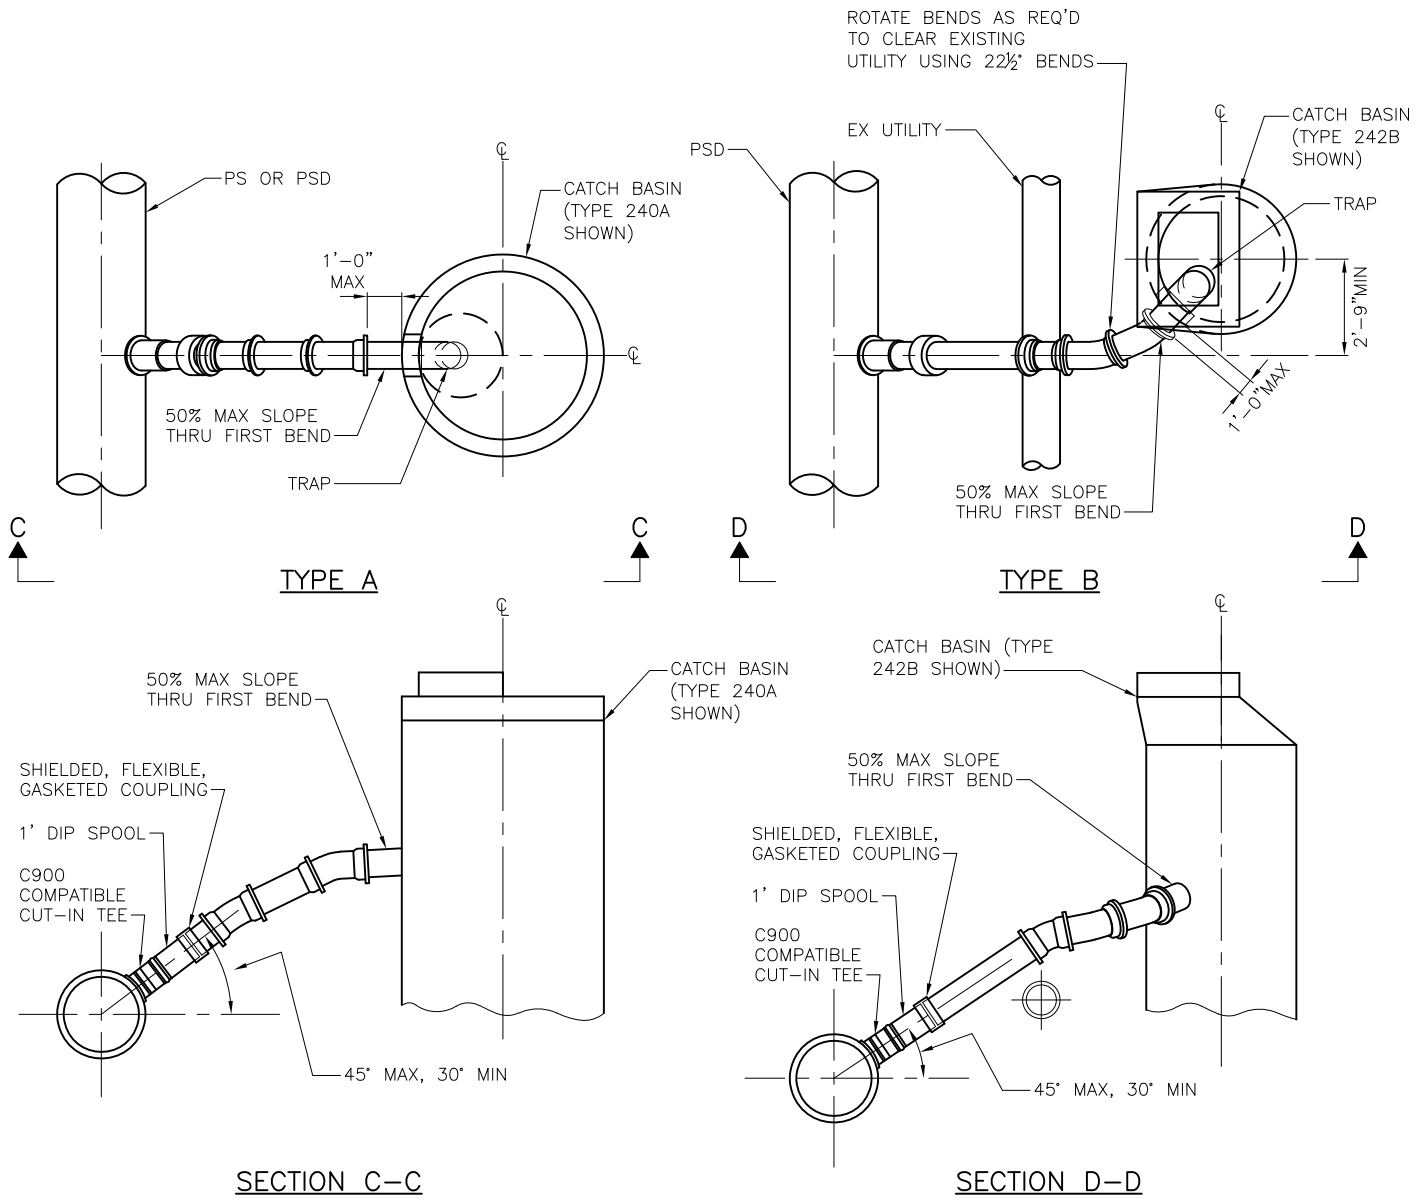

NOTES:

1. TYPE A CONNECTIONS MUST BE USED WITH CB TYPES 240A, 240B AND 241.
2. TYPE B CONNECTIONS MUST BE USED WITH CB TYPES 240C, 240D, 242A AND 242B.
3. CONNECTIONS MUST MAINTAIN A MINIMUM OF 2% AND A MAXIMUM OF 100% GRADE.
4. MAX BEND MUST BE 2 1/2" OR 1/6 BEND. USE OF 1/6 BEND REQUIRES APPROVAL BY SPU.
5. 1' DI SPOOL AND COUPLING REQUIRED WITH CUT-IN TEE.



REF STD SPEC SEC 7-08




City of Seattle

NOT TO SCALE

TYPICAL CATCH BASIN CONNECTION

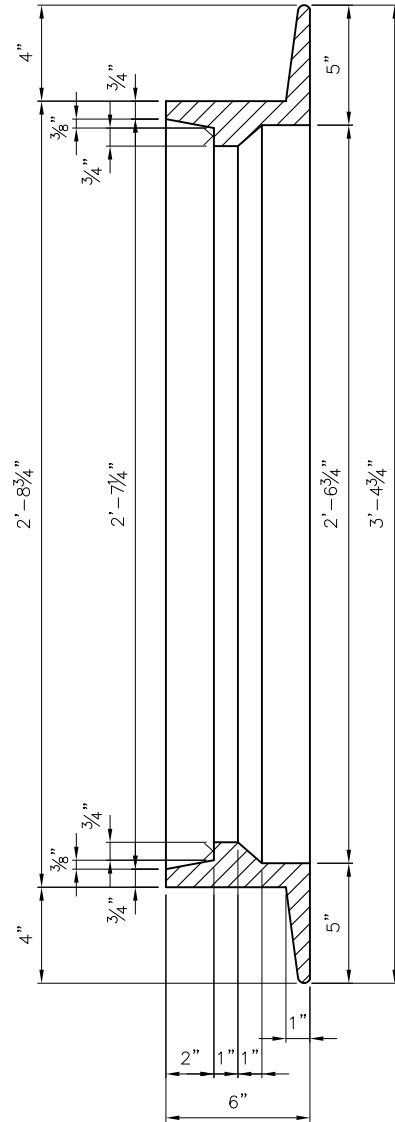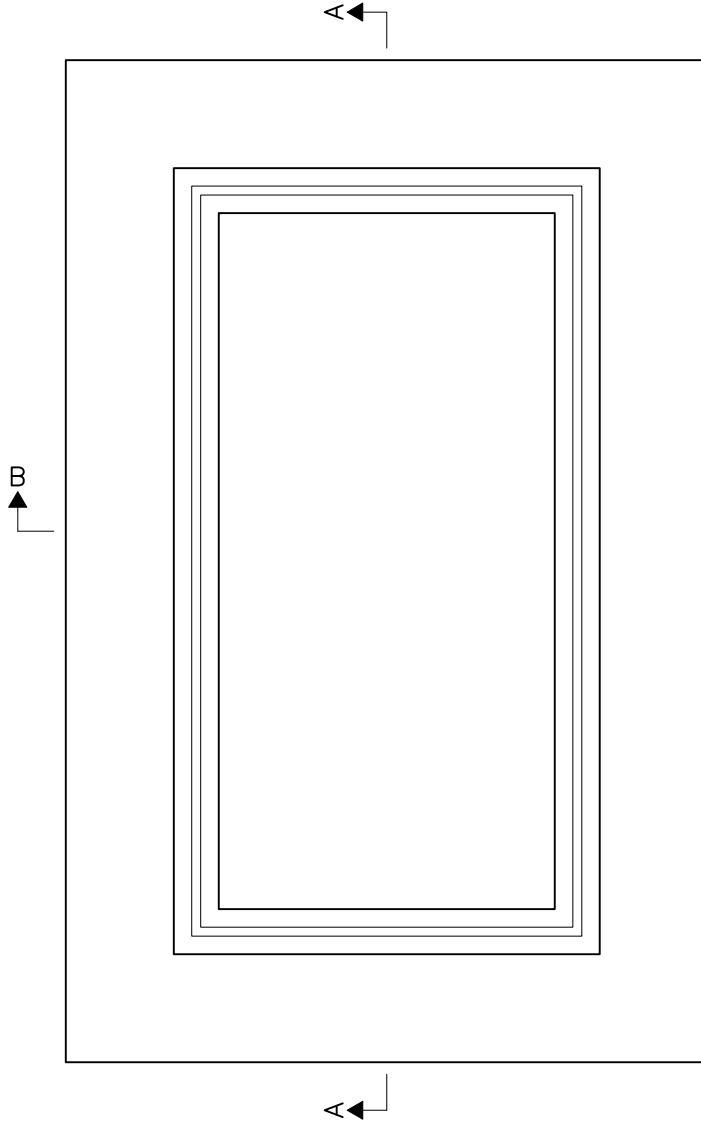

SECTION A-A

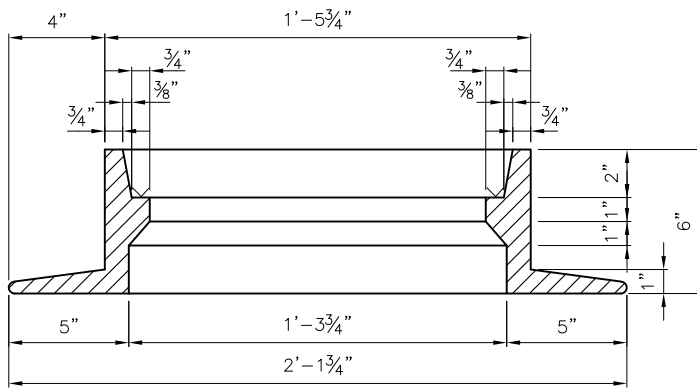

SECTION B-B


REF STD SPEC SEC 9-12




City of Seattle

NOT TO SCALE


TYPE 262 INLET FRAME

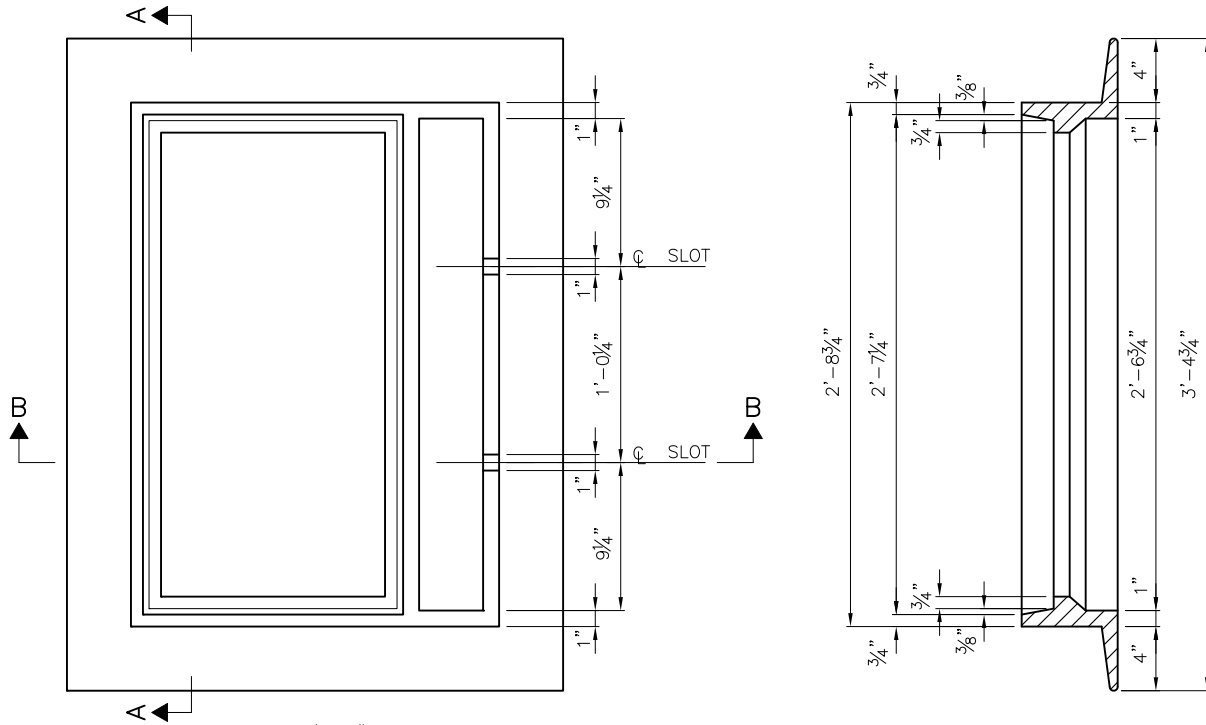

SECTION A-A

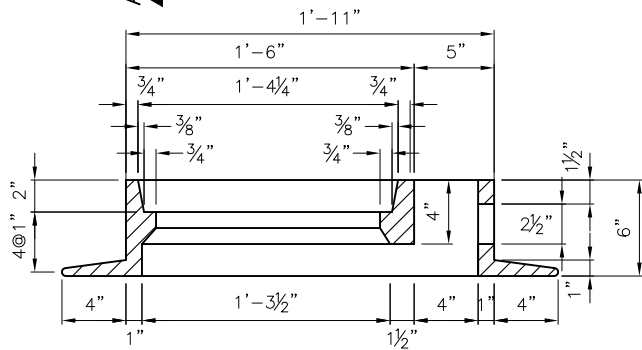

SECTION B-B

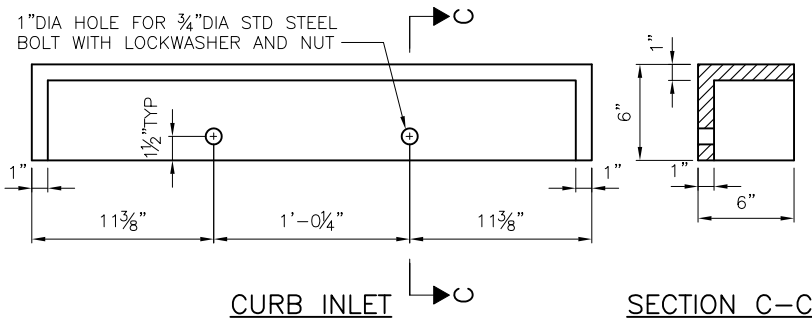

CURB INLET

SECTION C-C



REF STD SPEC SEC 9-12



City of Seattle

NOT TO SCALE

TYPE 263 INLET FRAME AND HOOD

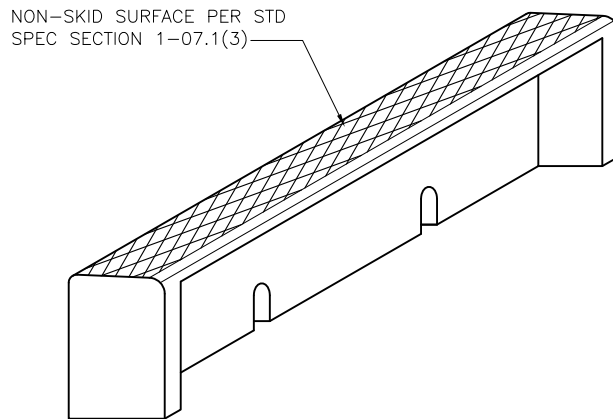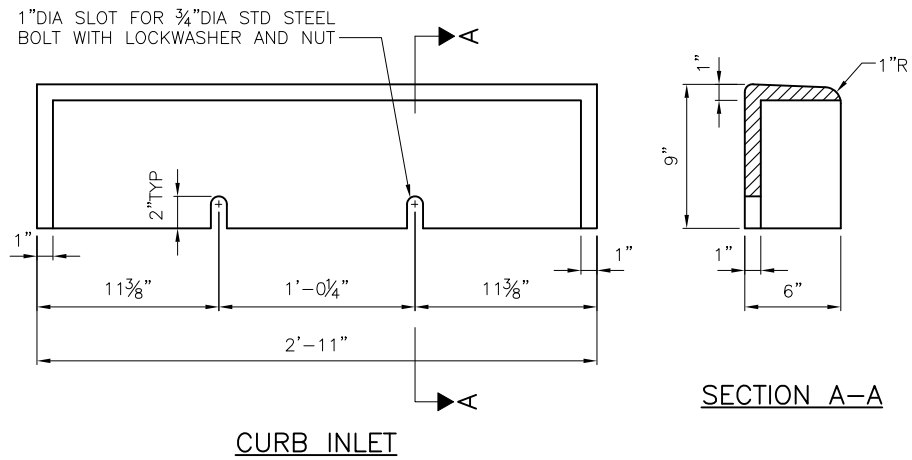


REF STD SPEC SEC 9-12



City of Seattle

NOT TO SCALE


TYPE 263 ALTERNATIVE
INLET HOOD

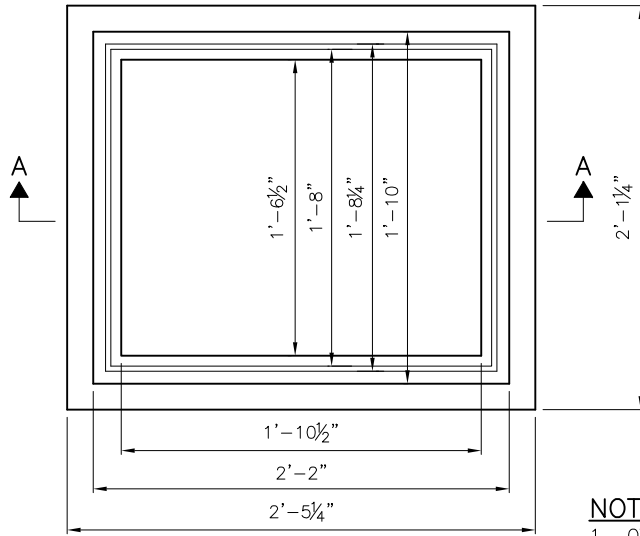


FRAME

NOTES:


1. OTHER GRATES ACCEPTABLE; SPECIFY VANE, SOLID COVER, BI-DIRECTIONAL VANE, ADA OR BEEHIVE ON PLANS.
2. GRATE MATERIAL: DUCTILE IRON

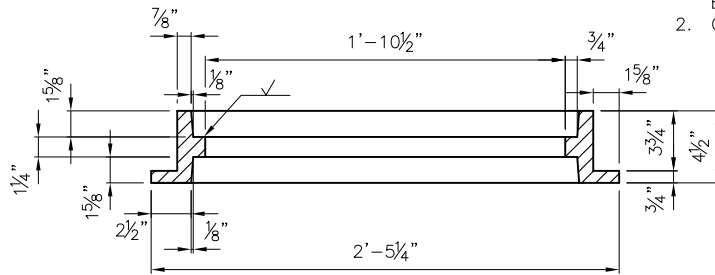


SECTION A-A

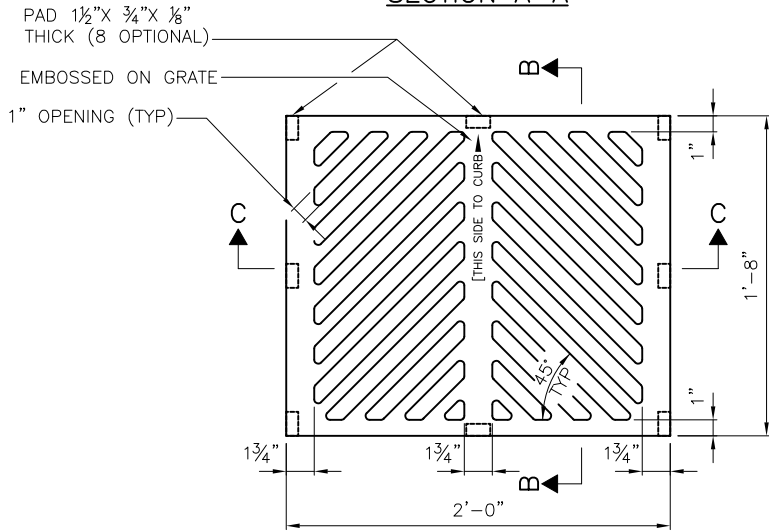

GRATE

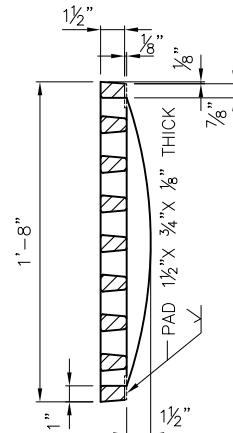

SECTION B-B

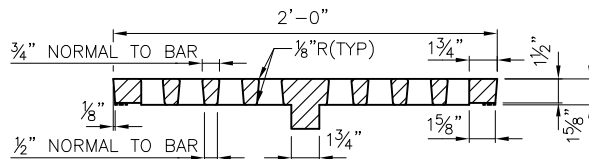

SECTION C-C



REF STD SPEC SEC 7-05



City of Seattle


NOT TO SCALE

INLET FRAME & GRATE

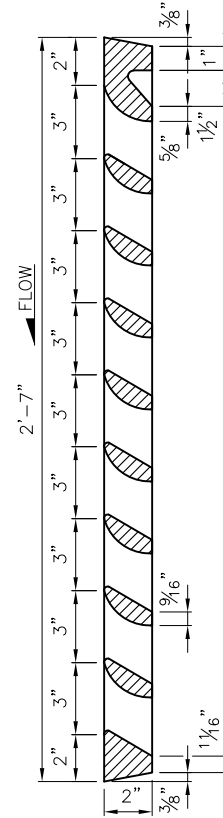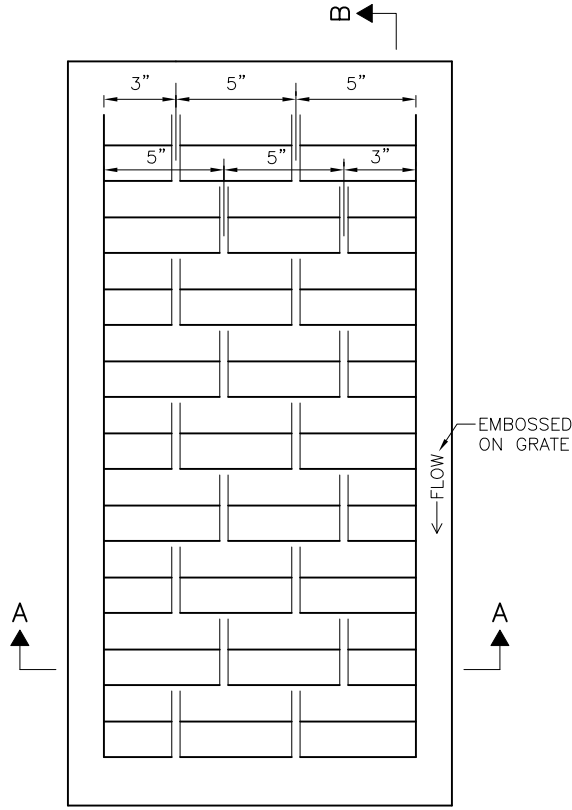


SECTION B-B


GRATE MATERIAL: DUCTILE IRON

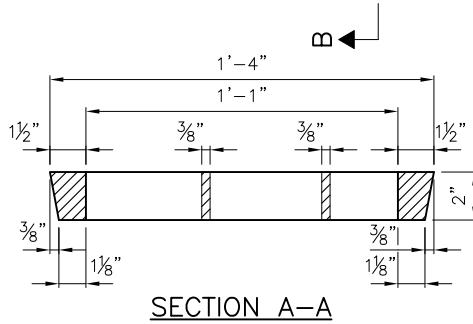

SECTION A-A

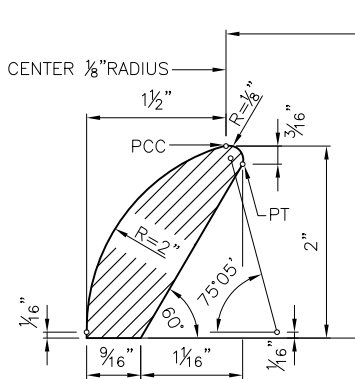

VANE DETAIL

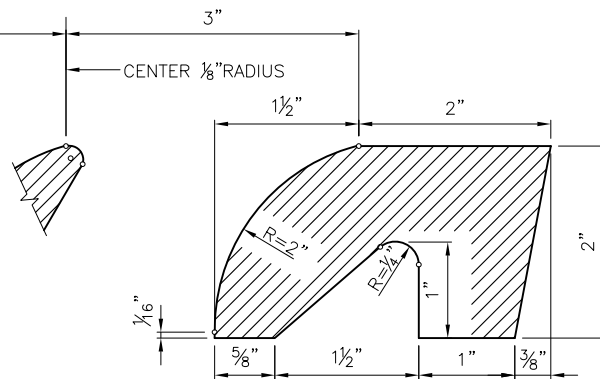

END DETAIL


REF STD SPEC SEC 7-05



City of Seattle

NOT TO SCALE

VANED GRATE

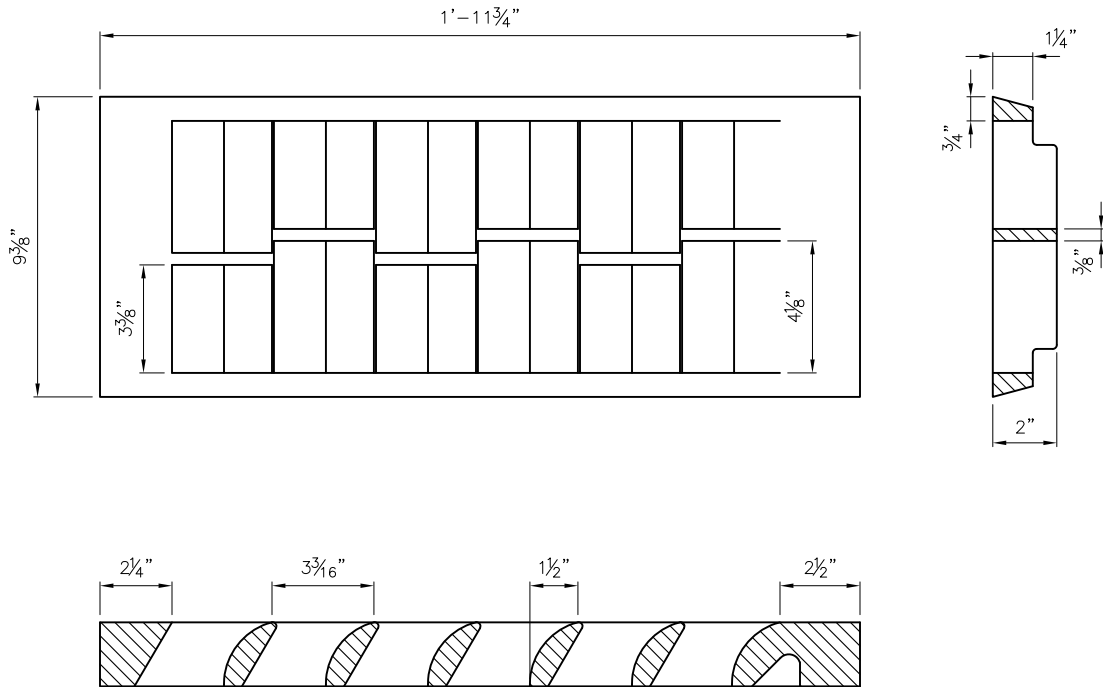

NOTES:

1. OPEN AREA – 100 SQUARE INCHES.
2. SEE STD PLAN NO 265 FOR VANE AND END DETAIL.
3. STD PLAN NO 266 DIMENSIONS GOVERN ON END DETAIL.
4. REPLACEMENT VANED GRATE FOR TYPE 164 INLET FRAMES.



REF STD SPEC SEC 7-20.3(6), 9-12



City of Seattle

NOT TO SCALE

**TYPE 266 REPLACEMENT
VANED GRATE**

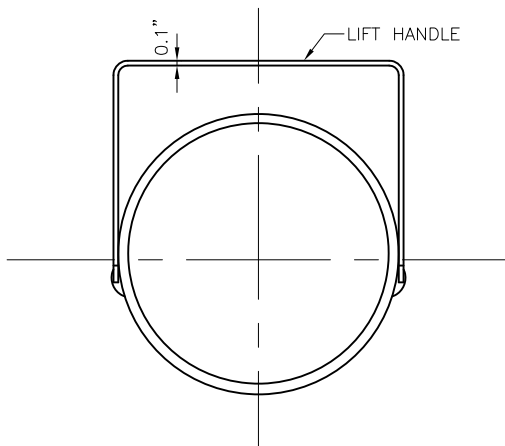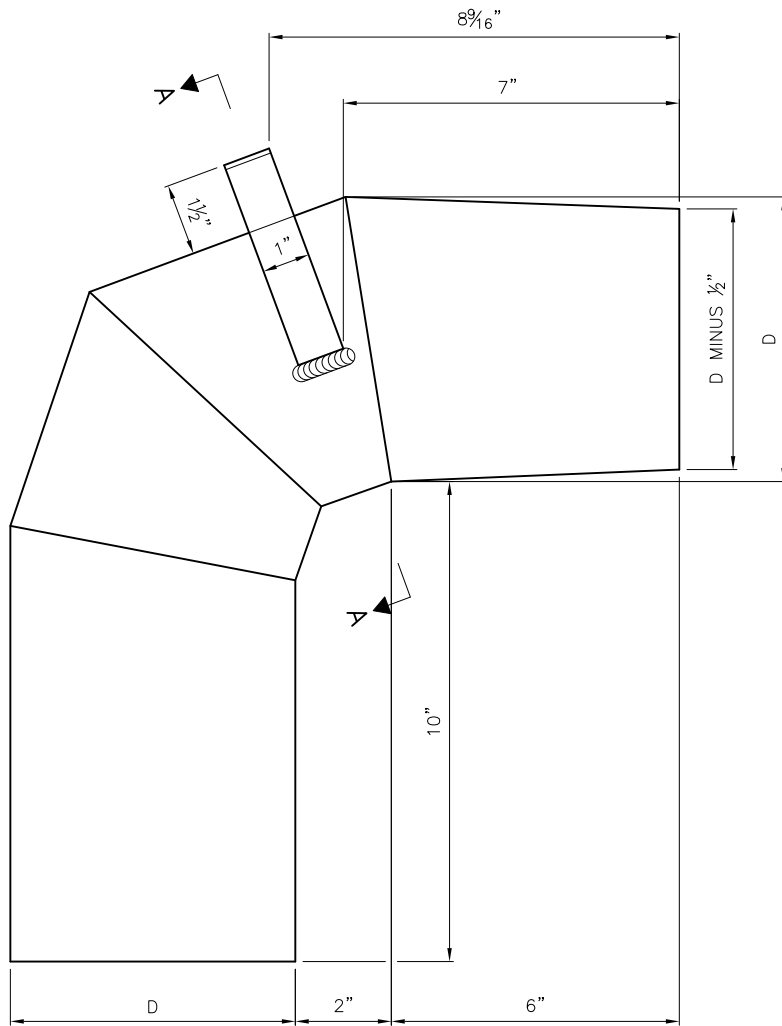

SECTION A-A
NTS

NOTES:

1. TRAP TO BE MADE OF 22 GA SHEET METAL OR 16 GA ALUMINUM
2. ALL JOINTS TO BE SEAMED AND SOLDERED, OR WELDED
3. ALL LONGITUDINAL JOINTS TO BE RIVETED OR WELDED
4. DIAMETER "D" IS NOMINAL DIAMETER OF OUTLET PIPE
5. LIFT HANDLE MUST BE WELDED TO OUTSIDE OF TRAP (1" WIDE X 0.1" THICK)




REF STD SPEC SEC 9-12



City of Seattle

NOT TO SCALE

OUTLET TRAP

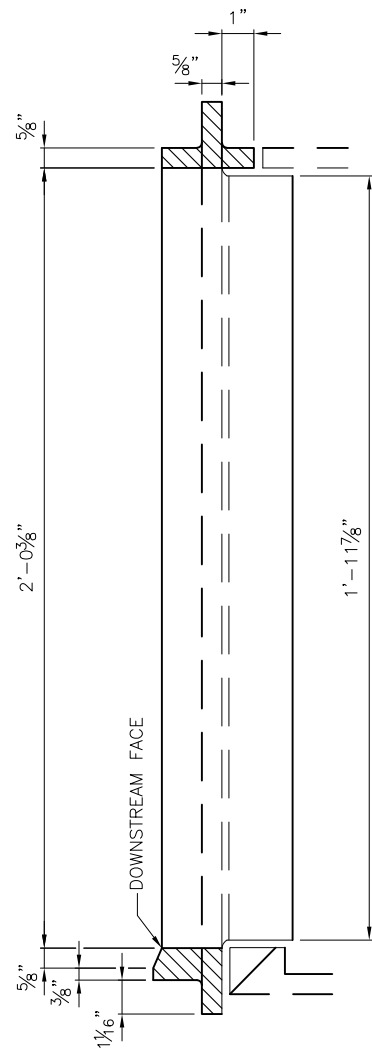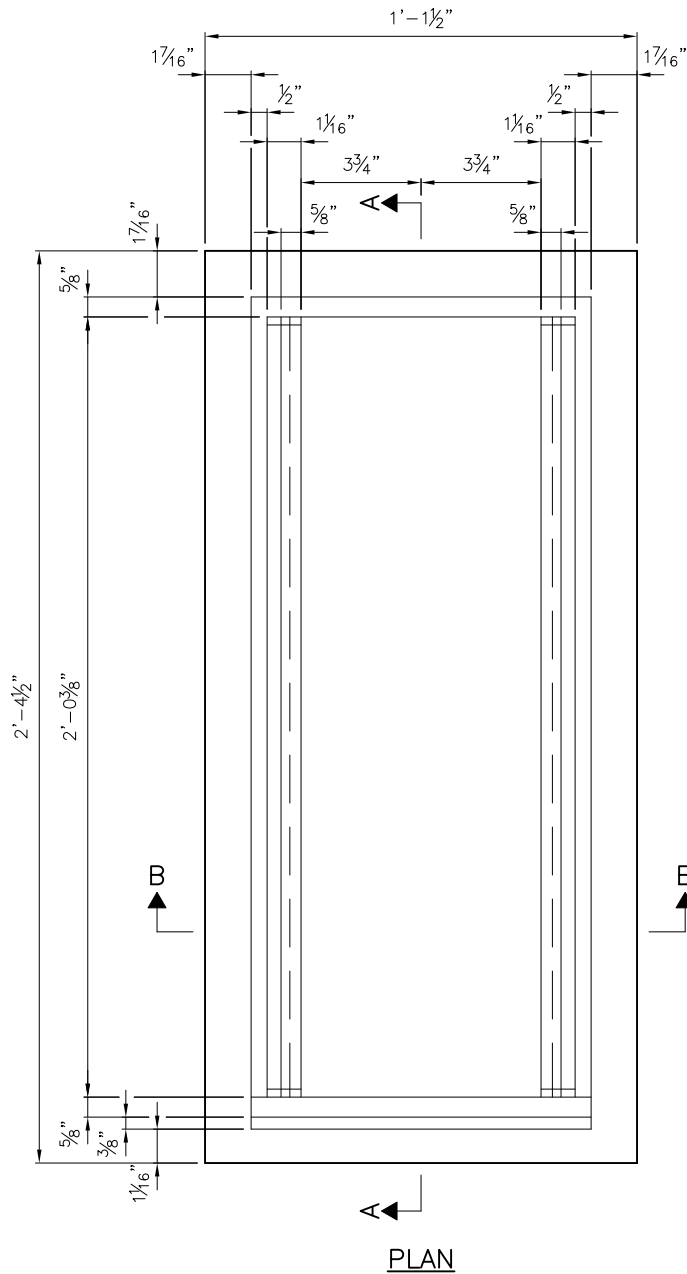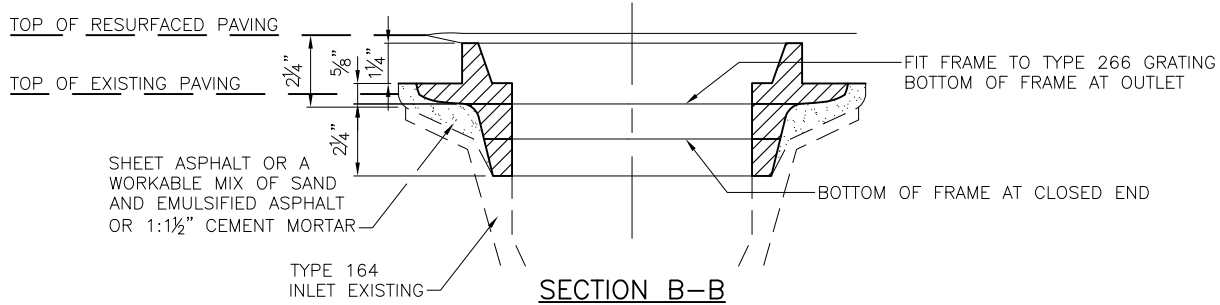

THESE DIMENSIONS MAY BE CHANGED IF NECESSARY TO FIT EXISTING CASTINGS



REF STD SPEC SEC 9-05




City of Seattle

NOT TO SCALE

EXTENSION FOR INLET

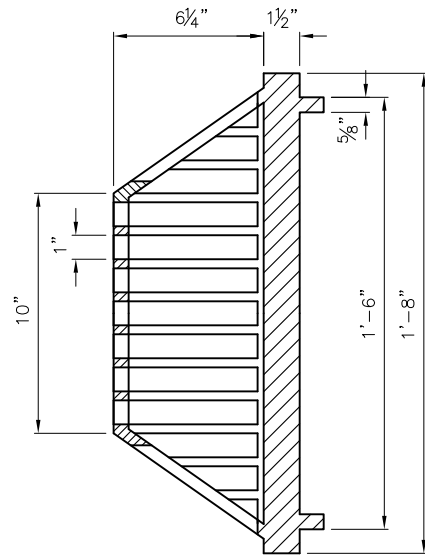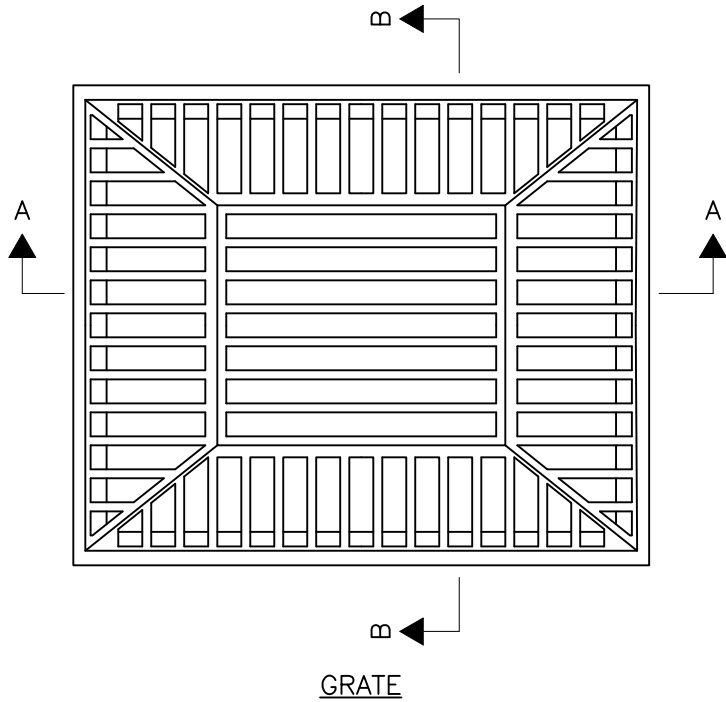

SECTION B-B

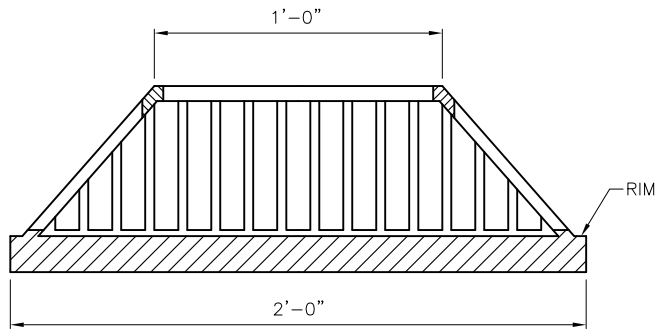

SECTION A-A

NOTES:

1. GRATE MATERIAL: DUCTILE IRON
2. FRAME PER STD PLAN NO 264



REF STD SPEC SEC 9-12



City of Seattle

NOT TO SCALE

**BEEHIVE GRATE FOR
BIORETENTION**

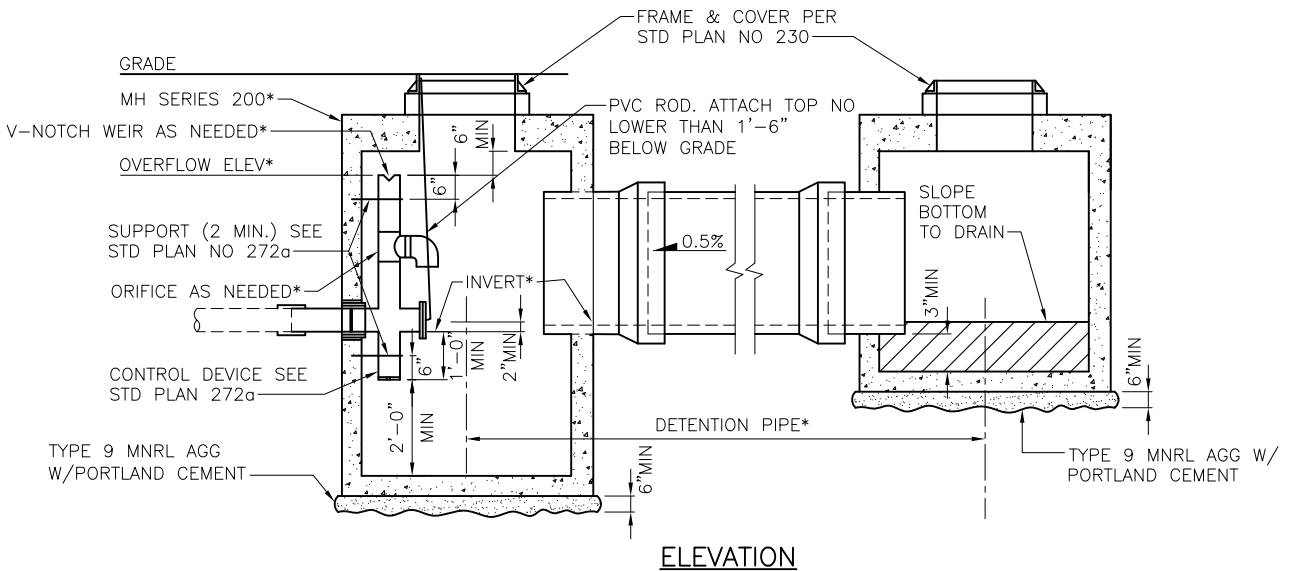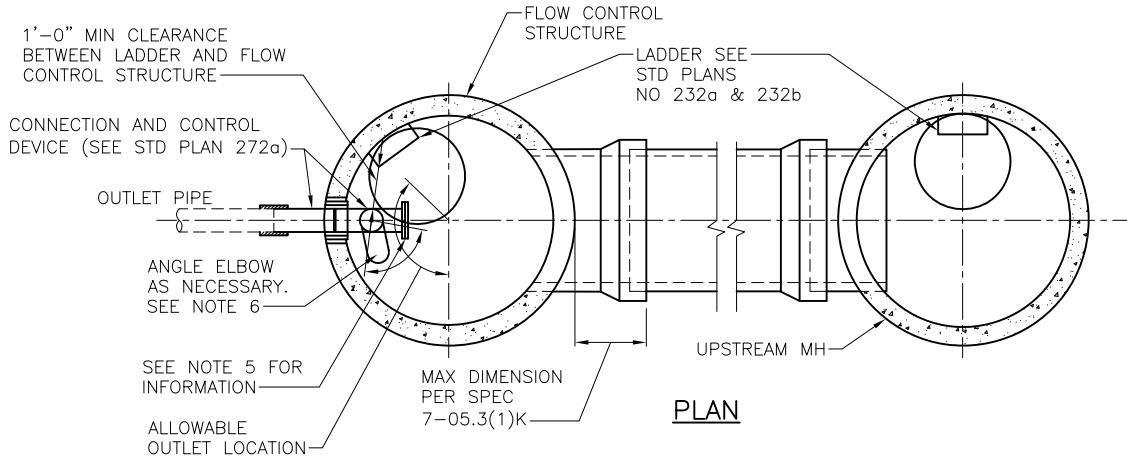

NOTES:

1. DETENTION PIPE MATERIAL MUST BE AS SHOWN ON THE APPROVED CONSTRUCTION DRAWINGS. MATERIALS THAT MAY BE APPROVED FOR USE IN THE ROW INCLUDE:
 - * DUCTILE IRON PIPE (DIP)
 - * REINFORCED CONCRETE PIPE (RCP)
 - * POLYPROPYLENE PIPE (PP DETENTION)
 - * STEEL REINFORCED POLYETHYLENE PIPE (STL REINF PE DETENTION). ONLY MANUFACTURER SUPPLIED TEES MUST BE USED FOR CONNECTIONS.
2. BEDDING FOR DETENTION PIPE MUST BE CLASS B. DIP AND RCP MUST BE BEDDED IN MINERAL AGGREGATE TYPE 9. FLEXIBLE PIPE MUST BE BEDDED IN MINERAL AGGREGATE TYPE 22.
3. INTERMEDIATE MHS WILL BE REQUIRED FOR DETENTION PIPE LENGTHS GREATER THAN 350LF.
4. OUTLET PIPE MUST CONNECT TO MH ON MAINLINE.
5. STRUCTURE DESIGN MUST BE MODIFIED FOR PRIVATE SYSTEM WITH EXCLUSION OF SHEAR GATE
6. ROTATE ELBOW RESTRICTOR CLEAR OF ACCESS OPENING.
7. FRAME LADDER AND STEPS OFFSET:
 - 7.1. CLEAN OUT IS VISIBLE FROM TOP
 - 7.2. CLIMB DOWN SPACE IS CLEAR OF RISER AND CLEAN OUT GATE
 - 7.3. MH OPENING MUST NOT BE PLACED DIRECTLY OVER THE TOP OF INLET PIPE

DETENTION PIPE DIAMETER	FLOW CONTROL STRUCTURE* (MH SIZE)	UPSTREAM** (MH SIZE)
18"	204.5b	204b
24"	205b	204.5b
30"	205b	205b
36"	206b	206b
48"	207b	207b
60"	208b	208b
72"	210b	210b

*SPECIFIC DESIGN INFORMATION AS INDICATED ON CONSTRUCTION DRAWINGS

**SIZE OF UPSTREAM MH MUST BE ADJUSTED FOR ALTERNATIVE PIPE MATERIAL


REF STD SPEC SEC 7-16



City of Seattle

NOT TO SCALE

FLOW CONTROL STRUCTURE WITH DETENTION PIPE

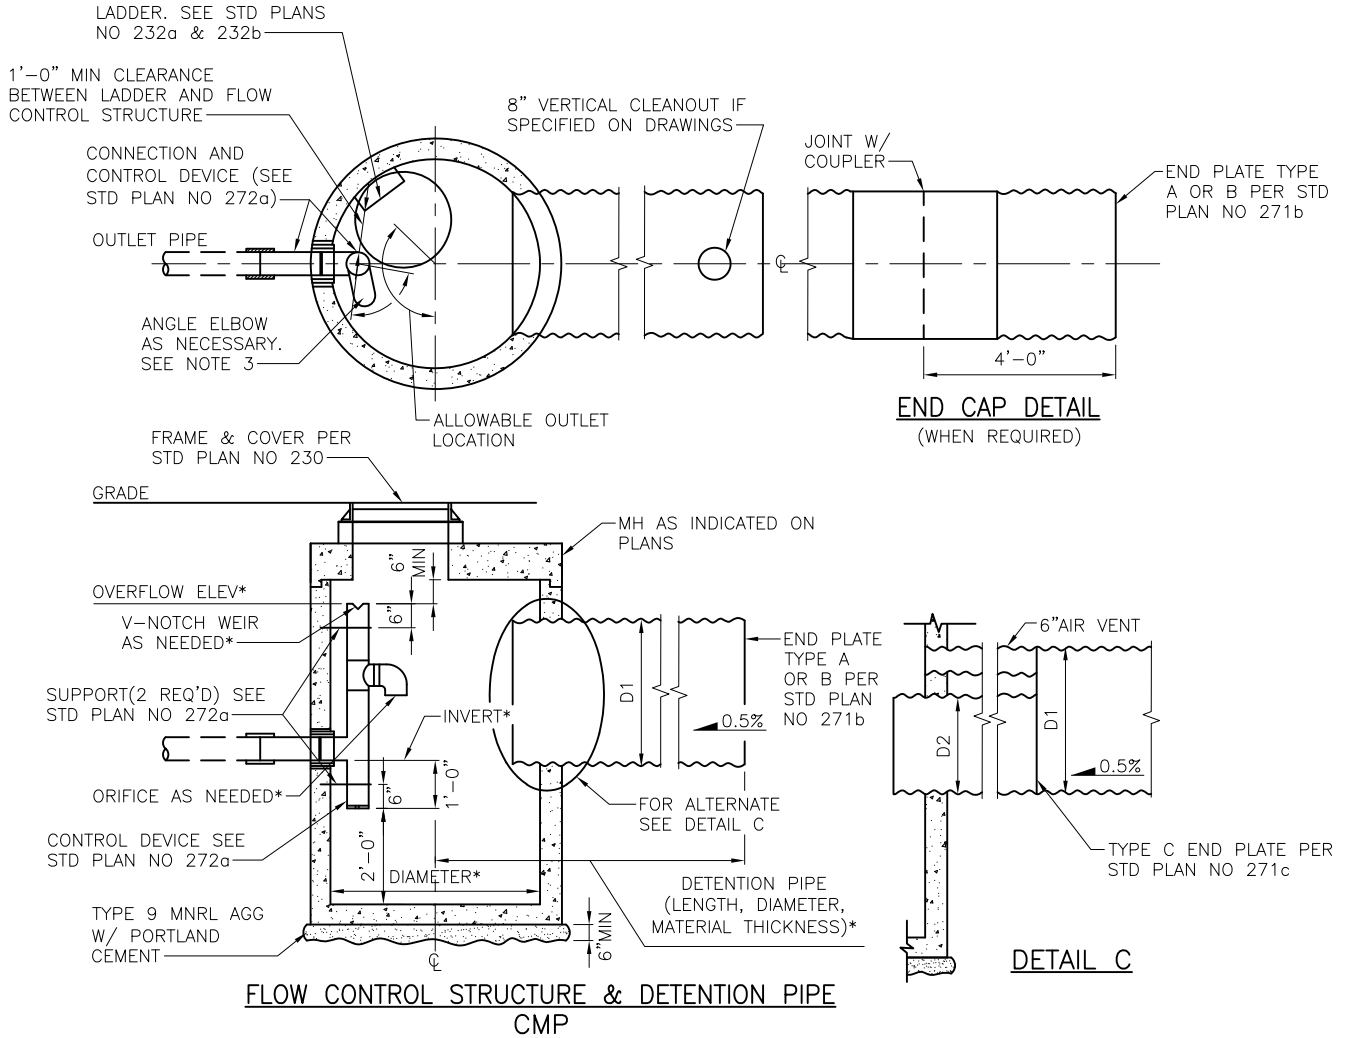

NOTES:

1. INVERT OF DETENTION PIPE TO BE HIGHER THAN INVERT OF OUTLET PIPE
2. *SPECIFIC DESIGN INFORMATION WILL BE INDICATED ON ACTUAL CONSTRUCTION DRAWINGS
3. ROTATE ELBOW RESTRICTOR CLEAR OF ACCESS OPENING
4. FOR ALTERNATIVE PIPE MATERIALS, REFER TO STD PLAN NO 270
5. FRAME LADDER AND STEPS OFFSET:
 - 5.1. CLEAN OUT IS VISIBLE FROM TOP
 - 5.2. CLIMB DOWN SPACE IS CLEAR OF RISER AND CLEAN OUT GATE
 - 5.3. MH OPENING MUST NOT BE PLACED DIRECTLY OVER THE TOP OF INLET PIPE


REF STD SPEC SEC 7-16




City of Seattle

NOT TO SCALE

**CMP DETENTION PIPE
PRIVATE SYSTEM ONLY**

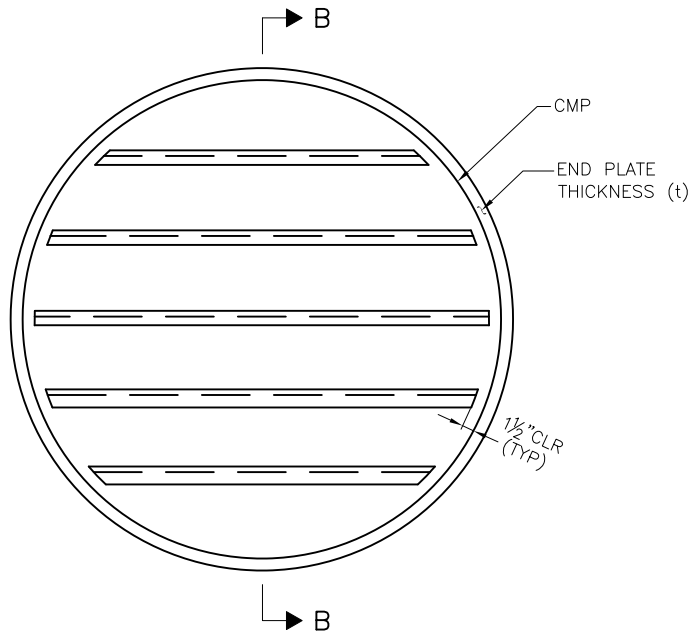


SECTION A-A

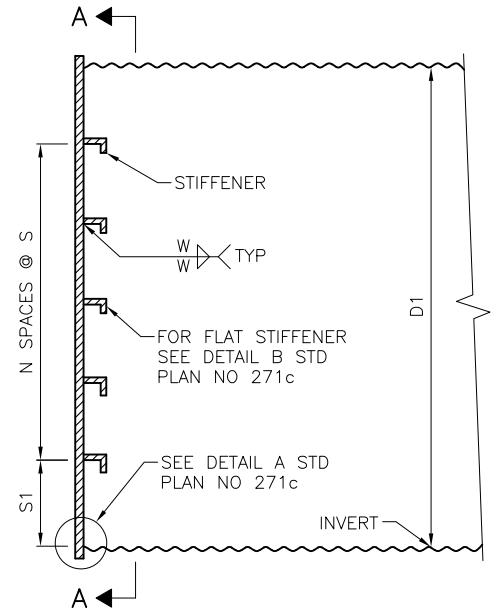


SECTION B-B

TYPE A

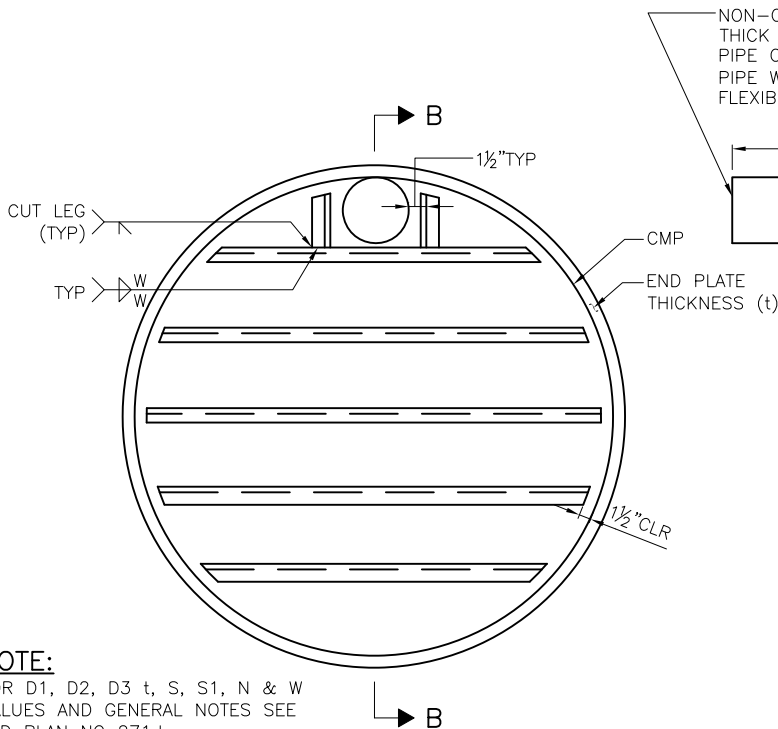

SECTION A-A

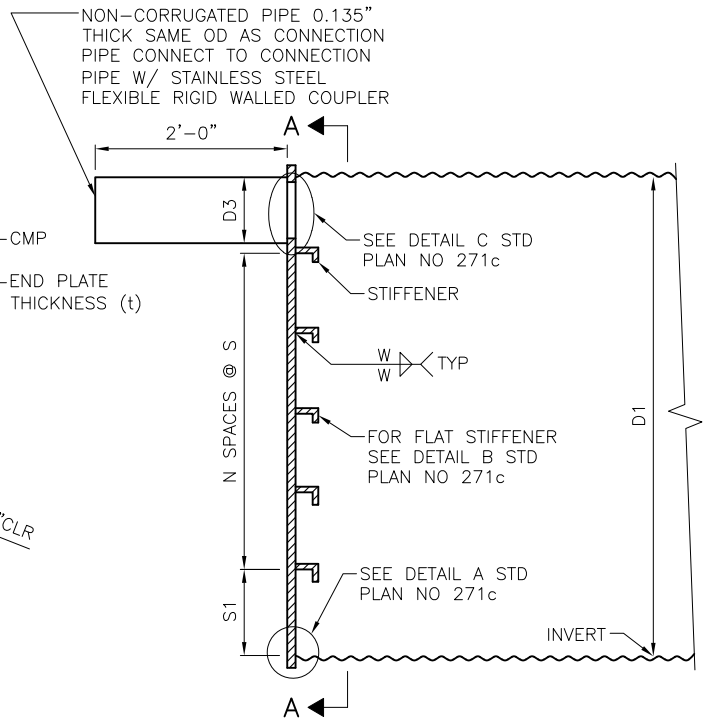

SECTION B-B

TYPE B

NOTE:

FOR D1, D2, D3 t, S, S1, N & W VALUES AND GENERAL NOTES SEE STD PLAN NO 271d


REF STD SPEC SEC 7-16




City of Seattle

NOT TO SCALE

**CMP DETENTION STRUCTURE
END PLATE DETAILS
TYPES A & B**

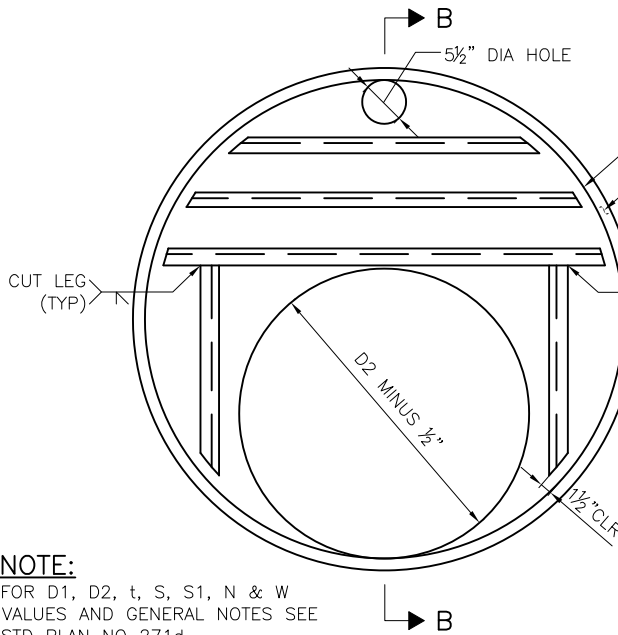


SECTION A-A

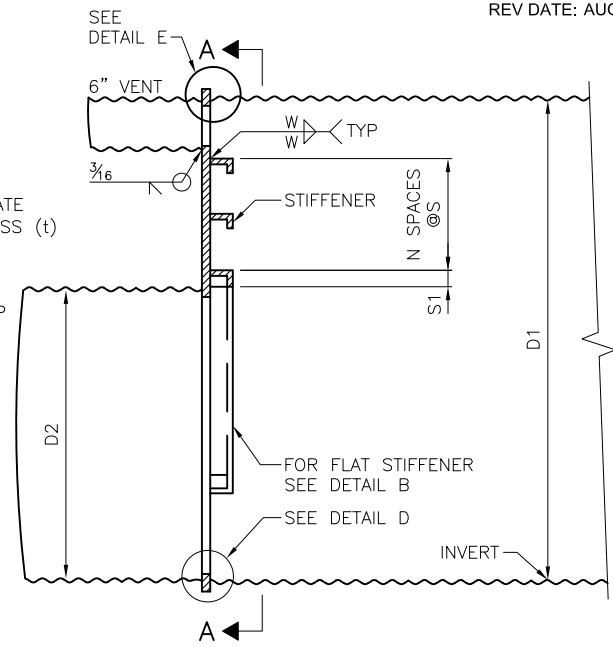

SECTION B-B

NOTE:
FOR D1, D2, t, S, S1, N & W
VALUES AND GENERAL NOTES SEE
STD PLAN NO 271d

TYPE C

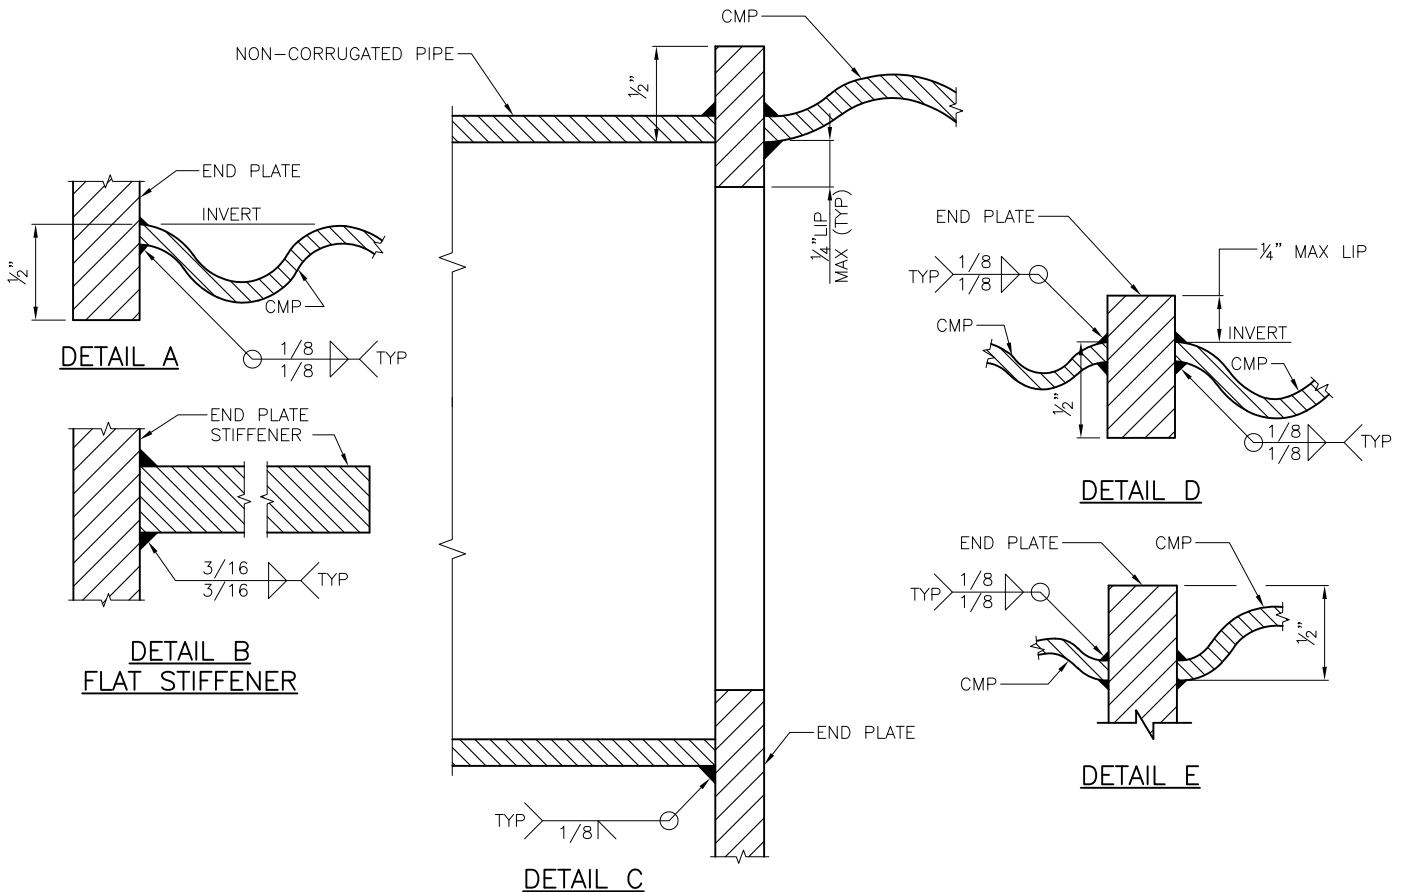

DETAIL A

DETAIL B
FLAT STIFFENER

DETAIL C

DETAIL D

DETAIL E

REF STD SPEC SEC 7-16



City of Seattle

NOT TO SCALE

**CMP DETENTION STRUCTURE
END PLATE DETAILS
TYPE C**

PIPE DIAMETER			END PLATE THICKNESS t	STIFFENER TYPE & SIZE	STIFFENER SPACING			SIZE W
D1	D2	D3			S1	S	N	
TYPE A								
30"	-	-	¼"	FLAT 2½" X ¼"	6"	6"	3	⅜"
36"	-	-	¼"	FLAT 3" X ¼"	6"	6"	4	⅜"
48"	-	-	¼"	FLAT 4¼" X ¼"	8"	8"	4	⅜"
60"	-	-	⅜"	L 2½" X 2" X ⅜"	10"	10"	4	¼"
72"	-	-	⅜"	L 3" X 3" X ⅜"	6"	10"	6	¼"
TYPE B								
30"	-	6"	¼"	FLAT 2½" X ¼"	5½"	5½"	3	⅜"
	-	8"			5"	5"	3	
	-	12"			4"	6"	2	
36"	-	6"	¼"	FLAT 3" X ¼"	6"	5½"	4	⅜"
	-	8"			6"	5"	4	
	-	12"			5½"	5½"	3	
48"	-	6"	¼"	FLAT 4¼" X ¼"	8"	8"	4	⅜"
	-	8"			6"	8"	4	
	-	12"			4"	7½"	4	
60"	-	6"	⅜"	L 2½" X 2" X ⅜"	7"	9"	5	¼"
	-	8"			10"	10"	4	
	-	12"			6"	10"	4	
72"	-	6"	⅜"	L 3" X 3" X ⅜"	8"	8"	7	¼"
	-	8"			8"	9"	6	
	-	12"			8"	10"	5	
TYPE C								
48"	30"	-	¼"	FLAT 4¼" X ¼"	2"	8"	1	⅜"
60"	36"	-	⅜"	L 2½" X 2" X ⅜"	2"	7"	2	½"
72"	36"	-	⅜"	L 2" X 3" X ⅜"	3"	8½"	3	¼"

NOTES:

- DESIGNS VALID FOR PIPE INSTALLED WITH 6'-0" OR LESS OF COVER FROM CROWN OF PIPE TO GRADE. MAXIMUM WATER SURCHARGE 3'-0" ABOVE CROWN OF PIPE
- END PLATE MATERIAL: ALUMINUM 6061-T6
- DESIGNS MUST BE USED ONLY FOR ALUMINUM CMP



REF STD SPEC SEC 7-16




City of Seattle

NOT TO SCALE


**CMP DETENTION STRUCTURE
END PLATE DIMENSIONS**

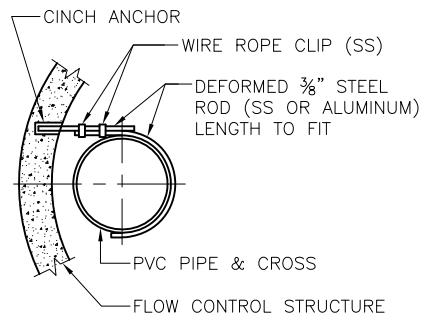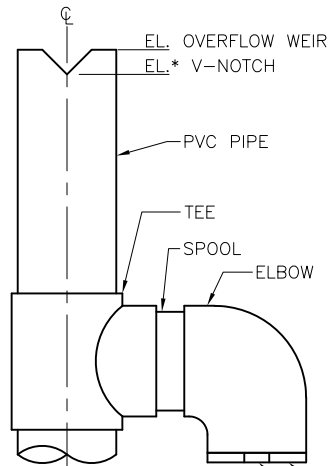

PIPE SUPPORT DETAIL

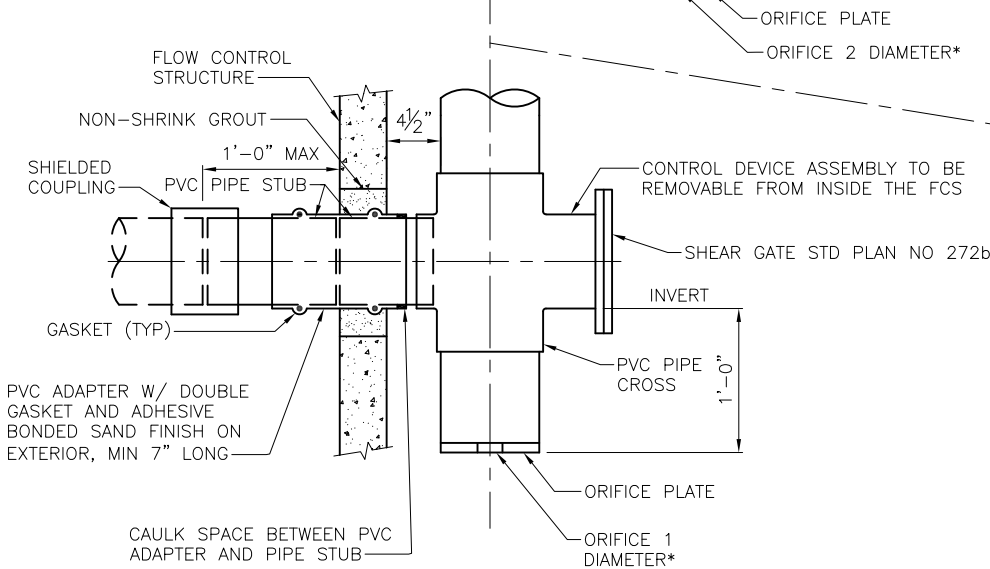

CONNECTION & CONTROL DEVICE FOR ROW USE

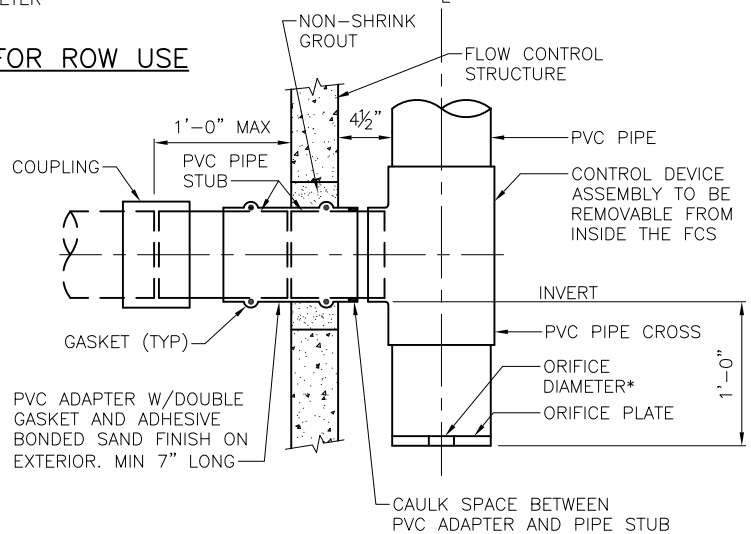

CONNECTION & CONTROL DEVICE FOR PRIVATE SYSTEM

NOTES:

1. PVC PIPE MUST BE SCHEDULE 40, PER ASTM 1785.
2. *CONSTRUCTION DRAWINGS MUST PROVIDE ELEVATION AND DIAMETER FOR ORIFICE 1 AND ORIFICE 2 AND DIMENSIONS AND ELEVATION FOR THE BOTTOM OF THE V-NOTCH WEIR AND ELEVATION FOR OVERFLOW.
3. FIELD CHANGES TO DETENTION PIPE INVERT AND SLOPE REQUIRE CONFIRMATION FROM THE ENGINEER OF RECORD THAT THE CONSTRUCTION DRAWING ELEVATIONS FOR THE FLOW CONTROL DEVICE ASSEMBLY STILL MEET THE DESIGN REQUIREMENTS.



REF STD SPEC SEC 7-16



City of Seattle



NOT TO SCALE

FLOW CONTROL DEVICE ASSEMBLY

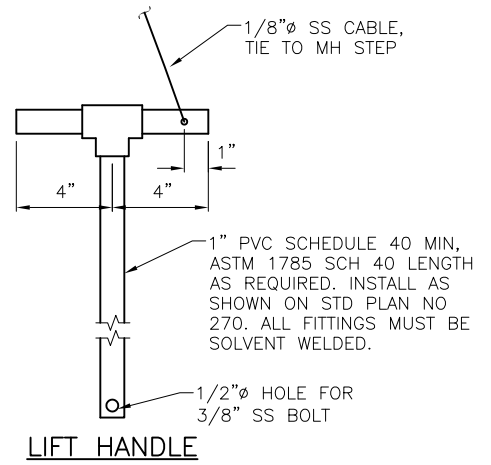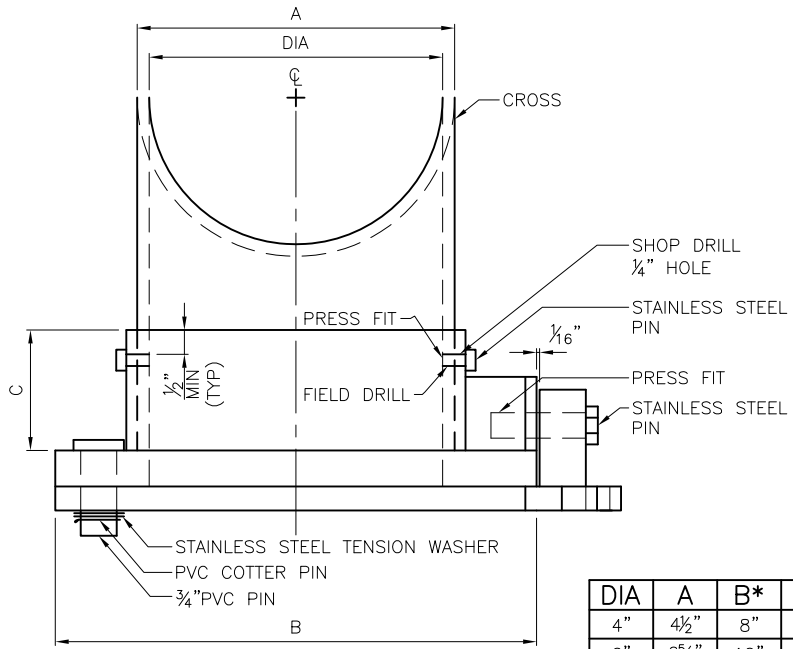

DIA	A	B*	C*
4"	4½"	8"	2"
6"	6⅝"	10"	2½"
8"	8⅞"	12"	3"
10"	10¾"	14"	3"
12"	12¾"	16"	3"

*MINIMUM DIA= OUTLET PIPE DIAMETER

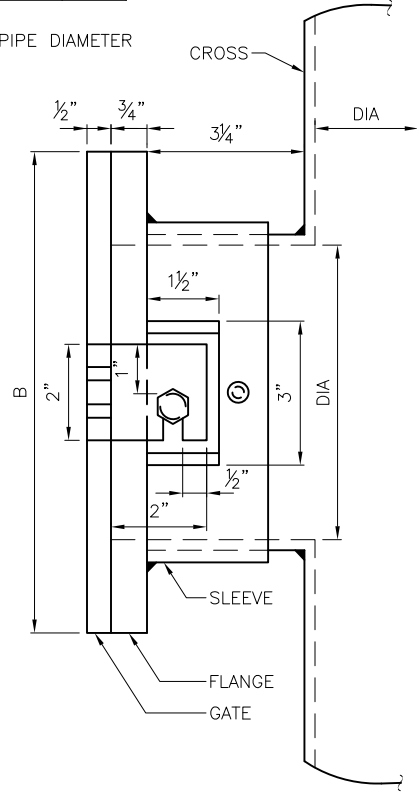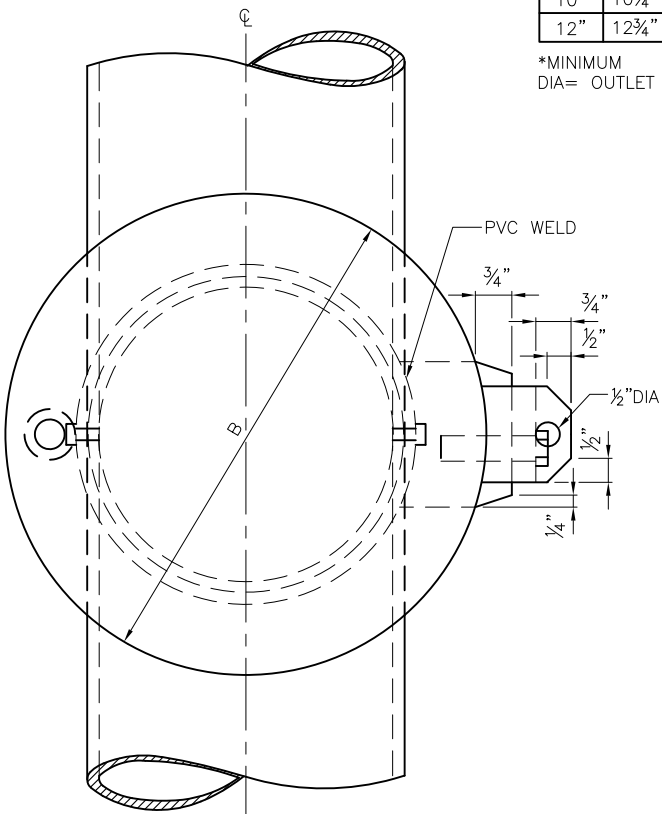

FRONT VIEW


SIDE VIEW

REF STD SPEC SEC 7-16




NOT TO SCALE

PVC SHEAR GATE FOR USE IN ROW ONLY

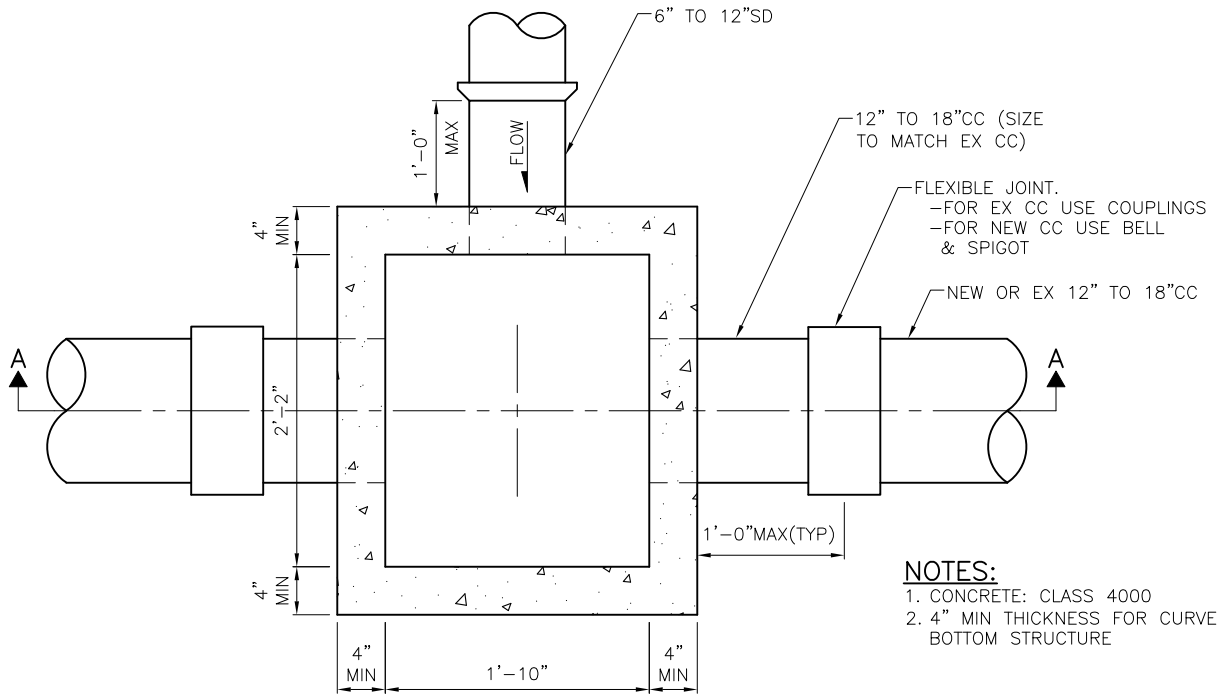

- NOTES:**
1. CONCRETE: CLASS 4000
 2. 4" MIN THICKNESS FOR CURVED BOTTOM STRUCTURE

PLAN

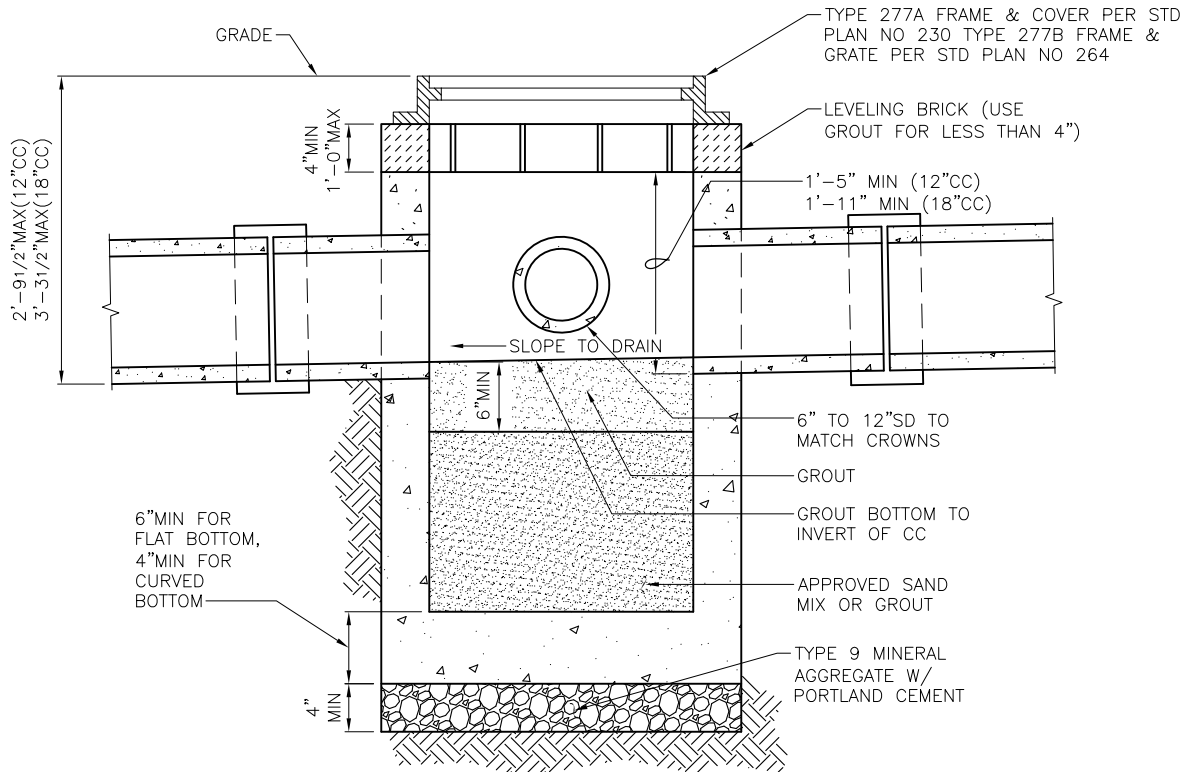

SECTION A-A


REF STD SPEC SEC 7-05



City of Seattle

NOT TO SCALE

TYPE 277 JUNCTION BOX & INSTALLATION

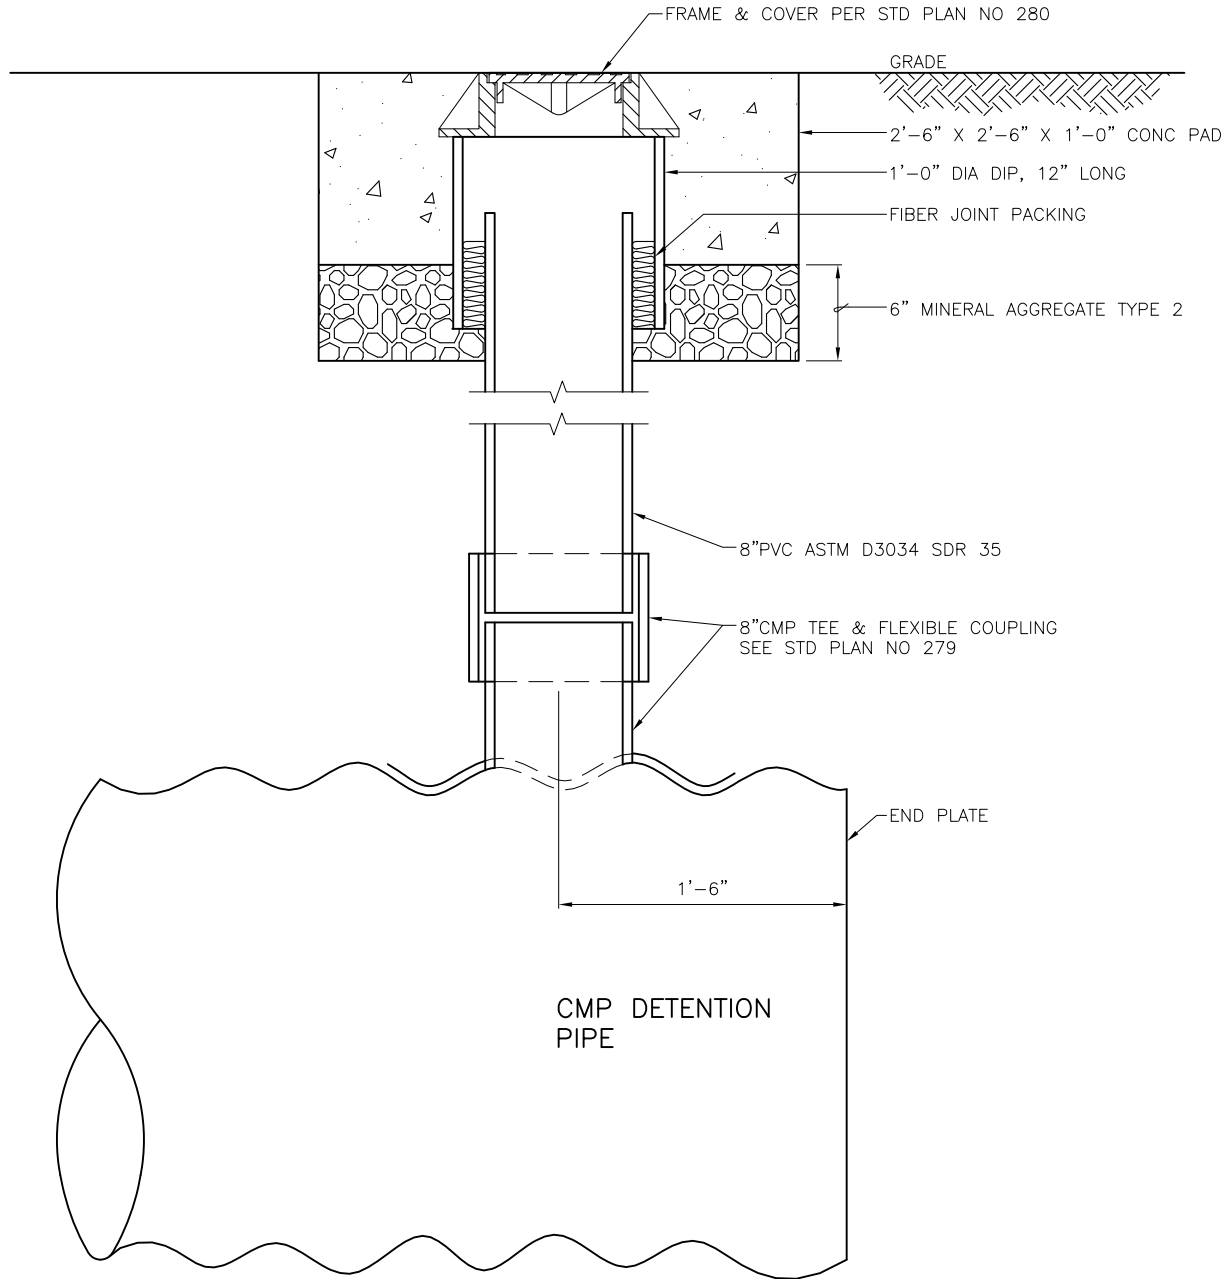



REF STD SPEC SEC 7-19, 7-16.2



City of Seattle

NOT TO SCALE

VERTICAL CLEAN OUT/
CORRUGATED METAL PIPE

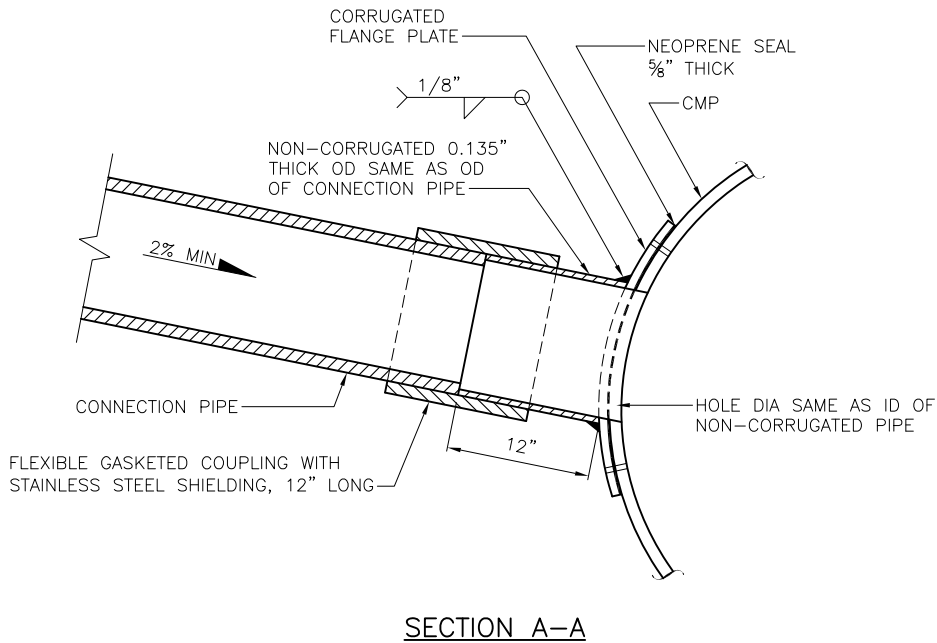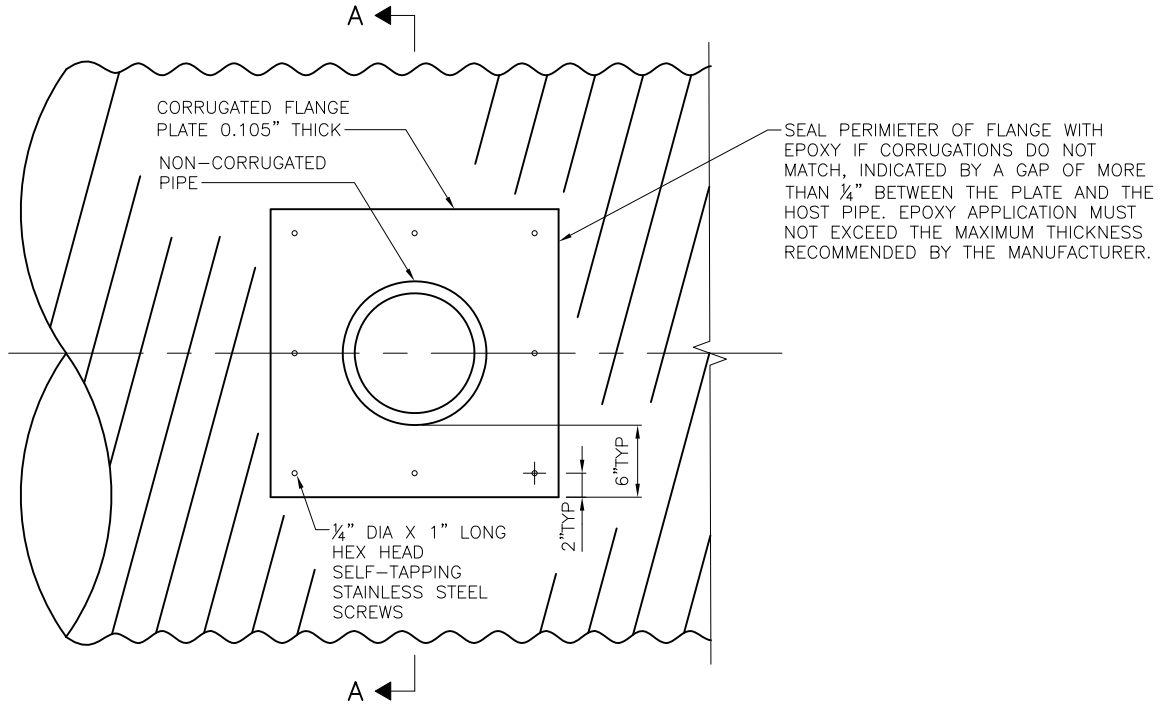

NOTES:

1. CORRUGATED FLANGE PLATE AND NON-CORRUGATED PIPE MUST BE ALUMINUM.
2. SELF-TAPPING SCREWS TO BE STAINLESS STEEL MEETING ASTM A 307.


REF STD SPEC SEC 7-17, 7-16.2



City of Seattle

NOT TO SCALE

TEE INSTALLATION
CORRUGATED METAL PIPE

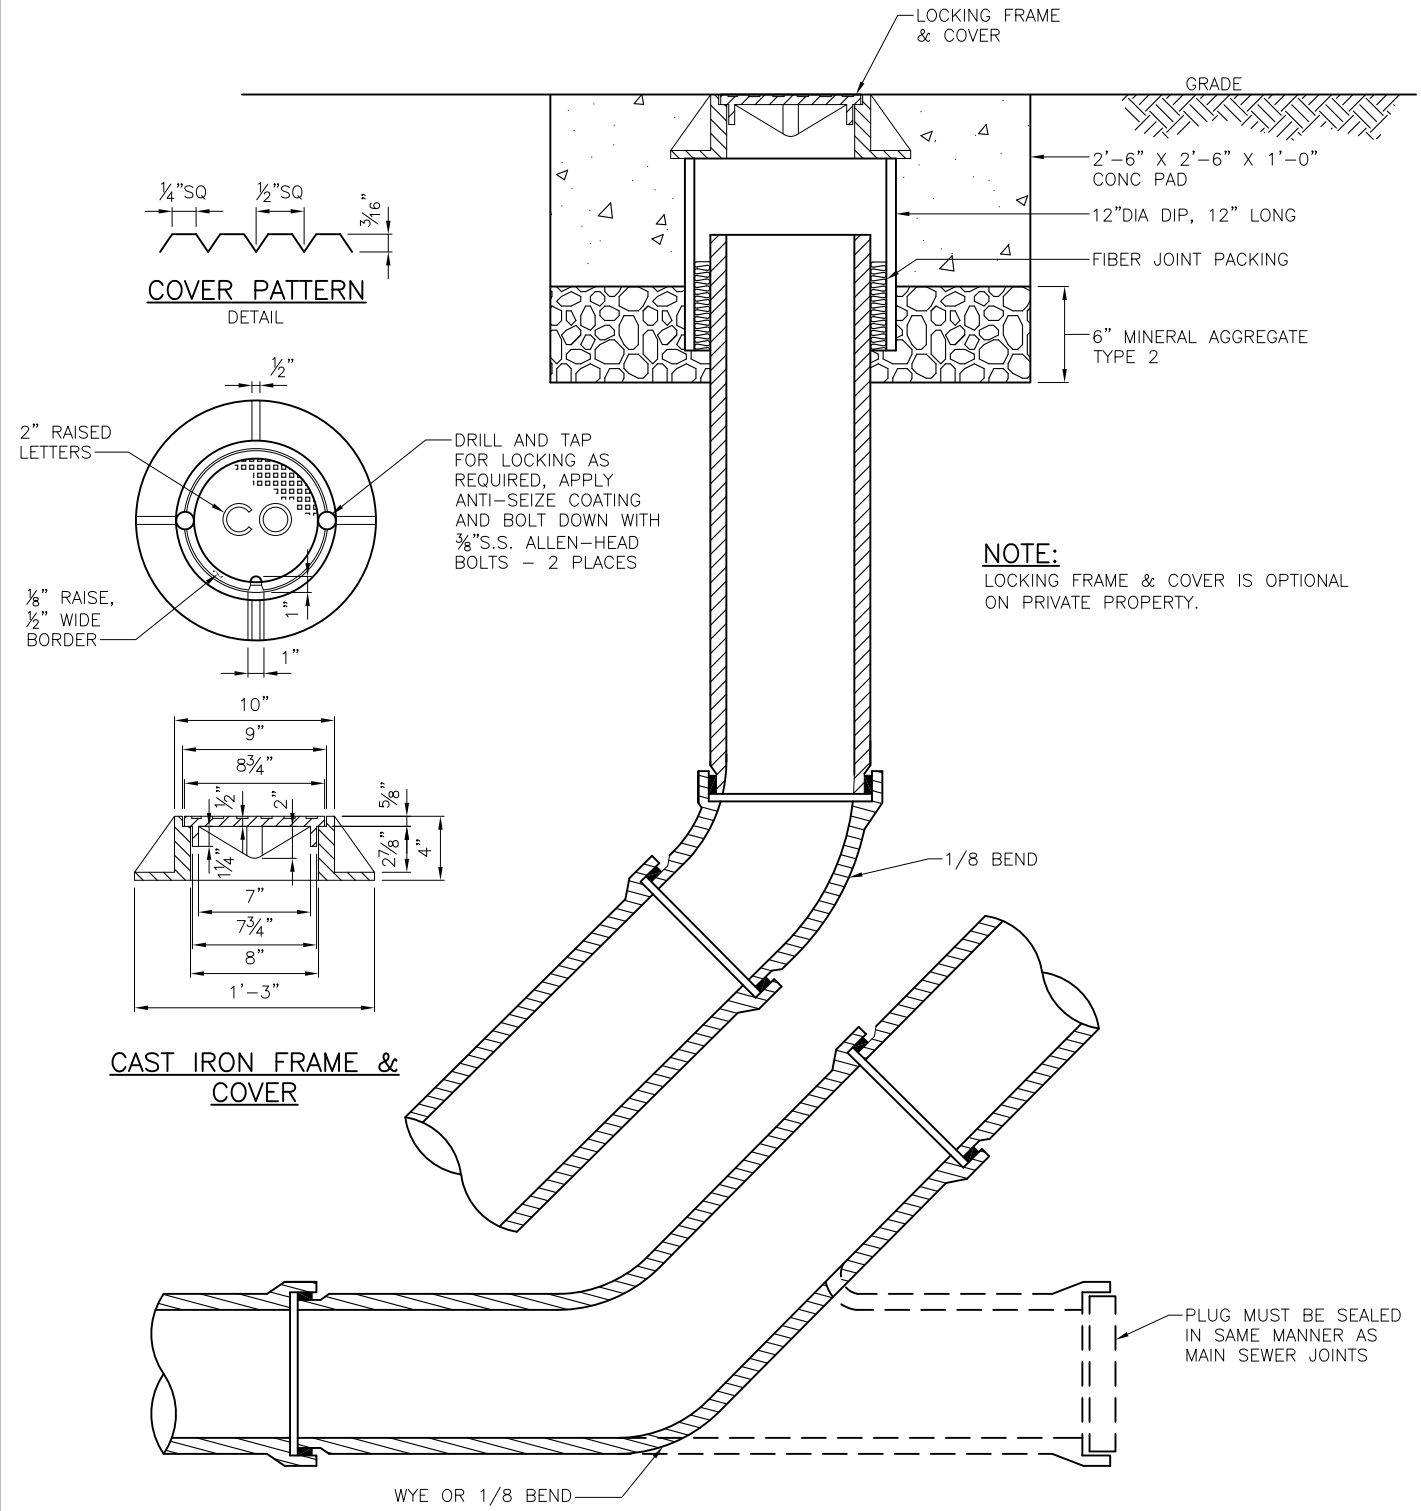


REF STD SPEC SEC 7-19







City of Seattle

NOT TO SCALE


8" CLEAN-OUT

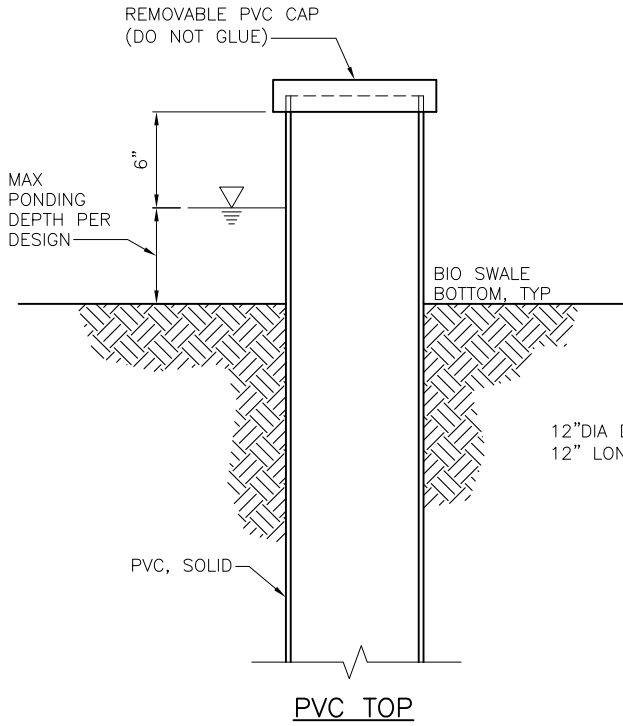

NOTE:
USE LOCKING CLEAN-OUT IN CONCRETE WALK AREAS. DRILL AND TAP, APPLY ANTI-SEIZE COATING AND BOLT DOWN WITH 3/8" S.S. ALLEN-HEAD BOLTS - 2 PLACES.

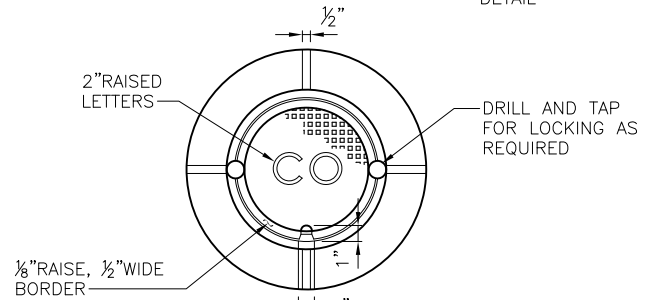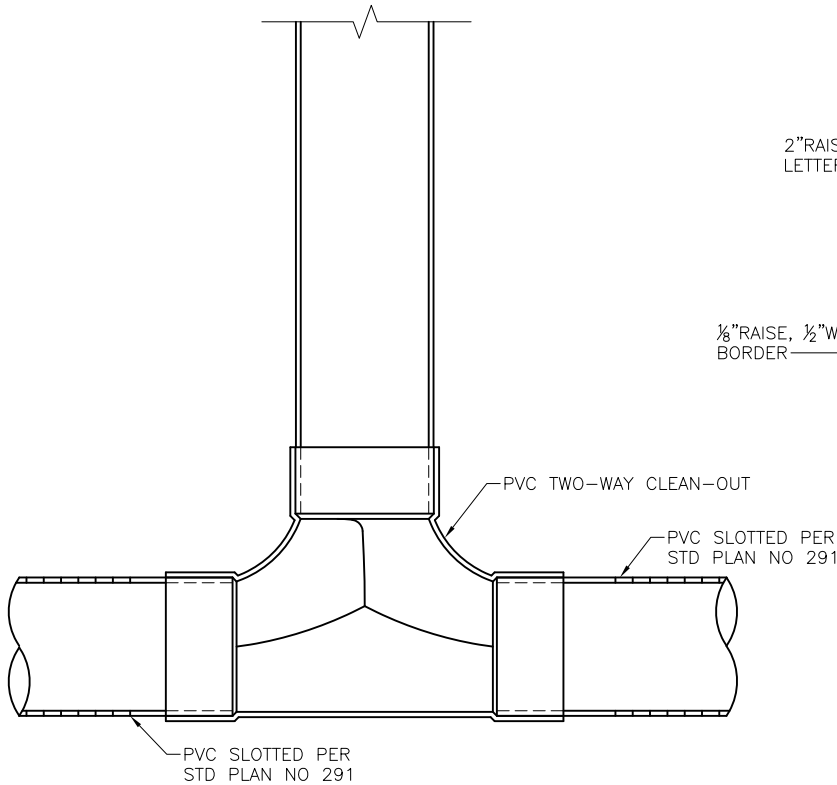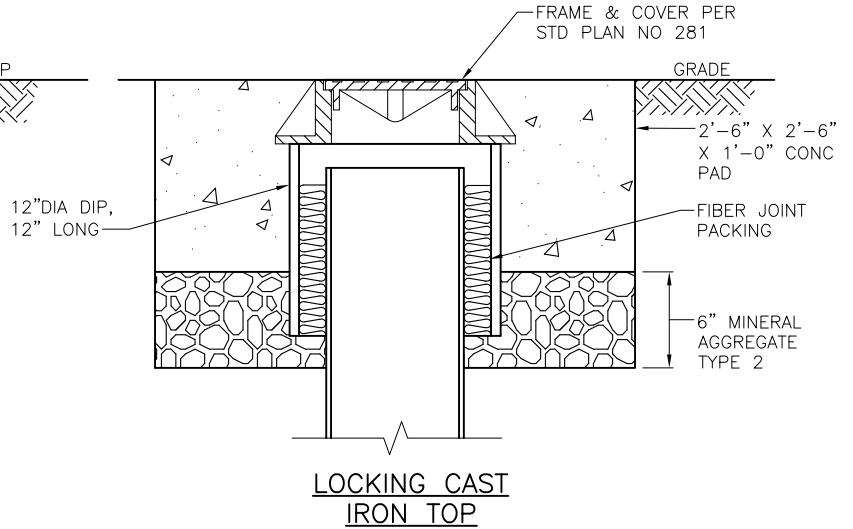

NOTE:
MINIMUM DIAMETER = 6"

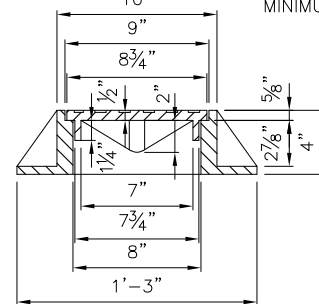

CAST IRON FRAME & COVER



REF STD SPEC SEC 7-19



City of Seattle

NOT TO SCALE

**BIORETENTION UNDER DRAIN
CLEAN-OUT AND
OBSERVATION PORT**

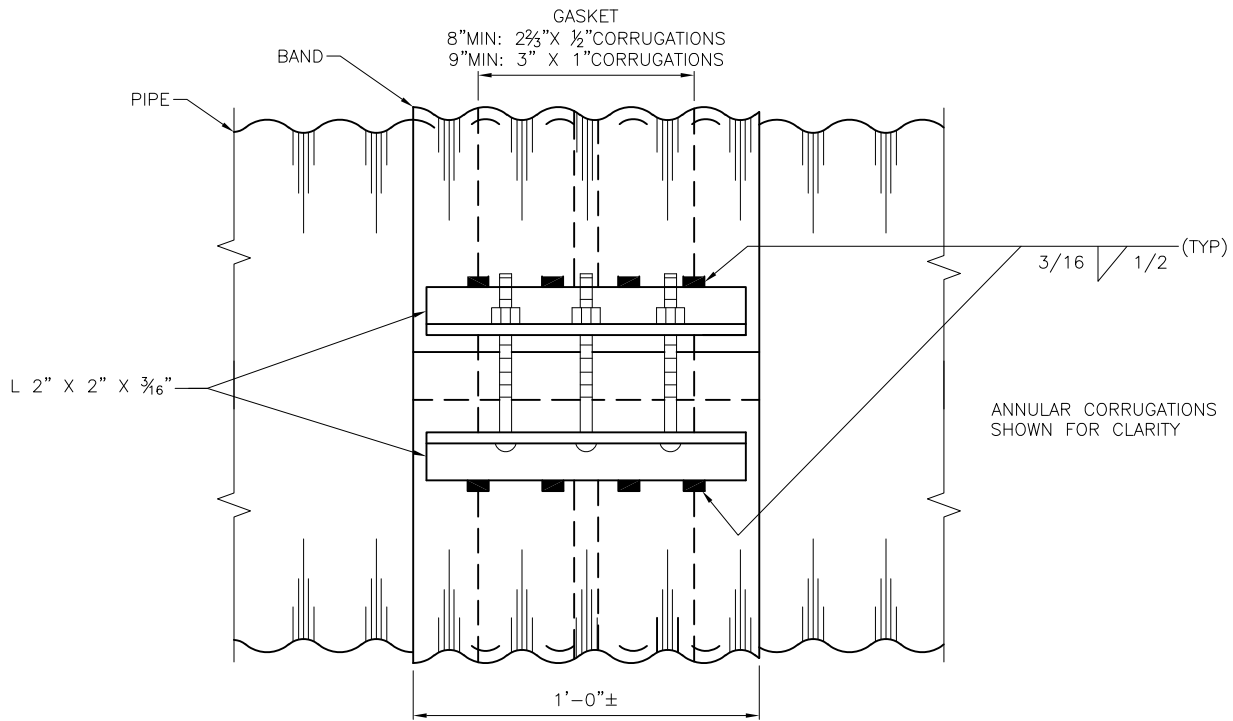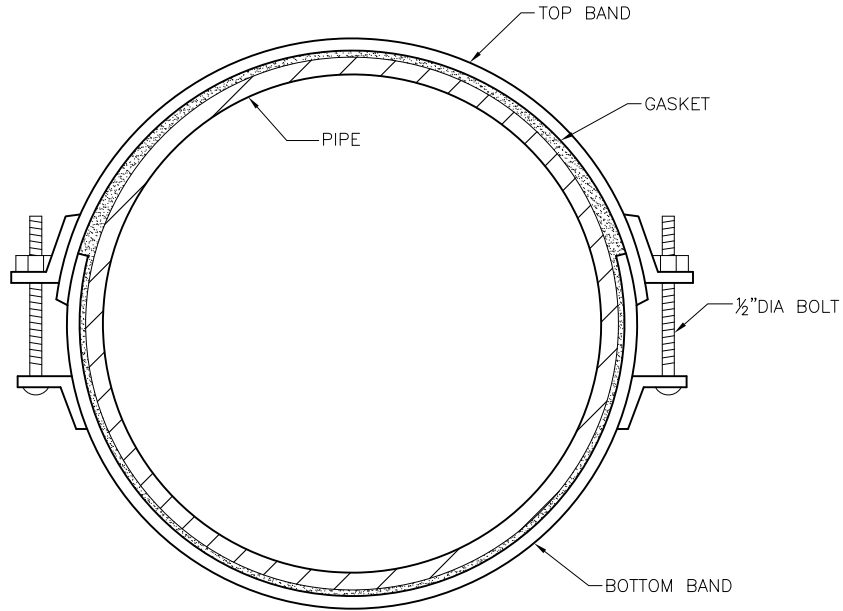

FOR PIPES LESS THAN 48" DIAMETER
(HELICAL OR ANNULAR)



REF STD SPEC SEC 7-16.2, 9-05



City of Seattle

NOT TO SCALE

CORRUGATED METAL
PIPE COUPLING BANDS

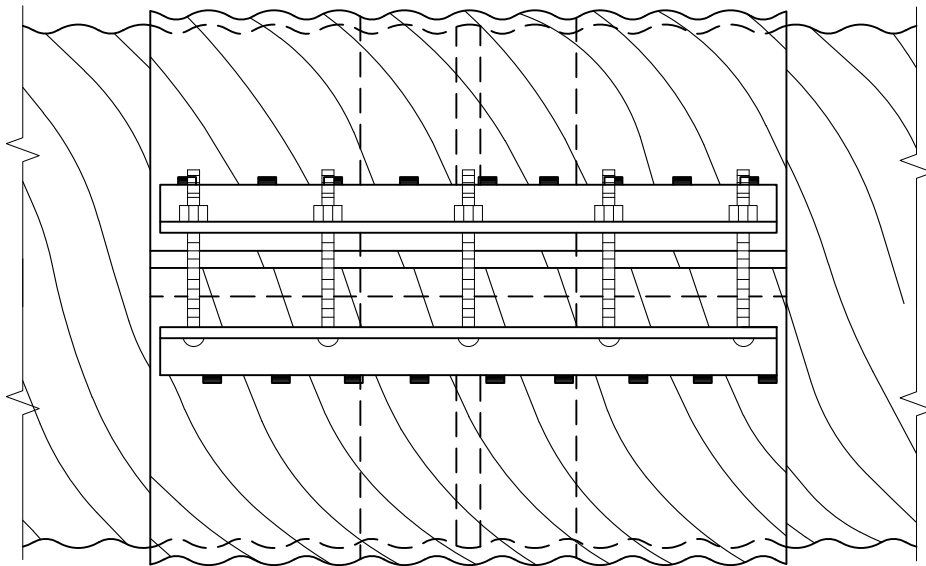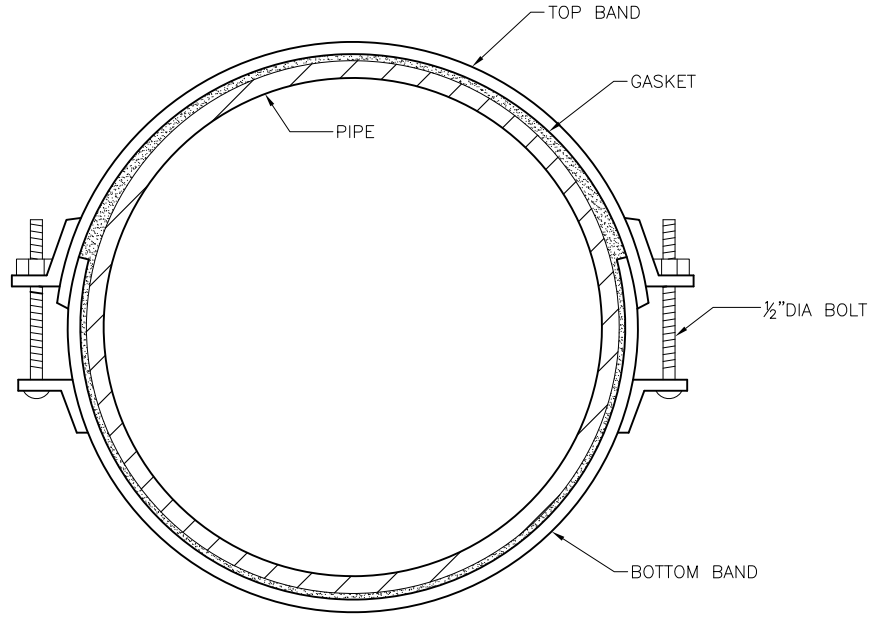


REF STD SPEC SEC 7-16.2, 9-05



City of Seattle

NOT TO SCALE

**CORRUGATED METAL
PIPE COUPLING BANDS**

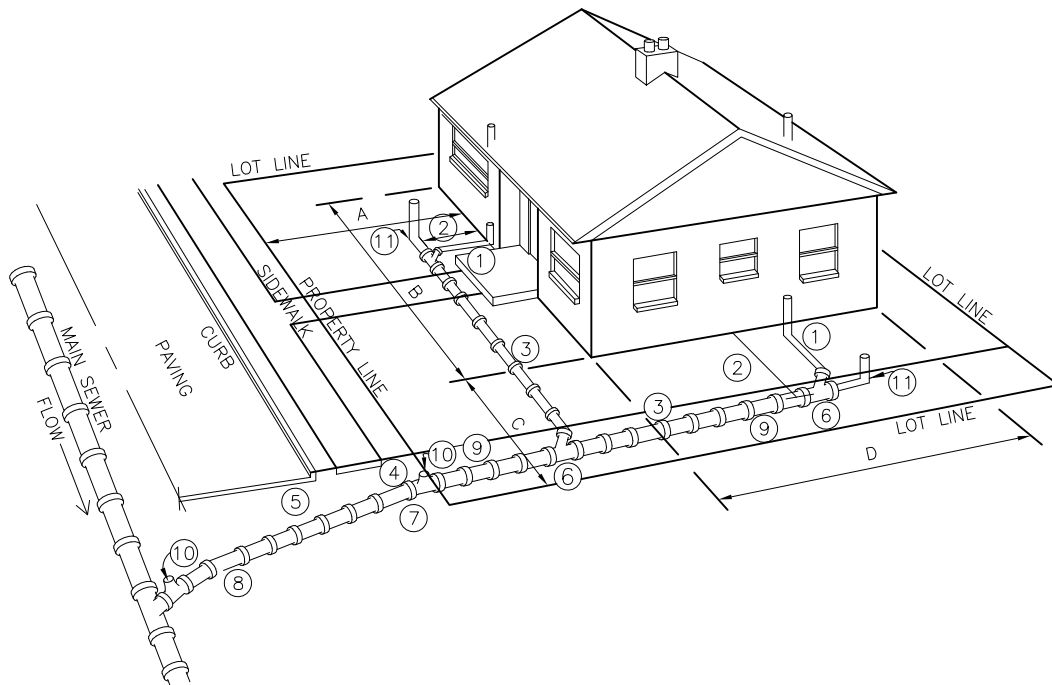

NOTES:

1. ALL SANITARY PLUMBING OUTLETS MUST BE CONNECTED TO THE SANITARY SEWER OR COMBINED SEWER.
 2. 2'-6" MIN DISTANCE FROM HOUSE, EXCEPT FOR SOIL PIPE CONNECTION.
 3. 1'-6" MIN COVER OF PIPE.
 4. 2'-6" MIN COVER AT PROPERTY LINE.
 5. 5'-0" MIN COVER AT CURB LINE.
 6. LAY PIPE IN STRAIGHT LINE BETWEEN BENDS. MAKE ALL CHANGES IN GRADE OR LINE WITH BENDS OR WYES.
 7. STANDARD 4" TO 6" INCREASER.
 8. 6" SEWER PIPE: MIN SIZE IN STREET, AND ELSEWHERE AS DIRECTED. 2% MIN GRADE, 100% MAX.
 9. 4" SEWER PIPE: MIN SIZE ON PROPERTY. 2% MIN GRADE, 100% (45°) MAX.
 10. TEST "T" WITH PLUG
 11. CLEANOUT AT UPSTREAM END OF SIDE SEWER.
- A. CONSTRUCTION IN STREET MUST BE DONE BY A REGISTERED SIDE SEWER CONTRACTOR.
 B. ALL CONSTRUCTION MUST BE IN ACCORDANCE WITH THE CURRENT SIDE SEWER ORDINANCE.


REF STD SPEC SEC 7-18



City of Seattle

NOT TO SCALE

SIDE SEWER INSTALLATION

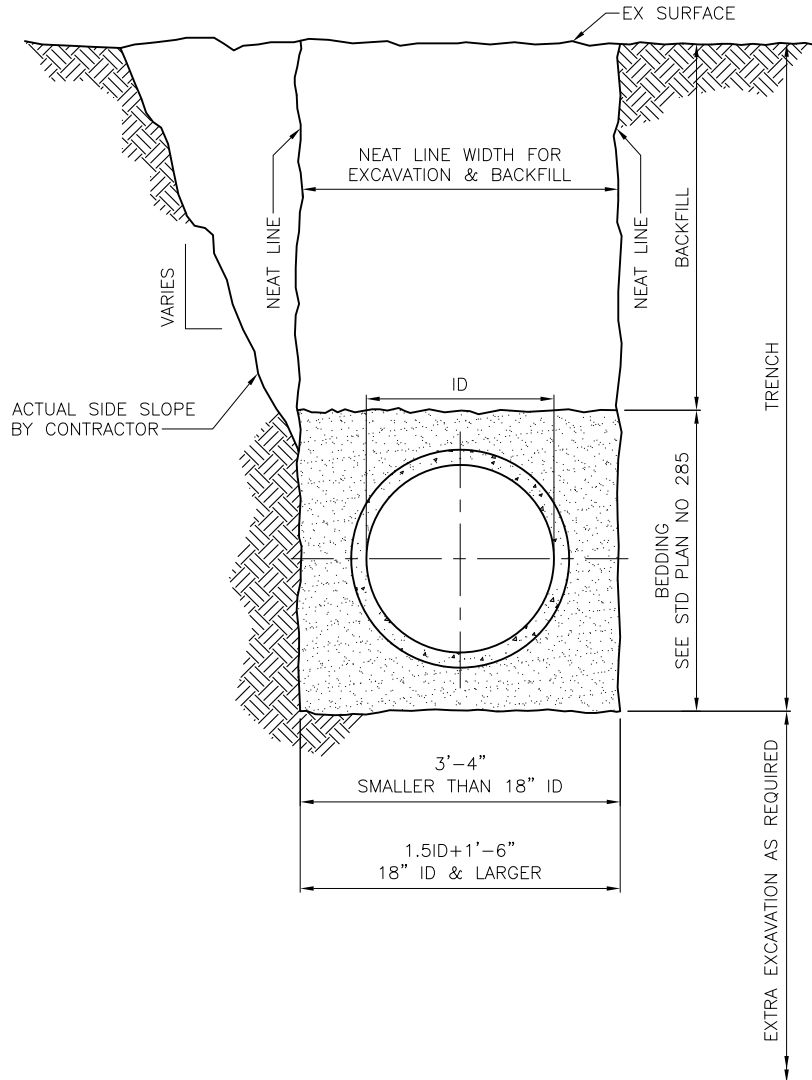


REF STD SPEC SEC 2-07, 7-17




City of Seattle

NOT TO SCALE


TYPICAL TRENCH DETAIL
FOR SEWER & STORM DRAIN

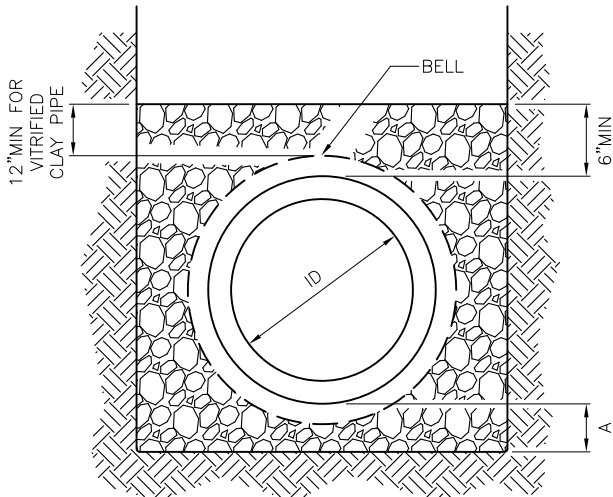


CLASS B BEDDING

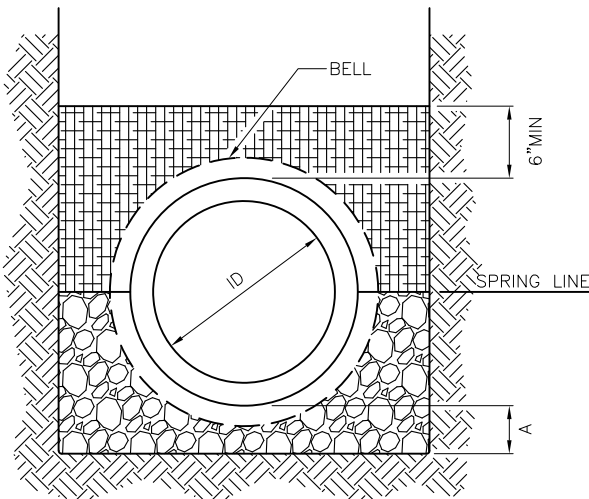

CLASS C BEDDING




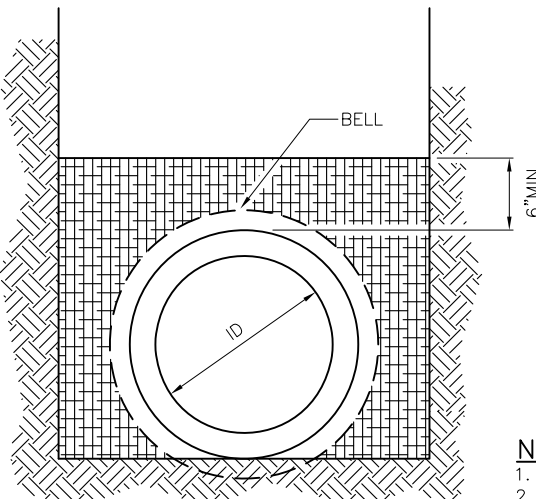



CLASS D BEDDING

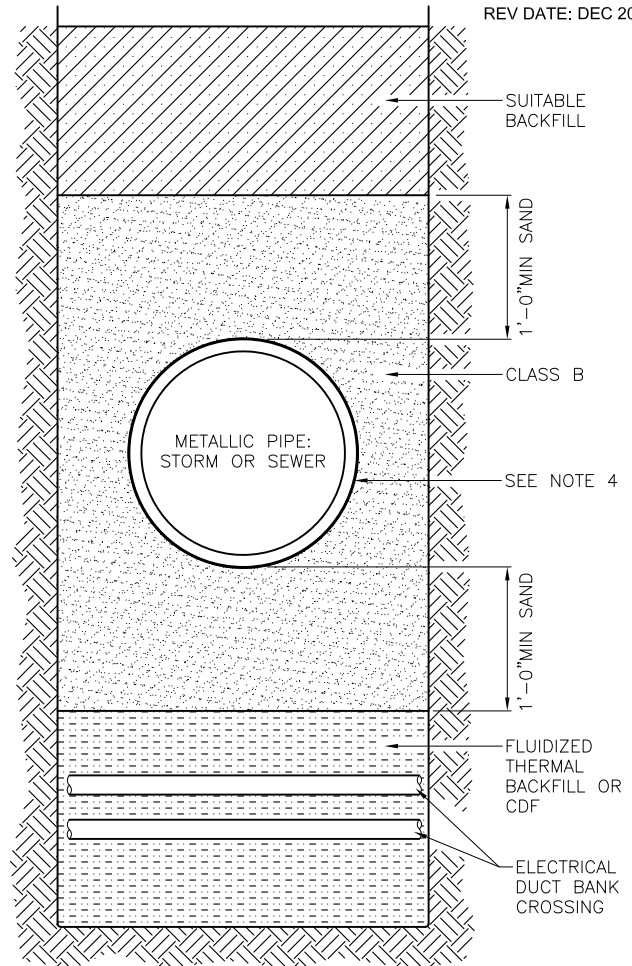

SAND BEDDING AT TRENCH CROSSING OF METAL PIPE

AT METALLIC PIPE CROSSING OF FLUIDIZED THERMAL BACKFILL OR CDF CONDUIT CROSSINGS

-  MINERAL AGGREGATE PER STD SPEC 9-03.14 TYPE 9 FOR DUCTILE IRON WHEN APPLICABLE OR CONCRETE PIPE TYPE 22 FOR VITRIFIED CLAY AND FLEXIBLE PIPE
-  SELECTED NATIVE MATERIAL PER STD SPEC 2-10.2(1)
-  SUITABLE BACKFILL
-  FLUIDIZED THERMAL BACKFILL PER SCL MATERIAL STD 7150.00 OR CDF (SEE CONTRACT DRAWINGS)
-  MINERAL AGGREGATE PER STD SPEC 9-03.14, TYPE 6 OR TYPE 7

NOTES:

1. FOR TRENCH WIDTH SEE STD PLAN NO 284
2. A=4"WHEN ID IS LESS THAN 2'-6", A=6"WHEN ID IS 2'-6"OR MORE.
3. UNIFORMLY SUPPORT PIPE BARREL. EXCAVATE HOLES FOR BELLS AND COUPLING.
4. FOR FLUIDIZED THERMAL BACKFILL (FTB) OR CDF CROSSINGS OF METALLIC PIPE, WRAP METALLIC PIPE IN 8 MIL POLYETHYLENE ENCASEMENT FOR FULL TRENCH WIDTH.


REF STD SPEC SEC 2-10.2, 7-17




City of Seattle

NOT TO SCALE


**PIPE BEDDING
SEWER/STORM DRAIN**

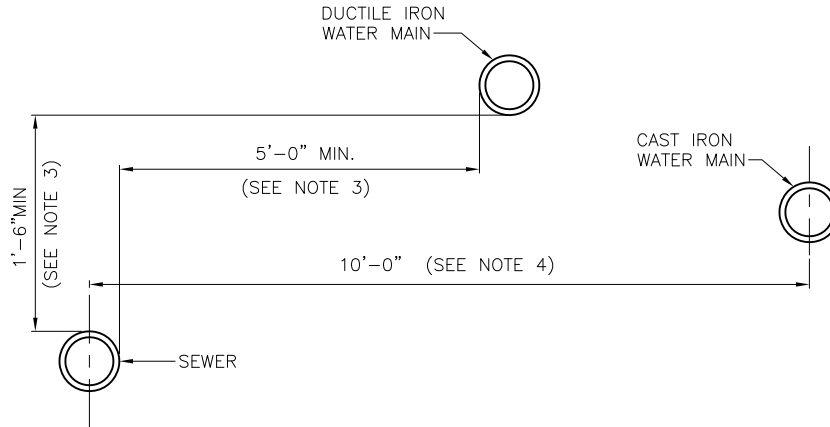

PARALLEL INSTALLATION

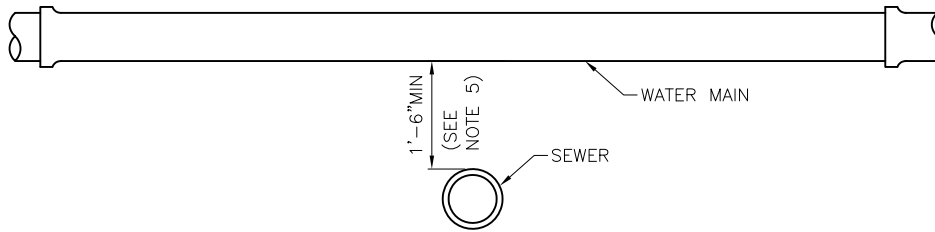

CROSSING WATER OVER SEWER

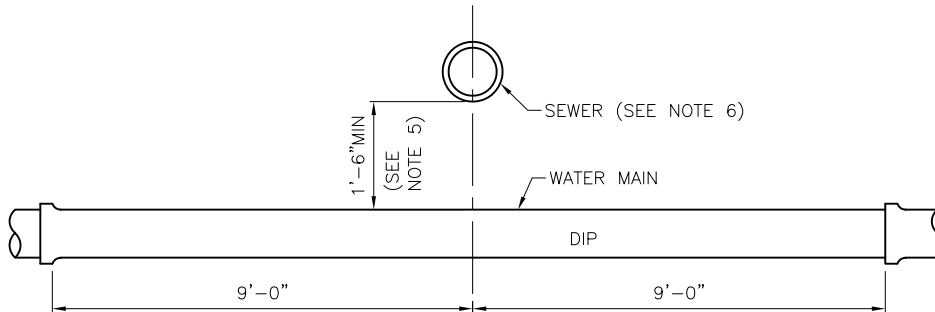

STANDARD SINGLE 18'-0" NOMINAL LENGTH DUCTILE IRON WATER MAIN SECTION CENTERED AT THE POINT OF CROSSING

CROSSING WATER UNDER SEWER

NOTES:

1. EXCEPTIONS TO STD PLAN NO 286 MUST BE APPROVED BY SEATTLE PUBLIC UTILITIES, WATER QUALITY DIVISION.
2. "SEWER" INCLUDES SANITARY SEWER, COMBINED SEWER AND SIDE SEWER.
3. WHERE MINIMUM CLEARANCES CANNOT BE MET, SEWER MUST BE CONSTRUCTED OF MATERIALS AND WITH JOINTS THAT ARE EQUIVALENT TO WATER MAIN STANDARDS INCLUDING WATER MAIN PRESSURE TESTING REQUIREMENTS.
4. NO VERTICAL CLEARANCE REQUIRED.
5. IF MINIMUM VERTICAL SEPARATION CANNOT BE MET, WATER MAIN MUST BE A STANDARD SINGLE 18'-0" NOMINAL LENGTH DUCTILE IRON WATER MAIN SECTION CENTERED AT THE POINT OF CROSSING.
6. SEWER MUST HAVE ADEQUATE FOUNDATION SUPPORT TO PREVENT SETTLEMENT ON THE WATER MAIN AND TO PREVENT DEFLECTION OF WATER MAIN JOINTS.
7. CROSSINGS AT AN ANGLE BETWEEN 90° AND 45° MAY OCCUR BETWEEN 9'-0" AND 6'-0" OF WATER MAIN JOINT. FOR CROSSINGS LESS THAN 45°, SEE NOTE 1.


REF STD SPEC SEC 1-07.17, 7-11



City of Seattle

NOT TO SCALE

SEWER & WATER
SPACING & CLEARANCES

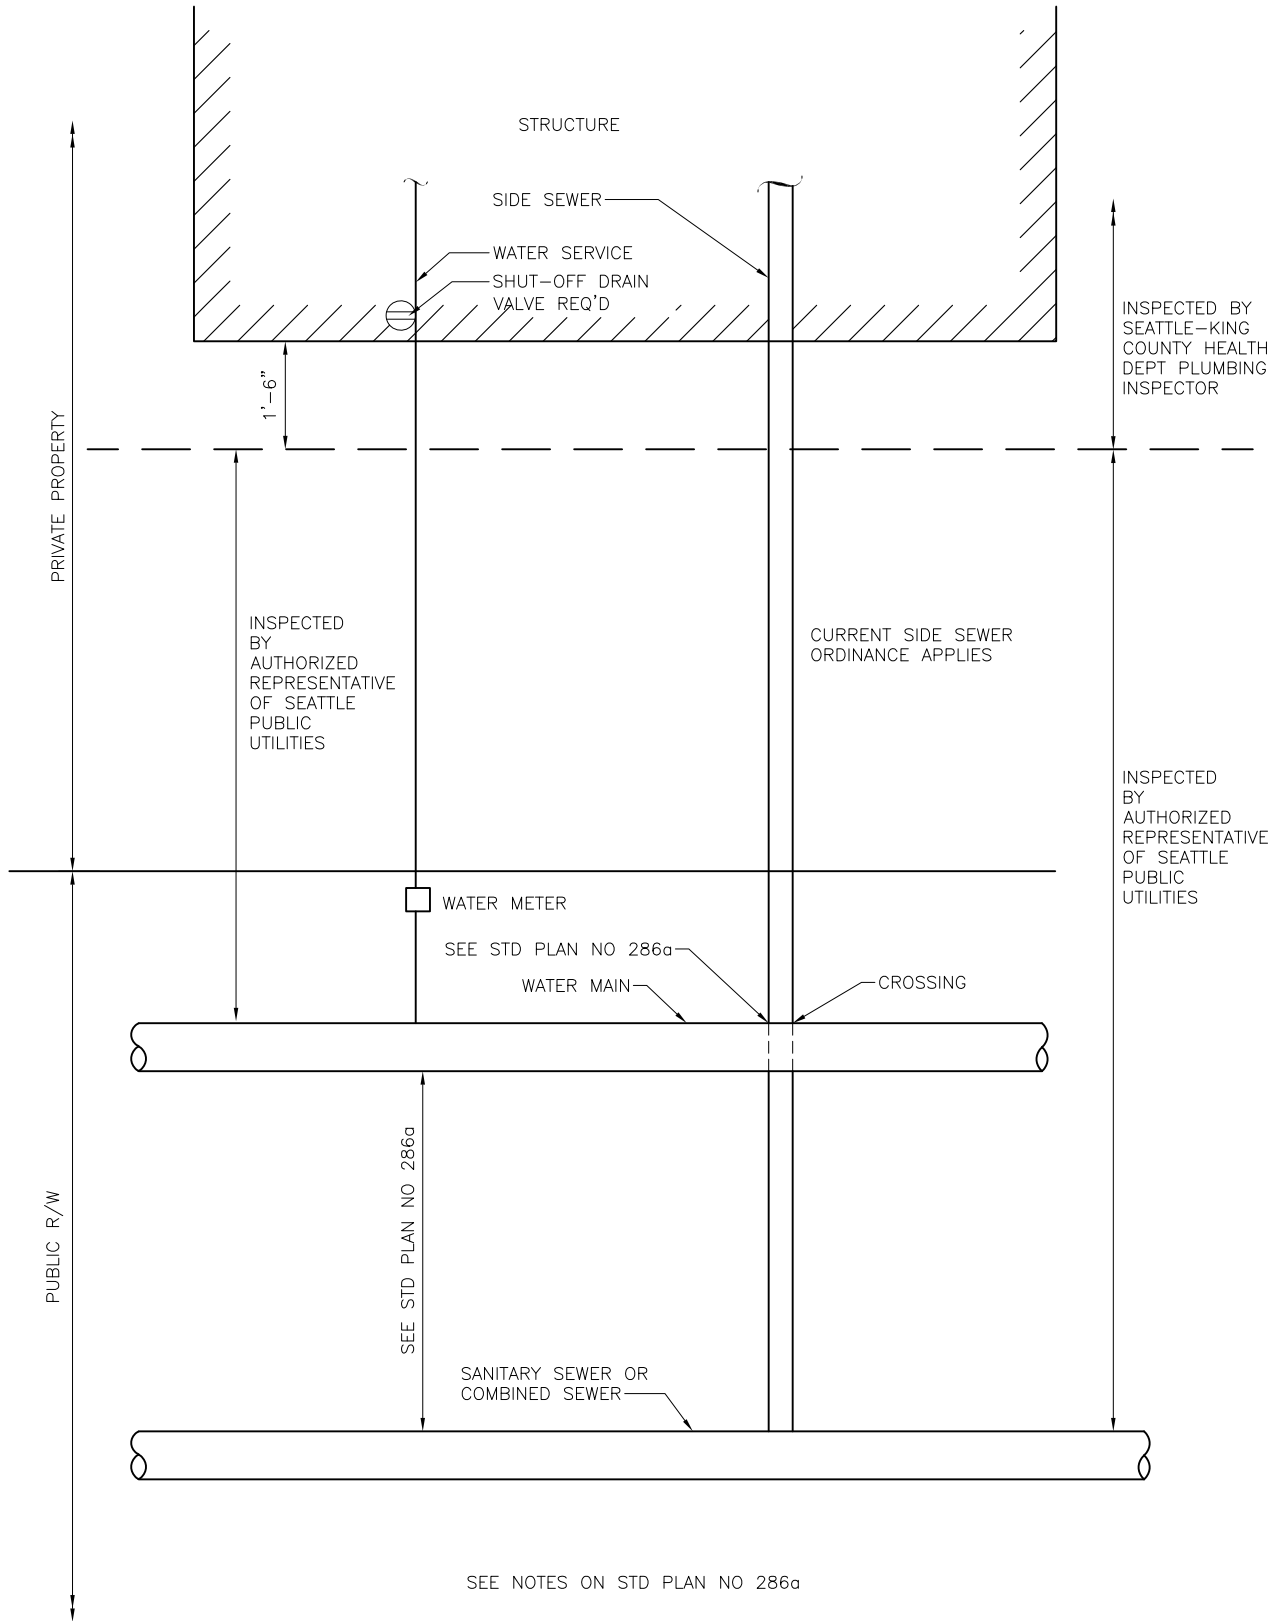


REF STD SPEC SEC 1-07.17, DIV 7



City of Seattle


NOT TO SCALE

SEWER & WATER
SPACING & CLEARANCES

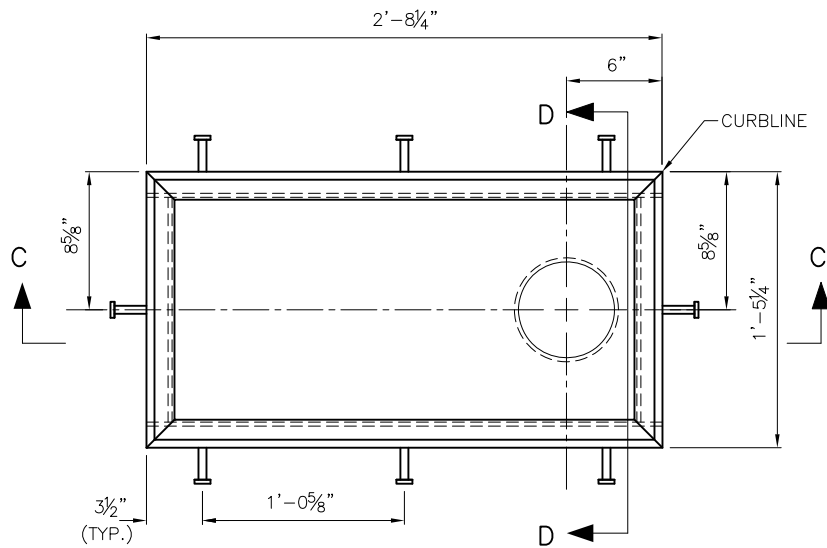


PLAN VIEW – BRIDGE DRAIN

SURFACE FLOW DIRECTION →

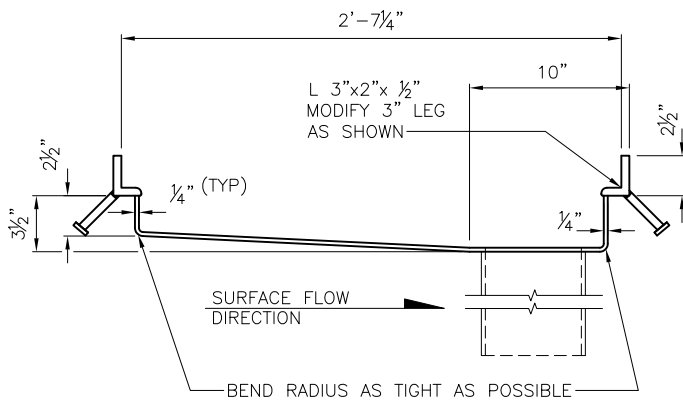

SECTION C-C

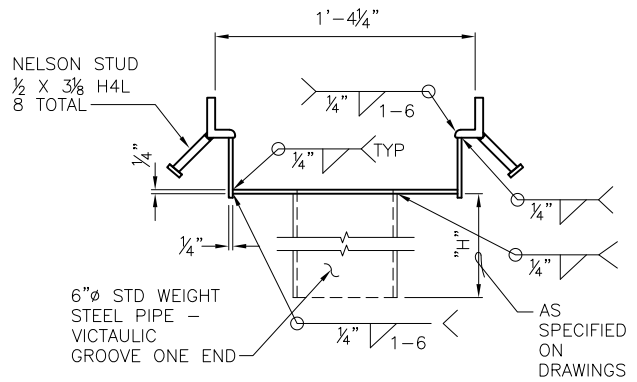

SECTION D-D

NOTES:

1. ALL 1/4" STEEL & L3"x 2"x 1/2" TO BE A-36.
2. 6"Ø PIPE TO BE STANDARD WEIGHT STEEL.
3. AFTER FABRICATION, DRAIN ASSEMBLY TO BE HOT DIP GALVANIZED.
4. VANED GRATE TO BE PER STD PLAN NO 265.


REF STD SPEC SEC 6-01, 7-05



City of Seattle

NOT TO SCALE

BRIDGE DRAIN

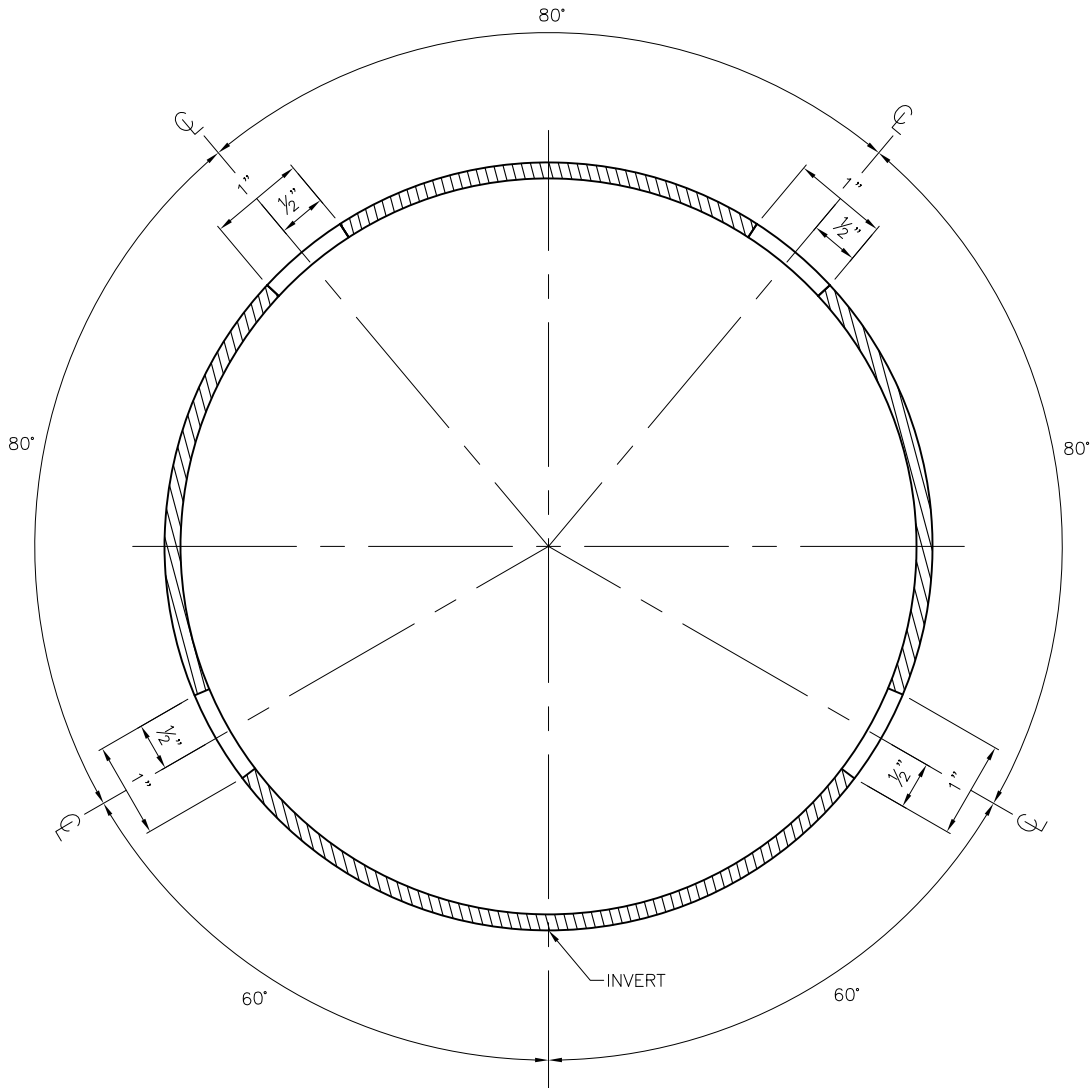

NOTES:

1. ASTM D 2241 SDR 21 CLASS 200 PVC PIPE OR
ASTM D 1785 SCH 40.
2. SLOT DIMENSIONS ARE 0.064" WIDE X 1.00" LONG
SPACED ALONG PIPE AT 0.3" ON CENTER.



REF STD SPEC SEC 9-05.4(1)




City of Seattle

NOT TO SCALE

PVC SUBSURFACE DRAIN PIPE

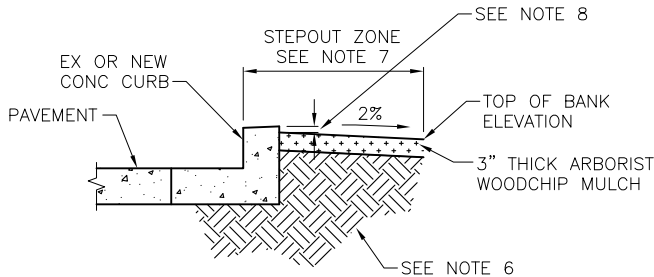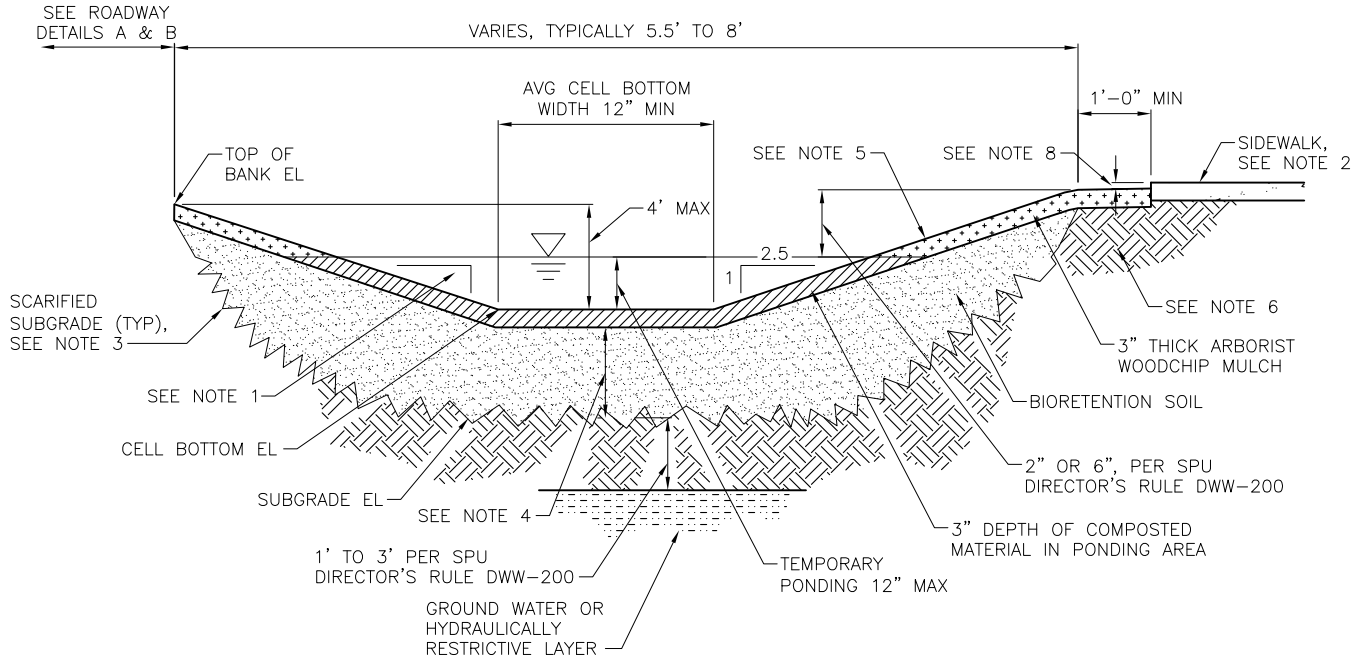

DETAIL A
CURBED ROADWAY
(ADJACENT TO PARKING ZONE)

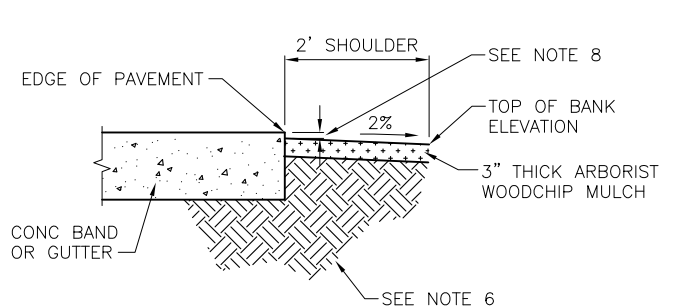

DETAIL B
CURBLESS ROADWAY

NOTES:

1. TYPICAL MAXIMUM SLOPE ALLOWED IS 2.5H=1V, 3H=1V MAX WHEN WITHIN 50- FEET OF INTERSECTIONS OR CURBLESS ROADWAY.
2. BIORETENTION OVERFLOW ELEVATIONS MUST BE SET BELOW SIDEWALK ELEVATION.
3. SCARIFY SUBGRADE AS SPECIFIED IN SPEC SECTION 7-21.3(2)B IN THE AREA SUBJECT TO TEMPORARY PONDING BEFORE BIORETENTION SOIL INSTALLATION.
4. 12" MIN OR 18" MIN IF WATER QUALITY TREATMENT IS REQUIRED PER STORMWATER CODE REQUIREMENT.
5. CELL MUST BE PLANTED PER APPROVED LANDSCAPE PLAN.
6. SOIL UNDER SHOULDERS OR PAVED AREAS MUST BE UNDISTURBED NATIVE SOIL OR APPROVED FILL COMPACTED TO 95% DENSITY.
7. FACE OF CURB TO TOP OF SLOPE MUST BE MIN 2'-0" FOR NON-MAJOR ARTERIAL STREET, MIN 4'-0" FOR MAJOR ARTERIAL STREET.
8. PROVIDE MIN ONE INCH GAP BETWEEN TOP OF WALKS, CURBS, PAVEMENTS AND DRIVEWAYS AND TOP OF ARBORIST WOODCHIP MULCH.


REF STD SPEC SEC 7-21



City of Seattle

NOT TO SCALE

**INFILTRATING BIORETENTION
WITH SLOPED SIDES**

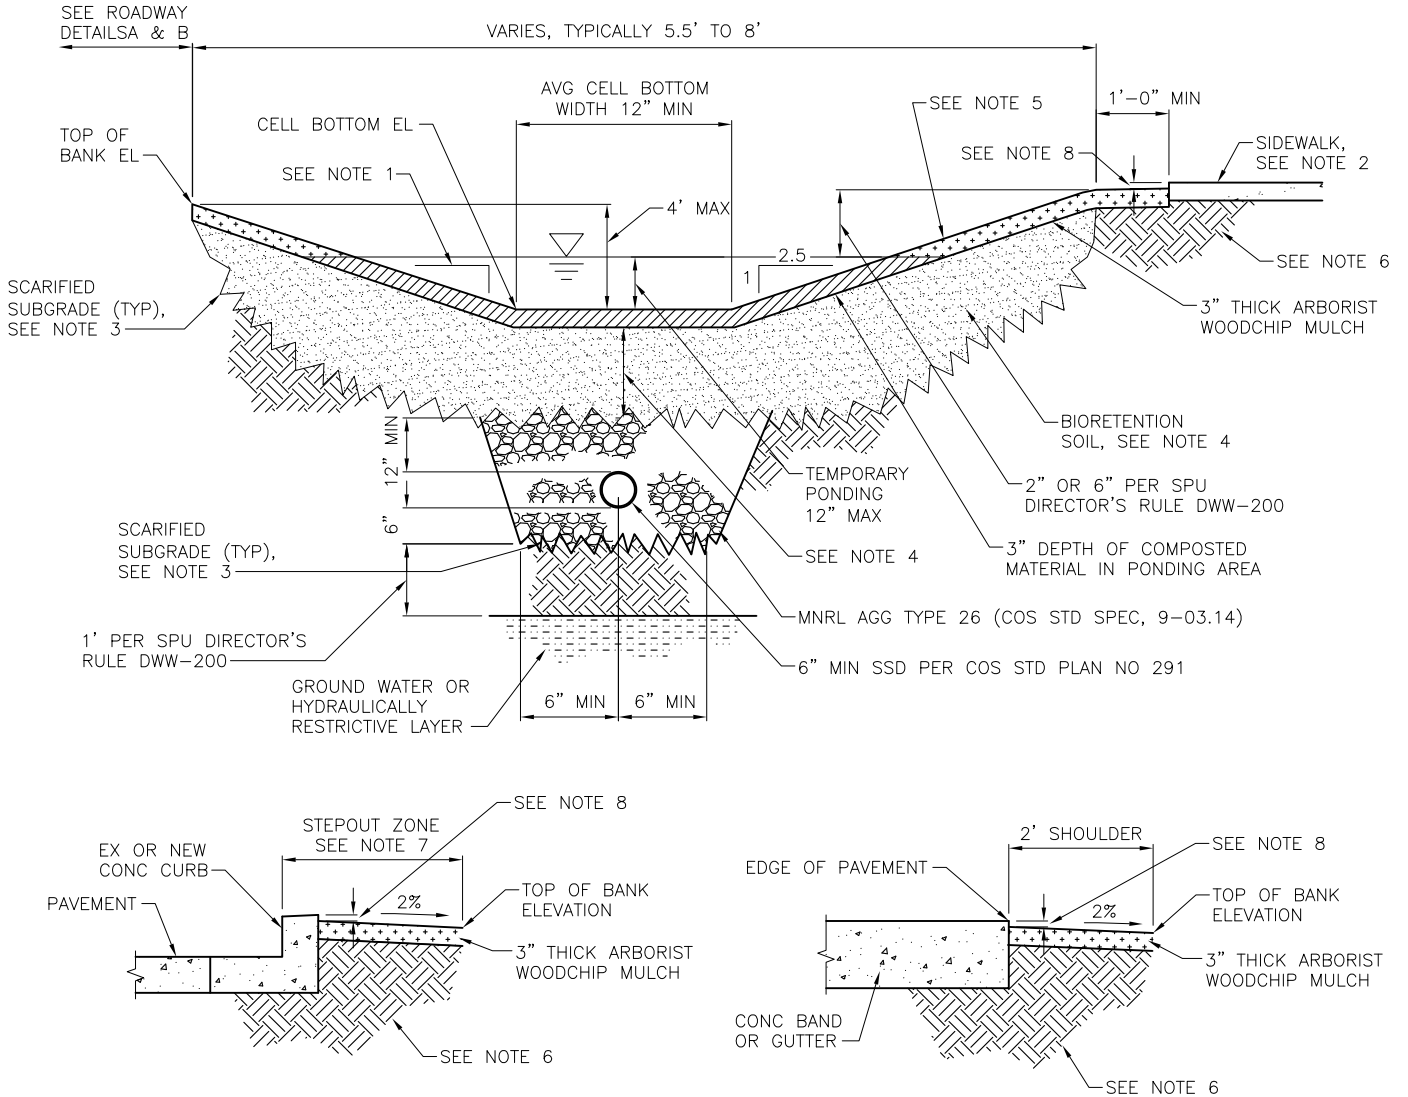

DETAIL A
CURBED ROADWAY
(ADJACENT TO PARKING ZONE)

DETAIL B
CURBLESS ROADWAY

NOTES:

1. TYPICAL MAXIMUM SLOPE ALLOWED IS 2.5H=1V, 3H=1V MAX WHEN WITHIN 50- FEET OF INTERSECTIONS OR CURBLESS ROADWAY.
2. BIORETENTION OVERFLOW ELEVATIONS MUST BE SET BELOW SIDEWALK ELEVATION.
3. SCARIFY SUBGRADE AS SPECIFIED IN SPEC SECTION 7-21.3(2)B IN THE AREA SUBJECT TO TEMPORARY PONDING BEFORE BIORETENTION SOIL INSTALLATION.
4. 12" MIN OR 18" MIN IF WATER QUALITY TREATMENT IS REQUIRED PER STORMWATER CODE REQUIREMENT.
5. CELL MUST BE PLANTED PER APPROVED LANDSCAPE PLAN.
6. SOIL UNDER SHOULDERS OR PAVED AREAS MUST BE UNDISTURBED NATIVE SOIL OR APPROVED SOIL COMPACTED TO 95% DENSITY.
7. FACE OF CURB TO TOP OF SLOPE MUST BE MIN 2'-0" FOR NON-MAJOR ARTERIAL STREET, MIN 4'-0" FOR MAJOR ARTERIAL STREET.
8. PROVIDE MIN ONE INCH GAP BETWEEN TOP OF WALKS, CURBS, PAVEMENTS AND DRIVEWAYS AND TOP OF ARBORIST WOODCHIP MULCH.



REF STD SPEC SEC 7-21




City of Seattle

NOT TO SCALE

**INFILTRATING BIORETENTION
WITH SLOPED SIDES
& UNDER DRAIN**

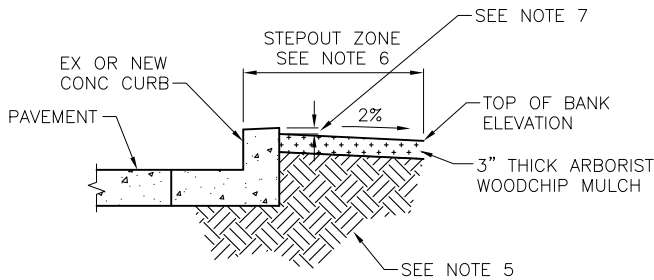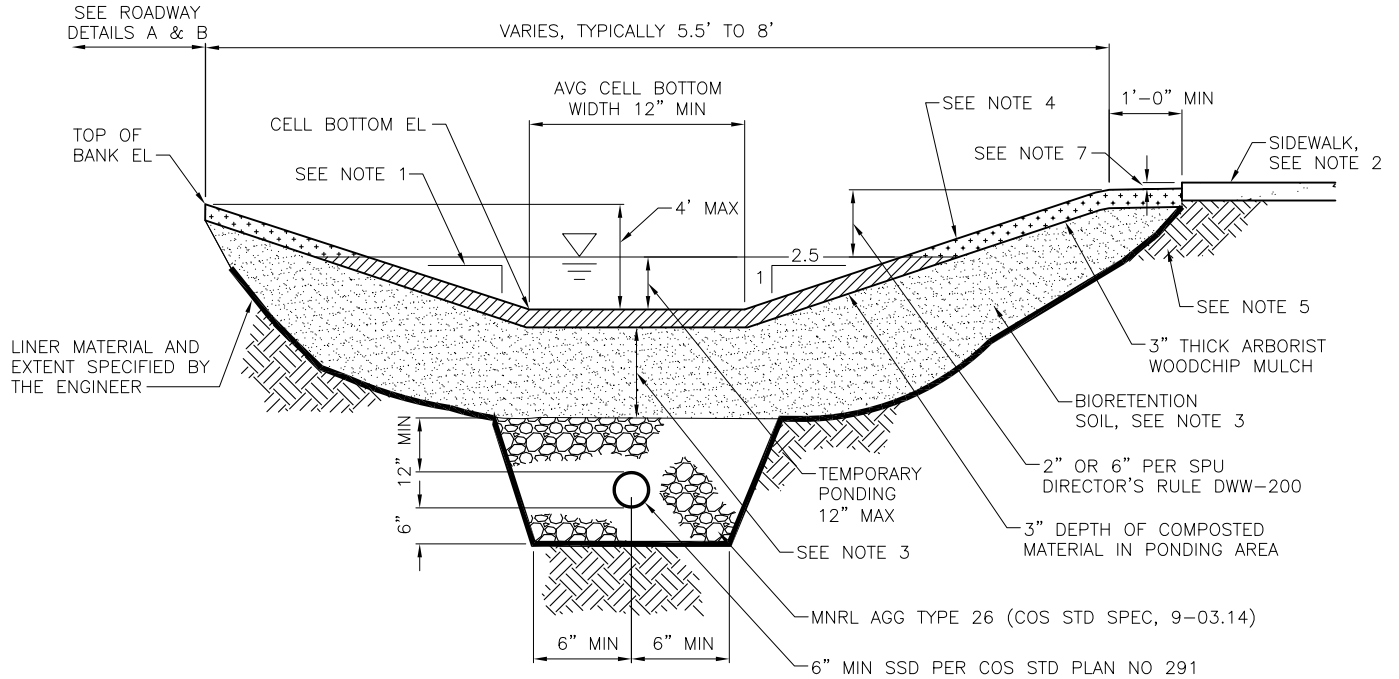

DETAIL A
CURBED ROADWAY
(ADJACENT TO PARKING ZONE)

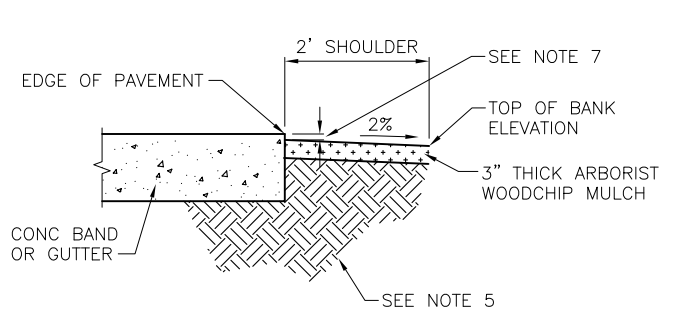

DETAIL B
CURBLESS ROADWAY

NOTES:

1. TYPICAL MAXIMUM SLOPE ALLOWED IS 2.5H=1V, 3H=1V MAX WHEN WITHIN 50- FEET OF INTERSECTIONS OR CURBLESS ROADWAY.
2. BIORETENTION OVERFLOW ELEVATIONS MUST BE SET BELOW SIDEWALK ELEVATION.
3. 12" MIN OR 18" MIN IF WATER QUALITY TREATMENT IS REQUIRED PER STORMWATER CODE REQUIREMENT.
4. CELL MUST BE PLANTED PER APPROVED LANDSCAPE PLAN.
5. SOIL UNDER SHOULDERS OR PAVED AREAS MUST BE UNDISTURBED NATIVE SOIL OR APPROVED SOIL COMPACTED TO 95% DENSITY
6. FACE OF CURB TO TOP OF SLOPE MUST BE MIN 2'-0" FOR NON-MAJOR ARTERIAL STREET, MIN 4'-0" FOR MAJOR ARTERIAL STREET.
7. PROVIDE MIN ONE INCH GAP BETWEEN TOP OF WALKS, CURBS, PAVEMENTS AND DRIVEWAYS AND TOP OF ARBORIST WOODCHIP MULCH.



REF STD SPEC SEC 7-21




City of Seattle

NOT TO SCALE

**NON-INFILTRATING BIORETENTION
WITH SLOPED SLIDES
& UNDER DRAIN**

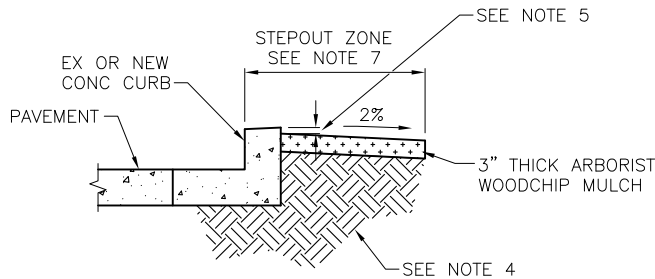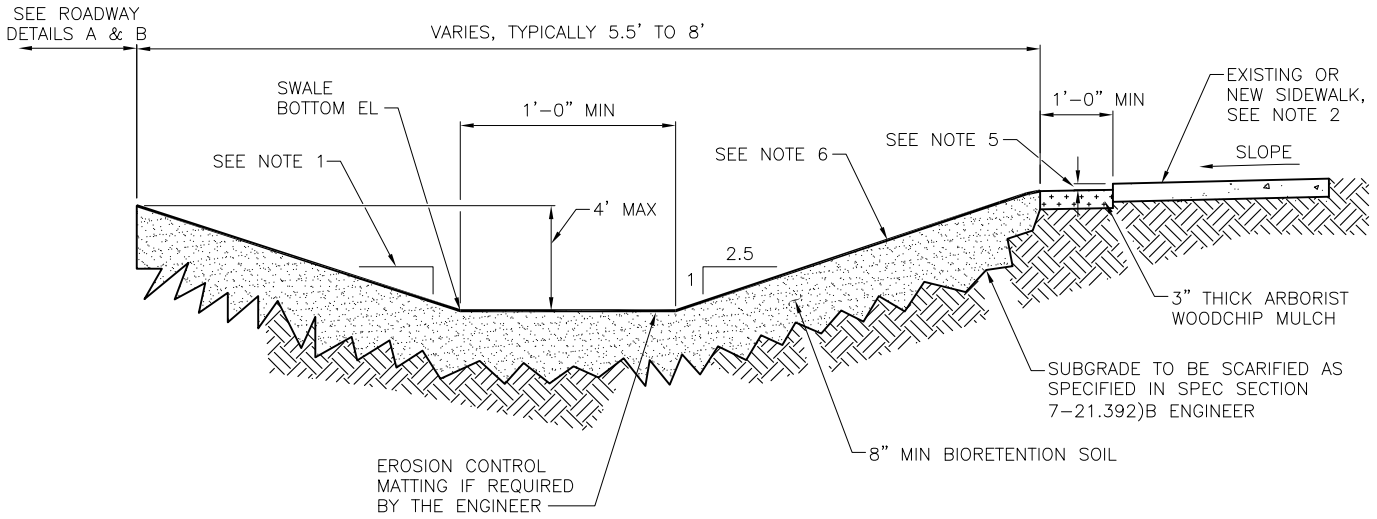

DETAIL A
CURBED ROADWAY
 (ADJACENT TO PARKING ZONE)

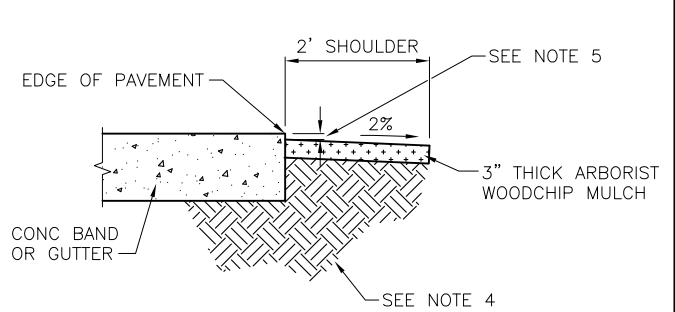

DETAIL B
CURBLESS ROADWAY

NOTES:

1. TYPICAL MAXIMUM SLOPE ALLOWED IS 2.5H=1V, 3H=1V MAX WHEN WITHIN 50- FEET OF INTERSECTIONS OR CURBLESS ROADWAY.
2. CONVEYANCE SWALE OVERFLOW ELEVATIONS MUST BE SET BELOW SIDEWALK ELEVATION.
3. LONGITUDINAL SLOPE GREATER THAN OR EQUAL TO 4%, CHECK DAM REQUIRED.
4. UNDISTURBED NATIVE SOIL OR APPROVED SOIL COMPACTED TO 95% DENSITY.
5. PROVIDE MIN ONE INCH GAP BETWEEN TOP OF WALKS, CURBS, PAVEMENTS AND DRIVEWAYS AND TOP OF TREATMENT LAYER.
6. PLANTING PER APPROVED LANDSCAPE PLAN.
7. FACE OF CURB TO TOP OF SLOPE MUST BE MIN 2'-0" FOR NON-MAJOR ARTERIAL STREETS, MIN 4'-0" FOR MAJOR ARTERIAL STREETS.


REF STD SPEC SEC 7-21



City of Seattle

NOT TO SCALE

VEGETATED CONVEYANCE SWALE
 (NOT FOR WATER QUALITY TREATMENT)

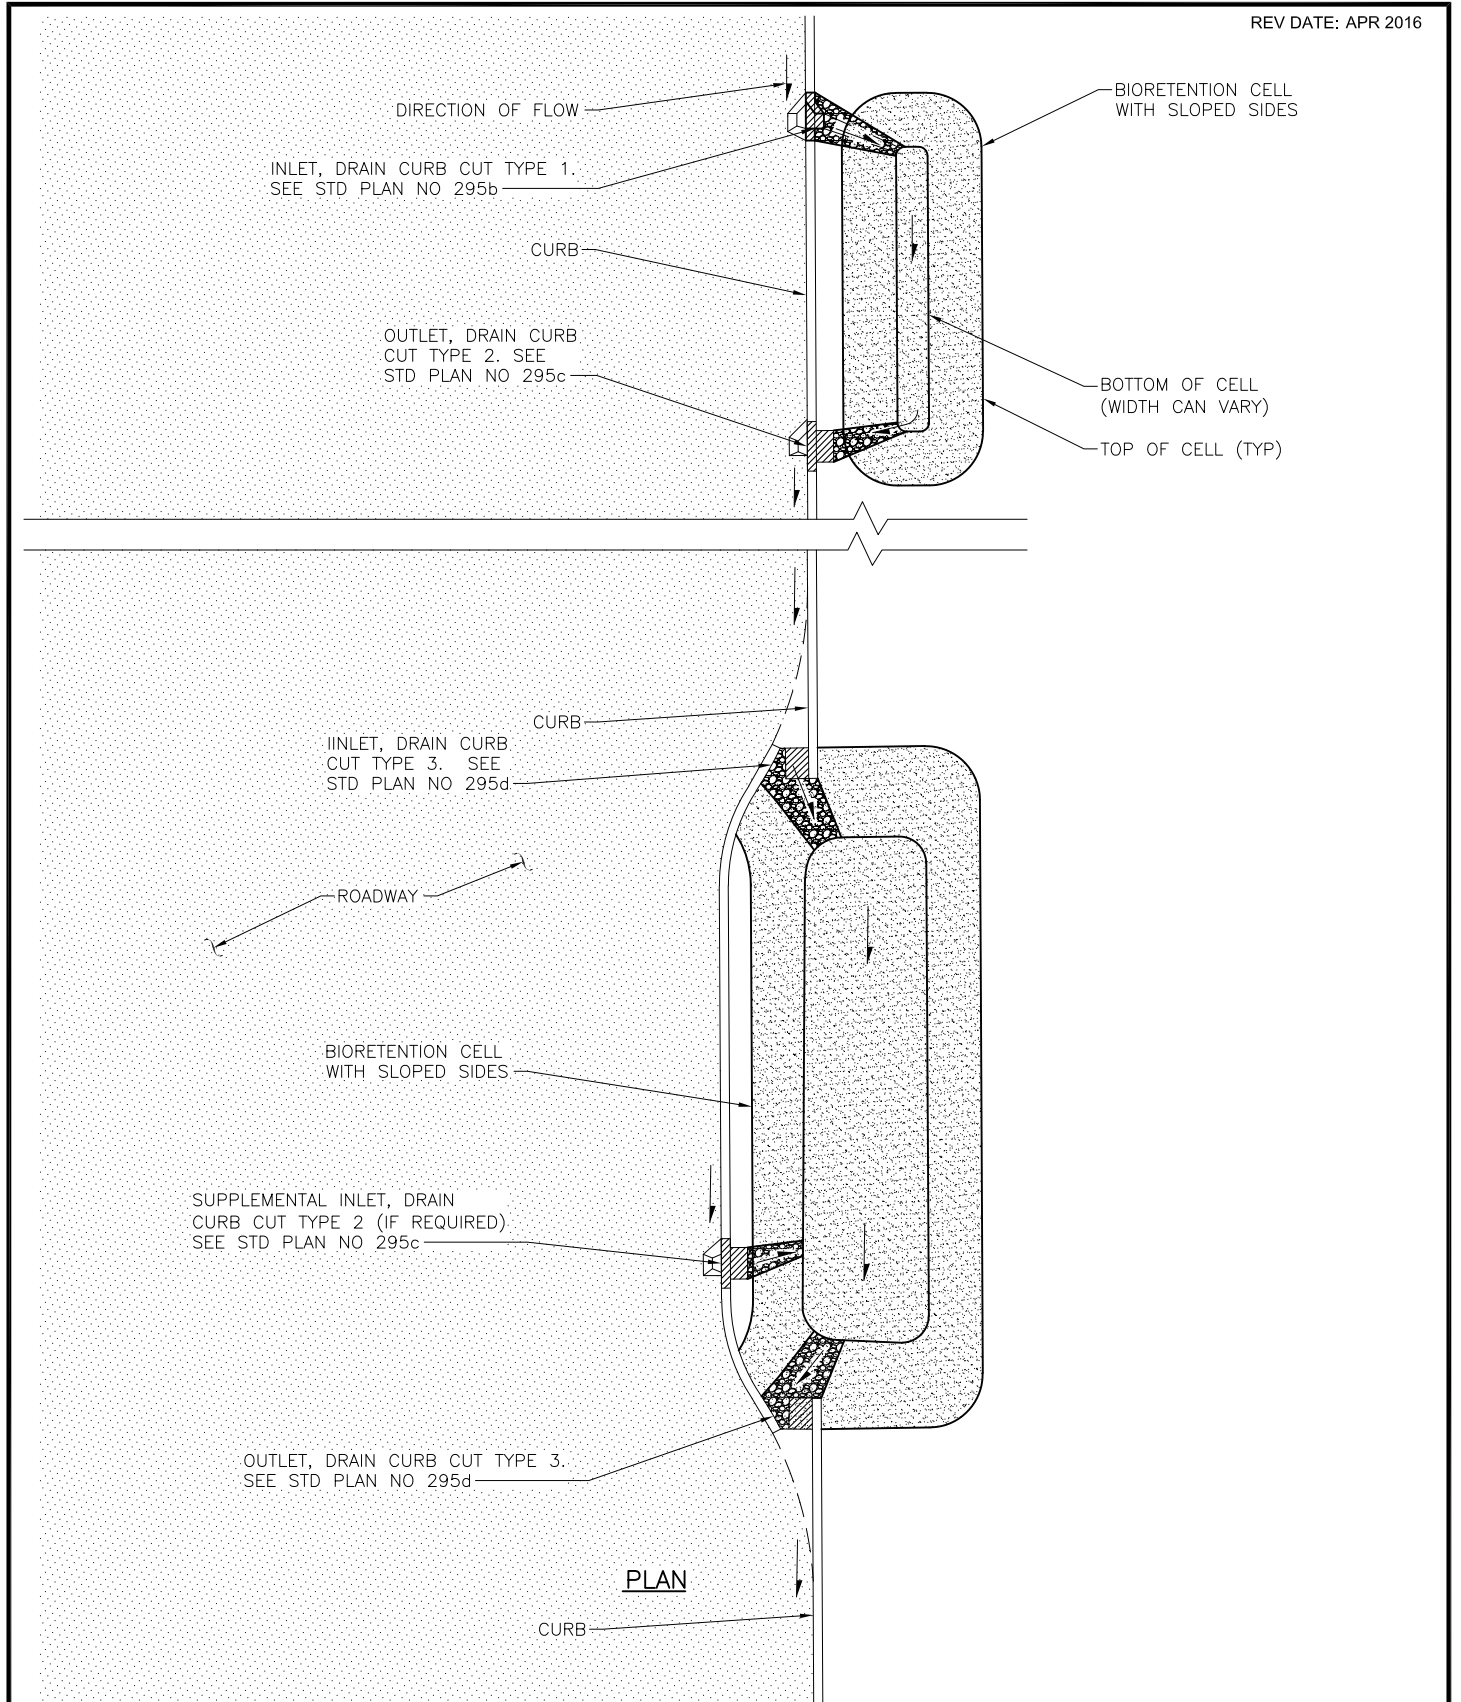


REF STD SPEC SEC 7-21, 9-03



City of Seattle

NOT TO SCALE

TYPICAL DRAIN CURB CUT LOCATION FOR BIORETENTION WITH SLOPED SIDES

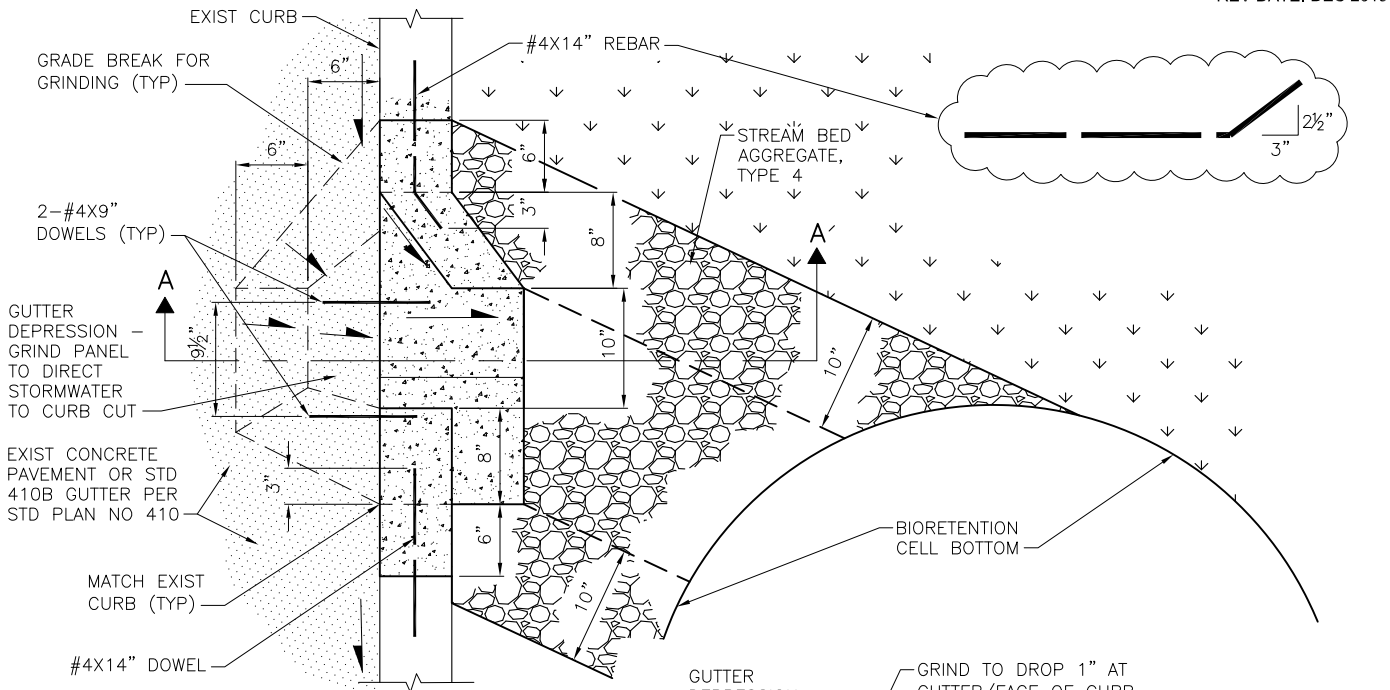


PLAN

EXIST CONCRETE PAVEMENT OR STD 410B GUTTER PER STD PLAN NO 410

NOTES:


1. DRAIN CURB CUTS MUST NOT BE LOCATED WITHIN CONCRETE ROAD PANEL JOINT.
2. USE DRAIN CURB CUT TYPE 1 WHERE GUTTER LINE LONGITUDINAL SLOPE IS 0 TO 5%. WHERE LONGITUDINAL SLOPE IS GREATER THAN 5%, DRAIN CURB CUT OPENING WILL BE DESIGNED BY THE ENGINEER.

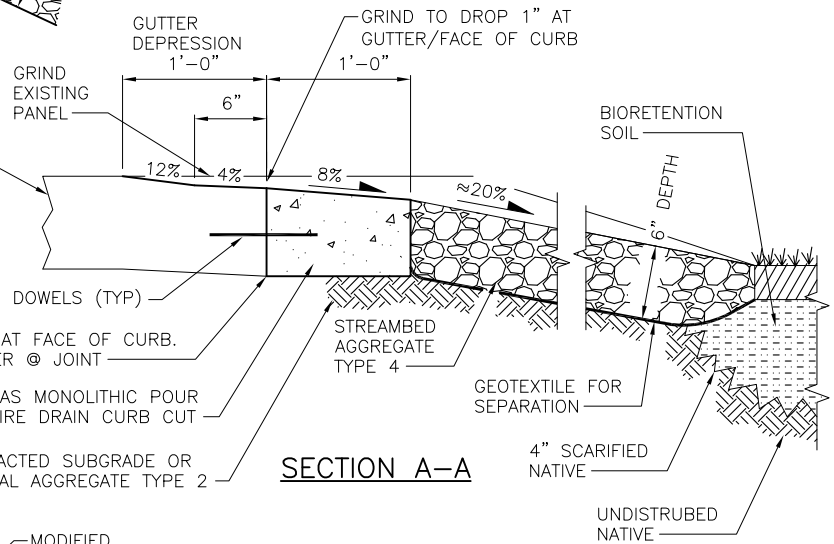

SECTION A-A

START CURB HEIGHT TRANSITION (NO JOINT)

MATCH EXIST CURB HEIGHT

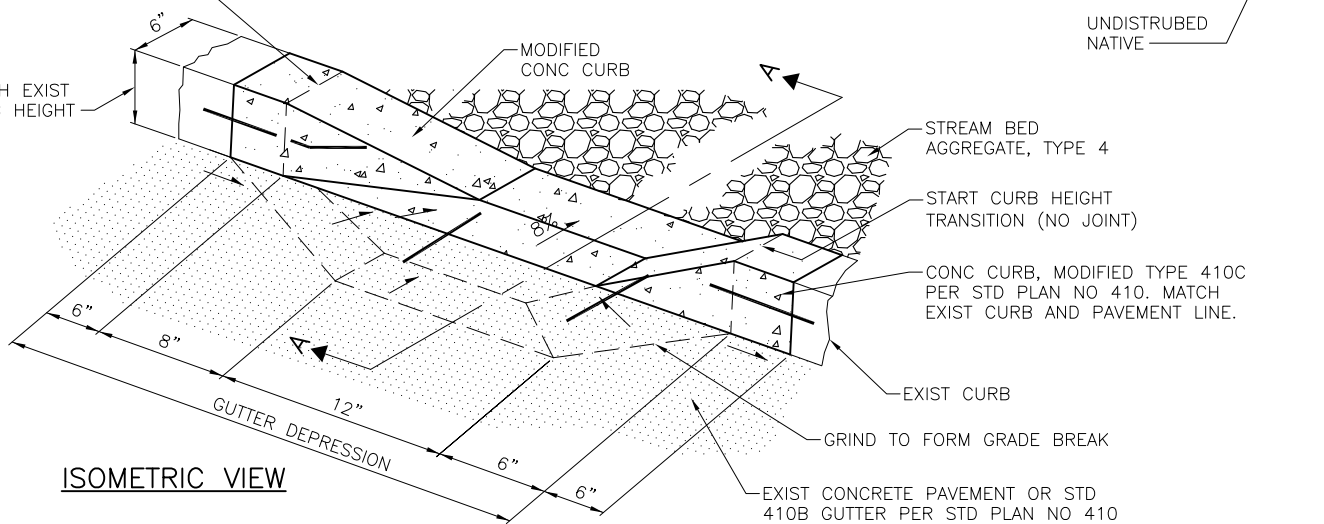

ISOMETRIC VIEW


REF STD SPEC SEC 7-21, 9-03



City of Seattle

NOT TO SCALE


DRAIN CURB CUT TYPE 1

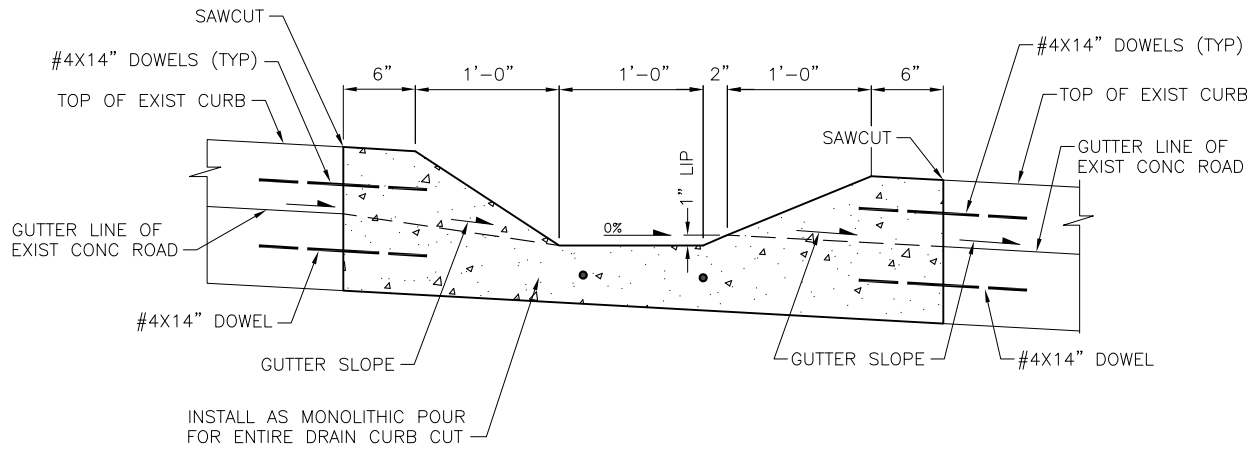


SECTION A-A

NOTES:

1. DRAIN CURB CUT MUST NOT BE LOCATED WITHIN CONCRETE ROAD PANEL JOINT.

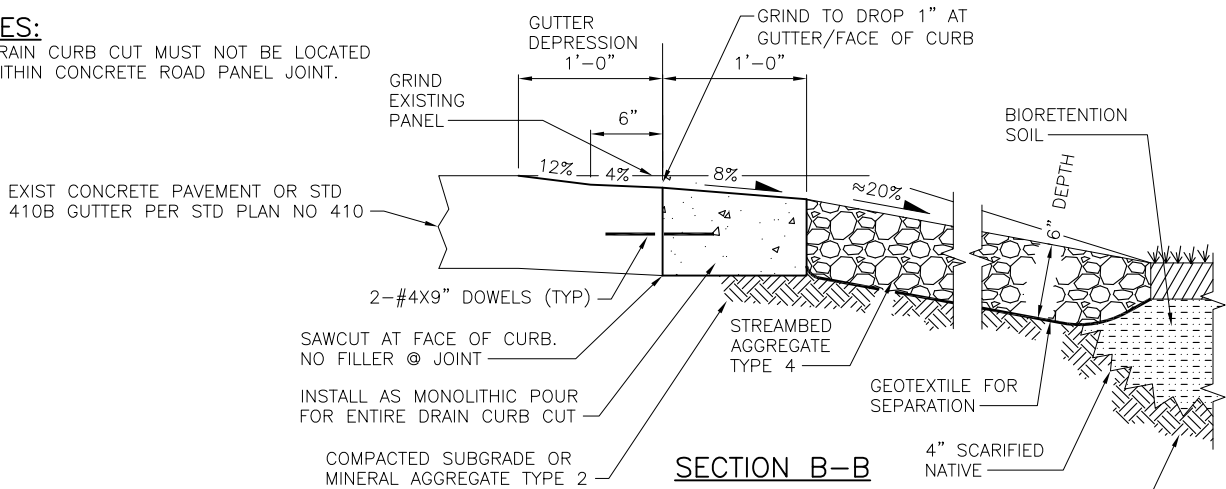

SECTION B-B

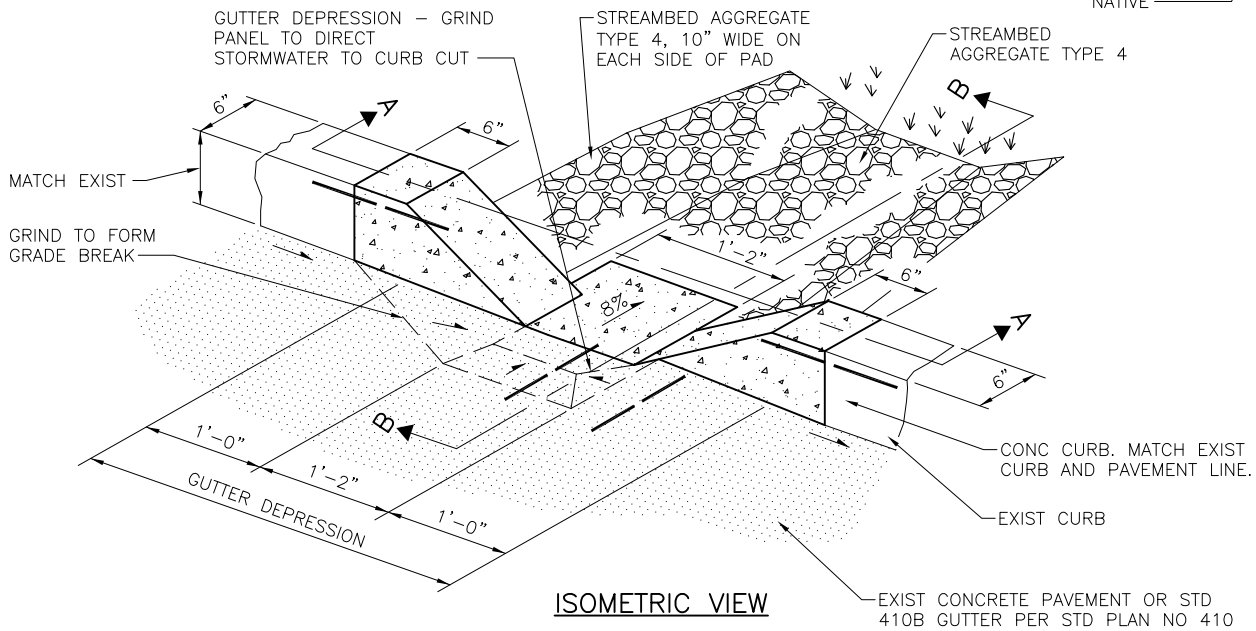

ISOMETRIC VIEW


REF STD SPEC SEC 7-21, 9-03




City of Seattle

NOT TO SCALE

DRAIN CURB CUT TYPE 2

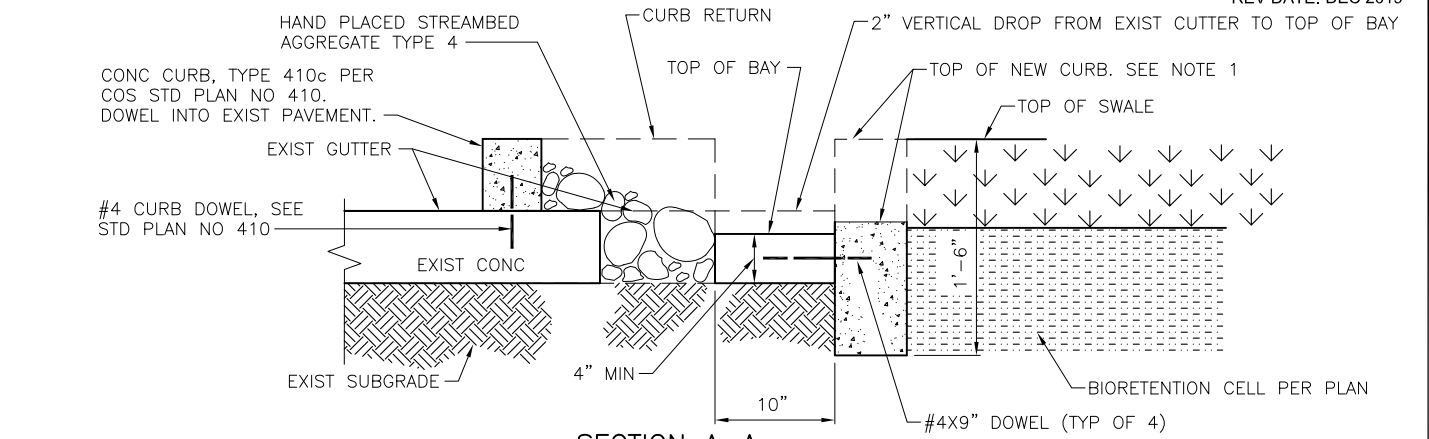


SECTION A-A

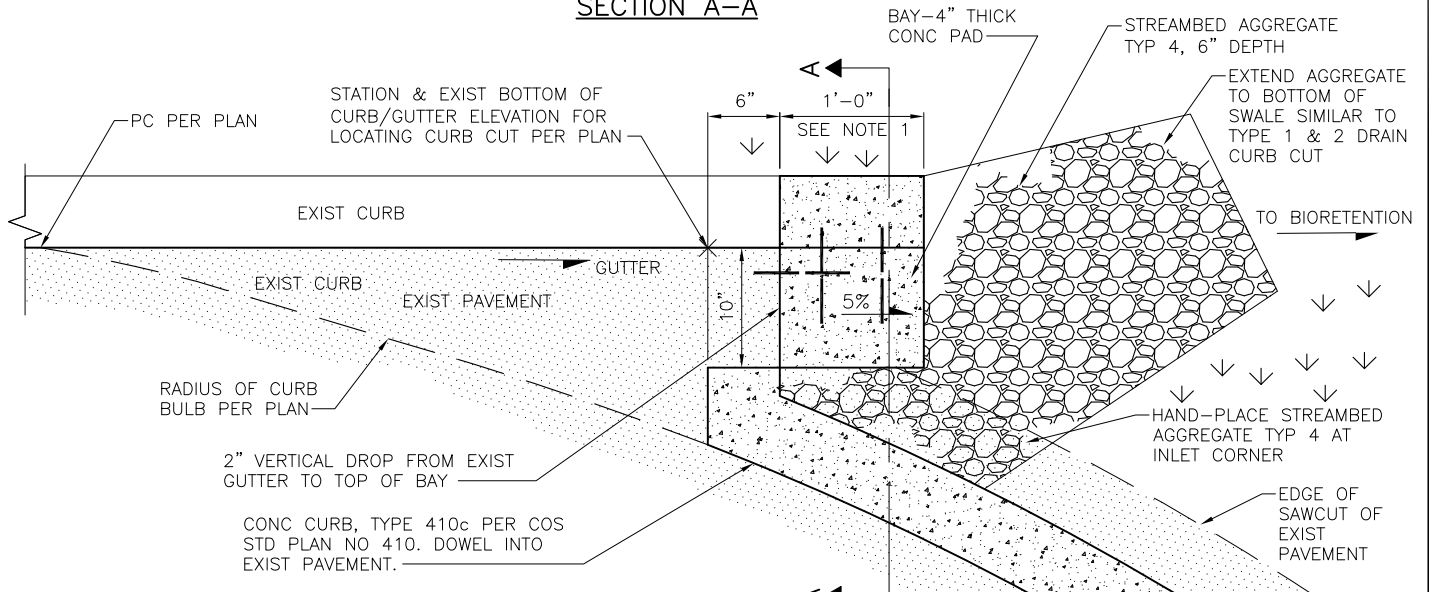

INLET PLAN VIEW

NOTES:

- 1. TAPER CURB HEIGHT FROM TOP OF EXISTING CURB TO TOP OF BAY.

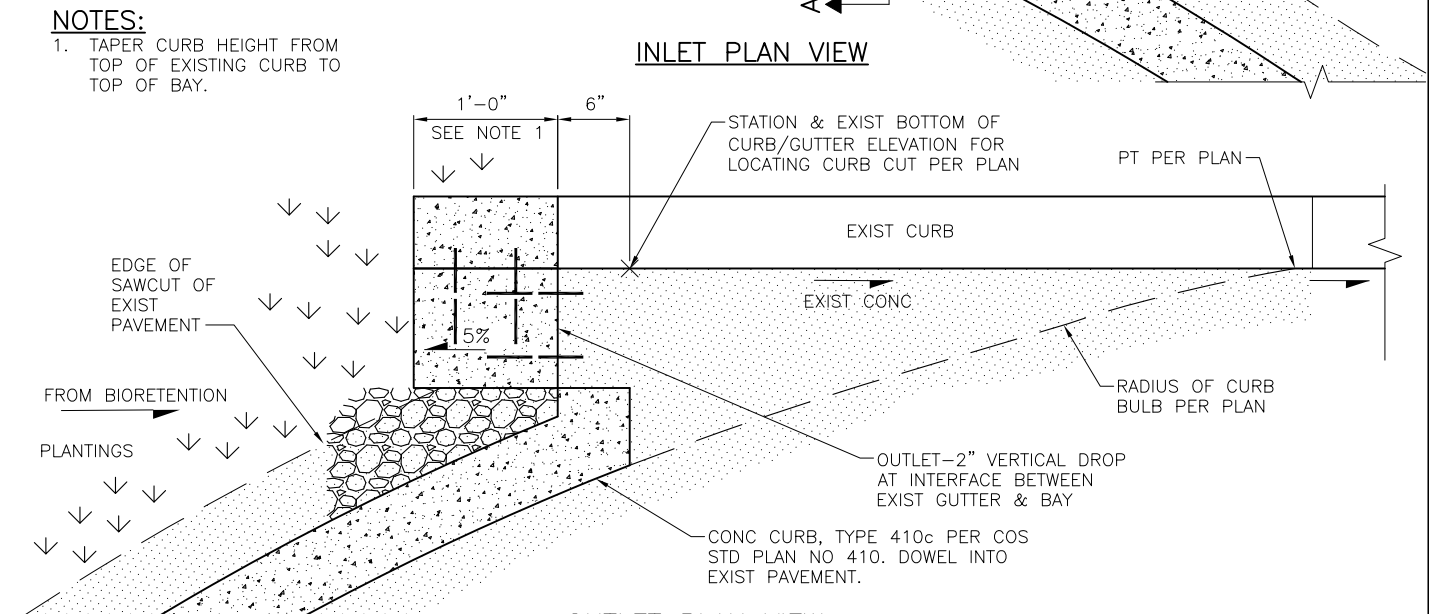

OUTLET PLAN VIEW




REF STD SPEC SEC 7-21, 9-03



City of Seattle

NOT TO SCALE

DRAIN CURB CUT TYPE 3

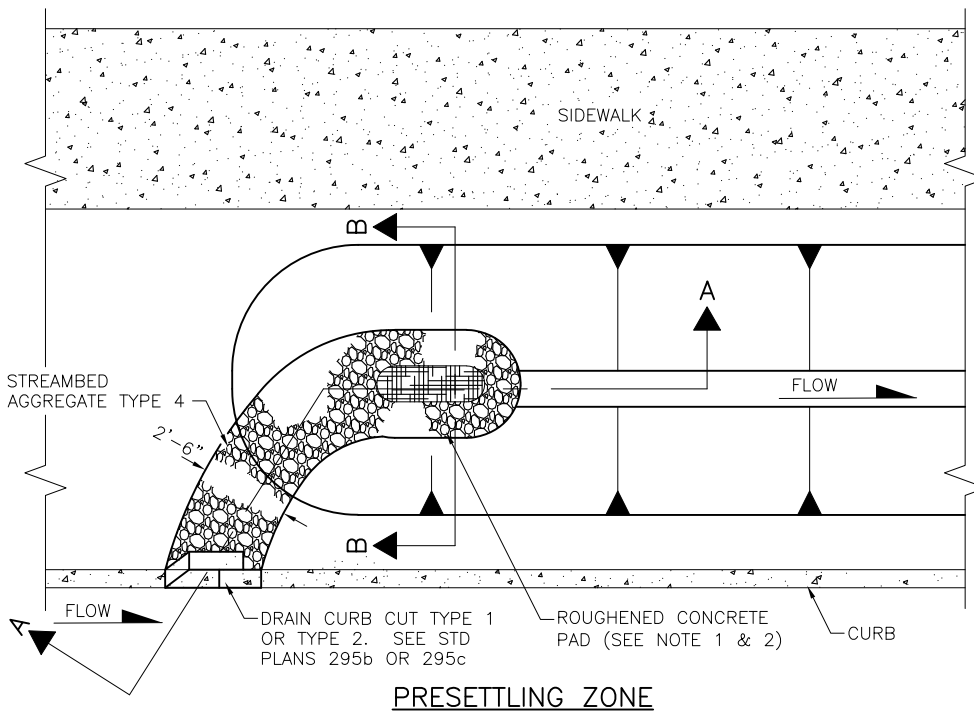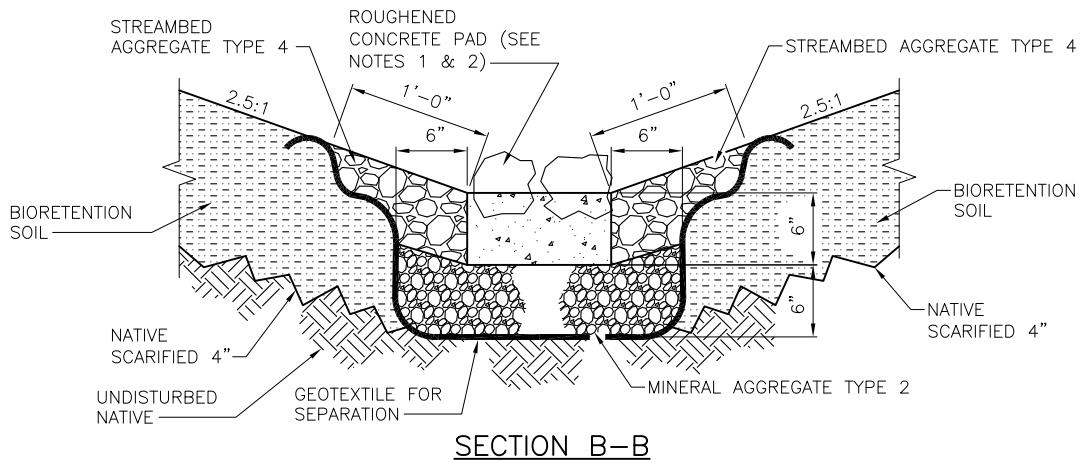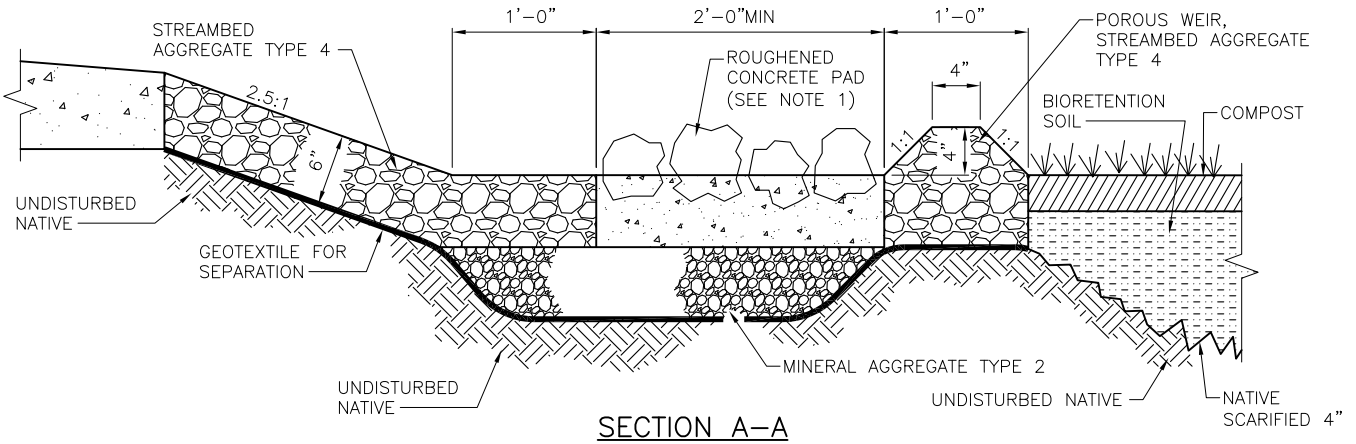

NOTES:

1. ROUGHENED CONCRETE PAD MUST BE MIN 2' LONG & 2.5 SF OR 5.0SF PER SPU DIRECTOR'S RULE 200
2. ROUGHENED CONCRETE PAD MUST BE CONSTRUCTED WITH COMMERCIAL CONCRETE (STD SPEC 6-02) EMBED WELL MIXED 6"-8" STREAMBED AGGREGATE TO CREATE ROUGHNESS. 50% MIN OF THE SURFACE MUST HAVE PROTRUDING AGGREGATE



REF STD SPEC SEC 7-21, 9-03




City of Seattle

NOT TO SCALE

PRESETTLING ZONE

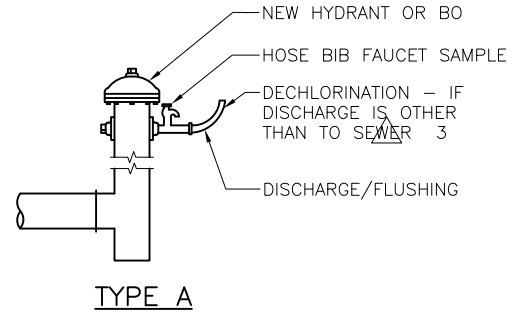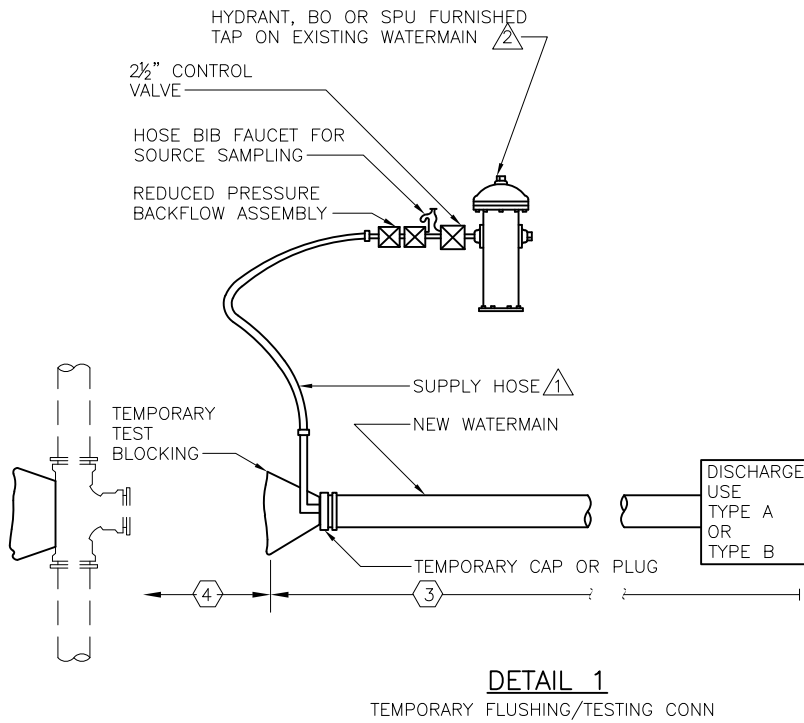

TEMP SAMPLE TAP AND FLUSHING ASSEMBLY (RESTRAINT OR BLOCKING REQ'D)

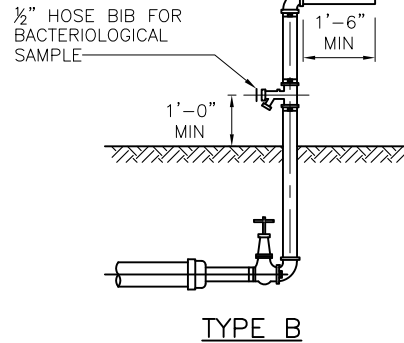

NOTES:

1. ALL FITTINGS MUST BE DUCTILE IRON
2. ALL EXCAVATION MUST PROVIDE A MINIMUM OF 1'-0" CLEAR AROUND PIPE AND FITTINGS.
3. THESE PLANS ARE FOR DIP AND CIP WATERMANS 12" OR SMALLER DIA OTHER SIZES AND TYPES SEE PROJECT DRAWINGS
4. REDUCED PRESSURE BACKFLOW ASSEMBLY (RPBA) MUST BE INSTALLED AS A UNIT (TWO SHUT-OFF VALVES, RELIEF PORT, TWO CHECK VALVES AND FOUR TEST COCKS). WHEN RPBA IS CONNECTED TO HYDRANT AND THE HOSE BIB FAUCET SAMPLE THEY MUST BE CAPPED WHEN NOT IN USE. ASSEMBLY MUST BE TESTED WHEN INSTALLED BY A WASHINGTON STATE CERTIFIED BACKFLOW ASSEMBLY TESTER (BAT) AND A CURRENT TEST REPORT MUST BE ON SITE. FOR INSTALLATION PROCEDURES CALL 684-3536.
5. ALL FITTINGS AND MATERIALS FURNISHED BY CONTRACTOR AND TO BE INSTALLED BY SPU MUST BE VERIFIED, INSPECTED AND ON THE JOB SITE PRIOR TO SHUTDOWN OF EXISTING MAIN. FAILURE TO MEET THIS REQUIREMENT COULD RESULT IN DELAYS.

LEGEND

- ① CLEAN & DISINFECTED POTABLE WATER HOSE ONLY. SIZE FLUSHING RISER PER TABLE IN STD SPEC SEC 7-11.3(12)
- ② HYDRANT PERMIT REQUIRED
- ③ CHECK WITH SEWER UTILITY BEFORE DISCHARGE TO SEWERS
- ④ CONTRACTOR TO DETERMINE ALIGNMENT, GRADE AND OUTSIDE DIAMETER OF EXISTING PIPE PRIOR TO INSTALLING NEW WATERMAIN. ENGINEER TO DETERMINE OUTSIDE DIAMETER OF EXISTING PIPE WHEN CONTRACTOR EXCAVATES TO DETERMINE ALIGNMENT & GRADE.
- ⑤ ALL EXCAVATION, PIPE, FITTINGS (EXCEPT AS NOTED BELOW), OTHER MATERIAL, BEDDING, BACKFILL, COMPACTION & STREET RESTORATION BY CONTRACTOR. ALL MATERIALS MUST BE ON JOB SITE PRIOR TO SHUTDOWN OF EXISTING MAIN.
- ⑥ INSTALLED BY CONTRACTOR
- ⑦ CONNECTION PIPE: CONTRACTOR FURNISHED, INSTALLED BY SPU
- ⑧ WATERMAIN WITH PLAIN ENDS
- ⑨ MECHANICAL JOINT SLEEVE WITH SPACER CUT TO FIT GAP, FURNISHED AND INSERTED AT TIME OF CONNECTION BY SPU
- ⑩ TAPPING SLEEVE & TAPPING VALVE FURNISHED AND INSTALLED BY SPU
- ⑪ APPLIES TO PIPES 4" THROUGH 12". ALL LARGER SIZES TO BE ADDRESSED ON DRAWINGS
- ⑫ MECHANICAL JOINT SLEEVE, FURNISHED BY CONTRACTOR AND INSTALLED BY SPU, SPACERS BY SPU WHERE REQUIRED.

REF STD SPEC SEC 7-11




City of Seattle

NOT TO SCALE

CONNECTIONS TO EXISTING WATERMANS

ELEVATION

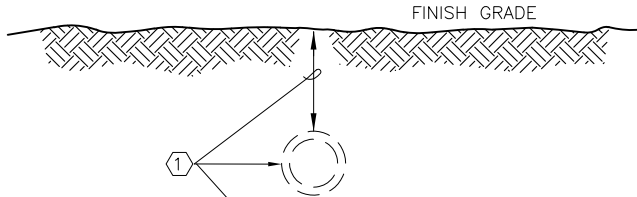


TABLE

SIZE WATERMAIN	L1	L2
4"Ø THRU 10"Ø	10'-0"	14'-0"
12"Ø	12'-0"	16'-0"
LARGER THAN 12"Ø	PER DRAWINGS	

NOTE:


(X) = SEE STD PLAN NO 300a FOR LEGEND

PLAN

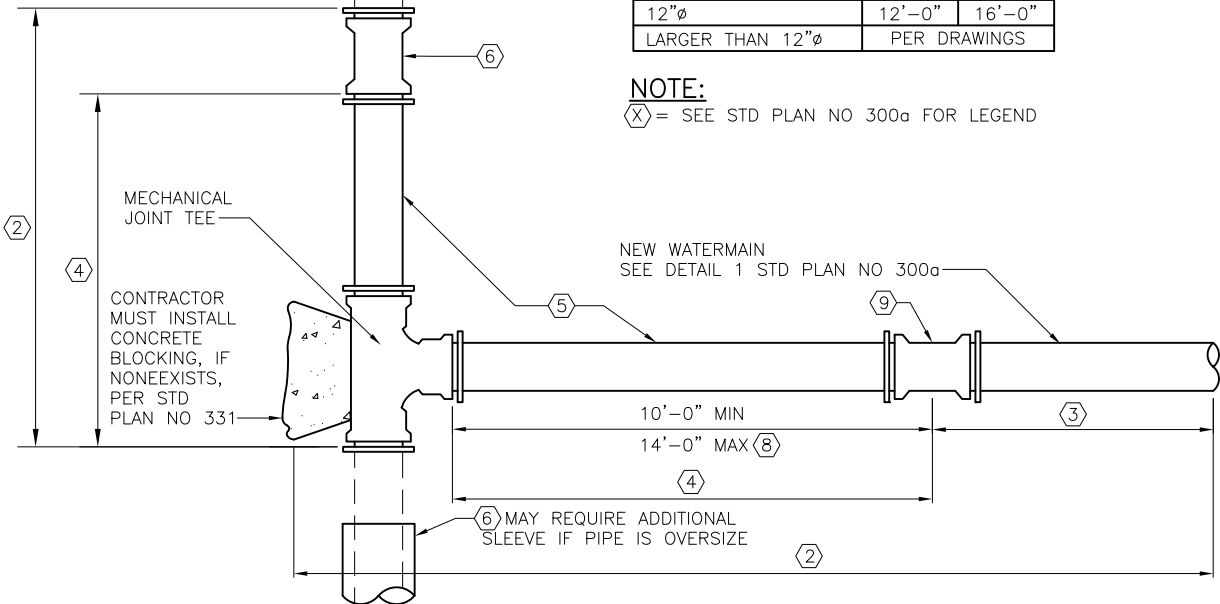


CONNECTIONS TO EXISTING MAIN, WITH A NEW TEE OR CROSS
(CUT IN NEW TEE)

ELEVATION

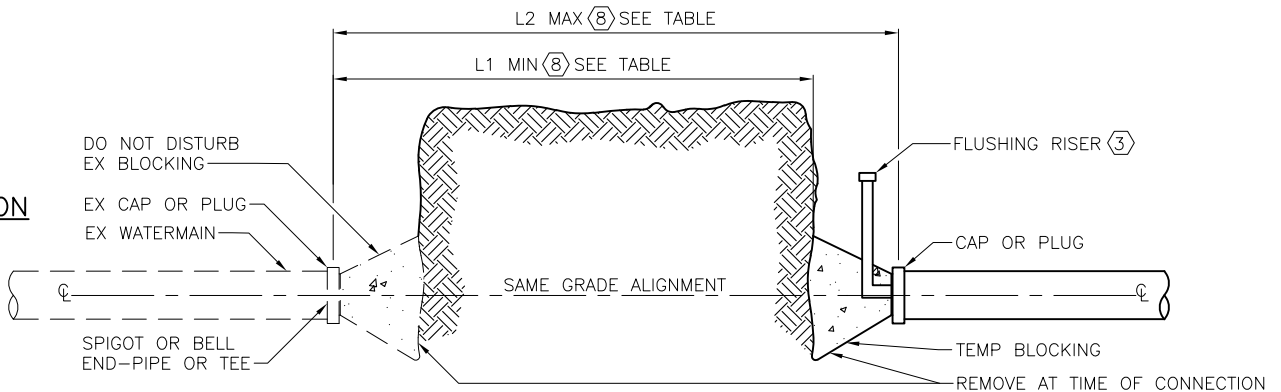

PLAN

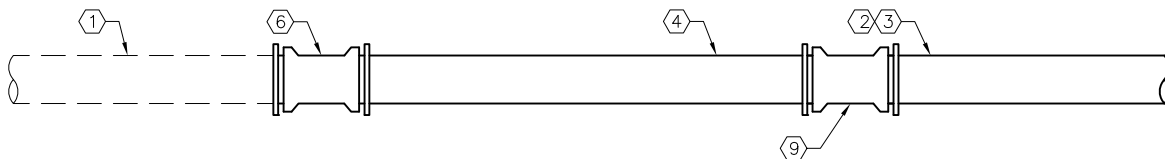

CONNECTIONS TO EXISTING MAIN, STUB
OR END OUTLET OF TEE OR CROSS


REF STD SPEC SEC 7-11




City of Seattle

NOT TO SCALE


CONNECTIONS TO EXISTING WATERMANS

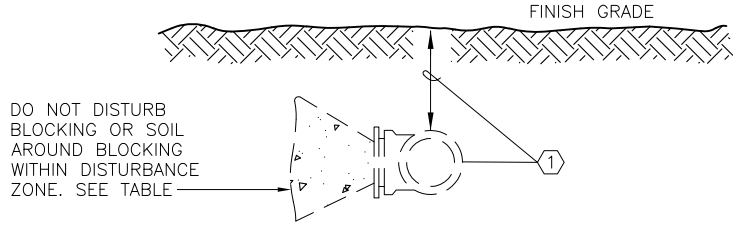

EXISTING PLUGGED TEE OR CROSS

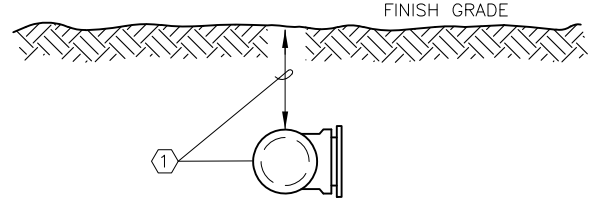

NEW PLUGGED TEE OR CROSS

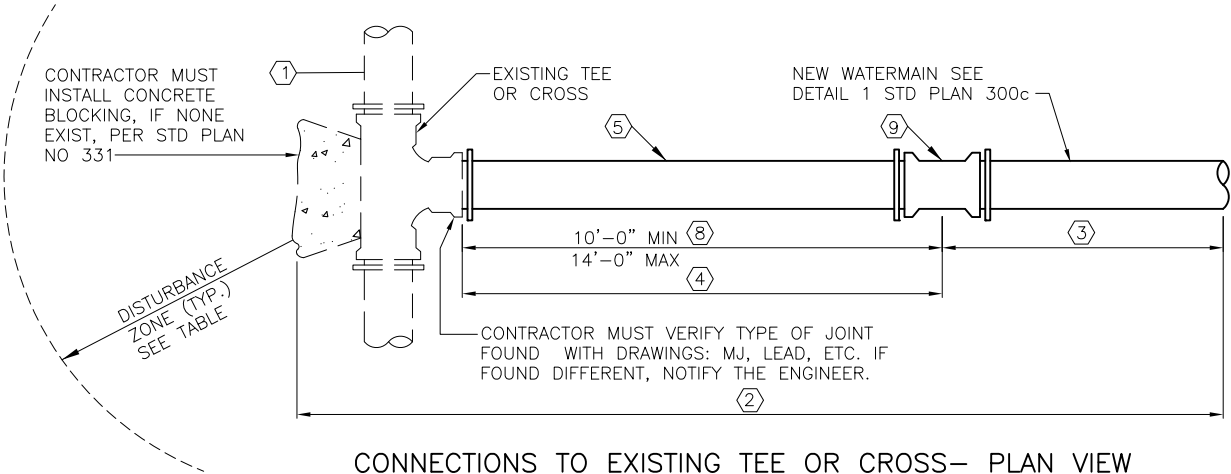

CONNECTIONS TO EXISTING TEE OR CROSS— PLAN VIEW


TABLE

SIZE OF WATERMAIN	DISTURBANCE ZONE
UP TO & INCLUDING 10"φ	10'-0"
OVER 10"φ	12'-0"

* SPU MAY INCREASE DISTURBANCE ZONE. SEE CONTRACT DOCUMENTS

NOTE:

(X) = SEE STD PLAN NO 300a FOR LEGEND

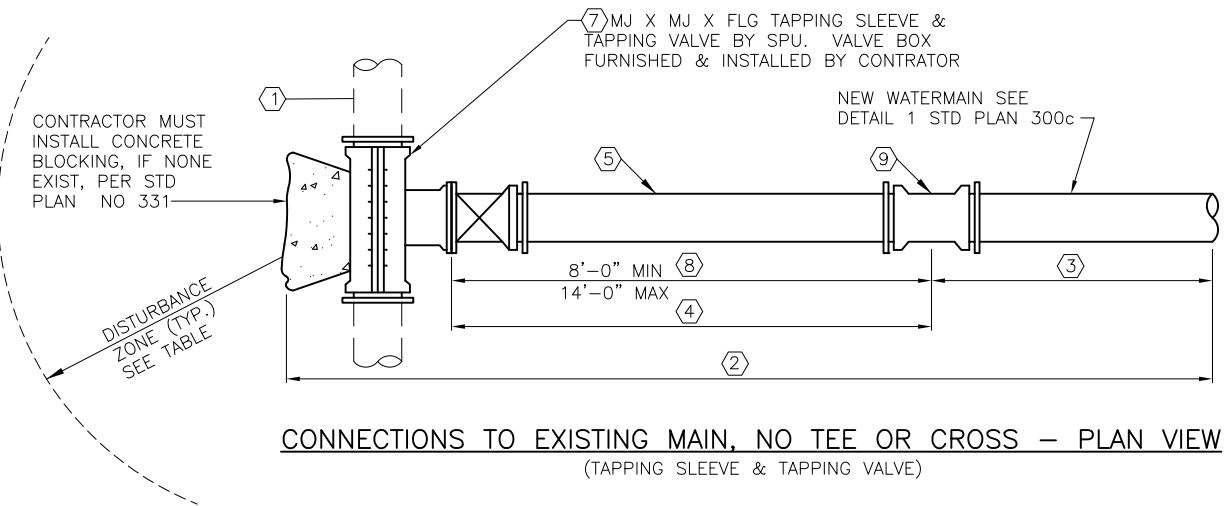

CONNECTIONS TO EXISTING MAIN, NO TEE OR CROSS – PLAN VIEW
(TAPPING SLEEVE & TAPPING VALVE)


REF STD SPEC SEC 7-11



City of Seattle

NOT TO SCALE

CONNECTIONS TO EXISTING WATERMAINS

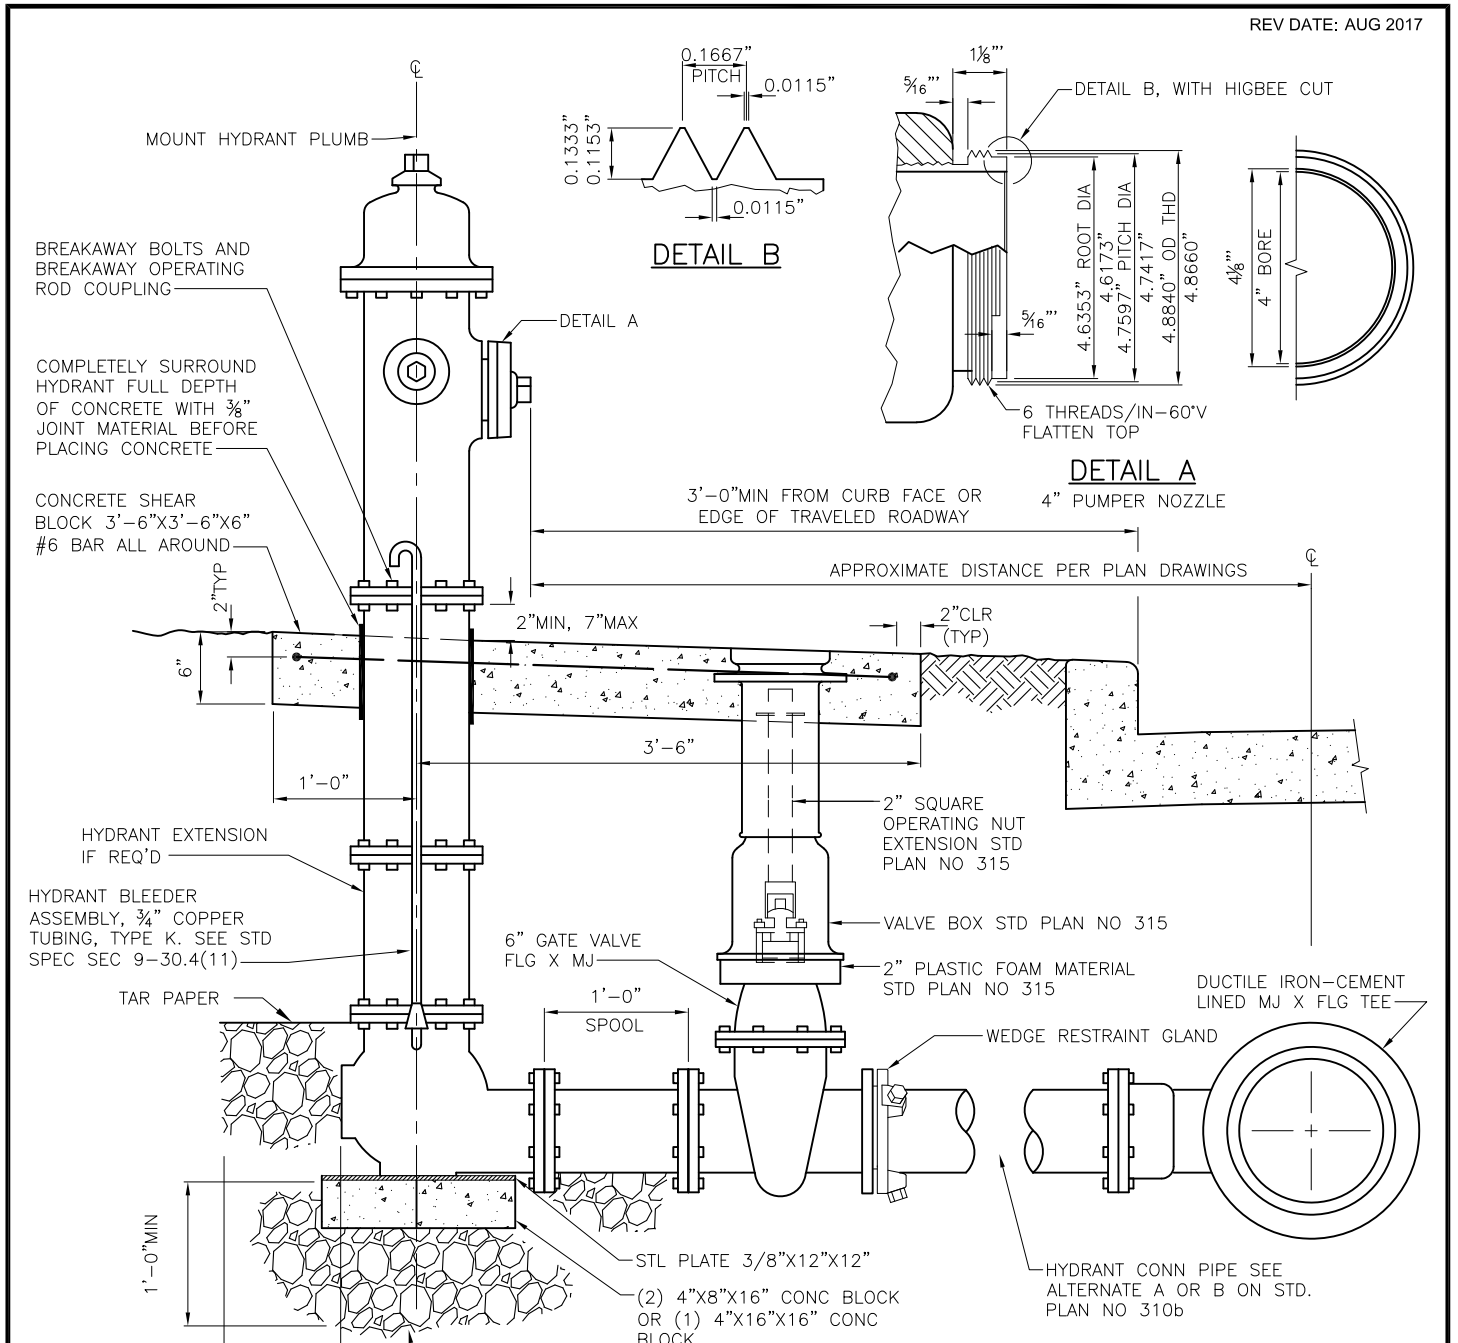

- NOTES:**
1. 6" HYDRANT CONNECTION PIPE MUST BE DIP CL52.
 2. HYDRANT TEES MUST BE SET HORIZONTALLY.
 3. THE THREADED NIPPLE ON THE 4" PUMPER NOZZLE MUST BE EQUIPPED WITH THE BLUNT START OR HIGBEE CUT.
 4. THE 2 1/2" NIPPLES MUST BE IN ACCORDANCE WITH THE NATIONAL FIRE PROTECTION ASSOCIATION BULLETIN NO 194 DATED 1974.
 5. AFTER INSTALLATION, ALL SHACKLE BOLTS, NUTS, MECHANICAL JOINT GLANDS AND SHACKLE RODS MUST BE CLEANED AND COATED WITH TWO COATS OF ROYSTON R28 MASTIC.
 6. AFTER BACKFILLING, THE OUTSIDE OF THE HYDRANT (ABOVE THE GROUND LINE) MUST BE THOROUGHLY CLEANED AND PAINTED WITH TWO COATS OF KELLY-MOORE LUXLITE 43-616 CAT YELLOW.
 7. PUMPER PORT MUST FACE CURB.
 8. RESTRAINT MUST BE BY WEDGE RESTRAINT SYSTEM SUCH AS MEGALUG OR UNIFLANGE. SEE STD SPEC 9-30.4(5).


REF STD SPEC SEC 7-14




City of Seattle

NOT TO SCALE


TYPE 310 HYDRANT SETTING
DETAIL

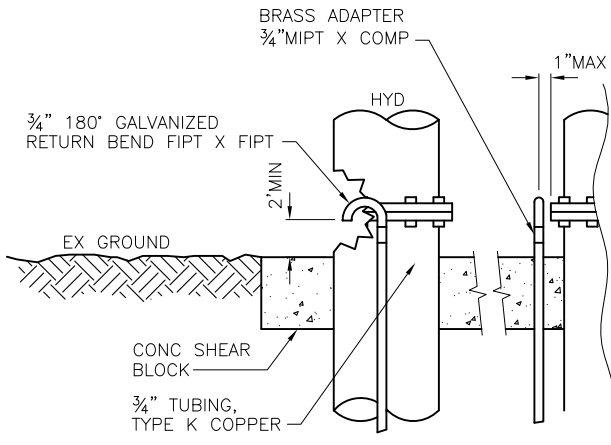

DETAIL A
HYDRANT BLEEDER

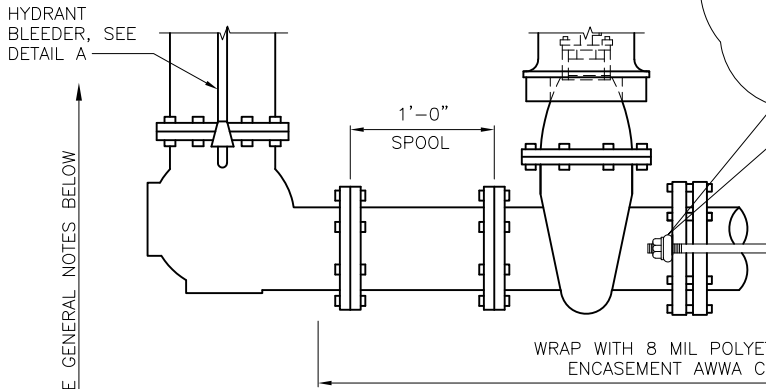

ALTERNATE A
TIEBOLT RESTRAINT

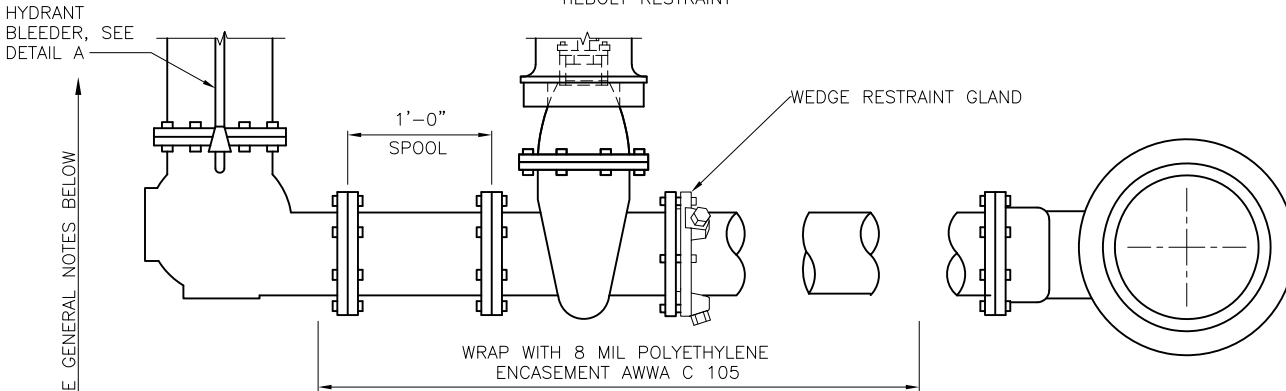

ALTERNATE B
MECHANICAL JOINT W/ WEDGE RESTRAINT GLANDS

NOTES:

1. WHERE WATERMANS ARE INSTALLED WITH POLYETHYLENE ENCASMENT OR TAPE COATINGS, THE HYDRANT BARREL AND VALVE MUST BE SIMILARLY ENCASED, COATED AND/OR JOINTS BONDED. WHERE WATERMAIN IS THERMOPLASTIC COATED, THE HYDRANT BARREL MUST BE TAPE COATED
2. WHERE 6" GATE VALVE IS TO BE LOCATED WITHIN A PARKING-PERMITTED AREA, A SECOND 6" GATE VALVE MUST BE INSTALLED AT THE HYDRANT ASSEMBLY PER STD PLAN NO 310a


REF STD SPEC SEC 7-14



City of Seattle

NOT TO SCALE

**TYPE 310 HYDRANT SETTING
DETAIL**

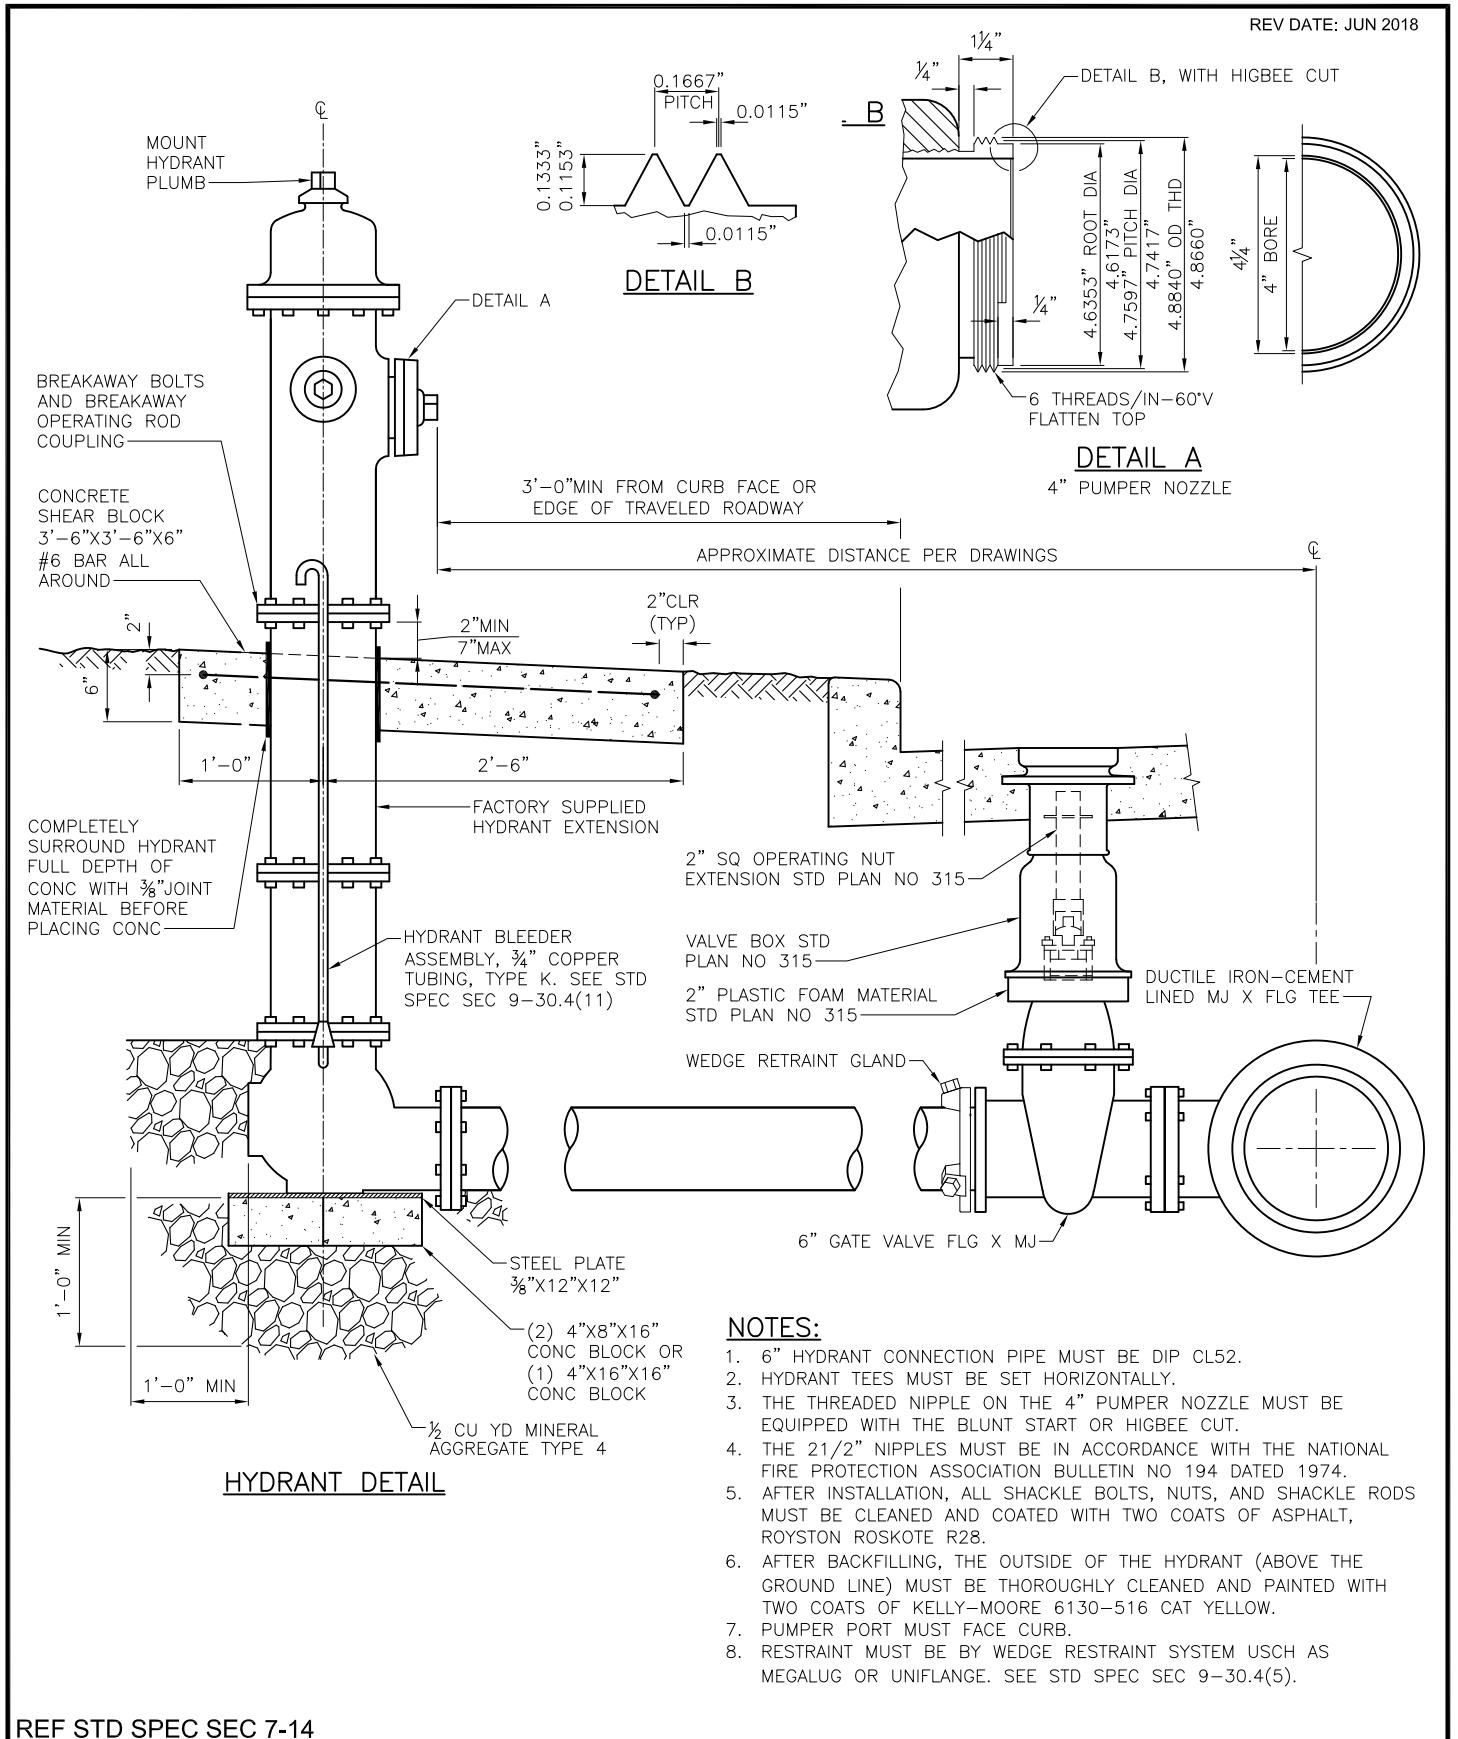





REF STD SPEC SEC 7-14



City of Seattle

NOT TO SCALE

TYPE 311 HYDRANT SETTING
DETAIL

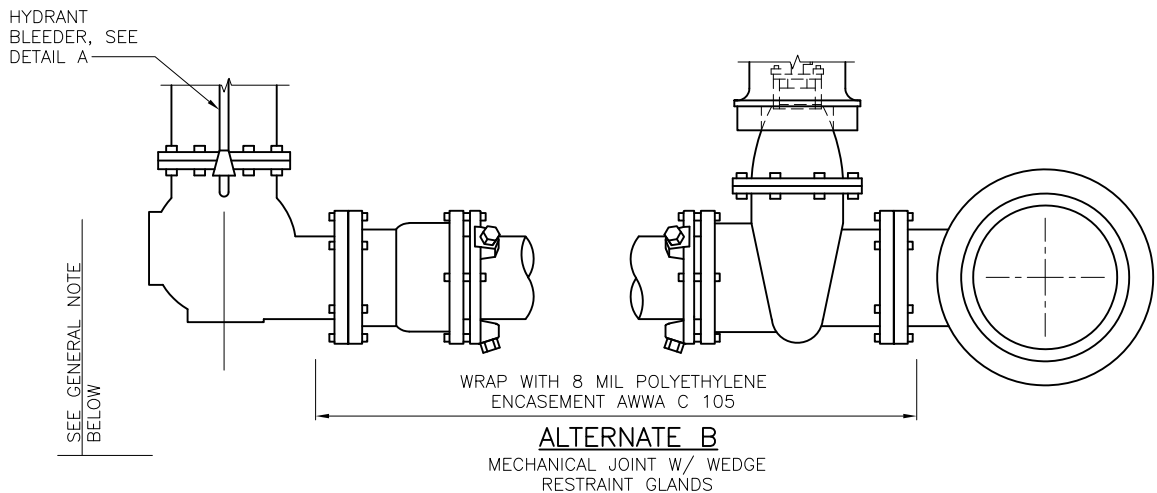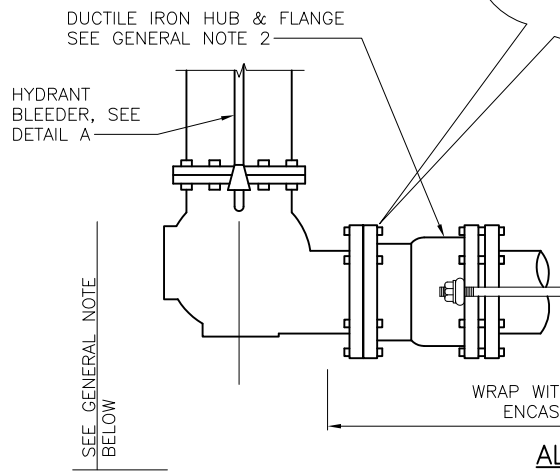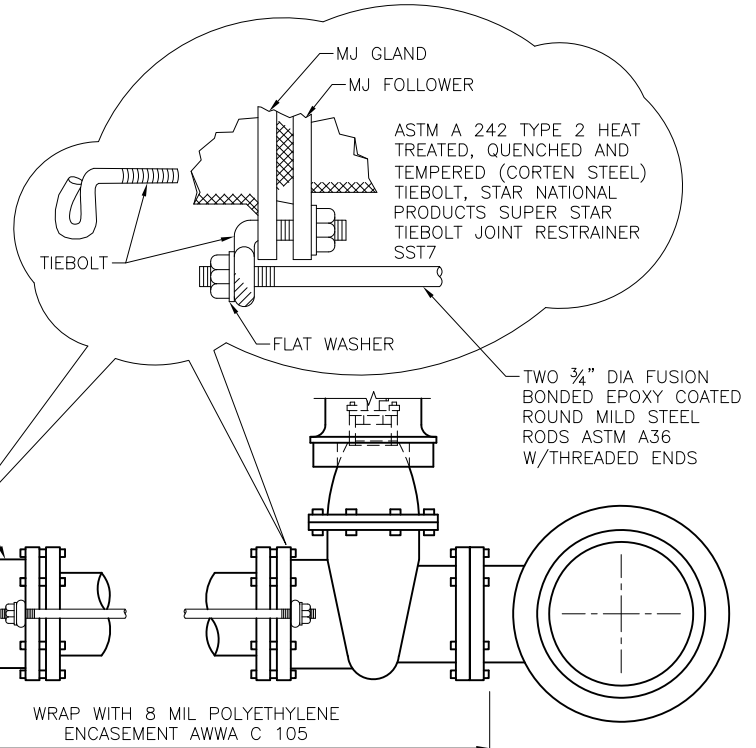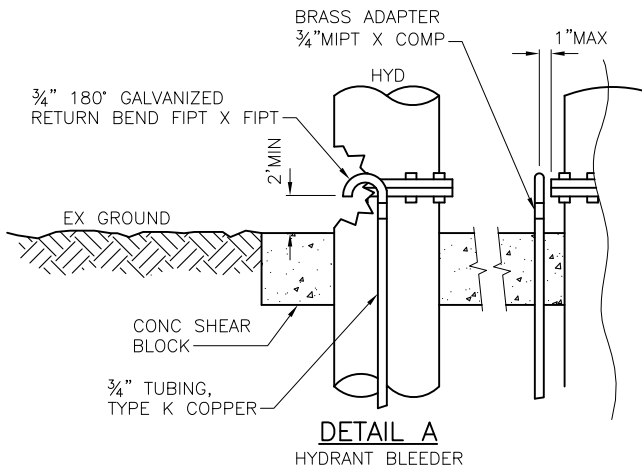

GENERAL NOTES:

1. WHERE WATERMANS ARE INSTALLED WITH POLYETHYLENE ENCASEMENT OR TAPE COATINGS, THE HYDRANT BARREL AND VALVE MUST BE SIMILARLY ENCASED, COATED AND/OR JOINTS BONDED. WHERE WATERMAIN IS THERMOPLASTIC COATED, THE HYDRANT BARREL MUST BE TAPE COATED
2. WHERE 6" GATE VALVE IS TO BE LOCATED WITHIN A PARKING-PERMITTED AREA, A SECOND 6" GATE VALVE MUST BE INSTALLED AT THE HYDRANT ASSEMBLY PER STD PLAN NO 310g



REF STD SPEC SEC 7-14



City of Seattle

NOT TO SCALE

**TYPE 311 HYDRANT SETTING
DETAIL**

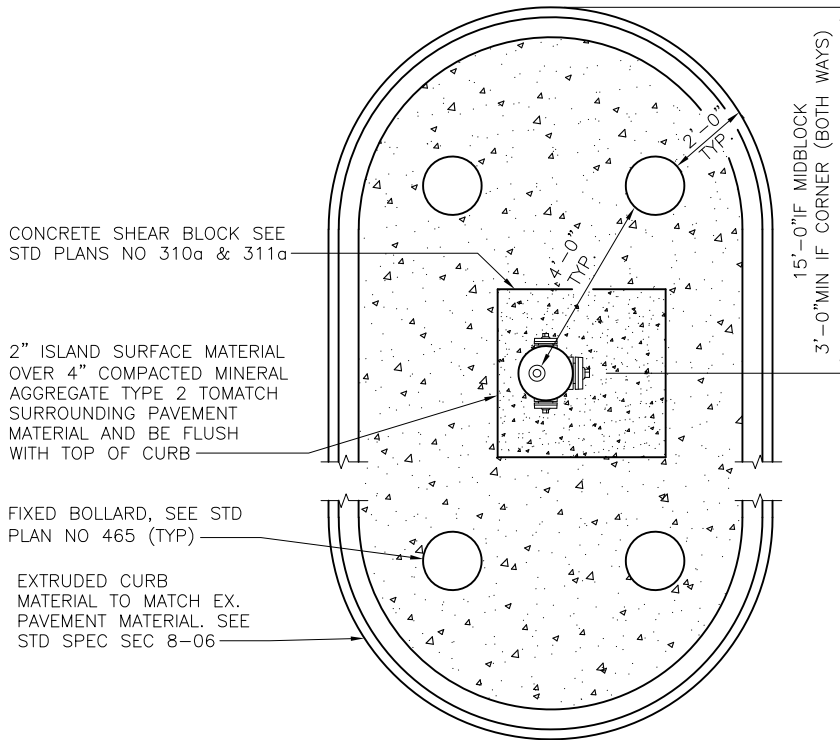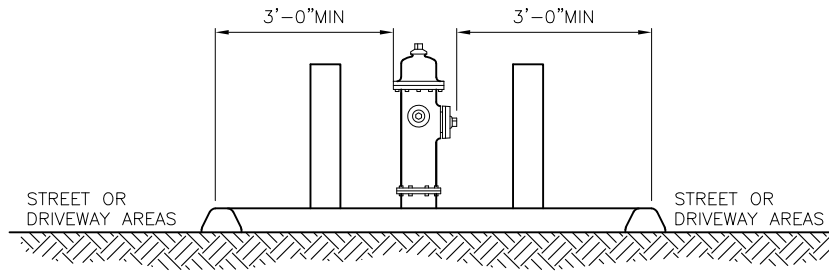

CONCRETE SHEAR BLOCK SEE STD PLANS NO 310a & 311a

2" ISLAND SURFACE MATERIAL OVER 4" COMPACTED MINERAL AGGREGATE TYPE 2 TOMATCH SURROUNDING PAVEMENT MATERIAL AND BE FLUSH WITH TOP OF CURB


FIXED BOLLARD, SEE STD PLAN NO 465 (TYP)

EXTRUDED CURB MATERIAL TO MATCH EX. PAVEMENT MATERIAL. SEE STD SPEC SEC 8-06

NOTE:

LAYOUT OF MARKER POST MUST BE VERIFIED FIRST WITH SPU AND SDOT

TRAFFIC ISLAND MARKER POST LAYOUT FOR FIRE HYDRANTS IN PARKING AREAS

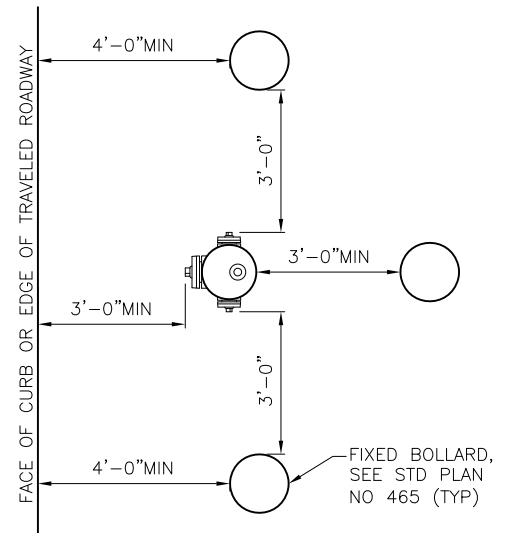

MARKER POST LAYOUT FOR FIRE HYDRANTS IN PARKING AREAS


REF STD SPEC SEC 7-14




City of Seattle

NOT TO SCALE

FIRE HYDRANT MARKER LAYOUT

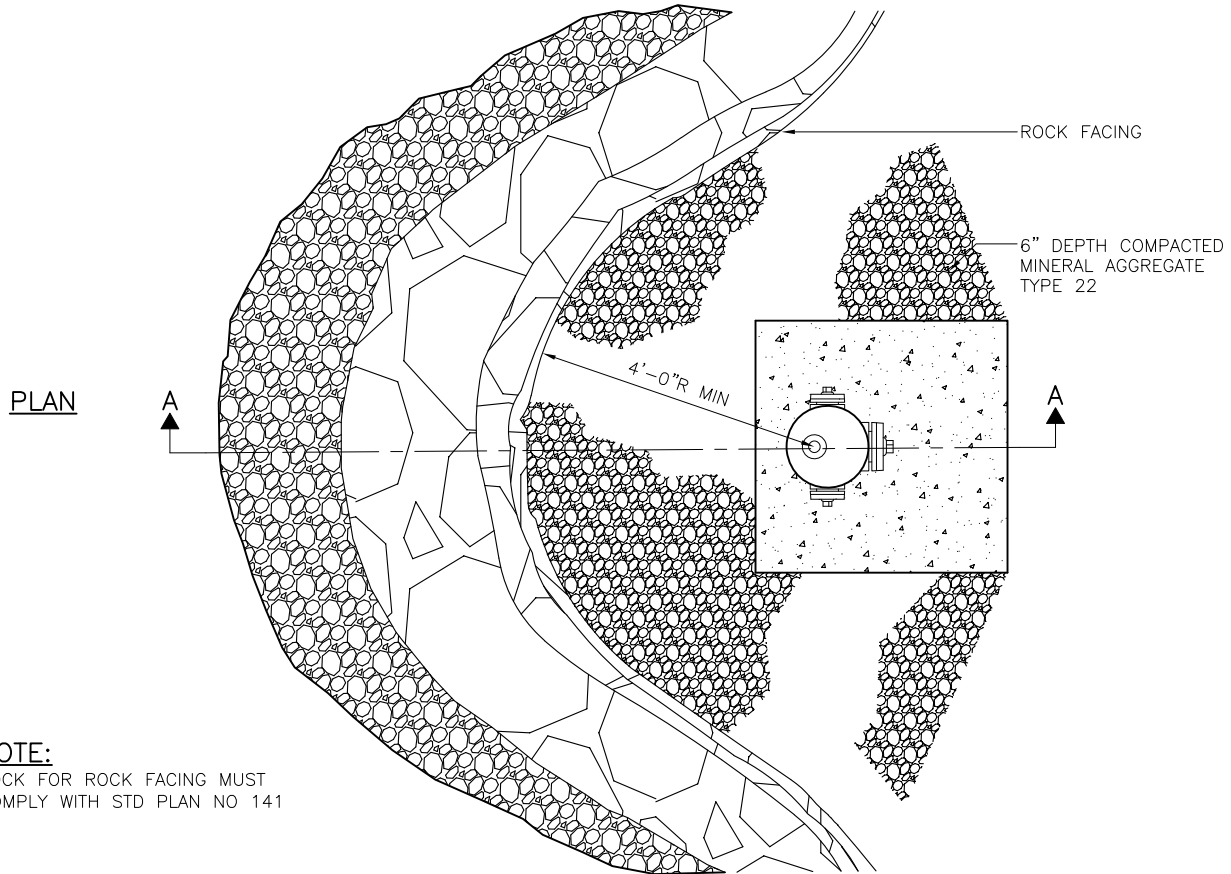

NOTE:
ROCK FOR ROCK FACING MUST COMPLY WITH STD PLAN NO 141

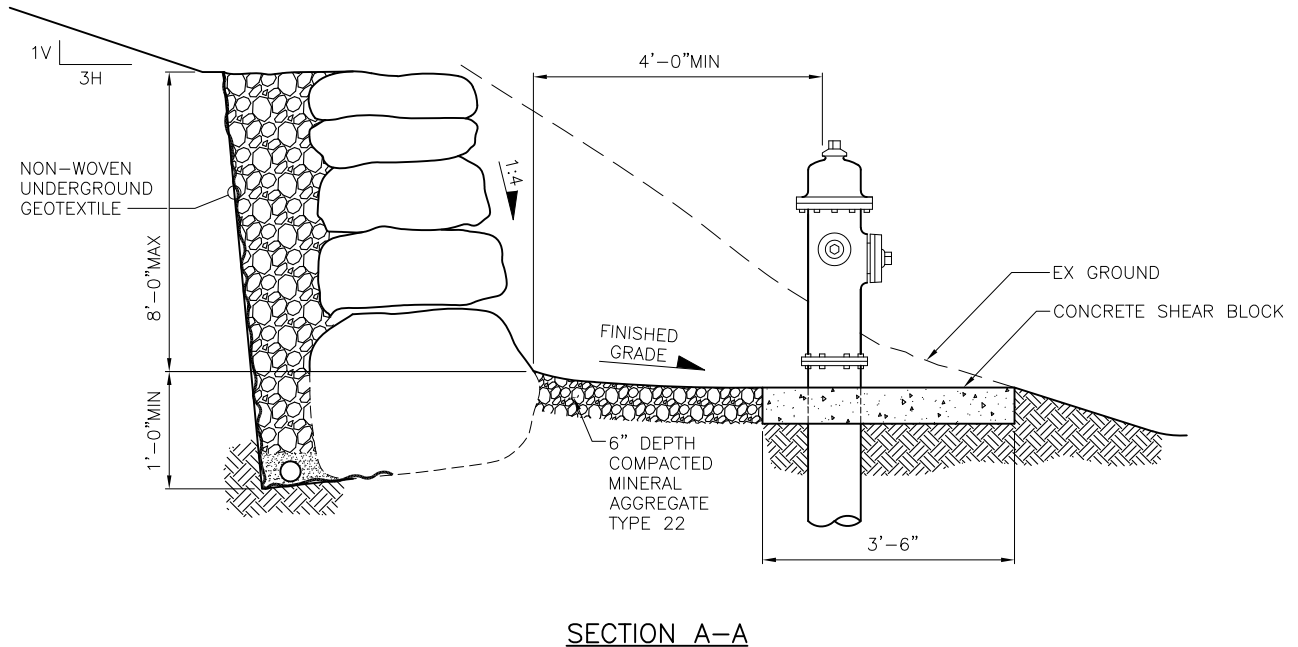

REF STD SPEC SEC 2-13



City of Seattle

NOT TO SCALE

WALL REQUIREMENTS FOR HYDRANTS


NOTES:

1. NO PARKING ZONE WITHIN 15'-0" RADIUS OF FIRE HYDRANT.
2. MIN DISTANCE FROM BACK FACE OF HYDRANT TO FRONT EDGE OF CONCRETE WALK MUST BE 2'-0".
3. MARKER MUST BE 6" OFFSET FROM CENTER OF ROADWAY IF CENTERLINE IS NOT STRIPED, OR 6" OFF STRIPED CENTERLINE. WHERE MEDIANS OR TWO-WAY LEFT TURN LANES EXIST, MARKER MUST BE INSTALLED WITH 6" OFFSET FROM THE LANE LINE CLOSEST TO THE HYDRANT

INSTALL BLUE TYPE 2A LANE MARKER ADJACENT TO FIRE HYDRANTS. SEE NOTE 3 (TYP)

3'-0"MIN, 15'-0"MAX ON CORNERS
7'-0"MAX MIDBLOCK

CURB OR EDGE OF TRAVELED PORTION OF ROADWAY

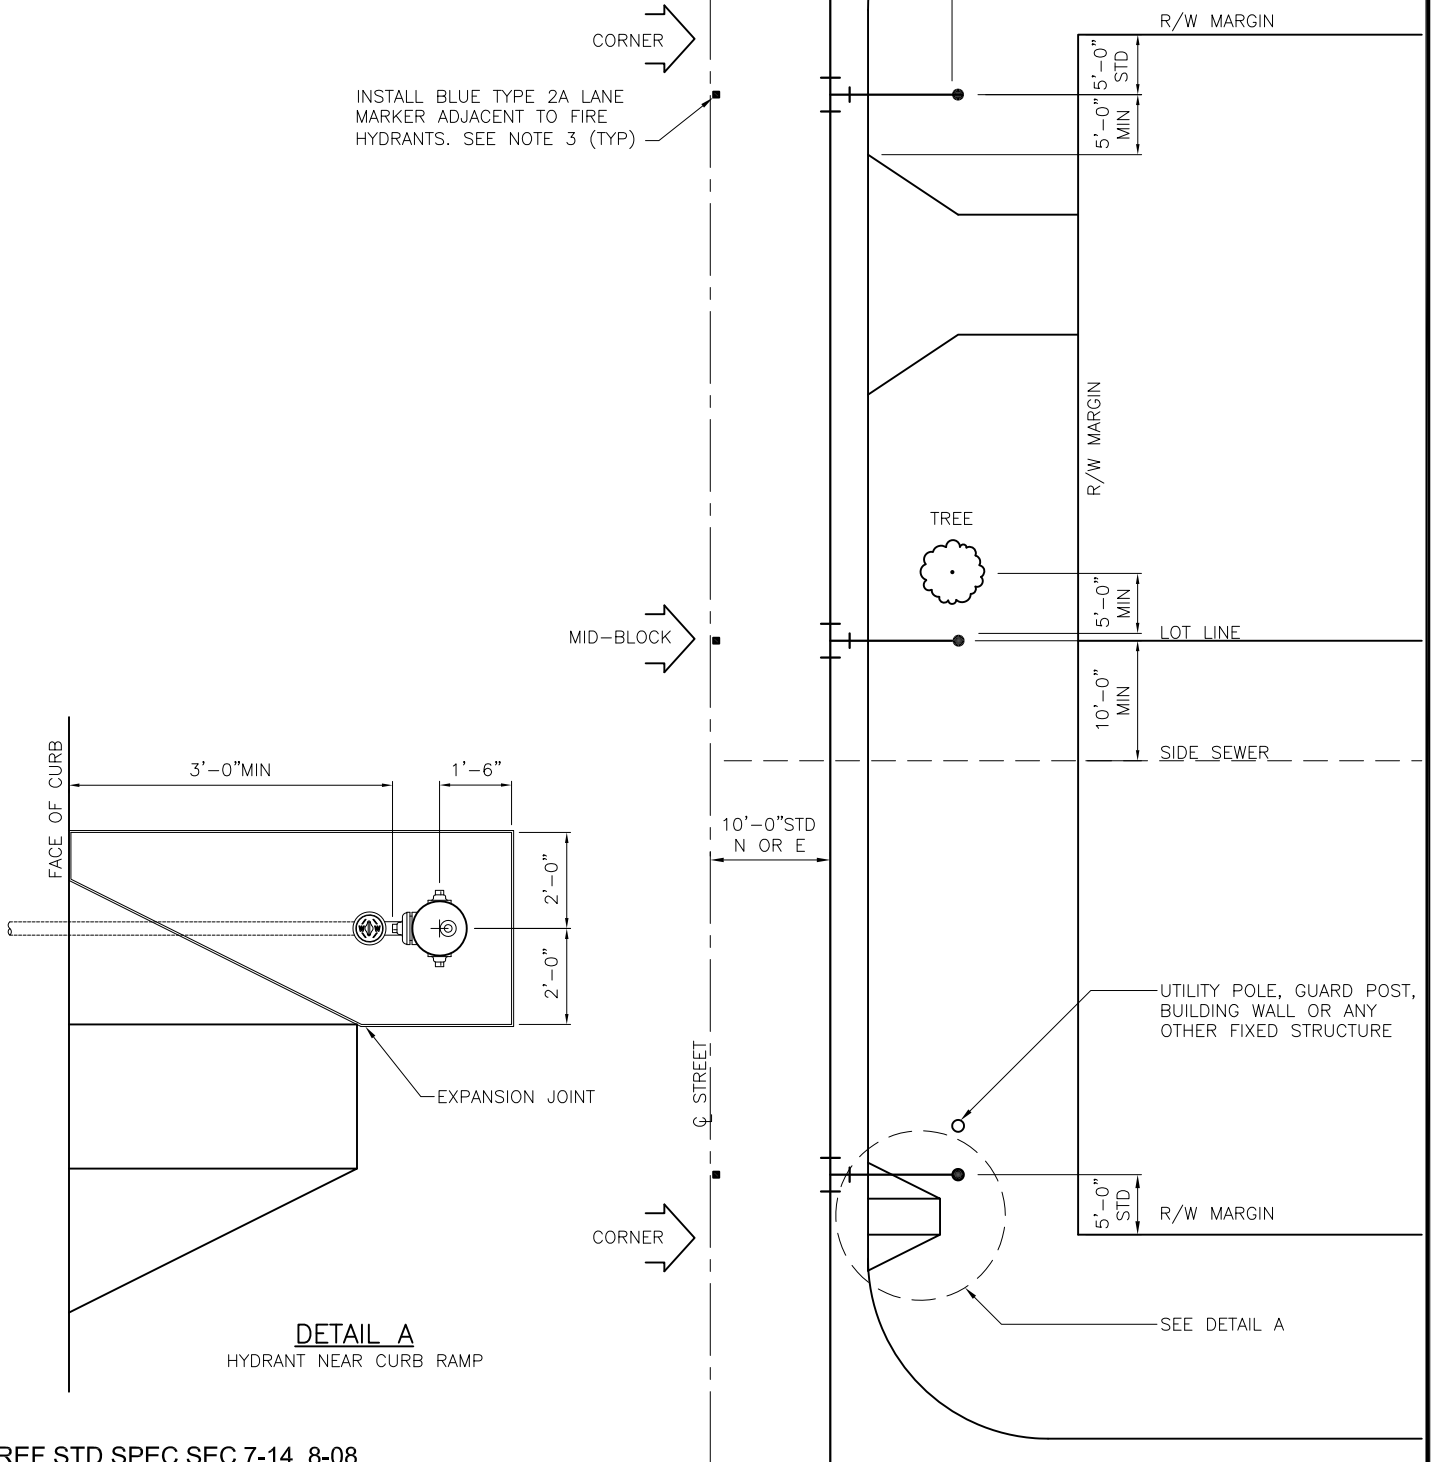

DETAIL A
HYDRANT NEAR CURB RAMP

REF STD SPEC SEC 7-14, 8-08



City of Seattle


NOT TO SCALE

**FIRE HYDRANT
LOCATIONS & CLEARANCES**

NOTES:

1. UNION POINT 2' OUTSIDE VAULT OR 2' FROM PROPERTY LINE.
2. 5' CLEARANCE FROM NEW TREES OR CLEAR OF DRIP LINE FOR EXISTING TREES
3. 5' CLEAR FROM POLES.
4. 2' CLEAR FROM EDGE OF DRIVEWAY OR ADA RAMP.
5. WATER SERVICE NOT TO BE INSTALLED IN DRIVEWAY, BEHIND ADA RAMP, OR STREET CORNER.
6. SIDE SEWER HORIZONTAL CLEARANCE 10' FOR CAST IRON WATER PIPE OR 5' FOR DUCTILE IRON WATER PIPE.
7. SIDE SEWER VERTICAL CLEARANCE 1.5' MIN.
8. VAULT HORIZONTAL CLEARANCE 12" MIN FROM OTHER UTILITIES. UNLESS OTHERWISE NOTED IN STD SPECS.
9. VERTICAL CLEARANCE 12" MIN FOR ALL OTHER UTILITY CROSSINGS UNLESS OTHERWISE NOTED IN STD SPECS.

SEE STD PLAN NO 003q FOR TYPICAL WATER SERVICE VAULTS

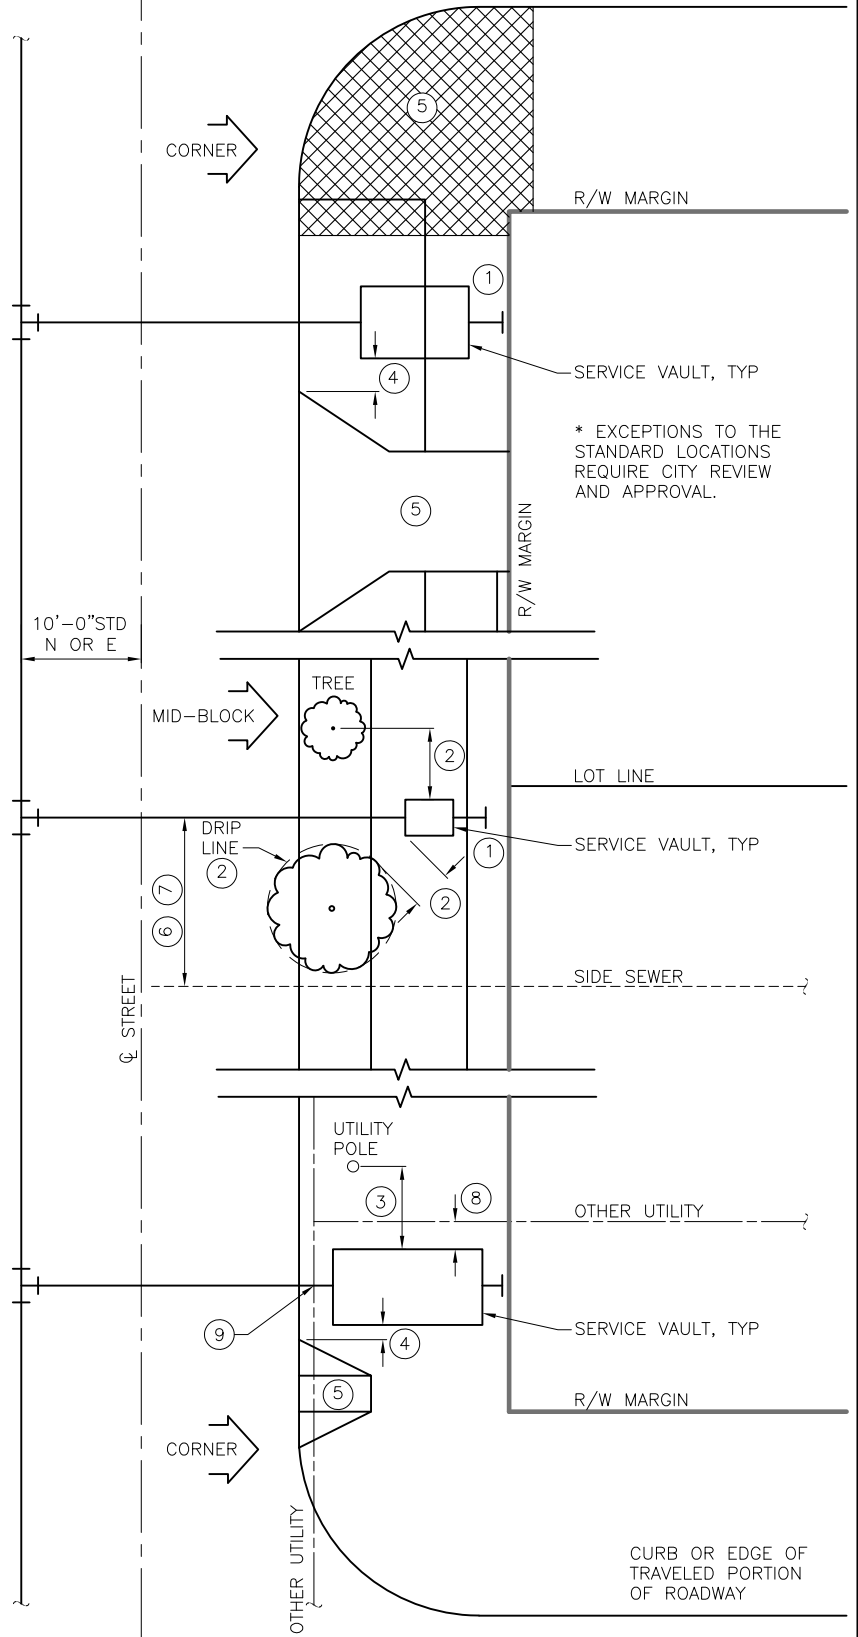


REF STD SPEC SEC 1-07.17(2)




City of Seattle

NOT TO SCALE

CLEARANCES FOR TYPICAL WATER SERVICE VAULTS

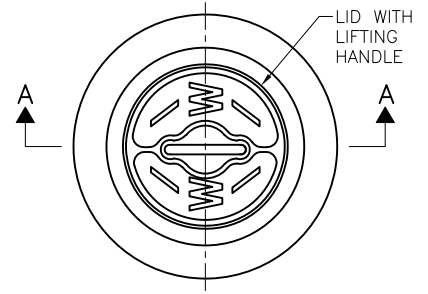


PLAN

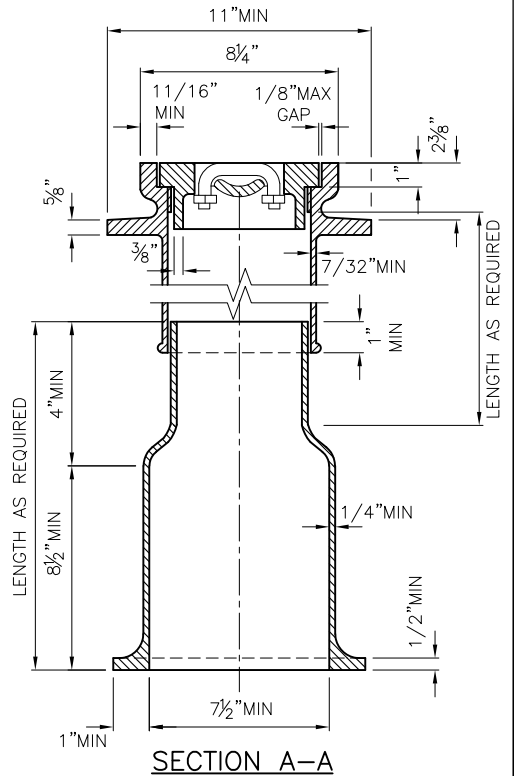

SECTION A-A

NOTE:
VALVE BOX FOR USE ON 12" OR
SMALLER VALVE INSTALLATIONS

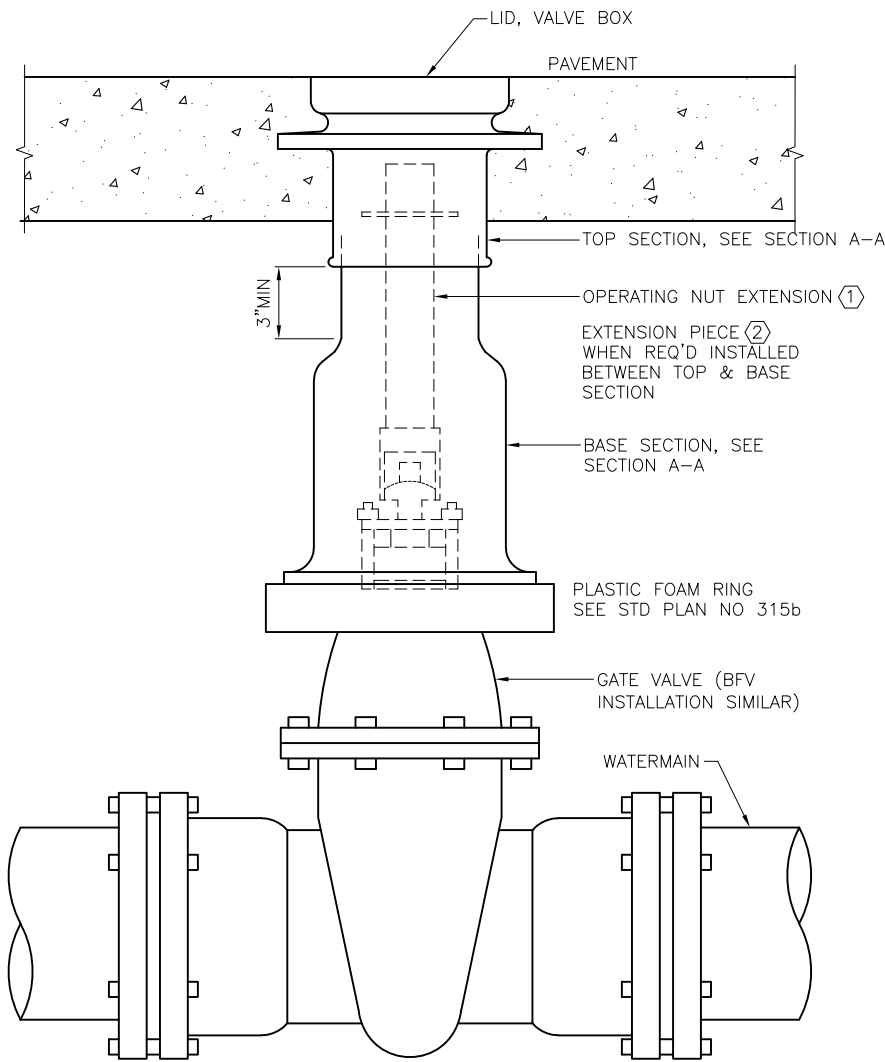

VALVE BOX ASSEMBLY
TYPICAL SETTING DETAIL


REF STD SPEC SEC 7-12




City of Seattle

NOT TO SCALE


CAST IRON VALVE BOX &
OPERATING NUT EXTENSION

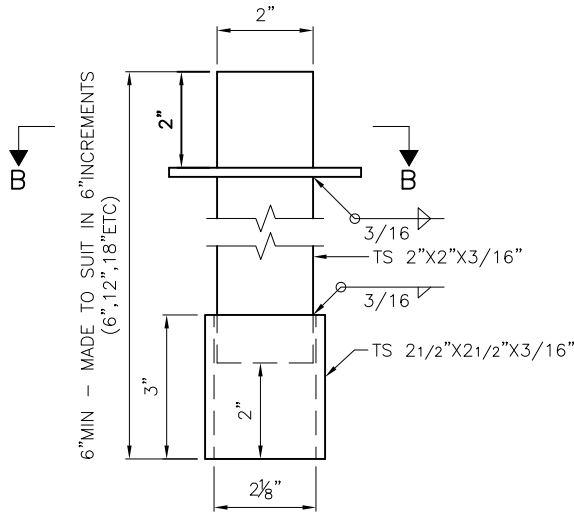


OPERATING NUT EXTENSION DETAIL 1

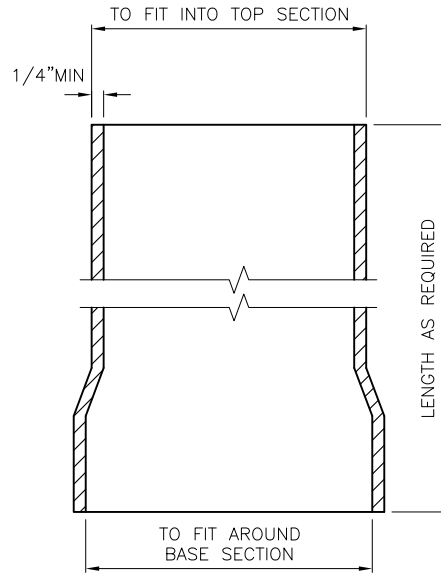

EXTENSION PIECE 2
WHEN REQUIRED

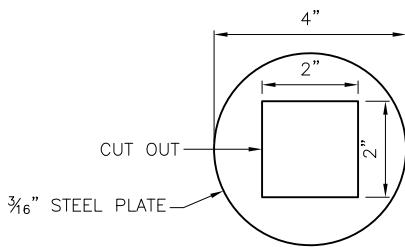

SECTION B-B

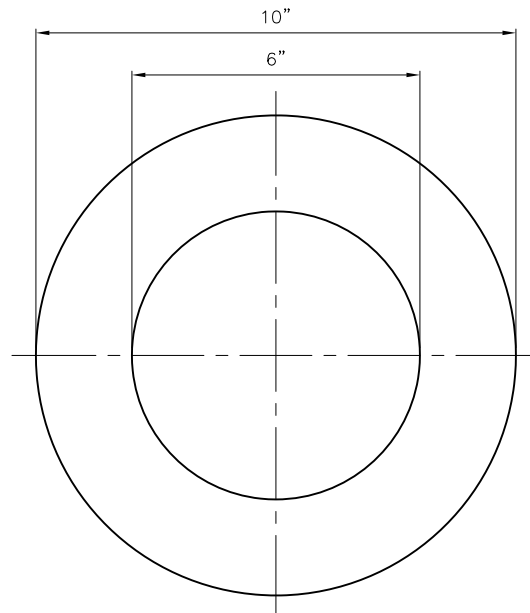

PLASTIC FOAM RING DETAIL

NOTES:

1. FRAME AND COVER MUST BE TESTED FOR ACCURACY OF FIT AND MUST BE MARKED IN SETS FOR DELIVERY
2. CASTINGS AND EXTENSIONS MUST BE HOT-DIPPED IN ASPHALTIC VARNISH ROYSTON ROSKOTE #612XM OR 2 COATS OF MASTIC ROYSTON INSIDE AND OUT.
3. VALVE BOXES MUST BE EAST JORDAN: COVER & TOP SECTION #3664, BOTTOM SECTION #8555; OR OLYMPIC FOUNDRY: LID #1908-33, TOP SECTION #1106-33, BASE SECTION #1301-33
4. ALL CASTINGS MUST BE DUCTILE OR GREY CAST IRON

LEGEND:

1. AN OPERATING NUT EXTENSION MUST BE INSTALLED WHEN THE GROUND SURFACE IS MORE THAN 2'-6" ABOVE THE VALVE OPERATING NUT. THE OPERATING NUT EXTENSION MUST EXTEND INTO THE TOP SECTION OF THE STANDARD VALVE BOX AND MUST CLEAR THE BOTTOM OF THE LID BY 6" MIN
2. EXTENSION PIECES (WHEN USED) MUST CONFORM TO MINIMUM THICKNESS REQUIREMENTS AND MUST FIT INTO THE TOP SECTION AND OVER THE BOTTOM SECTION


REF STD SPEC SEC 7-12, 9-30



City of Seattle


NOT TO SCALE

CAST IRON VALVE BOX & OPERATING NUT EXTENSION

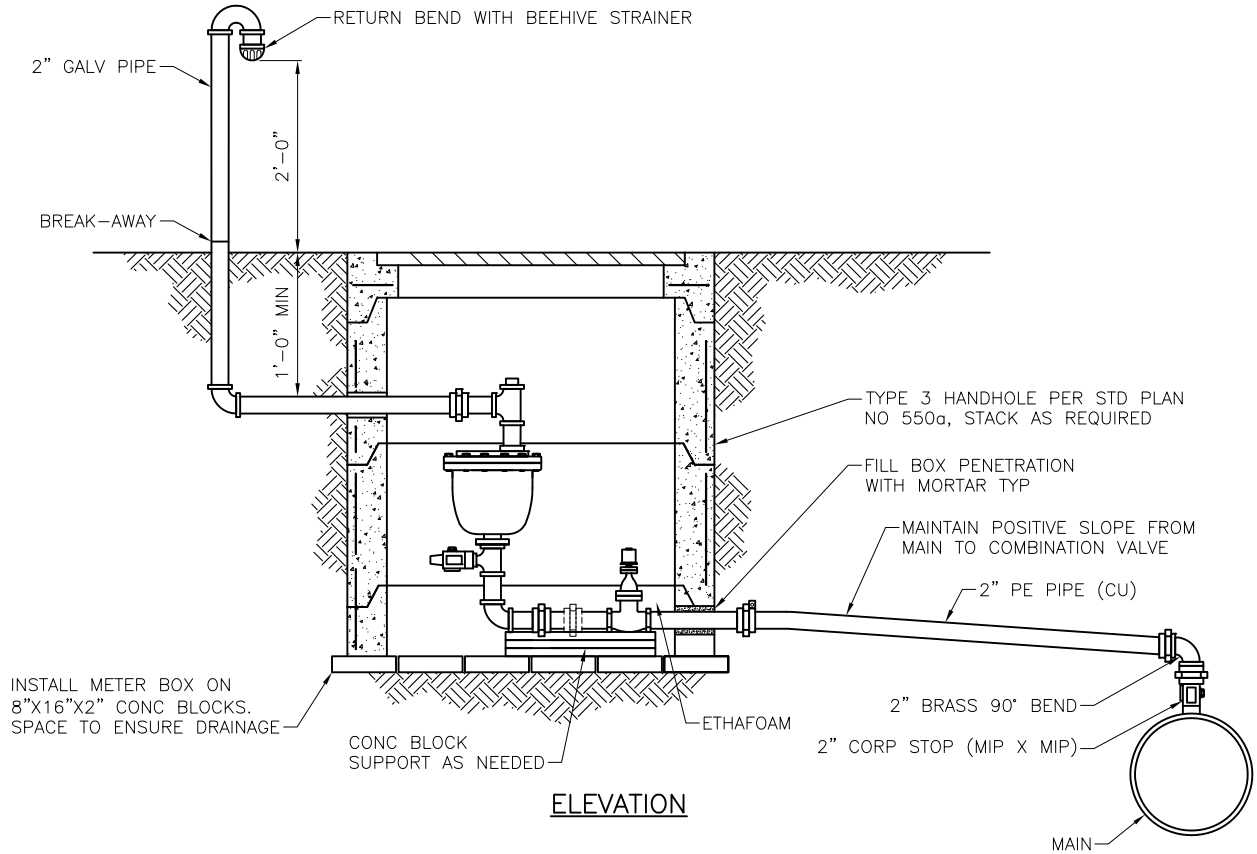

NOTES:

1. COMBINATION AIR RELEASE AND VACUUM VALVE MUST BE A 2" SIZE MINIMUM UNLESS OTHERWISE SHOWN N THE PLANS.
2. FOR 1" COMBINATION VALVE, INSTALL 2" X 1" REDUCER BETWEEN GATE VALVE AND UNION.
3. TEE MUST BE 2"x2"x1" WITH 1" CORP STOP FOR 2" COMBINATION VALVE. TEE MUST BE 2"x2"x¾" WITH ¾" CORP STOP FOR 1" COMBINATION VALVE.
4. SET METER BOX WITHIN CITY ROW, FLUSH WITH SIDEWALK OR CURB ELEVATION IF LOCATED IN LAWN ARES. SET METER BOX APPROXIMATELY 2" ABOVE FINISHED GRADE IF IN LANDSCAPED AREA.

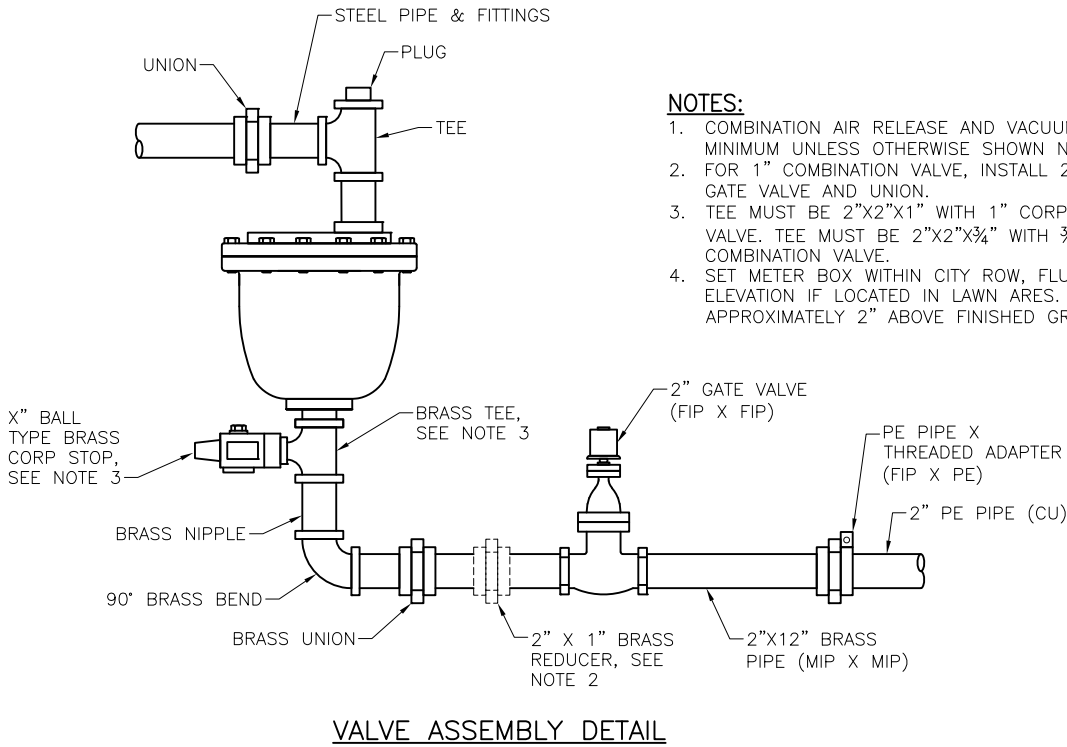


REF STD SPEC SEC 7-12



City of Seattle

NOT TO SCALE


AIR RELEASE
AIR VACUUM VALVE

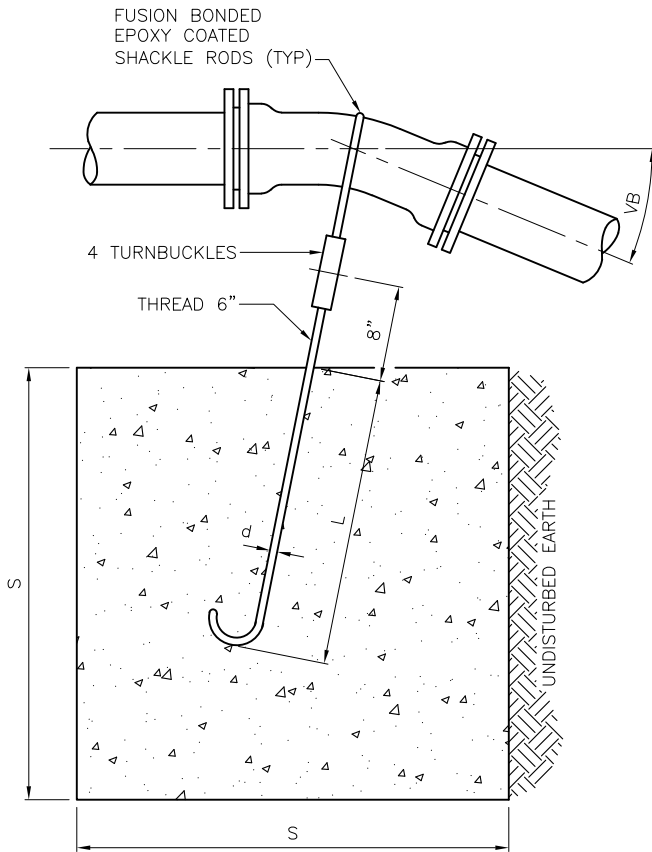

TYPE A

TYPE A BLOCKING FOR 11¼° & 22½° VERTICAL BENDS

PIPE SIZE NOM DIA INCHES	TEST PRESSURE PSI	VB VERTICAL BEND DEGREES	NO OF CU FT OF CONC BLOCKING	S SIDE OF CUBE FEET	d DIA OF SHACKLE RODS (2) INCHES	L DEPTH OF RODS IN CONCRETE INCHES
4"	300	11¼	8	2	¾	18
		22½	12	2¼		24
6"	300	11¼	12	2¼	¾	24
		22½	27	3		24
8"	300	11¼	16	2½	¾	24
		22½	43	3½		24
12"	300	11¼	64	4	1	24
		22½	125	5	1	36

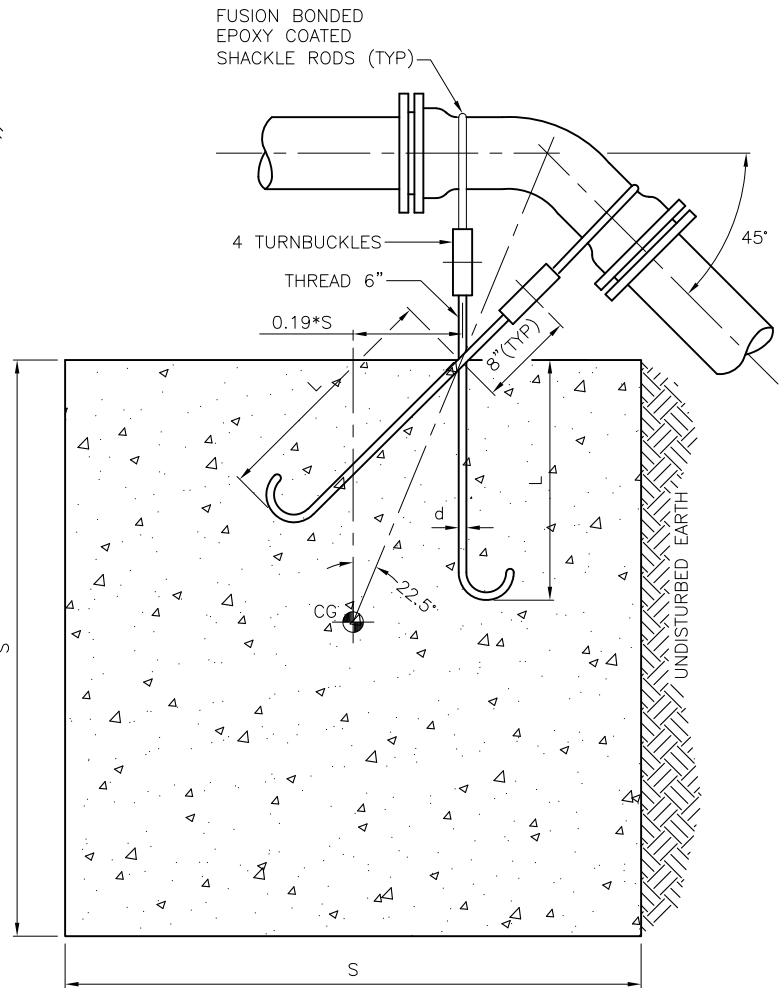

TYPE B

TYPE B BLOCKING FOR 45° VERTICAL BENDS

PIPE SIZE NOM DIA INCHES	TEST PRESSURE PSI	VB VERTICAL BEND DEGREES	NO OF CU FT OF CONC BLOCKING	S SIDE OF CUBE FEET	d DIA OF SHACKLE RODS (2) INCHES	L DEPTH OF RODS IN CONCRETE INCHES
4"	300	45	27	3	¾	20
6"			64	4		
8"			125	5		
12"			216	6		

FOR NOTES SEE STD PLAN NO 330b


REF STD SPEC SEC 7-11



City of Seattle

NOT TO SCALE

WATERMAIN THRUST BLOCKING VERTICAL FITTINGS

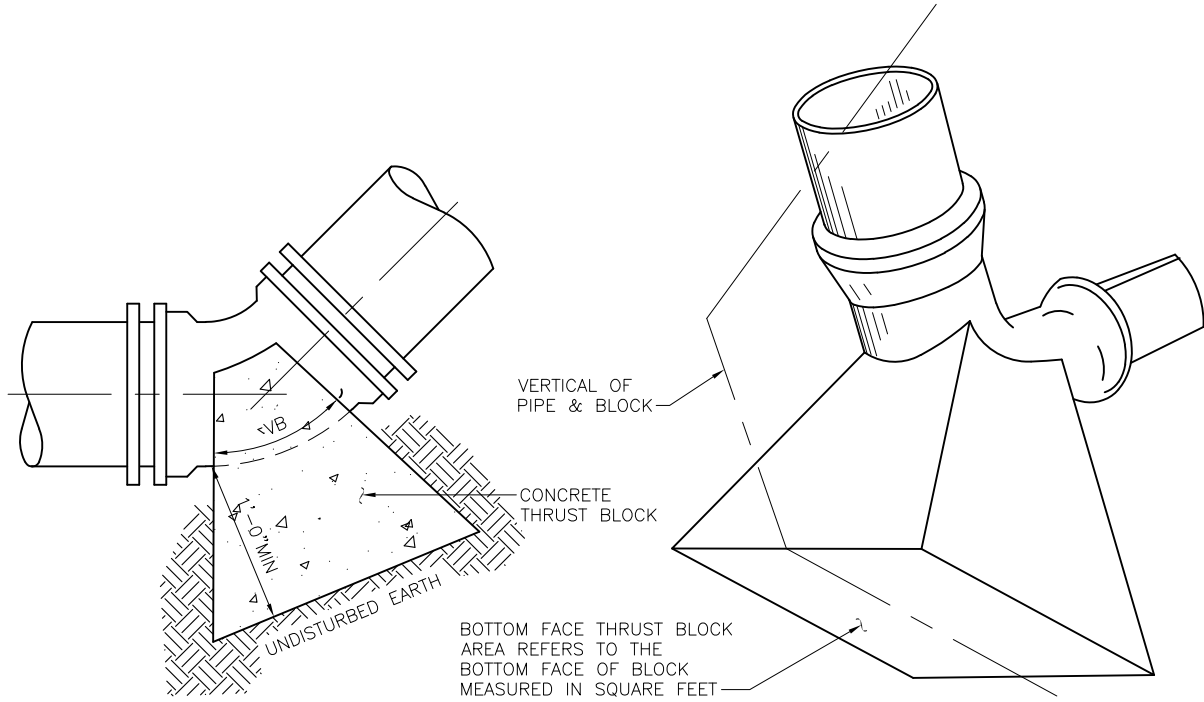

TYPE C

TYPE "C" BLOCKING FOR 1 1/4", 2 1/2", 45° AND 90° VERTICAL BENDS										
THRUST BLOCK AREA IN SQUARE FEET										
PIPE SIZE	SOIL	FIRM SILT OR FIRM SILTY SAND			COMPACT SAND			COMPACT SAND & GRAVEL		
	FITTING	90° BEND	TEE, 45° BEND & DEAD END	1 1/4" & 2 1/2" BEND	90° BEND	TEE, 45° BEND & DEAD END	1 1/4" & 2 1/2" BEND	90° BEND	TEE, 45° BEND & DEAD END	1 1/4" & 2 1/2" BEND
4"		5.8	4.2	1.7	2.9	2.1	1.0	2.2	1.6	1.0
6"		13.3	9.4	3.8	6.7	4.7	1.9	5.0	3.5	1.4
8"		23.3	16.7	6.7	11.7	8.4	3.4	8.8	6.3	2.5
12"		53.0	37.5	15.0	26.5	18.8	7.5	20.0	14.0	5.6
AREAS CALCULATED ON 300 PSI TEST PRESSURE AND 3'-0" MIN COVER OVER WATERMAIN										

NOTES:

1. LOCATION AND SIZE OF BLOCKING FOR PIPE LARGER THAN 12" DIAMETER AND FOR SOIL TYPES DIFFERENT THAN SHOWN MUST BE DETERMINED BY THE ENGINEER.
2. ALL BLOCKING FOR VERTICAL FITTINGS (POURED IN PLACE) MUST BEAR AGAINST UNDISTURBED NATIVE GROUND.
3. ALL POURED THRUST BLOCKS MUST BE BACKFILLED AFTER MIN. 1 DAY. PRESSURE TESTING MUST OCCUR AFTER CONCRETE HAS REACHED f'c.
4. ALL BLOCKING MUST BE CONCRETE CL 3000.
5. AFTER INSTALLATION, SHACKLE RODS & TURNBUCKLES MUST BE CLEANED AND COATED WITH 2 COATS OF ASPHALTIC VARNISH, ROYSTON ROYKOTE #612M OR APPROVED EQUAL.
6. SHACKLE RODS MUST BE FUSION BONDED EPOXY COATED ROUND MILD STEEL, ASTM A 36, WITH THREADS ON ENDS ONLY.
7. BLOCKING AGAINST FITTINGS MUST BEAR AGAINST THE GREATEST FITTING SURFACE AREA POSSIBLE, BUT MUST NOT COVER OR ENCLOSE BELL ENDS, JOINT BOLTS OR GLANDS. REASONABLE ACCESS TO BOLTS AND GLANDS MUST BE PROVIDED.


REF STD SPEC SEC 7-11




City of Seattle

NOT TO SCALE


**WATERMAIN THRUST BLOCKING
VERTICAL FITTINGS**

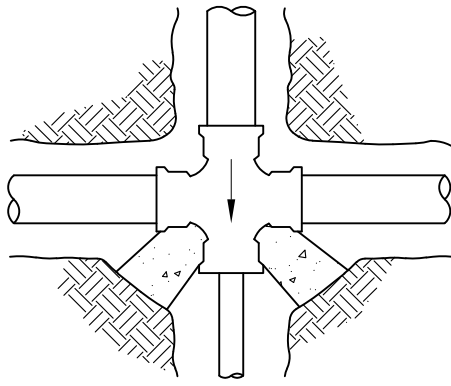


UNBALANCED CROSS

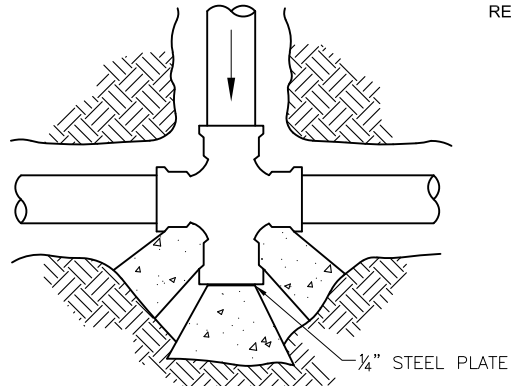


CROSS WITH PLUG

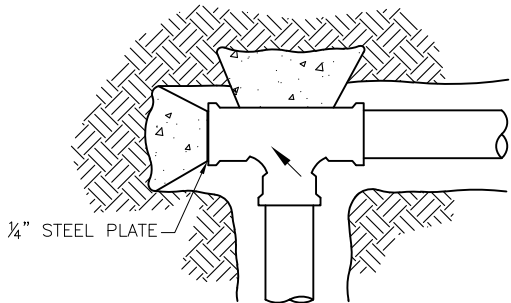


PLUGGED TEE

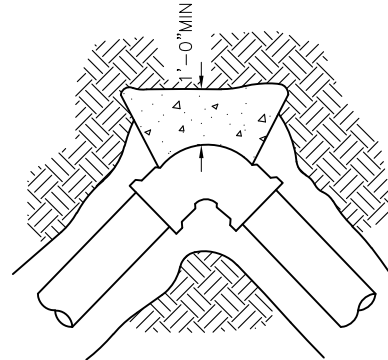

HORIZONTAL BEND

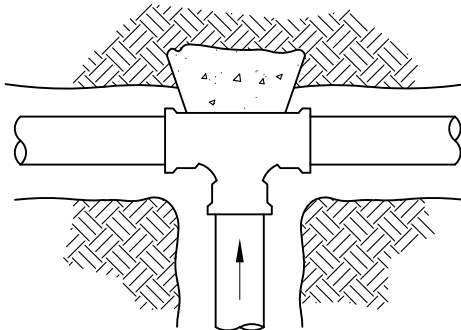

TEE

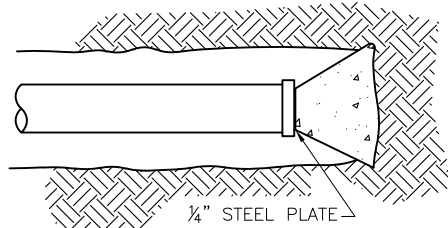


PIPE & CAP

THRUST BLOCK AREA IN SQUARE FEET (SEE STD PLAN NO 331B)

PIPE SIZE	FIRM SILT OR FIRM SILTY SAND		COMPACT SAND				COMPACT SAND & GRAVEL					
	90° BEND	TEE	45° BEND CAP OR PLUG	11¼' & 22½' BEND	90° BEND	TEE	45° BEND CAP OR PLUG	11¼' & 22½' BEND	90° BEND	TEE	45° BEND CAP OR PLUG	11¼' & 22½' BEND
4"	7.0	4.2	4.2	1.7	2.9	2.1	2.1	1.0	2.2	1.6	1.6	1.0
6"	13.3	9.4	9.4	3.8	6.7	4.7	4.7	1.9	5.0	3.5	3.5	1.4
8"	23.3	16.7	16.7	6.7	11.7	8.4	8.4	3.4	8.8	6.3	6.3	2.5
12"	53.0	37.5	37.5	15.0	26.5	18.8	18.8	7.5	20.0	14.0	14.0	5.6

AREAS CALCULATED ON 300 PSI TEST PRESSURE AND 3'-0" MIN COVER OVER WATERMAIN

 ECOLOGY BLOCKS, PER STD PLAN NO 460, MAY BE USED, AT THE DISCRETION OF THE ENGINEER ONLY, IN LIEU OF POURED-IN-PLACE BLOCKING FOR FITTINGS IN HEAVY OUTLINED PORTION OF TABLE. ECOLOGY BLOCKS USED FOR THRUST BLOCKING AT TEES MUST TRANSFER LOAD TO THE PIPE BODY PER SPEC SECTION 7-11.3(13).


REF STD SPEC SEC 7-11



City of Seattle

NOT TO SCALE

WATERMAIN THRUST BLOCKING HORIZONTAL FITTINGS

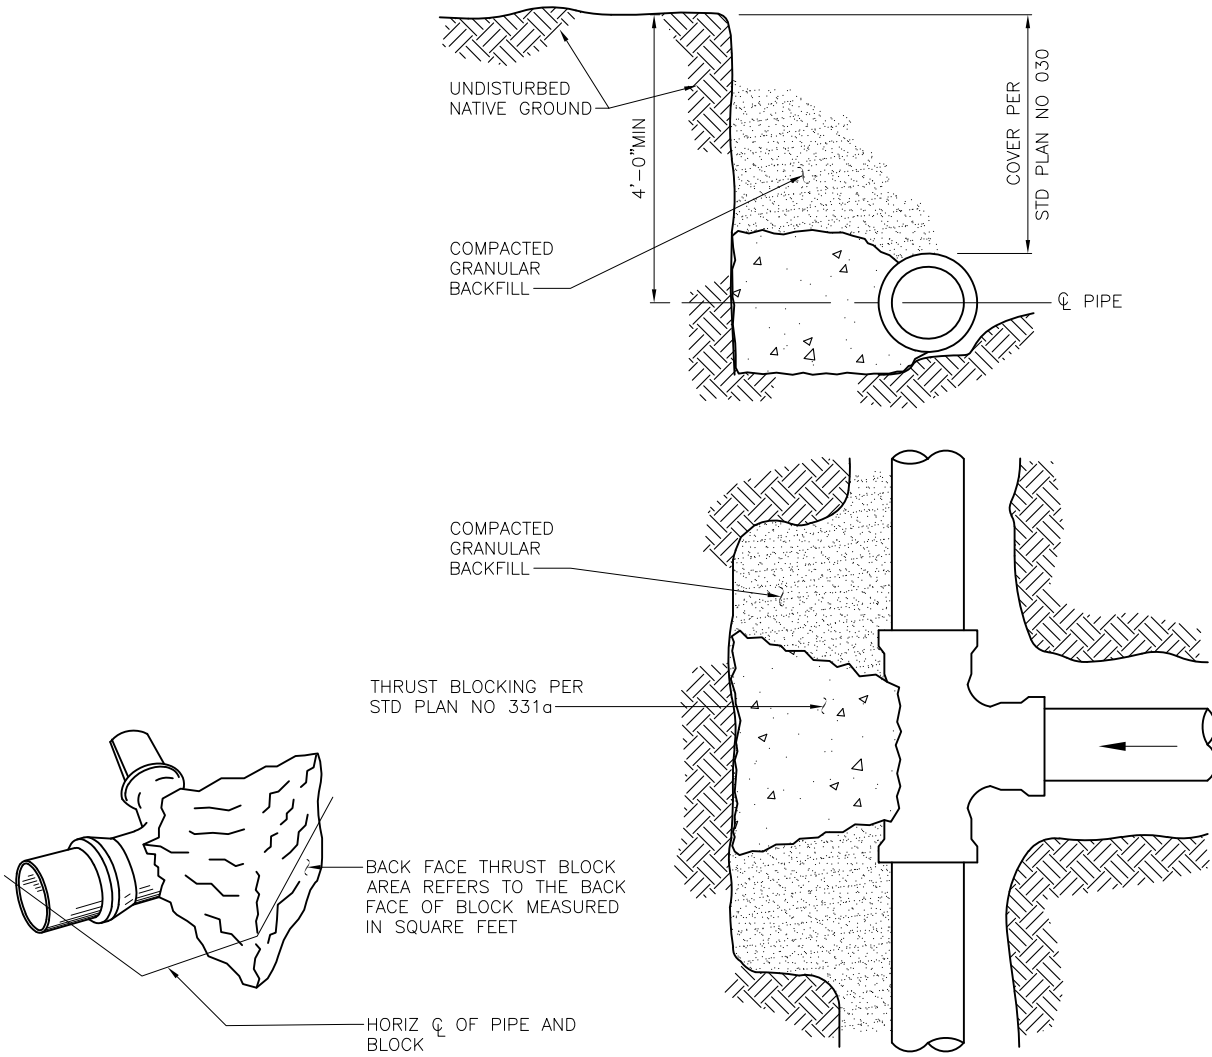

THRUST BLOCK DETAIL

NOTES:

1. LOCATION AND SIZE OF BLOCKING FOR PIPE LARGER THAN 12" DIAMETER AND FOR SOIL TYPES DIFFERENT THAN SHOWN MUST BE DETERMINED BY THE ENGINEER.
2. ALL BLOCKING FOR HORIZONTAL FITTINGS (POURED IN PLACE) MUST BEAR AGAINST UNDISTURBED NATIVE GROUND.
3. ALL POURED THRUST BLOCKS MUST BE BACKFILLED AFTER MIN. 1 DAY. PRESSURE TESTING MUST OCCUR AFTER CONCRETE HAS REACHED f'c.
4. ALL BLOCKING TO BE CONCRETE CL 3000.
5. BLOCKING AGAINST FITTINGS MUST BEAR AGAINST THE GREATEST FITTING SURFACE AREA POSSIBLE, BUT MUST NOT COVER OR ENCLOSE BELL ENDS, JOINT BOLTS OR GLANDS. ACCESS TO BOLTS AND GLANDS MUST BE PROVIDED.
6. ALL HORIZONTAL BLOCKING THRUST AREAS MUST BE CENTERED ON PIPE.
7. WHERE POURED-IN-PLACE BLOCKING IS REQUIRED AT A POINT OF CONNECTION TO AN EXISTING WATERMAIN, THE BLOCKING MUST BE INSTALLED PRIOR TO CONNECTION.
8. TEMPORARY BLOCKING, IF USED, MUST BE APPROVED BY ENGINEER.



REF STD SPEC SEC 7-11



City of Seattle

NOT TO SCALE

**WATERMAIN THRUST BLOCKING
HORIZONTAL FITTINGS**

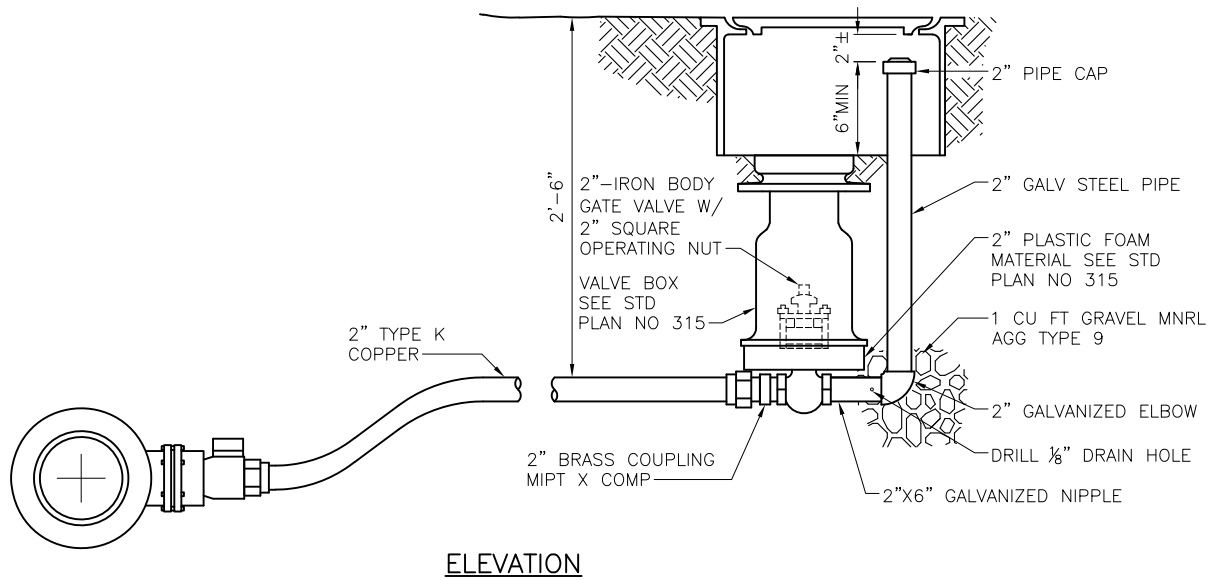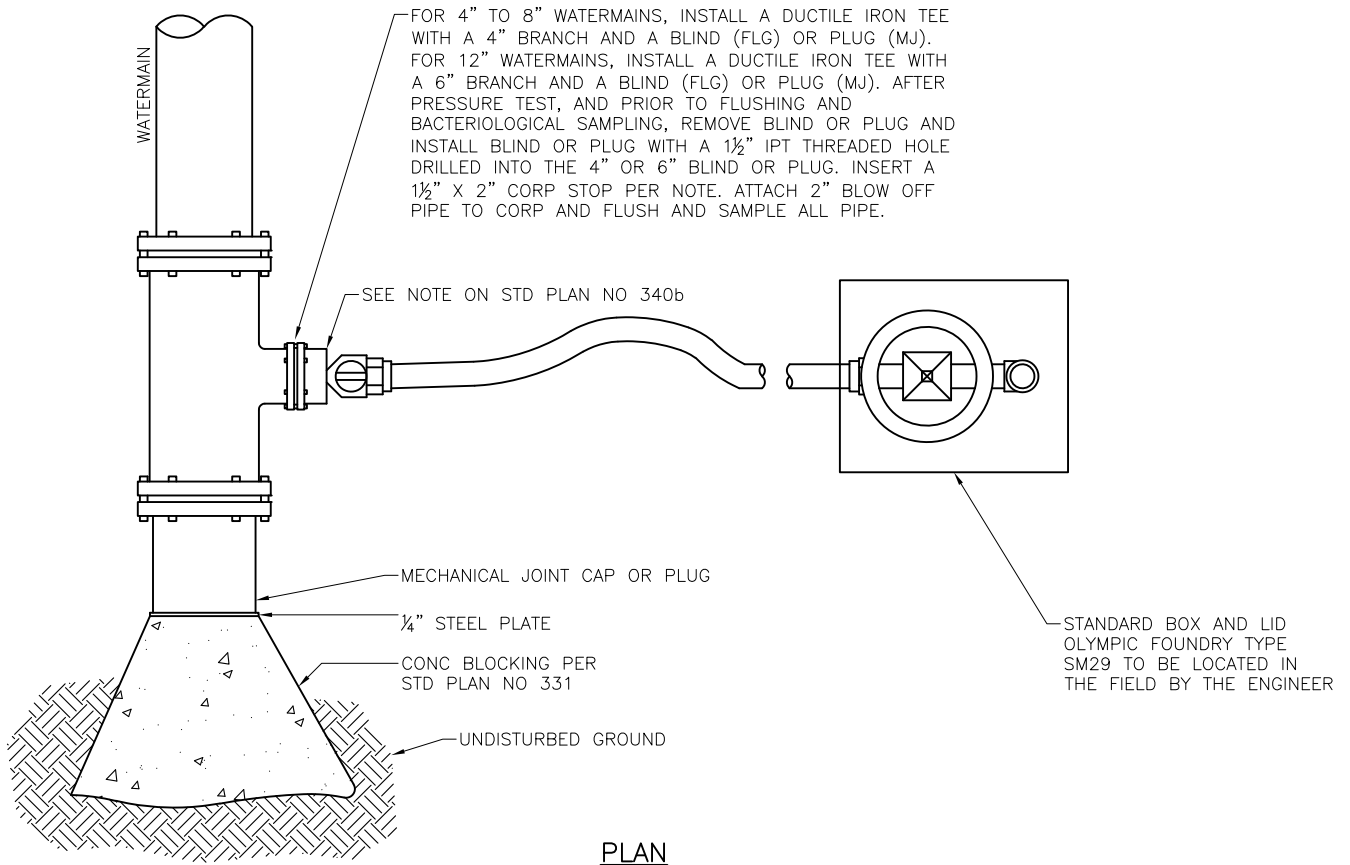


REF STD SPEC SEC 7-11




City of Seattle

NOT TO SCALE

2" BLOW OFF TYPE A
NON TRAFFIC INSTALLATION

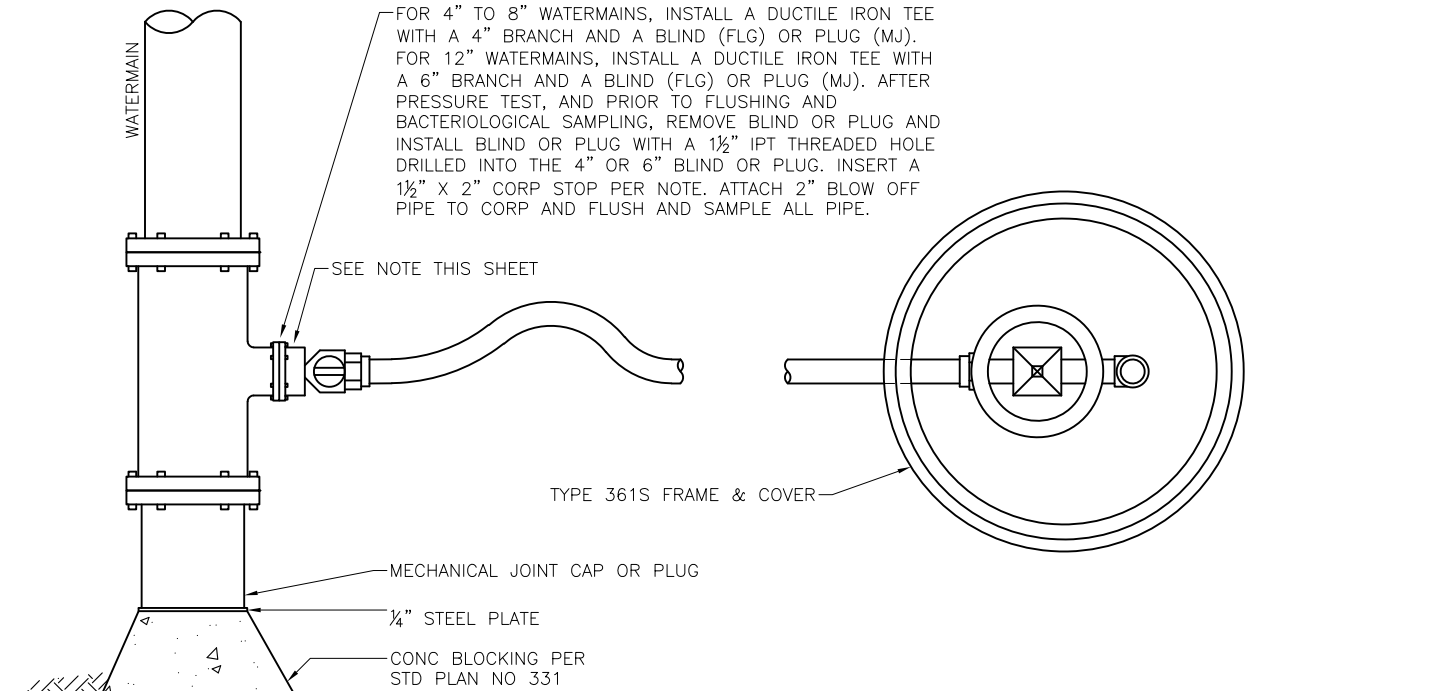

PLAN

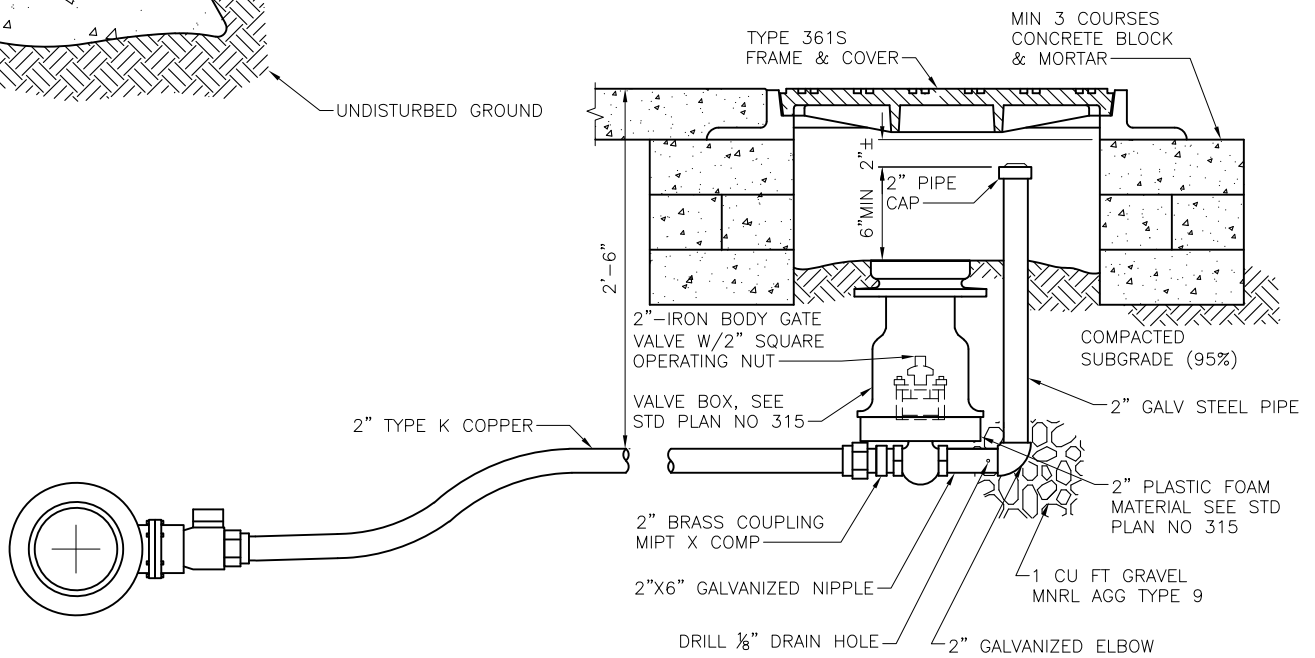

ELEVATION

NOTE:

1 1/2" X 2" COMP STOP, BALL TYPE BRASS BODY AWWA X COMP. WHERE COATED DUCTILE IRON PIPE IS USED, THE MECHANICAL JOINT CAP AND COMP MUST BE WAX TAPED PER 7-11.3(8)A AND 9-30.1(4)F.


REF STD SPEC SEC 7-11



City of Seattle

NOT TO SCALE

2" BLOW OFF DETAIL TYPE B TRAFFIC INSTALLATION

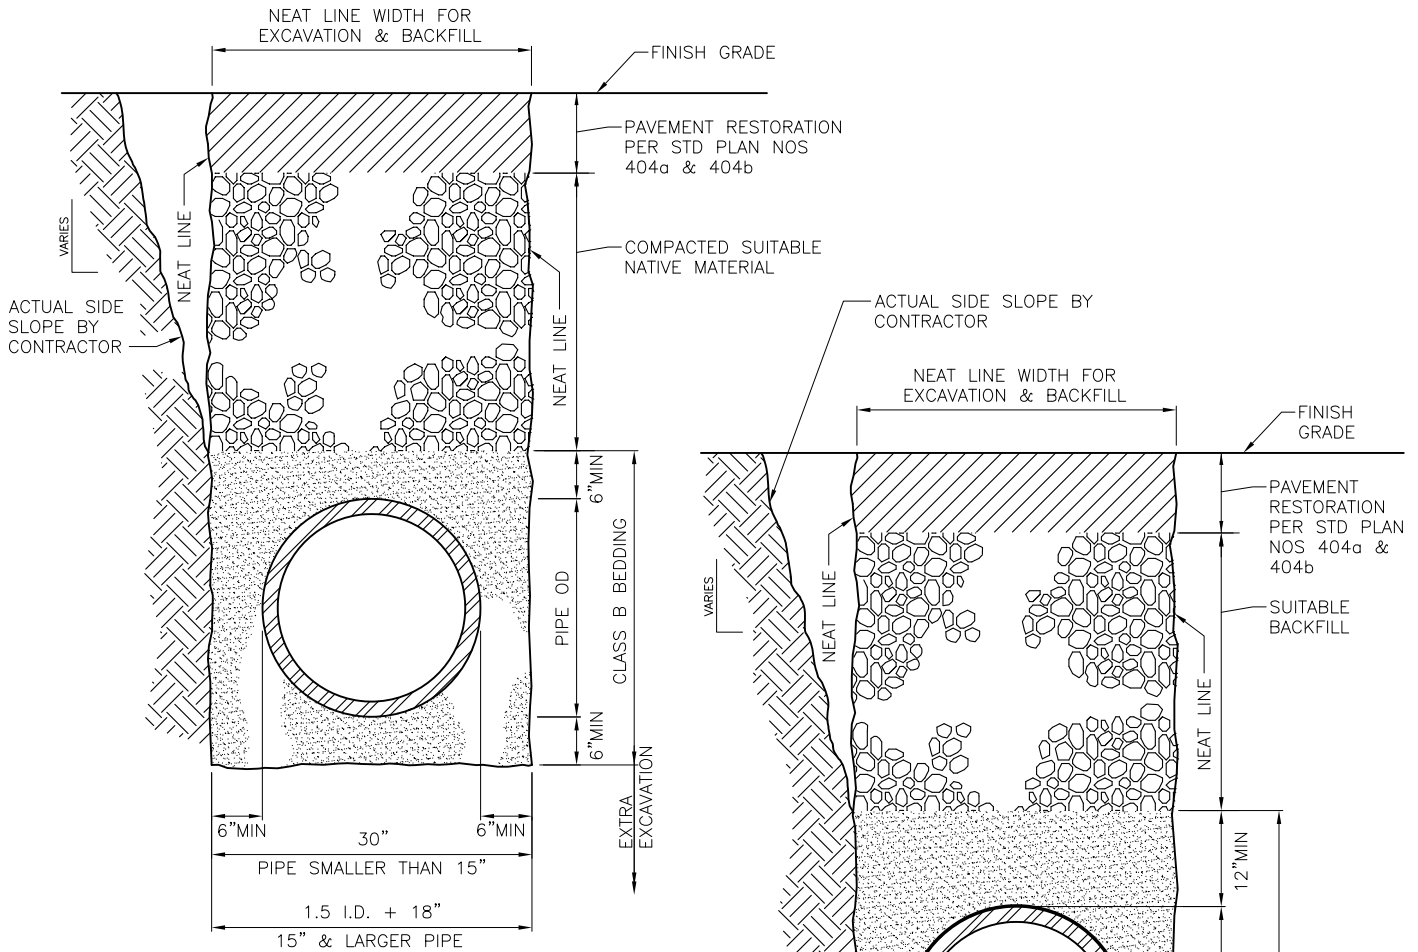

TYPICAL BEDDING

BEDDING AT TRENCH CROSSING

BEDDING MATERIAL

CLASS B:

- FOR DISTRIBUTION WATERMAIN, MINERAL AGGREGATE PER STD SPEC 9-03.16 TYPE 6 OR TYPE 7
- FOR TRANSMISSION WATERMAIN, MINERAL AGGREGATE PER STD SPEC 9-03.16 TYPE 9
- SPECIAL BEDDING TO BE INDICATED ON DRAWINGS

NOTES:

1. EXCAVATE FOR THE BELL TO ENSURE UNIFORM SUPPORT FOR THE PIPE BARREL
2. FOR FLUIDIZED THERMAL BACKFILL (FTB) OR CDF CROSSINGS OF METALLIC PIPE, WRAP METALLIC PIPE IN 8 MIL POLYETHYLENE ENCASEMENT FOR FULL TRENCH WIDTH.
3. FLUIDIZED THERMAL BEDDING PER SCL MATERIAL STANDARD 7150.00

SEE NOTE 2 FOR FTB OR CDF CONDUIT CROSSINGS


REF STD SPEC SEC 7-11, 9-03.16




City of Seattle

NOT TO SCALE



WATERMAIN TRENCH AND BEDDING

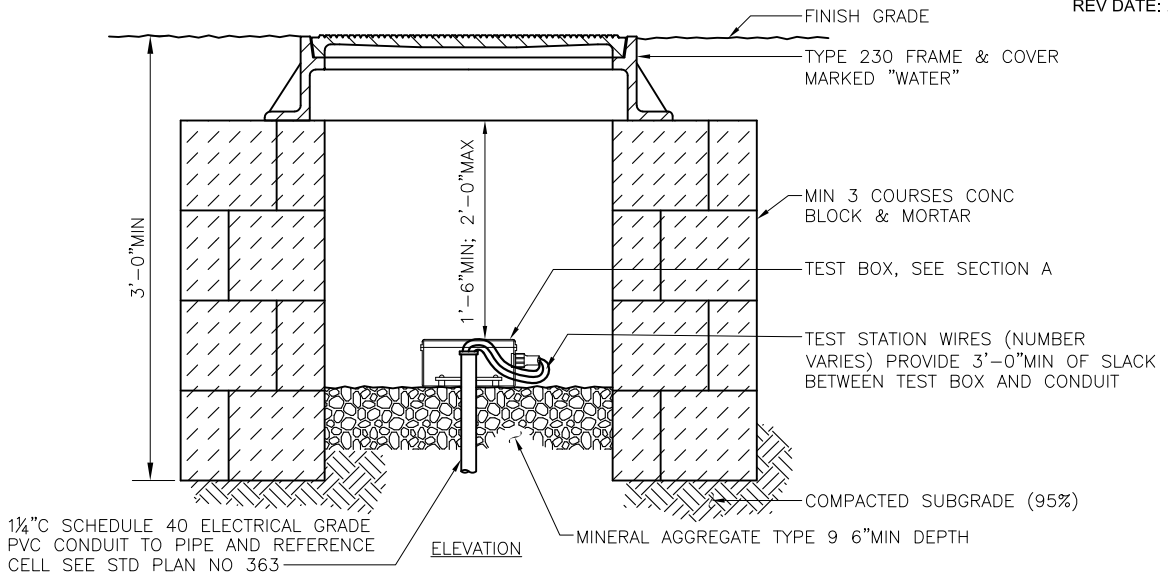

ELECTROLYSIS TEST STATION – TRAFFIC AREA

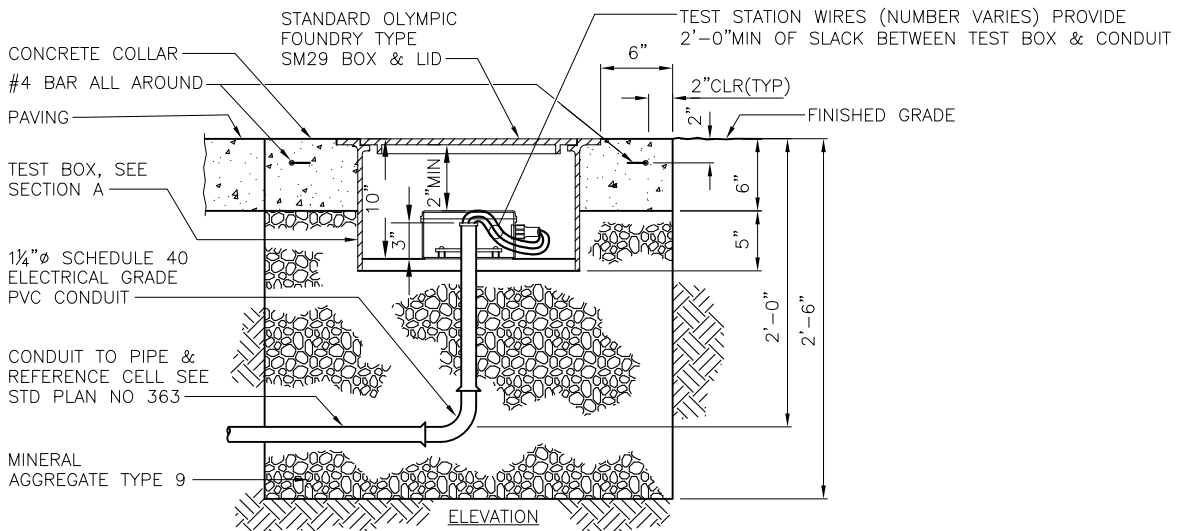

ELECTROLYSIS TEST STATION – NON-TRAFFIC AREA

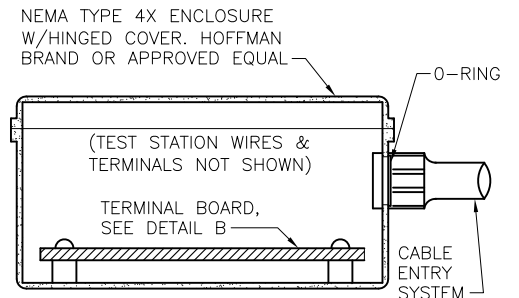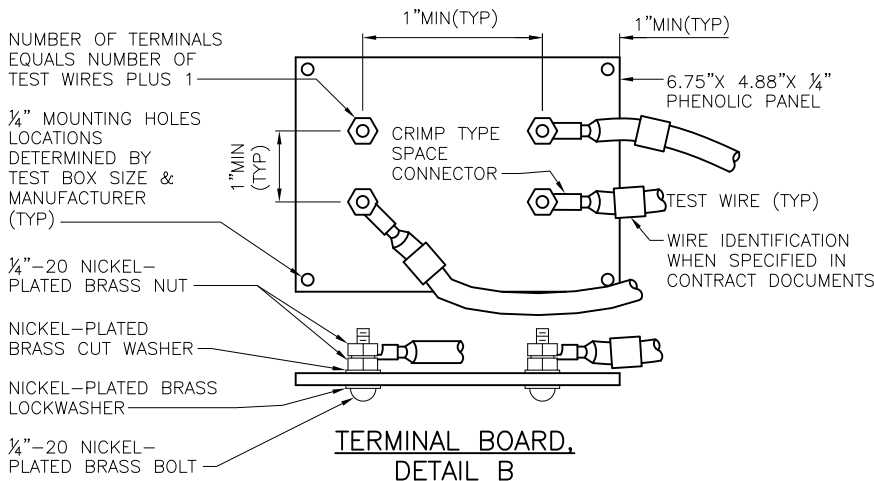

TEST BOX, SECTION A

REF STD SPEC SEC 7-11




City of Seattle


NOT TO SCALE

WATERMAIN ELECTROLYSIS TEST STATION


FRAME & COVER MUST BE TESTED FOR ACCURACY OF FIT AND MUST BE MARKED IN SETS FOR DELIVERY

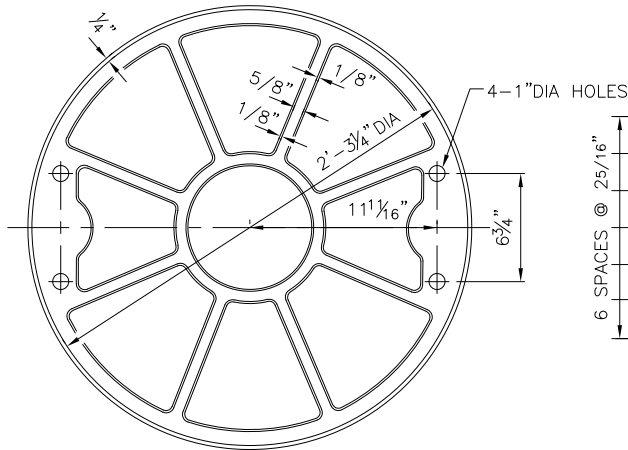

BOTTOM VIEW

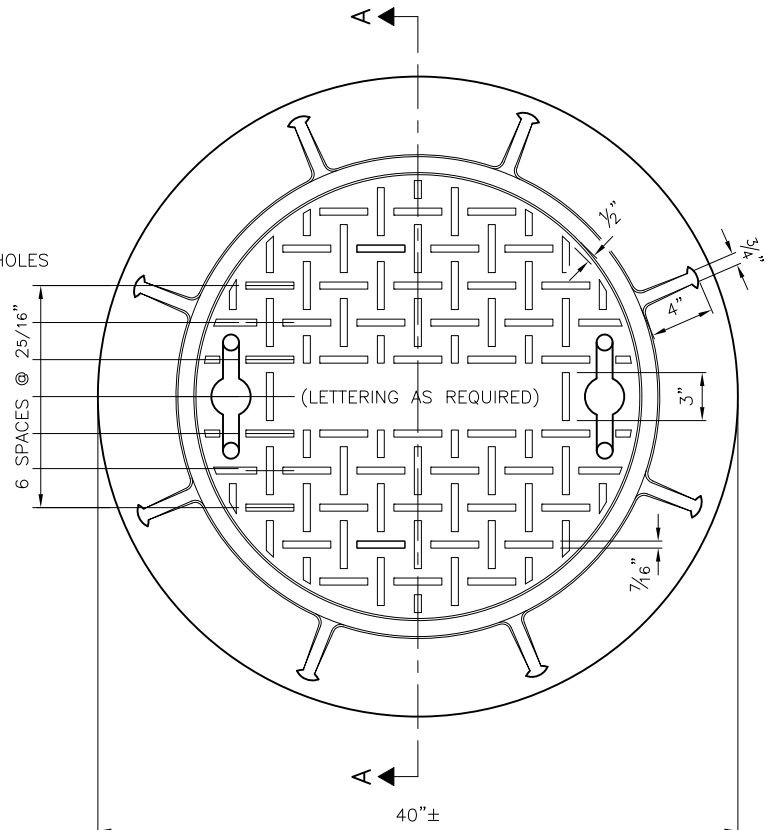


TOP VIEW

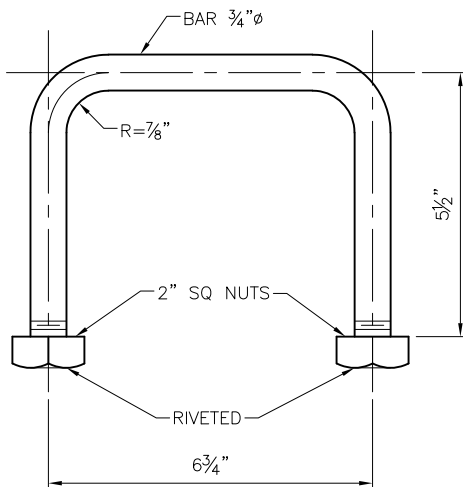

LIFTING HANDLE
(2 REQUIRED)

TYPE 361
H=9 1/4"
DESIGNATE SHALLOW FRAME AS TYPE 361S
H=4 1/4"
f=MACHINED FINISH

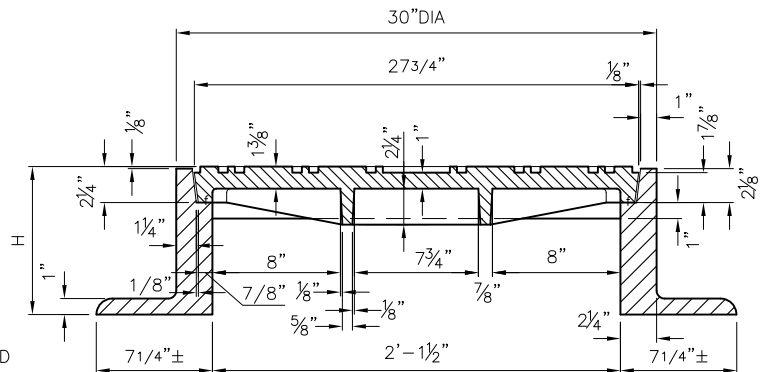

SECTION A-A

REF STD SPEC SEC 7-12




City of Seattle


NOT TO SCALE

TYPE 361a VALVE CHAMBER
FRAME & COVER IN
VEHICULAR TRAVELWAYS


FRAME & COVER MUST BE TESTED FOR ACCURACY OF FIT AND MUST BE MARKED IN SETS FOR DELIVERY

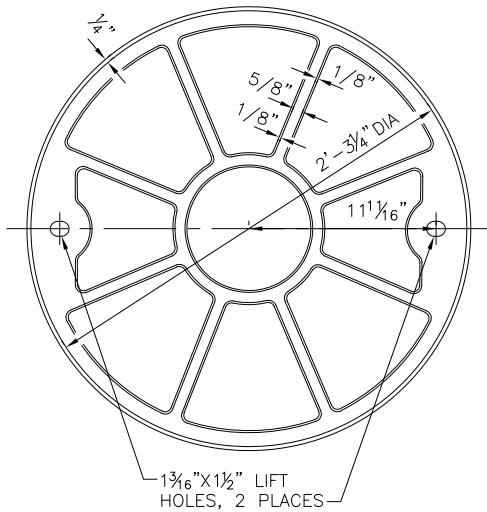

BOTTOM VIEW

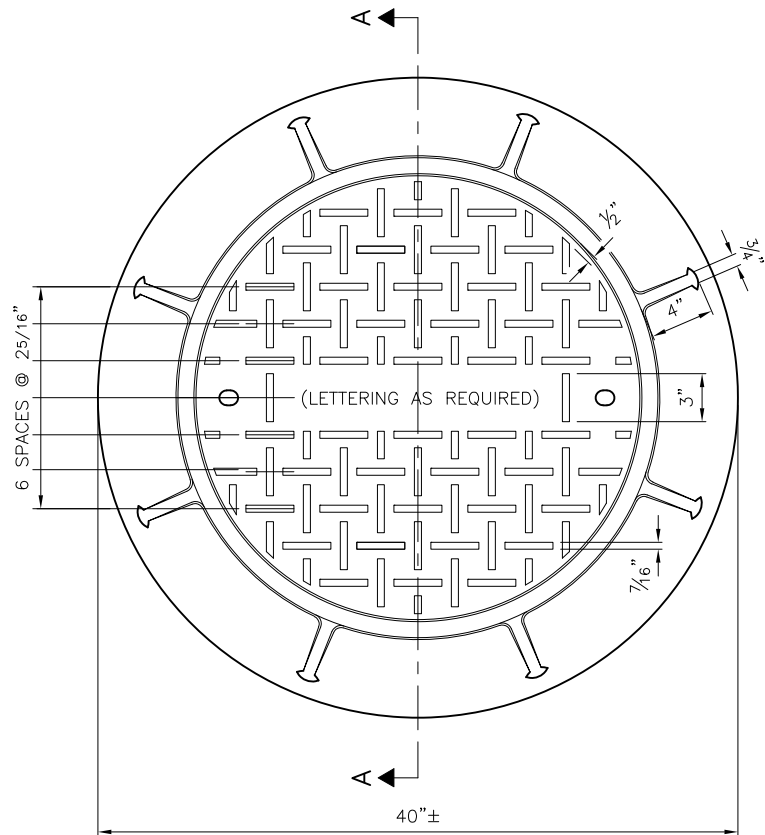

TOP VIEW

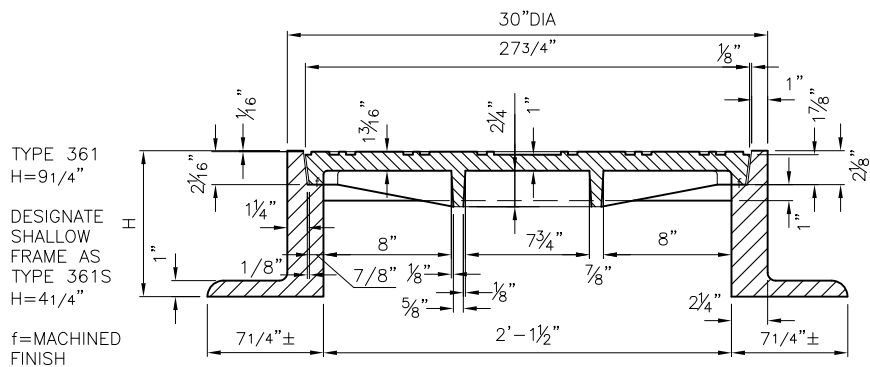

SECTION A-A


REF STD SPEC SEC 7-12




City of Seattle

NOT TO SCALE

**TYPE 361b VALVE CHAMBER
FRAME & COVER IN
PEDESTRIAN PATHWAYS**

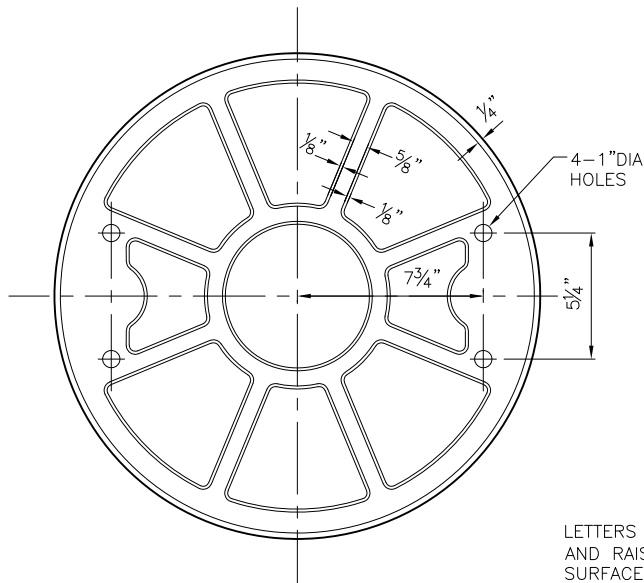


BOTTOM VIEW

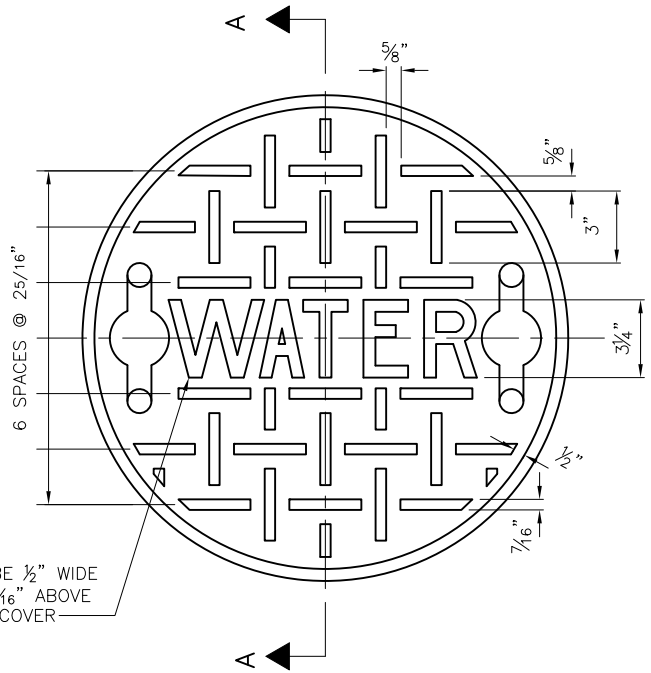


TOP VIEW

LETTERS TO BE $\frac{1}{2}$ " WIDE
AND RAISED $\frac{3}{16}$ " ABOVE
SURFACE OF COVER

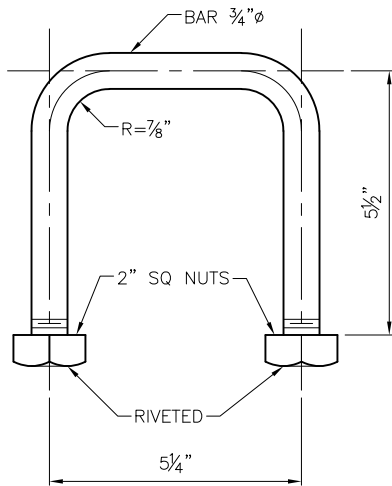

LIFTING HANDLE
(2 REQUIRED)

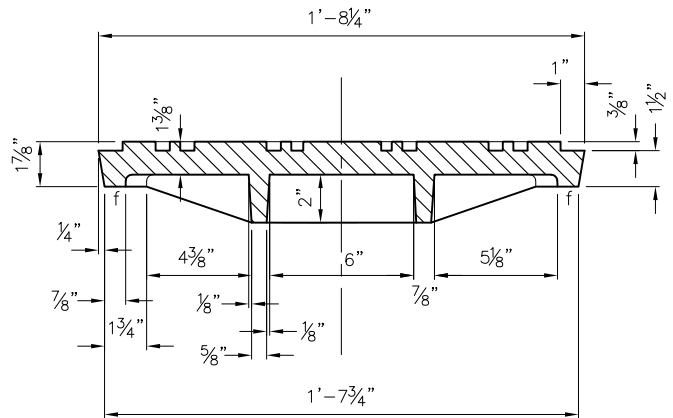

SECTION A-A

f=MACHINED FINISH


REF STD SPEC SEC 7-12, 7-20




City of Seattle

NOT TO SCALE


**TYPE 361c WATER VALVE
REPLACEMENT COVER IN
VEHICULAR TRAVELWAYS**

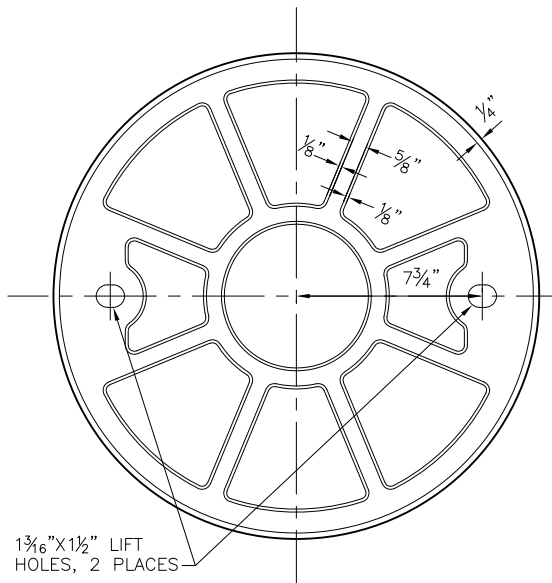

BOTTOM VIEW

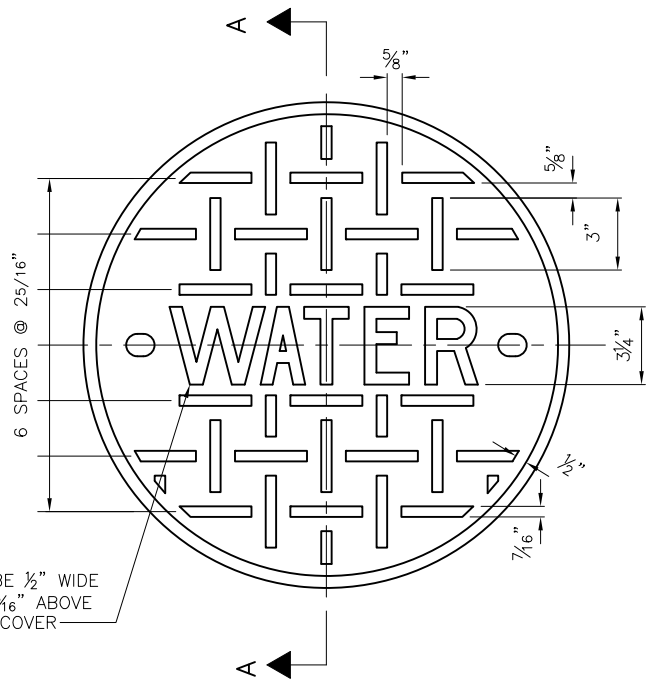

TOP VIEW

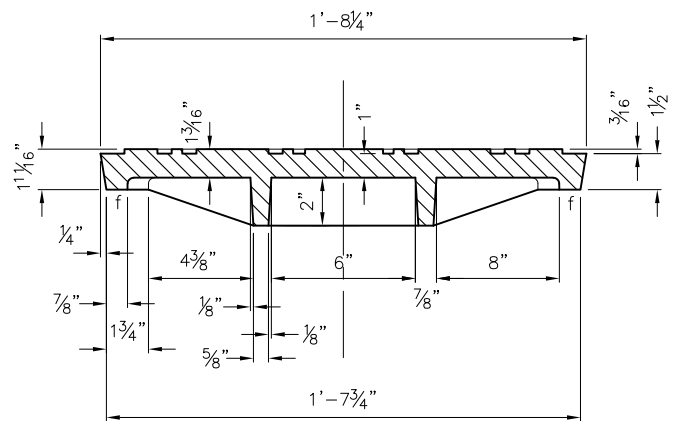

SECTION A-A

f=MACHINED FINISH


REF STD SPEC SEC 7-12, 7-20




City of Seattle

NOT TO SCALE


**TYPE 361d WATER VALVE
REPLACEMENT COVER IN
PEDESTRIAN PATHWAYS**

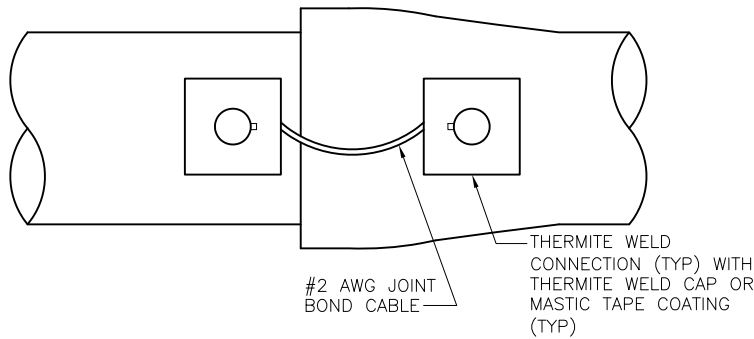


SLIP JOINT BOND CONNECTION

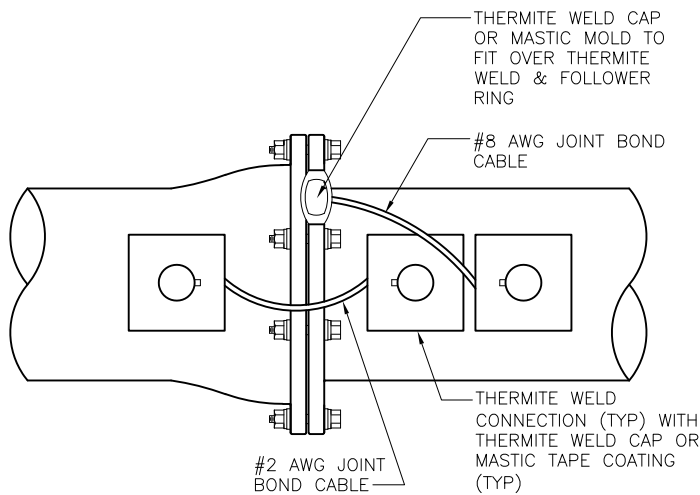

MECHANICAL JOINT BOND CONNECTION

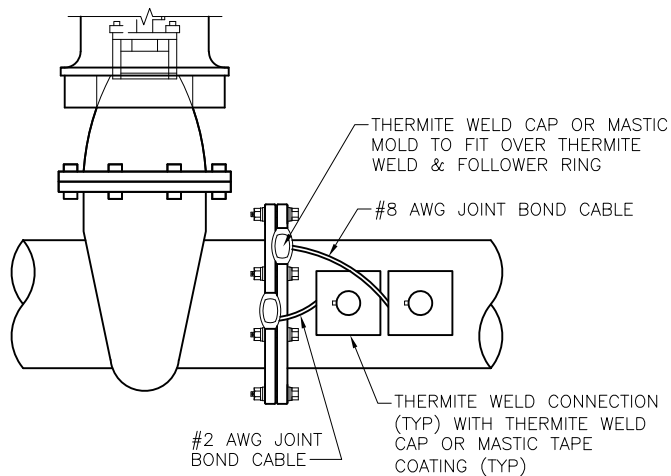

VALVE JOINT BOND CONNECTION

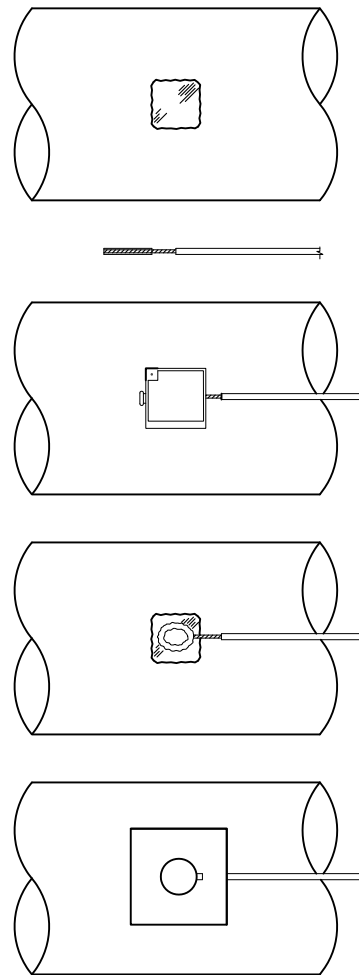

CONNECTION SEQUENCE:

1. REMOVE PIPE COATING TO BRIGHT & CLEAN METAL
2. STRIP INSULATION FROM TEST STION WIRE, INSTALL ADAPTER SLEEVE
3. HOLD MOLD FIRMLY WITH OPENING AWAY FROM OPERATOR AND IGNITE
4. REMOVE SLAG AND ALLOW TO COOL
5. 16 OUNCE HAMMER TEST PER STD. SPEC SEC 7-11.3(15)D1
6. FINAL CONNECTION TO BE MADE WATERTIGHT WITH MASTIC COATING OR PREFORMED THERMITE WELD CAP

THERMITE WELD CONNECTION

NOTES:

1. JOINT BONDS FOR PIPE 16" DIAMETER AND SMALLER.
2. FOR PIPE LARGER THAN 16" DIAMETER OR IMPRESSED SYSTEMS, SEE PROJECT DRAWINGS FOR JOINT BONDING DETAILS.


REF STD SPEC SEC 7-11




City of Seattle

NOT TO SCALE


JOINT BONDING FOR DIP WATERMAINS & JOINT BONDING DETAIL

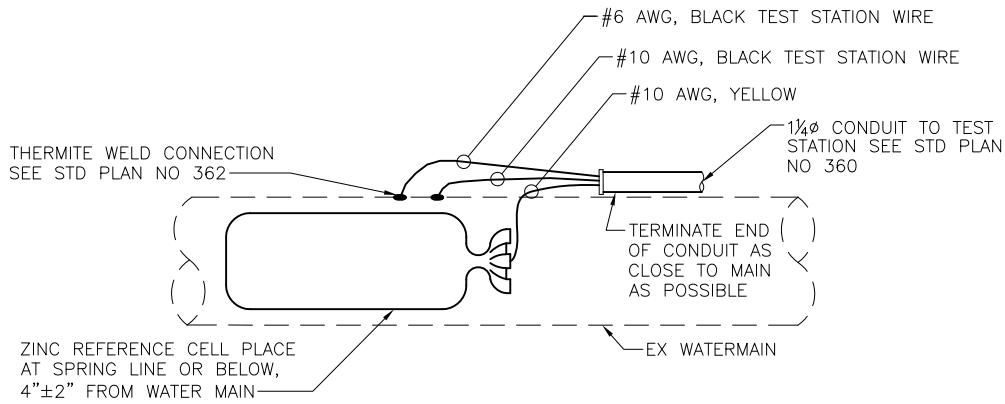

STANDARD 3-WIRE TEST STATION

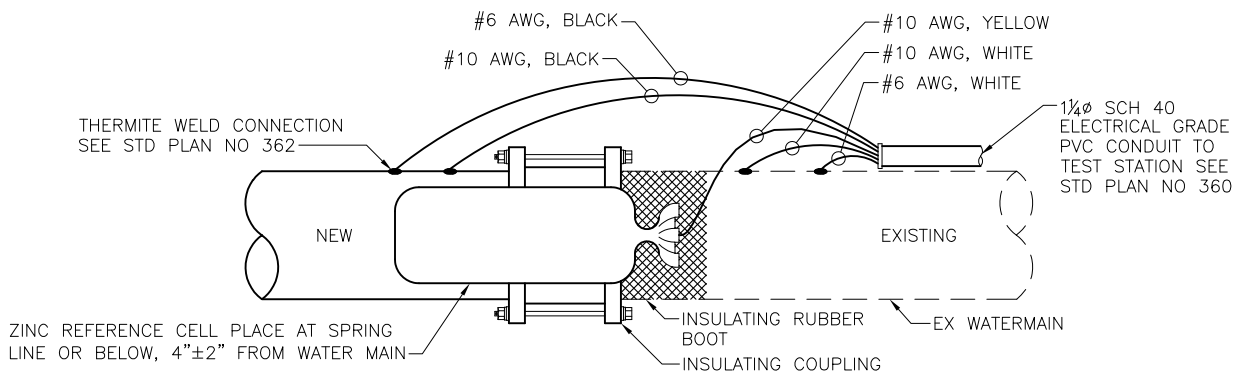

INSULATING COUPLING 5-WIRE TEST STATION

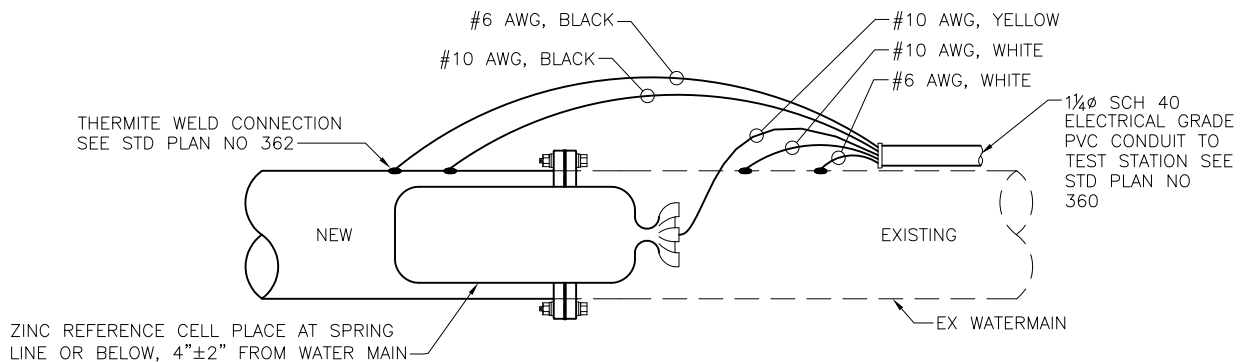

INSULATING FLANGE 5-WIRE TEST STATION

NOTE:

WIRE INSTALLATION PER STD SPEC SEC 9-30.12(3)


REF STD SPEC SEC 7-11.3(15), 9-30.12




City of Seattle

NOT TO SCALE

**ELECTROLYSIS TEST STATION
 WIRE INSTALLATION DETAILS**

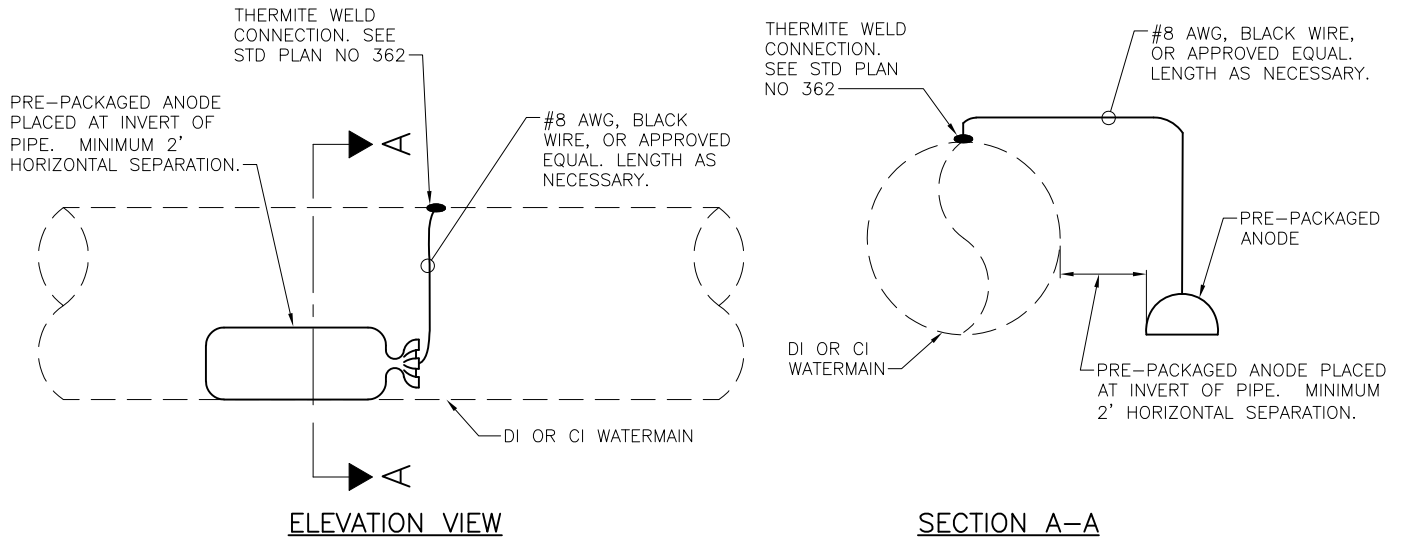

TYPICAL SINGLE HORIZONTAL ANODE INSTALLATION

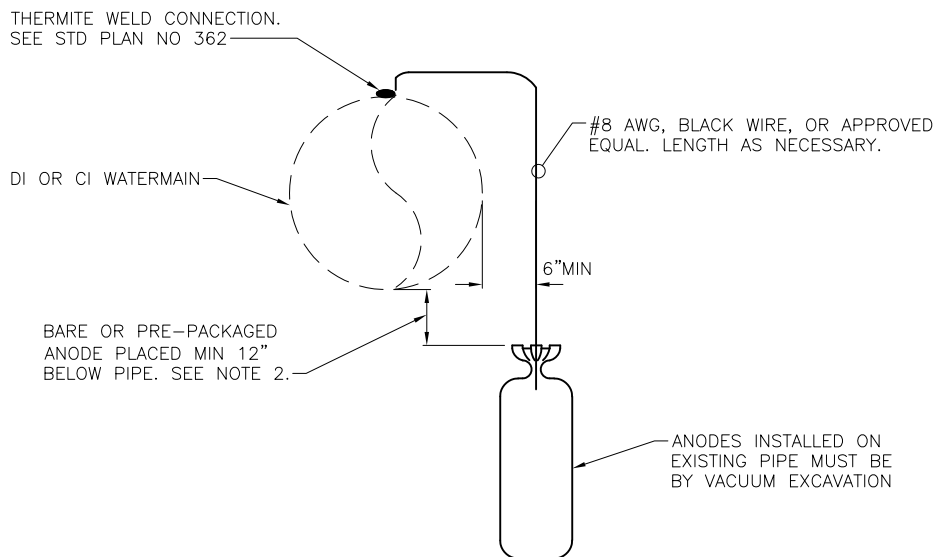

TYPICAL SINGLE VERTICAL ANODE INSTALLATION

NOTES:

1. SPU CORROSION PROTECTION MAY SPECIFY TYPE AND REQUIRED SPACING OF ANODE(S) LONGITUDINALLY ALONG WATER MAIN TO BE SHOWN IN DESIGN DRAWINGS. MAXIMUM SPACING MUST BE 36' UNLESS OTHERWISE NOTED ON PLANS.
2. FOR VERTICAL ANODE INSTALLATION, IF ANODE IS NOT PRE-PACKAGED, BARE ANODE MUST BE INSTALLED W/MIN 6" SACRIFICIAL ANODE BACKFILL PER SPEC SECTION 9-30.(7), AROUND ALL SIDES OF ANODE.
3. ANODE SIZE MUST BE 17LB HIGH POTENTIAL MAGNESIUM ANODE, UNLESS OTHERWISE NOTED ON THE PLANS.
4. PLACE RED "CAUTION" OR "DANGER" TAPE 6" OVER ANODE WIRES. TAPE MUST BE MIN 3" WIDE.
5. BACKFILL OVER ANODE WITH SUITABLE NATIVE MATERIAL OR APPROVED EQUAL.




REF STD SPEC SEC 7-11, 9-30



City of Seattle

NOT TO SCALE

SACRIFICIAL ANODE BONDED TO PIPE INSTALLATION DETAILS

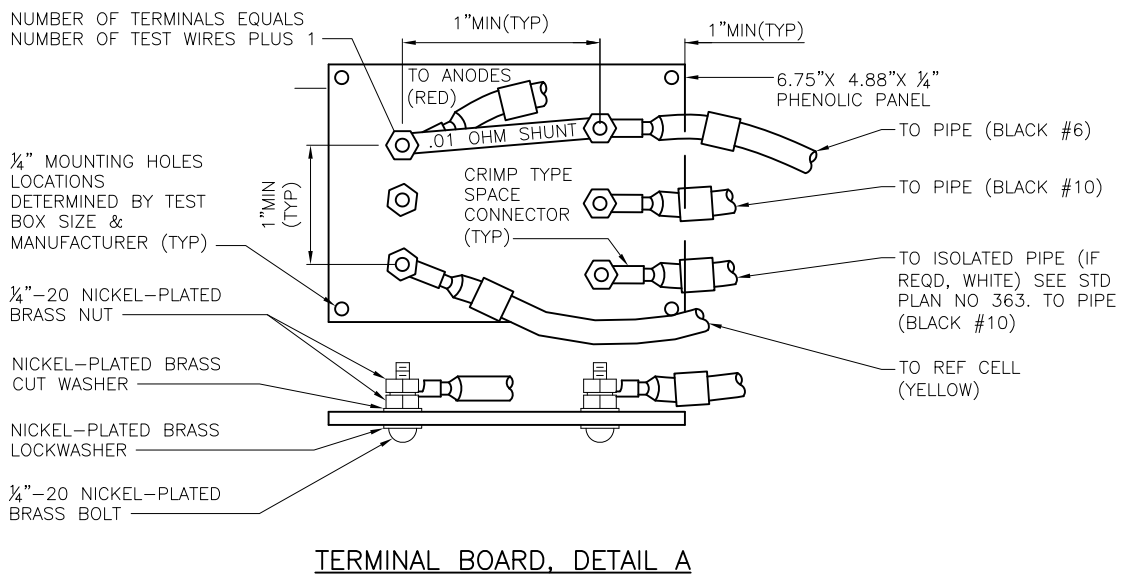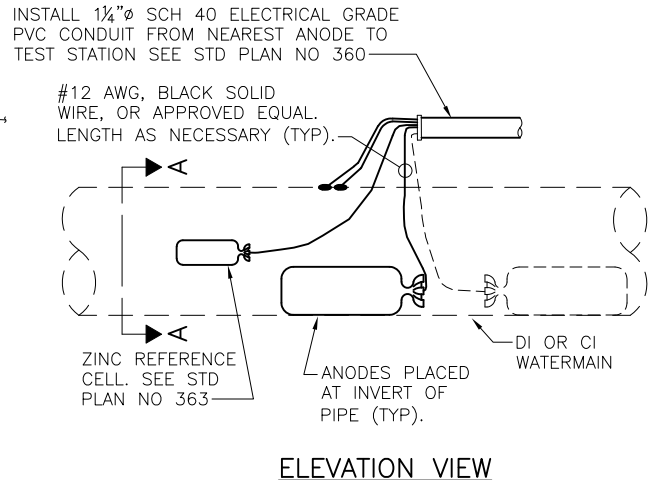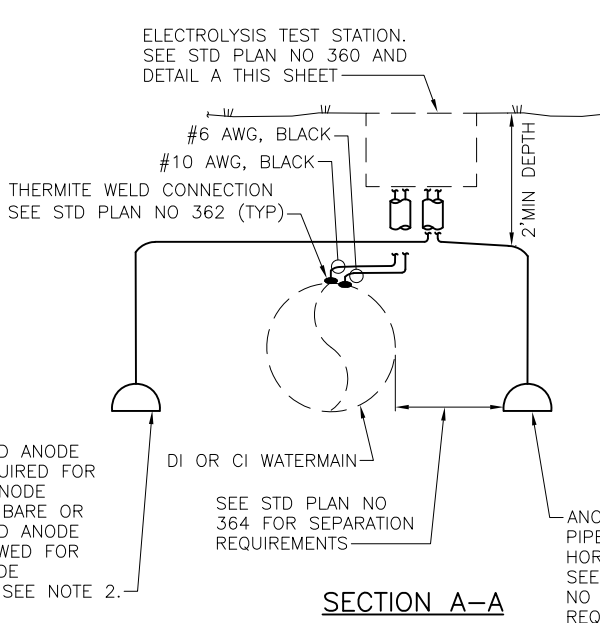

NOTES:

1. REQUIRED SPACING OF ANODE(S) TO BE SHOWN IN DESIGN DRAWINGS.
2. FOR VERTICAL INSTALLATION, IF ANODE IS NOT PRE-PACKAGED, BARE ANODE MUST BE INSTALLED W/ MIN 6" SACRIFICIAL ANODE BACKFILL PER SPEC SECTION 9-30.9(7), AROUND ALL SIDES OF ANODE.
3. ANODE SIZE MUST BE 17LB HIGH POTENTIAL MAGNESIUM ANODE, UNLESS OTHERWISE NOTED ON THE PLANS.
4. PLACE RED "CAUTION" OR "DANGER" TAPE 6" OVER ANODE WIRES AND CONDUIT. TAPE MUST BE MIN 3" WIDE.
5. BACKFILL OVER ANODE WITH SUITABLE NATIVE MATERIAL OR APPROVED EQUAL.


REF STD SPEC SEC 7-11, 9-30



City of Seattle

NOT TO SCALE

**SACRIFICIAL ANODE INSTALLATION
DETAILS - MULTIPLE ANODES
CONNECTED AT TEST STATION**

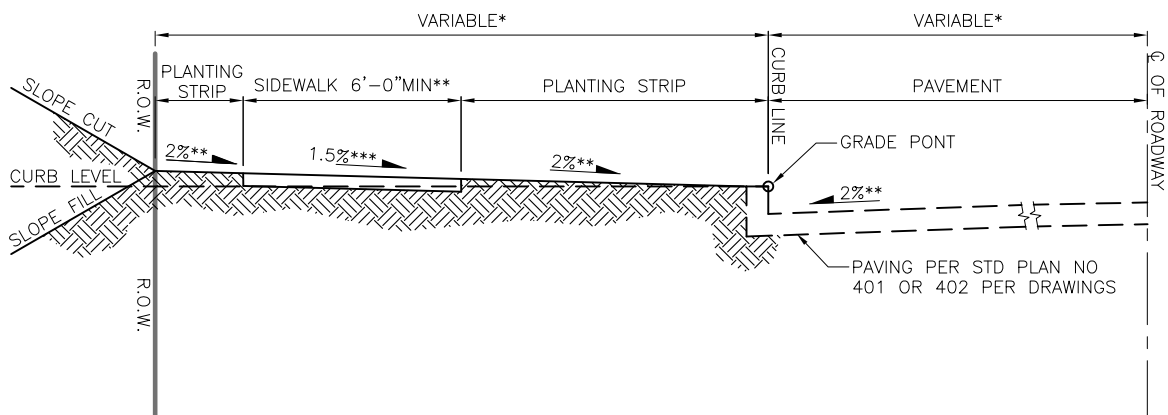

* SEE RIGHT OF WAY IMPROVEMENT MANUAL FOR DIMENSIONS.
 ** UNLESS OTHERWISE APPROVED BY THE ENGINEER.
 *** 2% MAXIMUM, 0.5% MINIMUM; USE 1.5% UNLESS OTHERWISE SHOWN IN CONTRACT OR APPROVED BY THE ENGINEER.


REF STD SPEC SEC 2-04




City of Seattle

NOT TO SCALE


HALF SECTION, GRADING

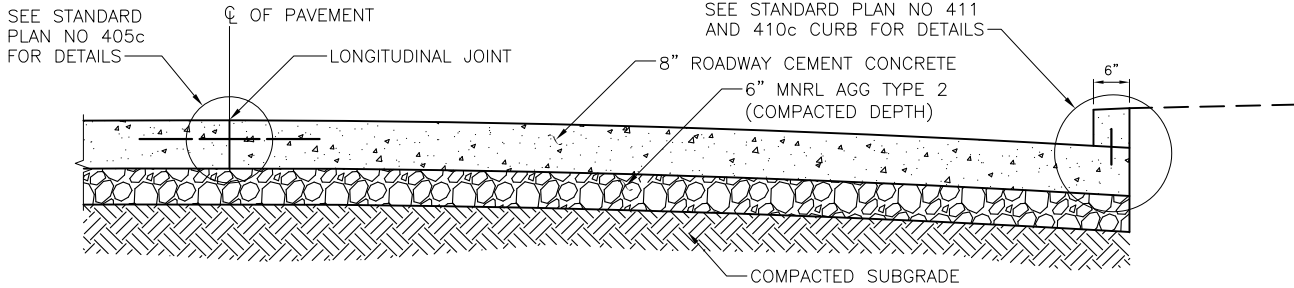


401A-CEMENT CONCRETE PAVEMENT WITH INTEGRAL CURB

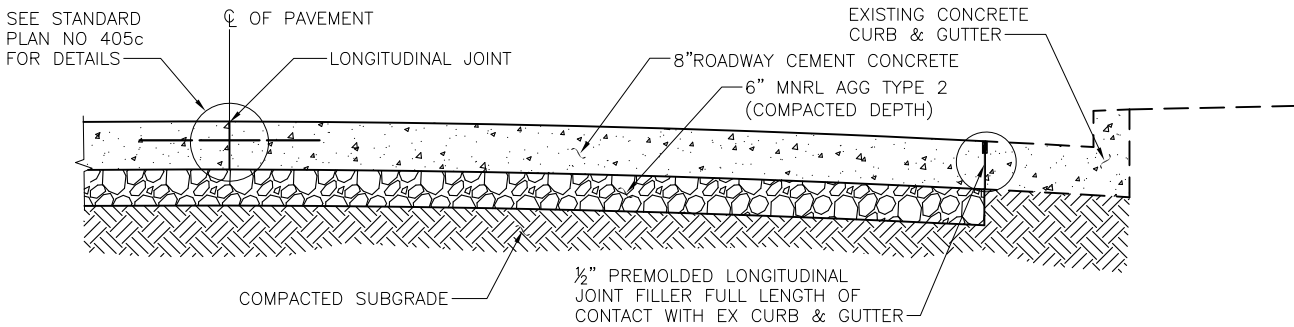

401B-CEMENT CONCRETE PAVEMENT WITH EXISTING CURB & GUTTER

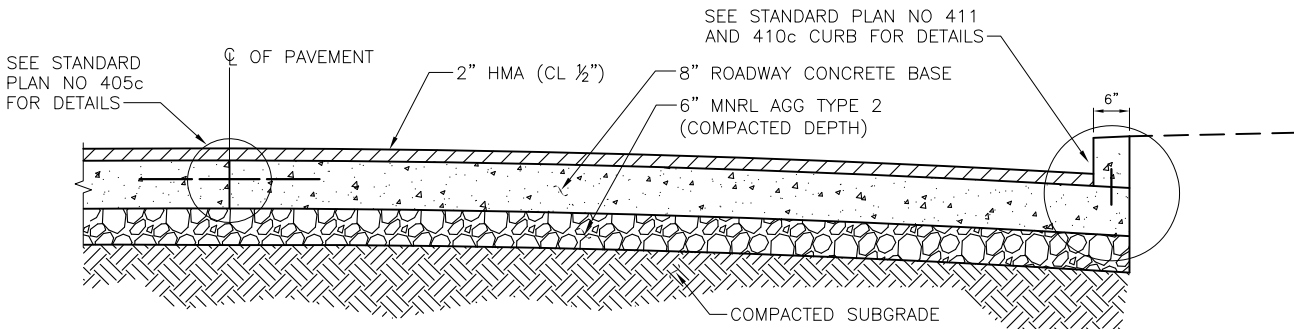

401C-HOT MIX ASPHALT ON CEMENT CONCRETE BASE

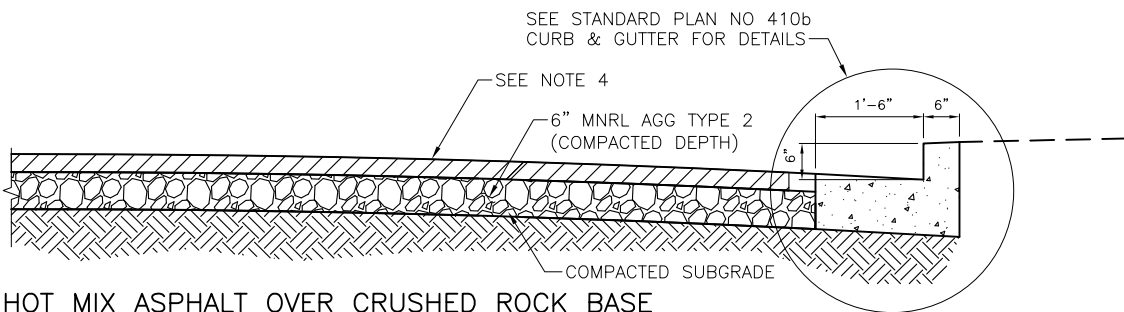

401D-HOT MIX ASPHALT OVER CRUSHED ROCK BASE

HMA DESIGN CRITERIA:

1. 3 MILLION ESAL'S UNLESS OTHERWISE SPECIFIED IN CONTRACT DOCUMENTS
2. ASPHALT PG 58H-22 UNLESS OTHERWISE SPECIFIED IN CONTRACT DOCUMENTS
3. WARM MIX ASPHALT MAY BE USED IN PLACE OF HMA WHERE SHOWN ON THE DRAWINGS
4. PAVEMENT DEPTH MUST BE 3" HMA (CL 1/2") WHEN REPLACING BITUMINOUS SURFACE TREATED RESIDENTIAL STREETS OR 2" HMA (CL 1/2") OVER 6" HMA (CL 1") FOR ALL OTHER RESIDENTIAL STREETS.
5. PROTECT ADJACENT PANELS FROM DAMAGE DUE TO UNDERMINING DURING EXCAVATION & PLACEMENT OF SUBGRADE. SEE SPEC SECTION 1-07.13.


REF STD SPEC SEC 4-04, 5-04, 5-05, 8-04



City of Seattle


NOT TO SCALE

RESIDENTIAL PAVEMENT SECTIONS

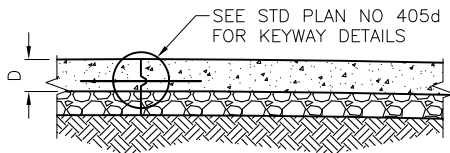


OPTIONAL KEYWAY
FOR LONGITUDINAL JOINT


NOTES:
IF CONC THICKNESS IS 9 INCH OR GREATER
OPTIONAL KEYWAY MAY BE USED SEE STD PLANS
NO 405c & 405d FOR DETAILS

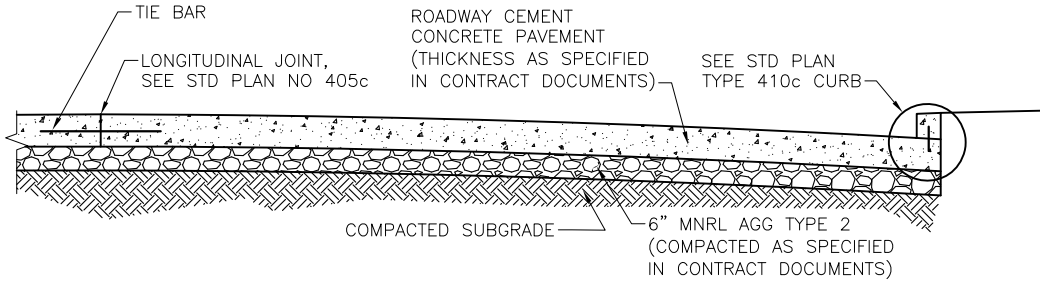

402A—ROADWAY CEMENT CONCRETE PAVEMENT ON CRUSHED ROCK

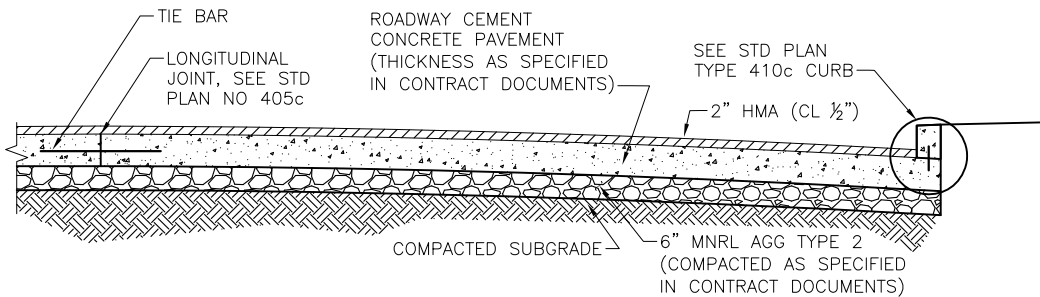

402B—HOT MIX ASPHALT ON CEMENT CONCRETE ON CRUSHED ROCK

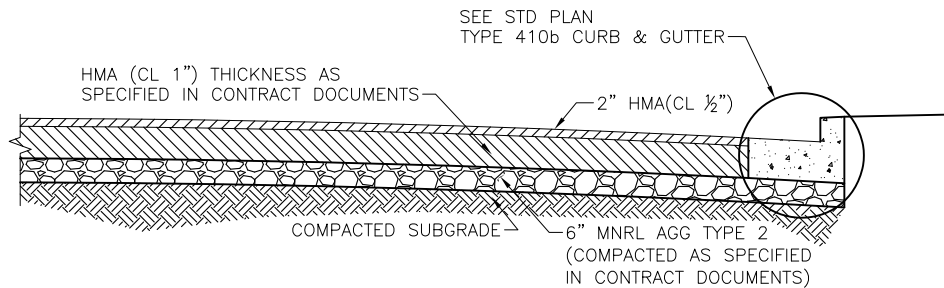

402C—HOT MIX ASPHALT ON CRUSHED ROCK BASE

HMA DESIGN CRITERIA:

1. 10 MILLION ESAL'S UNLESS OTHERWISE SPECIFIED IN CONTRACT DOCUMENTS.
2. ASPHALT PG 58H-22 UNLESS OTHERWISE SPECIFIED IN CONTRACT DOCUMENTS.
3. WARM MIX ASPHALT MAY BE USED IN PLACE OF HMA WHERE SHOWN ON THE DRAWINGS.
4. PROTECT ADJACENT PANELS FROM DAMAGE DUE TO UNDERMINING DURING EXCAVATION & PLACEMENT OF SUBGRADE. SEE SPEC SECTION 1-07.13.


REF STD SPEC SEC 4-04, 5-04, 5-05, 8-04




City of Seattle

NOT TO SCALE


**COMMERCIAL AND
ARTERIAL PAVEMENT
SECTIONS**

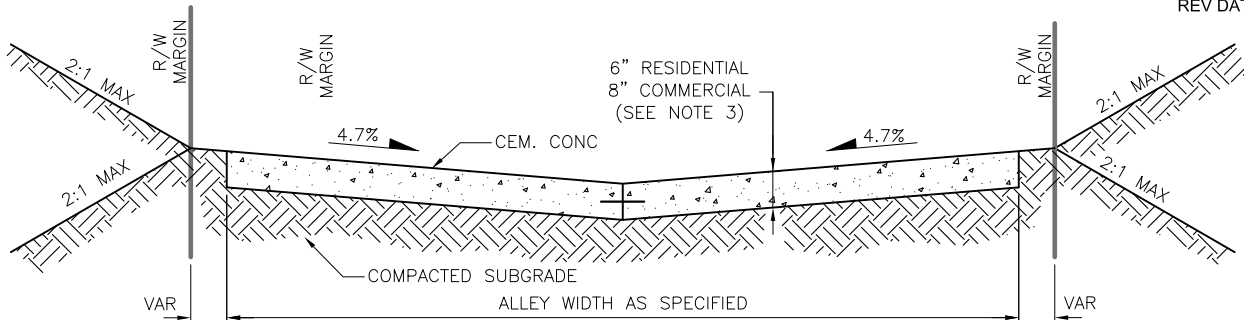

CONCRETE ALLEY PAVEMENT

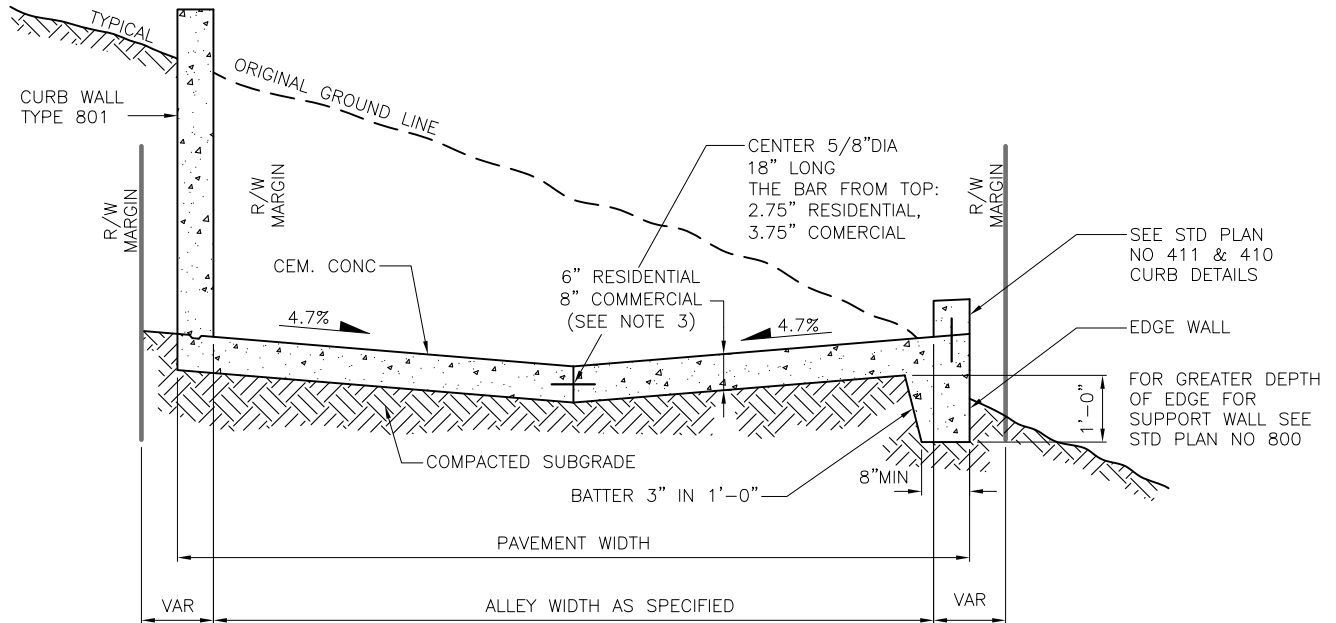

CEMENT CONCRETE ALLEY PAVEMENT 403B-FOR SHALLOW EMBANKMENT AREA

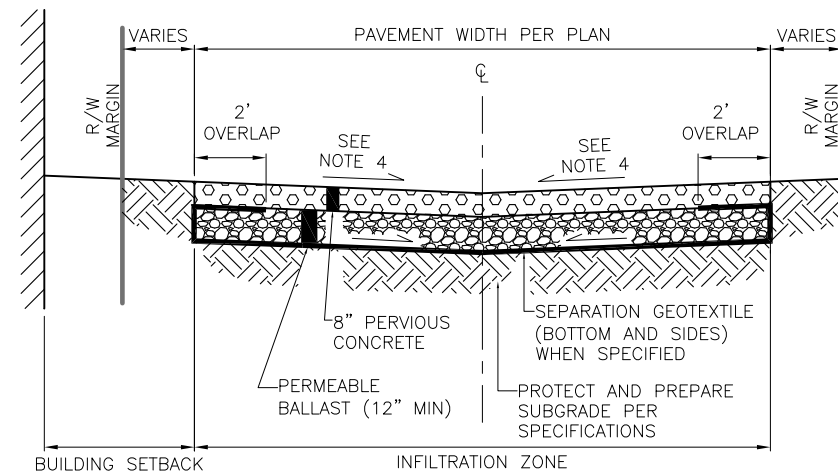

PERVIOUS CONCRETE PAVEMENT

NOTES:

1. WHEN ALLEY PAVEMENT IS 16'-0" OR WIDER PLACE CONSTRUCTION JOINT WITH TIE BAR PER STD PLAN NO 405 ALONG CENTERLINE OF ALLEY.
2. FOR ADA ACCESSIBLE ACCESS TO ENTRY IN ALLEY CONSIDER ALTERNATIVE DESIGN; SUBJECT TO APPROVAL BY THE ENGINEER.
3. 8" OR AS SHOWN IN CONTRACT OR APPROVAL BY THE ENGINEER.
4. MIN CROSS SLOPE IS 1%. MAX CROSS SLOPE IS 2%.
5. PERMEABLE BALLAST MUST BE MINERAL AGGREGATE TYPE 13, COS STD SPEC 9.03-13, UNLESS DETERMINED OTHERWISE BY ENGINEER.
6. FOR PERVIOUS CONCRETE ALLEYS, CONTRACTION JOINTS MUST NOT EXCEED 12 FT. FOR PAVEMENT THICKNESS OF 9 IN. OR LESS. FOR THICKER PAVEMENT, CONTRACTION JOINTS MAY BE 15 FT.

REF STD SPEC SEC 5-06, 8-17, 8-19




City of Seattle

NOT TO SCALE

ROADWAY CEMENT CONCRETE ALLEY PAVEMENTS

HALF SECTION

RIGID PAVEMENT WITH ASPHALT CONCRETE SURFACE

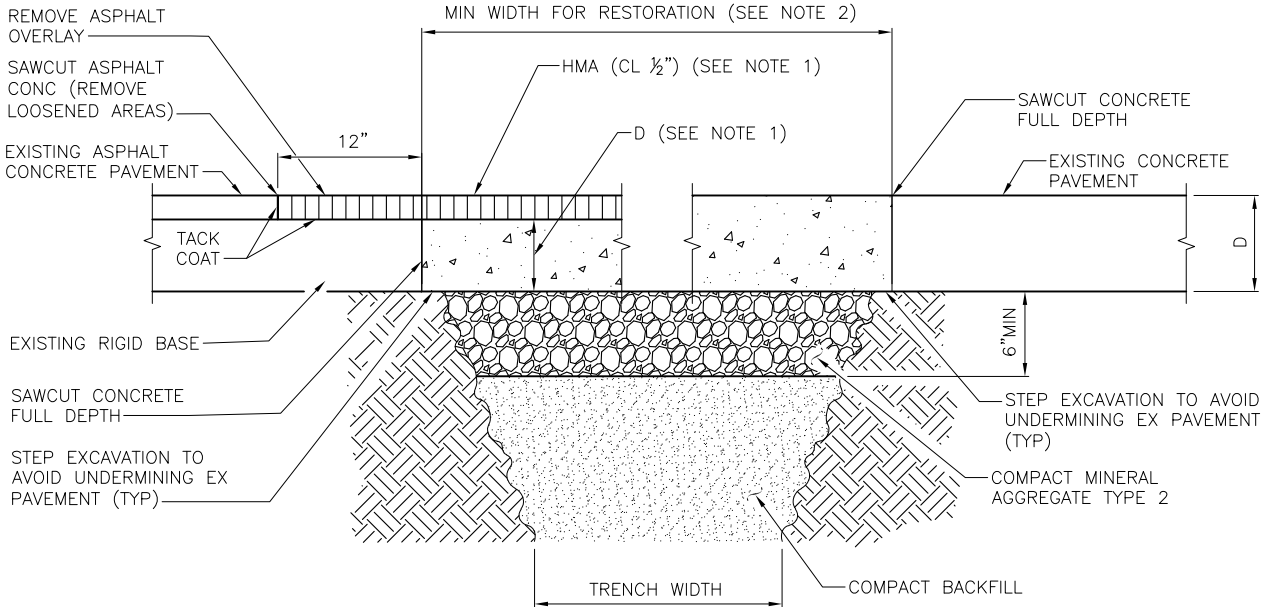


TYPICAL PATCH FOR RIGID PAVEMENT

HALF SECTION

CEMENT CONCRETE PAVEMENT

HALF SECTION

FLEXIBLE PAVEMENT (≤ 3 " TYP)

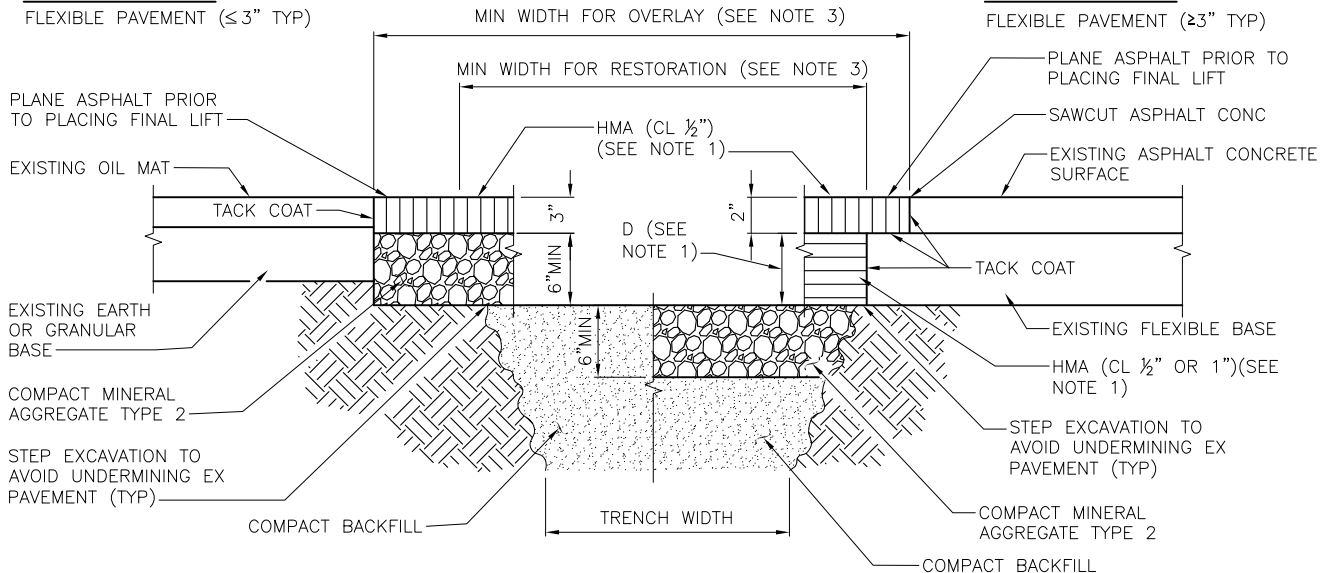

TYPICAL PATCH FOR FLEXIBLE PAVEMENT

1. DEPTH OF RESTORATION MUST MEET THE REQUIREMENTS OF "RIGHT OF WAY OPENING AND RESTORATION RULES".
2. FOR RIGID PAVEMENT (FULL DEPTH), WIDTH OF RESTORATION MUST EXTEND TO FULL PANEL WIDTH, OR AS REQUIRED IN THE "RIGHT OF WAY OPENING AND RESTORATION RULES" FOR OVERSIZED OR NON-STANDARD PANELS.
3. FOR FLEXIBLE PAVEMENT (FULL DEPTH & OVERLAY) RESTORATION WIDTH MUST MEET REQUIREMENTS OF STANDARD PLAN NO 404c AND THE "RIGHT OF WAY OPENING AND RESTORATION RULES".


REF STD SPEC SEC 2-02, 5-04, 5-05



City of Seattle

NOT TO SCALE

PAVEMENT PATCHING

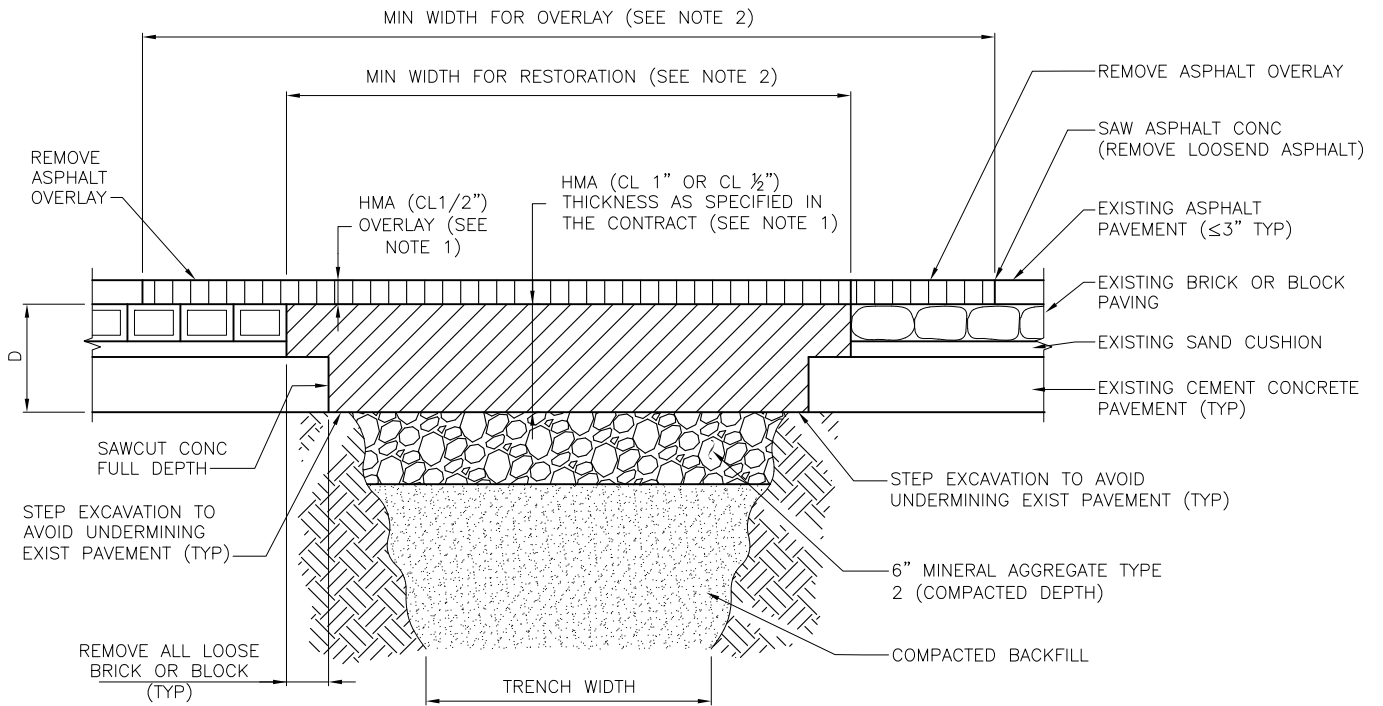

HOT MIX ASPHALT OVER SHEET ASPHALT, BRICK, OR STONE BLOCK PAVEMENT
 HALF SECTION

1. DEPTH OF RESTORATION MUST MEET THE REQUIREMENTS OF THE "RIGHT OF WAY OPENING AND RESTORATION RULES".
2. WIDTH OF RESTORATION MUST EXTEND TO FULL PANEL WIDTH, OR AS REQUIRED IN THE "RIGHT OF WAY OPENING AND RESTORATION RULES" FOR OVERSIZED OR NON-STANDARD PANELS.


REF STD SPEC SEC 2-02, 5-04, 5-05



City of Seattle

NOT TO SCALE

PAVEMENT PATCHING

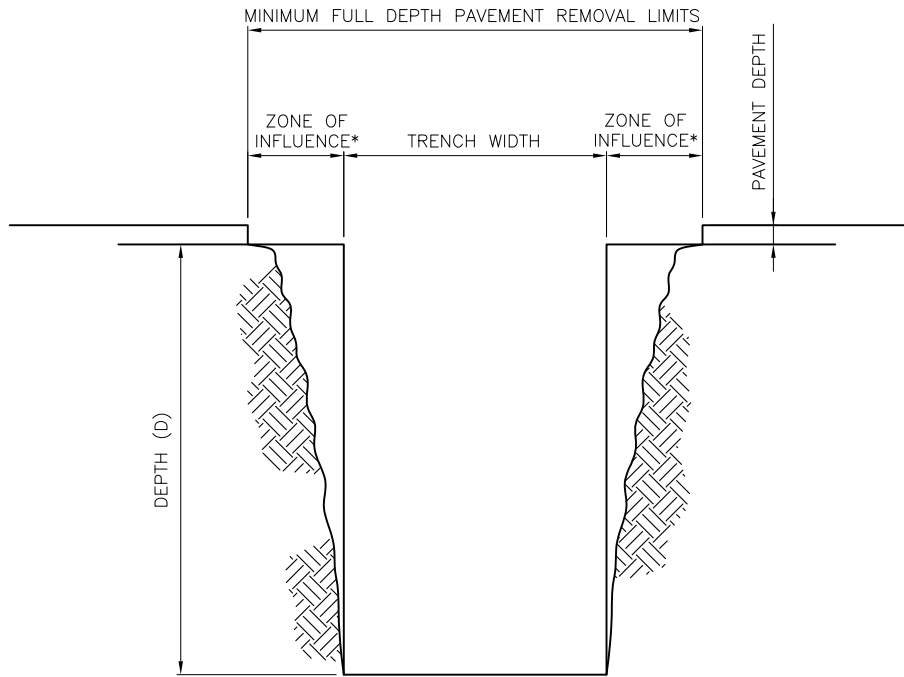

*TYPICALLY D/4

NOTES:

1. DUE TO POTENTIAL LOSS OF SOIL STRENGTH IN AREAS ADJACENT TO TRENCH OPENINGS, PAVEMENT REMOVAL MUST BE WIDENED TO INCLUDE THE ZONE OF INFLUENCE.
2. SEE "RIGHT-OF-WAY OPENING AND RESTORATION RULES" FOR MORE INFORMATION ON PAVEMENT OPENINGS ZONE OF INFLUENCE.
[HTTP://WWW.SEATTLE.GOV/TRANSPORTATION/STUSE_PAVEMENTOPEN.HTM](http://www.seattle.gov/transportation/stuse_pavementopen.htm)


REF STD SPEC SEC 2-02, 2-04




City of Seattle

NOT TO SCALE


PAVEMENT OPENING
ZONE OF INFLUENCE

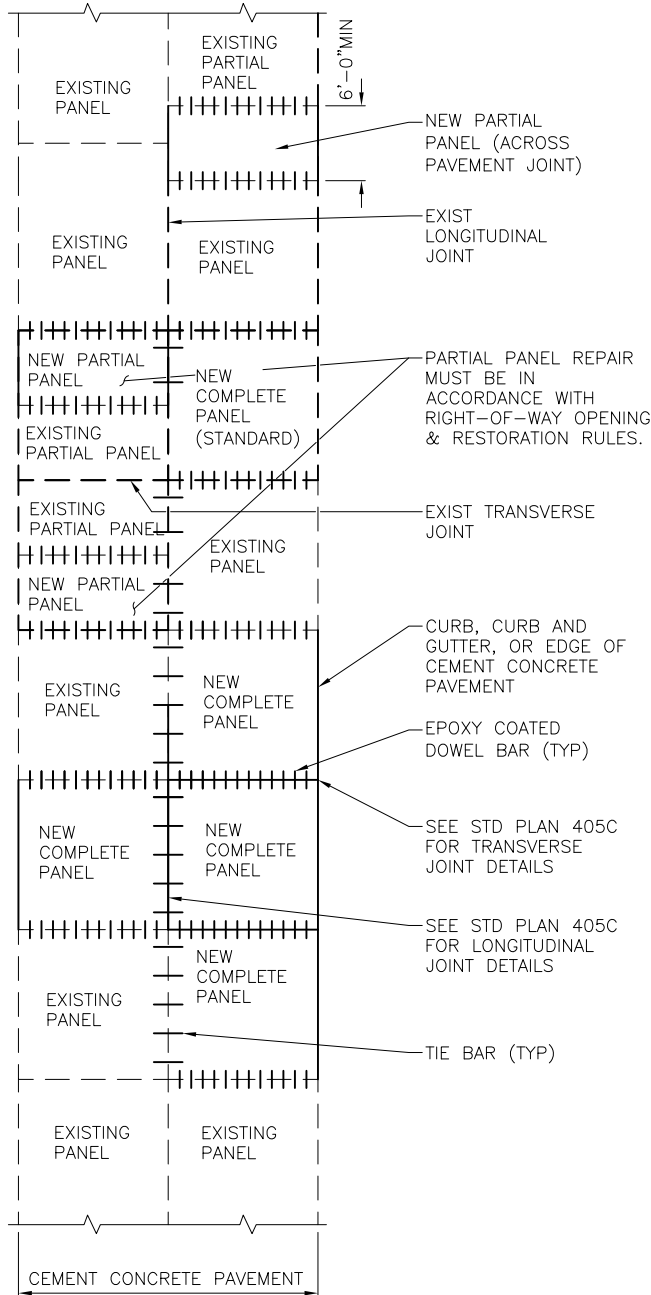

PLAN VIEW
PANEL REPLACEMENT

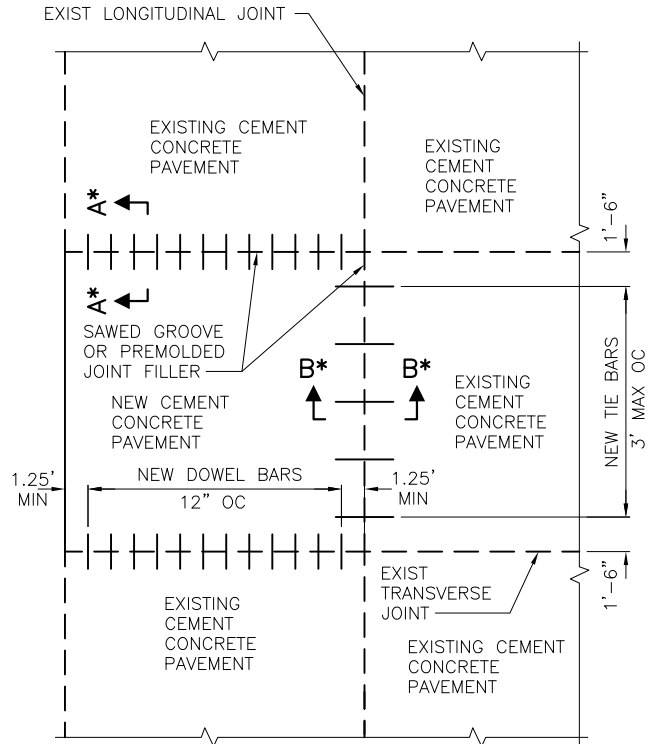

PLAN VIEW
COMPLETE PANEL REPLACEMENT

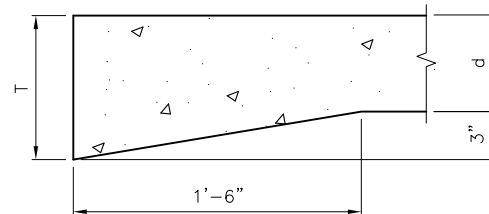

NOTES

1. INSTALL TIE BARS ALONG LONGITUDINAL JOINT BETWEEN FULL PANEL REPLACEMENT AND EXIST CEMENT CONC PAVEMENT. TIE BARS ARE NOT INSTALLED BETWEEN CEMENT CONC PAVEMENT AND HOT MIX ASPHALT SHOULDERS.
2. TIE BARS AND DOWELS ARE NOT REQUIRED:
 - 2.1. WHEN INDICATED ON THE DRAWINGS BY "NO TIE BARS" OR "NO DOWEL BARS".
 - 2.2. WHEN EXISTING PAVEMENT IS 8" OR LESS OR WHEN THE ENGINEER DETERMINES THE EXISTING CONC NOT TO BE COMPETENT.
3. DO NOT PLACE LONGITUDINAL JOINTS OR SKEWED JOINTS WITHIN BIKE LANES.
4. WHEN PAVING ADJACENT TO EXISTING PANELS, THE NEW TRANSVERSE JOINTS MUST BE PLACED TO MATCH JOINT LOCATIONS OF THE EXISTING ADJACENT PAVEMENT UNLESS OTHERWISE DIRECTED BY THE ENGINEER. SEE STD PLAN NO 405C FOR MAXIMUM TRANSVERSE JOINT SPACING.

A* SEE SECTION A-A STANDARD PLAN 405b
B* SEE SECTION B-B STANDARD PLAN 405b


REF STD SPEC SEC 5-05




City of Seattle

NOT TO SCALE


ROADWAY CONCRETE
PAVEMENT REPAIR

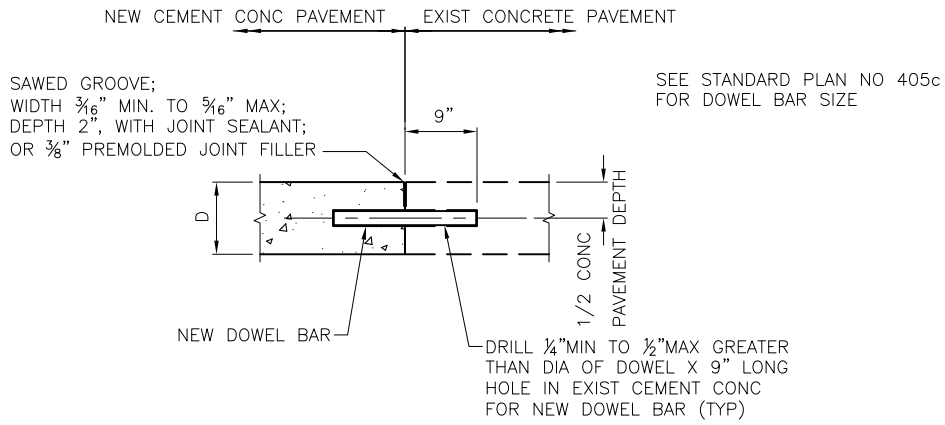

**SECTION A-A
DOWEL BAR DETAIL**

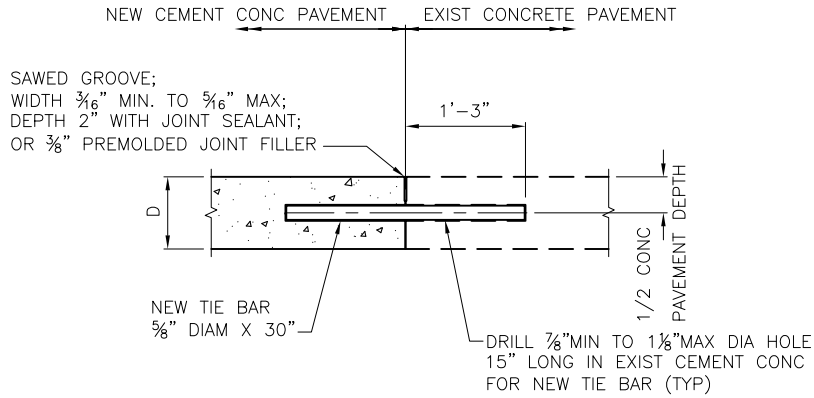

**SECTION B-B
TIE BAR DETAIL**

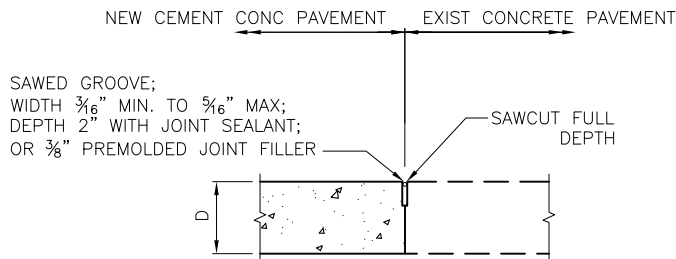

WITHOUT TIE BAR OR DOWEL

USE ONLY WHEN SHOWN IN
CONTRACT OR APPROVED BY
THE ENGINEER

REF STD SPEC SEC 5-05




City of Seattle

NOT TO SCALE

**PAVEMENT REPAIR
DOWEL BAR AND
TIE BAR DETAILS**


NOTES:

- DO NOT PLACE LONGITUDINAL JOINTS OR SKEWED JOINTS WITHIN BIKE LANES.
- WHEN A JOINT IS WITHIN 18 INCHES OF A CASTING JOINTS SHOULD BE SKEWED TO MEET THE CASTING AT 90 DEGREES UNLESS OTHERWISE DIRECTED BY THE ENGINEER OR SHOWN ON THE DRAWINGS.
- SEE STD PLAN NO 406 OR DRAWINGS FOR REBAR DETAIL AROUND CASTING 18 INCHES OR GREATER FROM JOINTS.
- DOWEL BARS MUST NOT BE PLACED WITHIN 15 INCHES OF THE EDGE OF PAVEMENT OR A PARALLEL JOINT.
- DOWEL BARS NOT REQUIRED FOR RESIDENTIAL PAVEMENT SECTIONS. SEE STD PLAN NO 401.

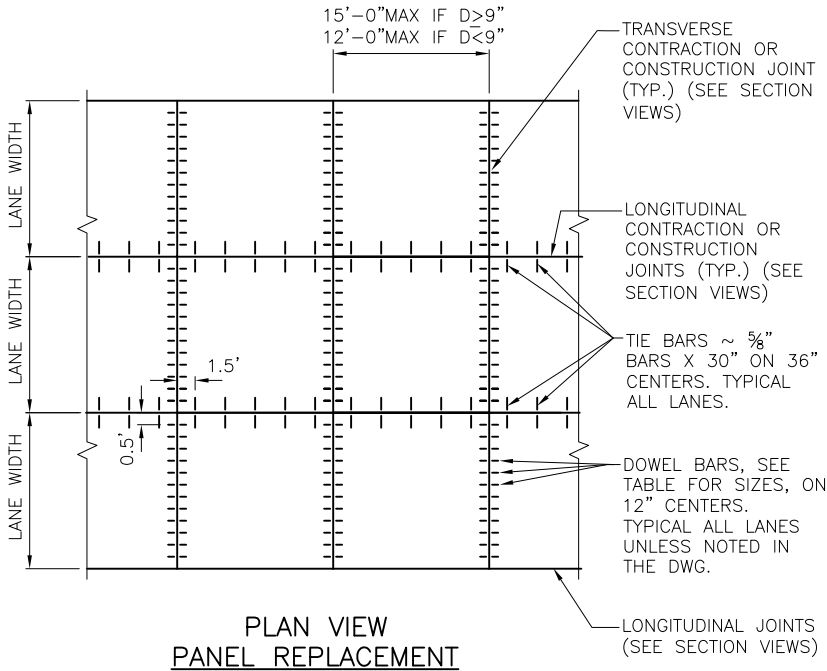


DEPTH (D) OF RDWY CEM. CONC	DOWEL BAR SIZE (DIA Ø)
6" ≤ D < 9"	1" X 18"
9" ≤ D < 11"	1 1/4" X 18"
11" ≤ D	1 1/2" X 18"



SAWED JOINT WIDTH 1/16" MIN.
3/16" MAX. WITH JOINT SEALANT OR
3/8" PREMOLDED JOINT FILLER

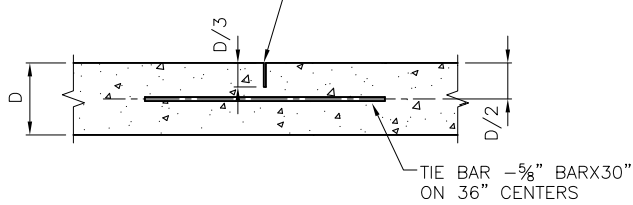

SAWED JOINT WIDTH 1/16" MIN.
3/16" MAX. WITH JOINT SEALANT
OR 3/8" PREMOLDED JOINT FILLER

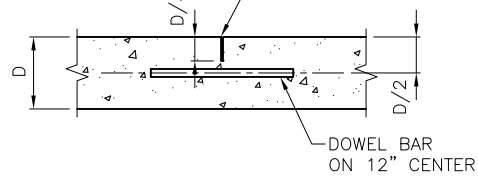

DRILL AND GROUT (WHEN APPLICABLE)

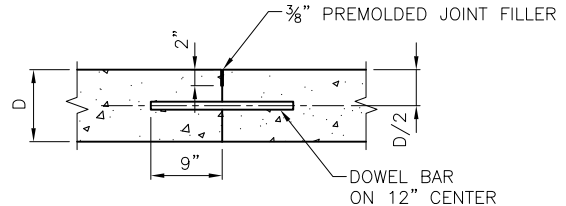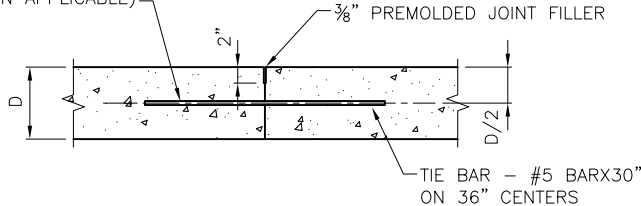


REF STD SPEC SEC 5-05




City of Seattle

NOT TO SCALE

ROADWAY CONCRETE PAVEMENT JOINTS

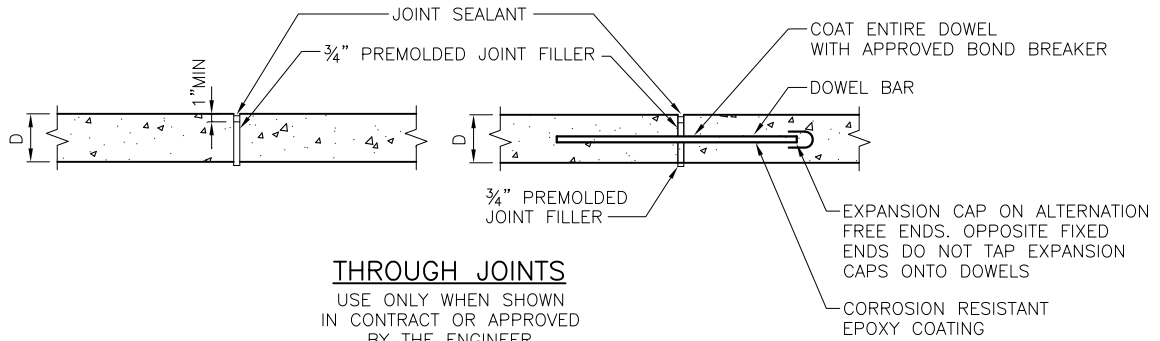

THROUGH JOINTS
 USE ONLY WHEN SHOWN
 IN CONTRACT OR APPROVED
 BY THE ENGINEER

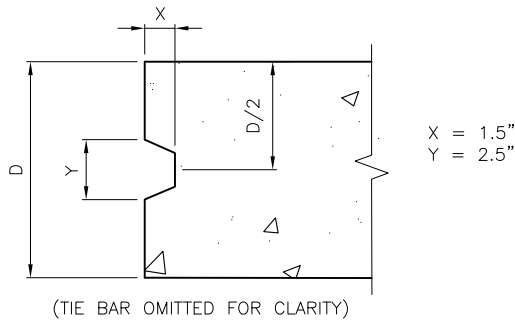

KEYWAY DETAIL
LONGITUDINAL JOINT WITH KEYWAY
 (OPTIONAL FOR ≥9 INCHES ONLY)

NOTE:
 USE OF OPTIONAL KEYWAY MAY BE REVOKED BY THE ENGINEER AT ANYTIME DUE TO QUALITY CONTROL ISSUES WITH MAINTAINING PLACEMENT REQUIREMENTS WITHIN ± 3/8 INCH VERTICALLY.


REF STD SPEC SEC 5-05



City of Seattle


NOT TO SCALE

**THROUGH JOINTS AND
 OPTIONAL KEYWAYS FOR
 CEMENT CONCRETE ROADWAY**

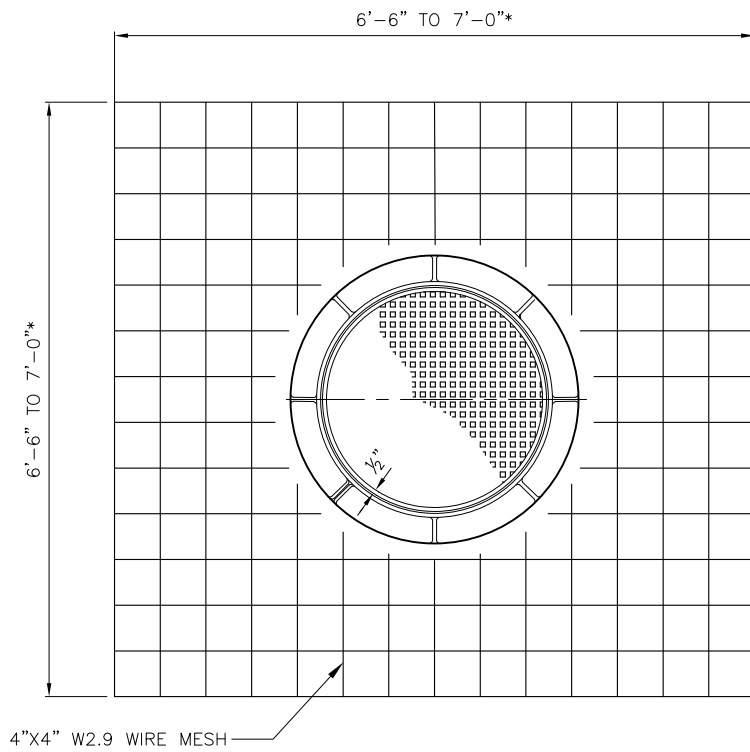

NOTES:

1. PLACE WIRE MESH AT 1/2 DEPTH OF CEMENT CONCRETE.
2. *THE DIMENSIONS OF THE MESH MUST BE ADJUSTED WHERE PAVEMENT JOINTS ARE ENCOUNTERED.
3. NO REINFORCING STEEL MUST BE WITHIN 2 1/2 INCHES OF ANY CEMENT CONCRETE SURFACE OR JOINT.

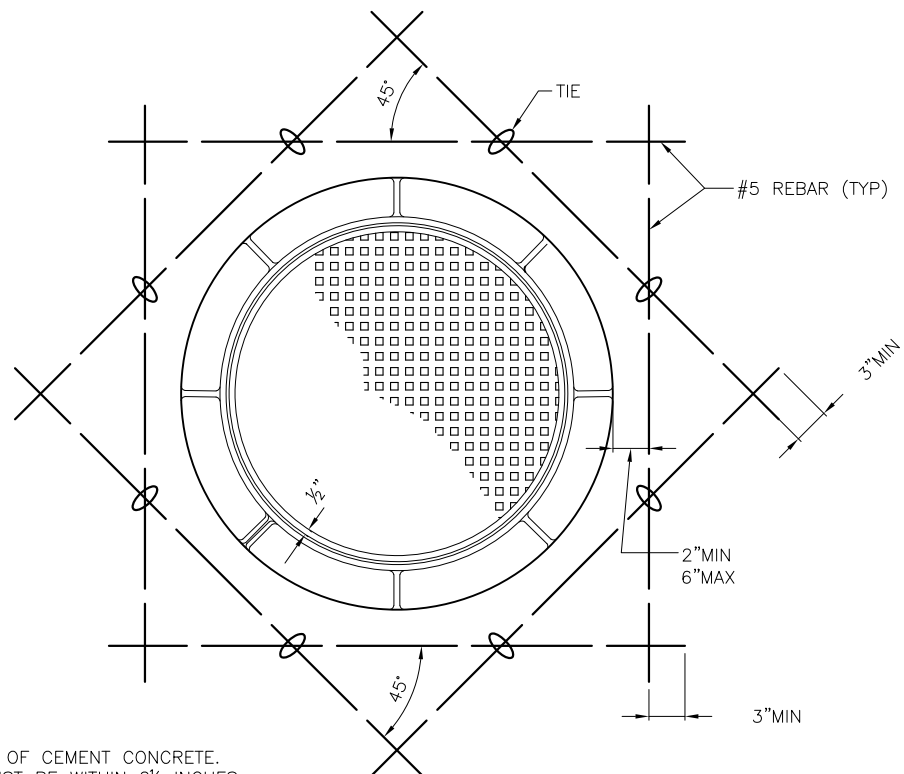

NOTES:

1. PLACE REBAR AT 1/2 DEPTH OF CEMENT CONCRETE.
2. NO REINFORCING STEEL MUST BE WITHIN 2 1/2 INCHES (3 INCHES DESIRED) OF ANY CEMENT CONCRETE SURFACE OR JOINT.


REF STD SPEC SEC 5-05




City of Seattle

NOT TO SCALE

**FRAME & COVER CEMENT
CONCRETE REINFORCEMENT
DETAIL**

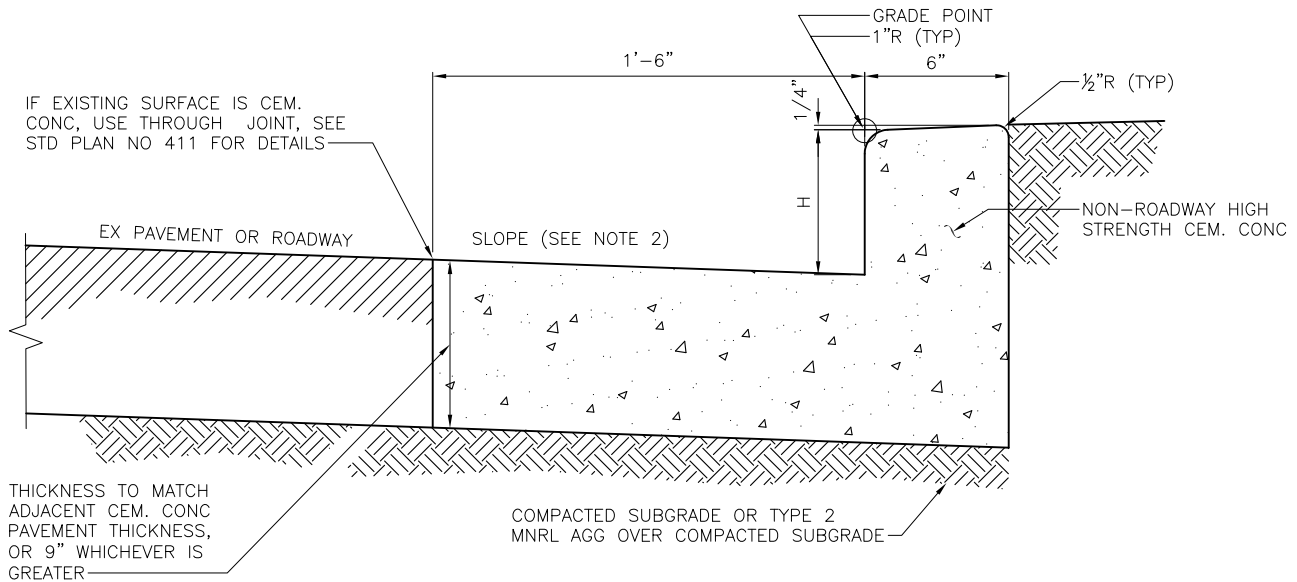

410B CURB & GUTTER

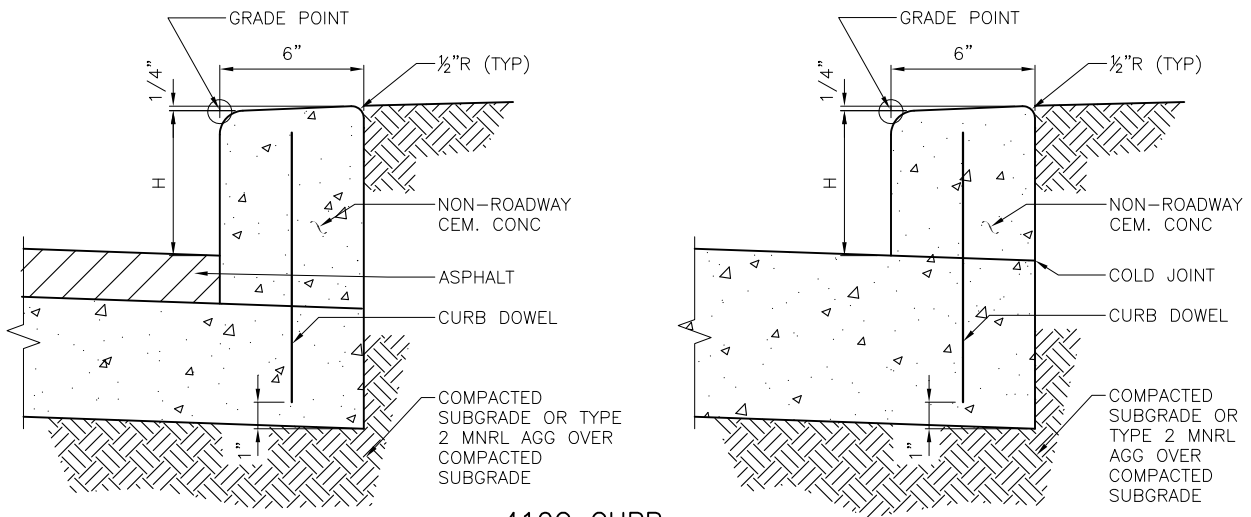

410C CURB

NOTES:

1. "H" MUST BE 6" FROM FINISHED ROADWAY GRADE UNLESS OTHERWISE SHOWN ON DRAWINGS
2. GUTTER MUST BE SLOPED THE SAME AS ADJACENT PAVEMENT OR 2% MIN, WHICHEVER IS GREATER.
3. SEE STD PLAN NO 411 FOR CURB DOWELS


REF STD SPEC SEC 8-04



City of Seattle

NOT TO SCALE


TYPE 410 CURB

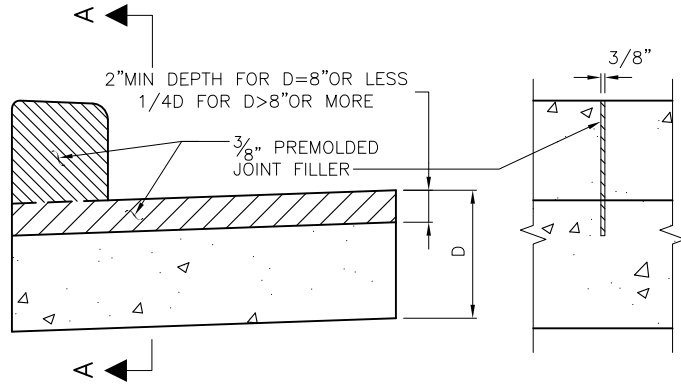

CONTRACTION JOINT FOR CURB OR CURB & GUTTER

SECTION A-A


NOTE:
JOINT AND JOINT FILLER FOR CURB OR FOR CURB & GUTTER, MATCHING PAVEMENT JOINT

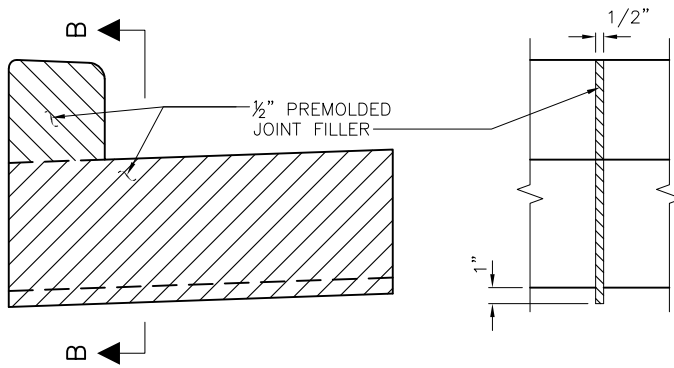

THROUGH JOINT FOR CURB OR CURB & GUTTER

SECTION B-B

NOTE:
JOINT AND JOINT FILLER FOR CURB OR FOR CURB & GUTTER, MATCHING PAVEMENT JOINT

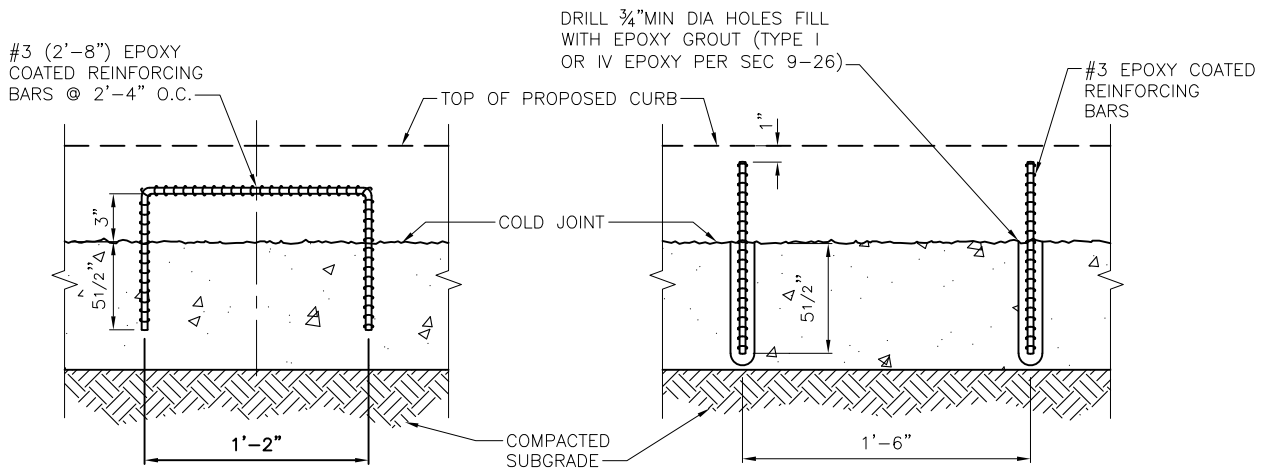

CURB DOWEL ON NEW PAVEMENT

CURB DOWEL PINS ON EXISTING PAVEMENT

DOWELS FOR DOWELLED CURB CONSTRUCTION


REF STD SPEC SEC 8-04




City of Seattle

NOT TO SCALE

CURB JOINTS & DOWELS

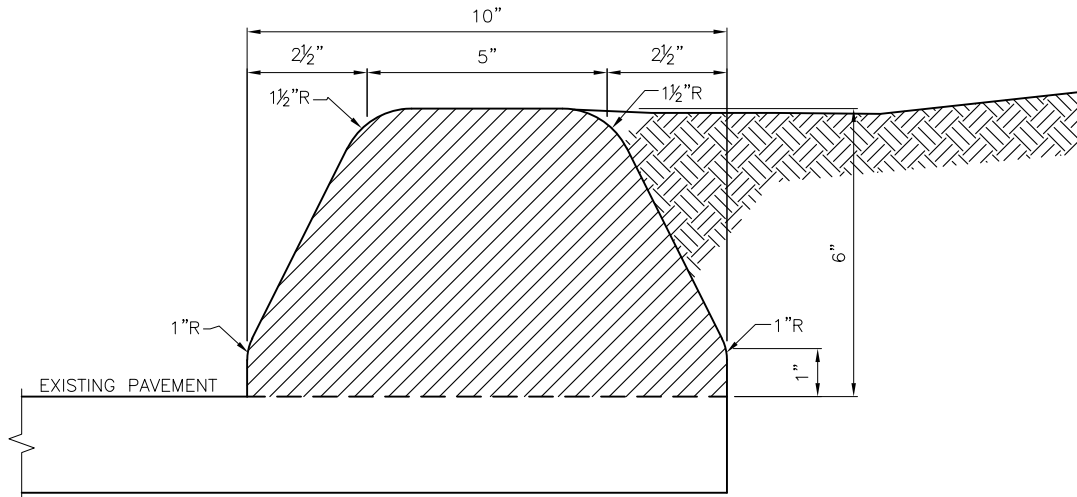

EXTRUDED ASPHALT CONCRETE CURB

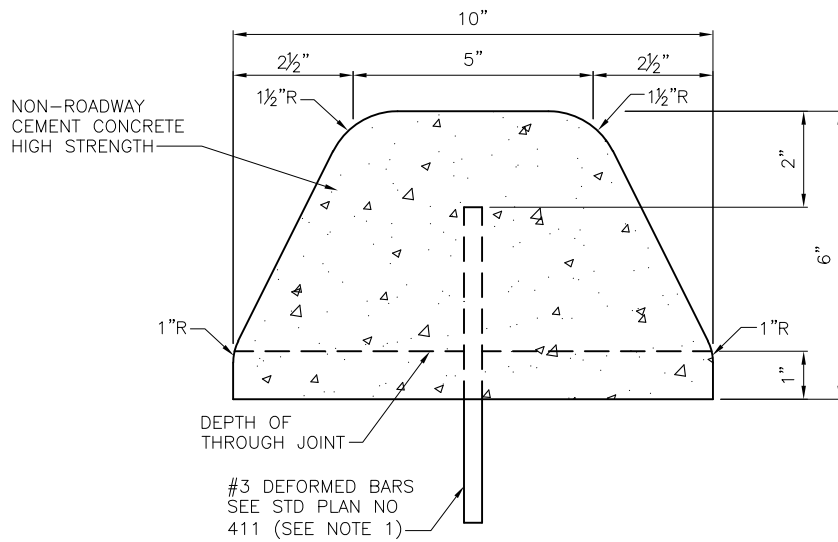

EXTRUDED CEMENT CONCRETE CURB

NOTE:

1. ALTERNATELY, THE USE OF EPOXY BONDING AGENT, IN PLACE OF #3 DEFORMED BARS, WILL BE ALLOWED.
2. EXTRUDED CURB MUST NOT BE USED IN SDOT MANAGED PUBLIC RIGHT OF WAY.


REF STD SPEC SEC 8-06




City of Seattle

NOT TO SCALE


EXTRUDED CURB

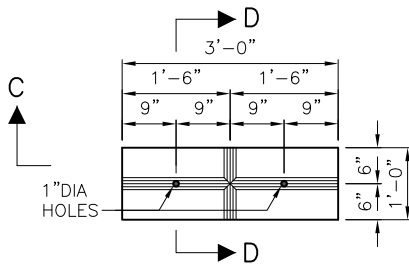


CURB PLAN




SECTION C-C

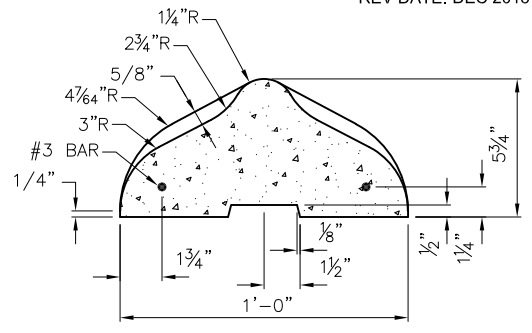


SECTION D-D

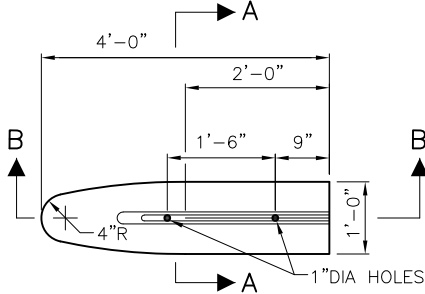


NOSING

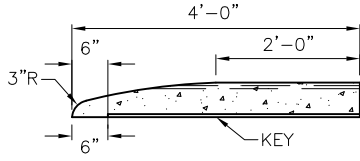

SECTION B-B

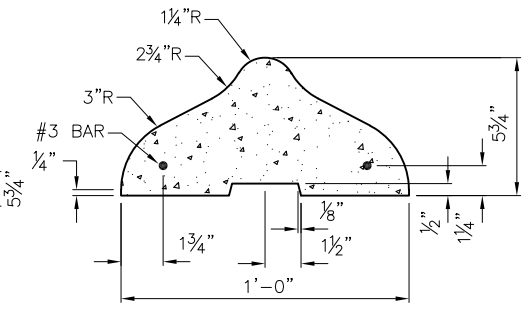


SECTION A-A

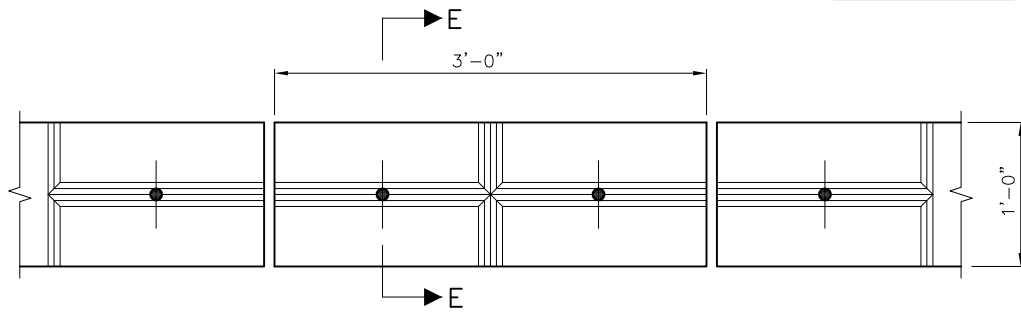

INSTALLATION DETAIL FOR STRAIGHT PRECAST TRAFFIC CURB

NOTE:

INSTALL 8" #4 REBAR IN EVERY HOLE AND FILL HOLE WITH GROUT

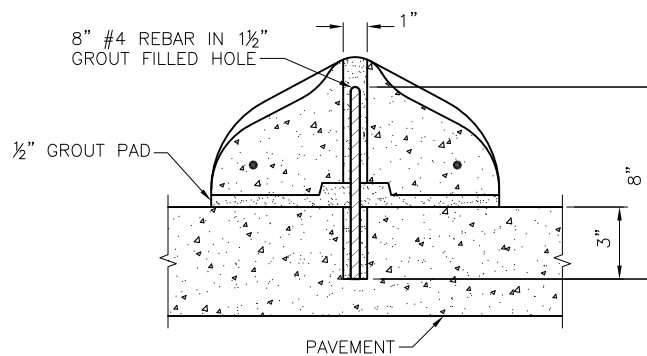

SECTION E-E



REF STD SPEC SEC 8-07





City of Seattle

NOT TO SCALE

3' PRECAST TRAFFIC CURB
(DUAL SLOPED)

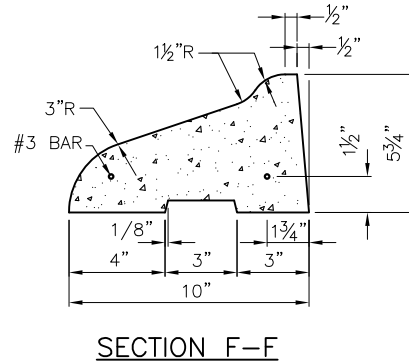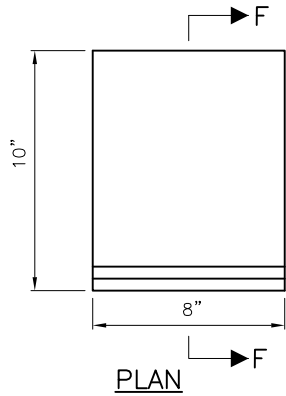

**8" STRAIGHT BLOCK CURB
(SINGLE SLOPED)**

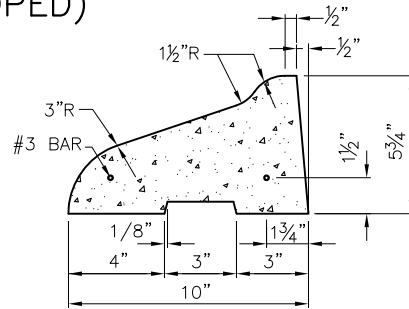
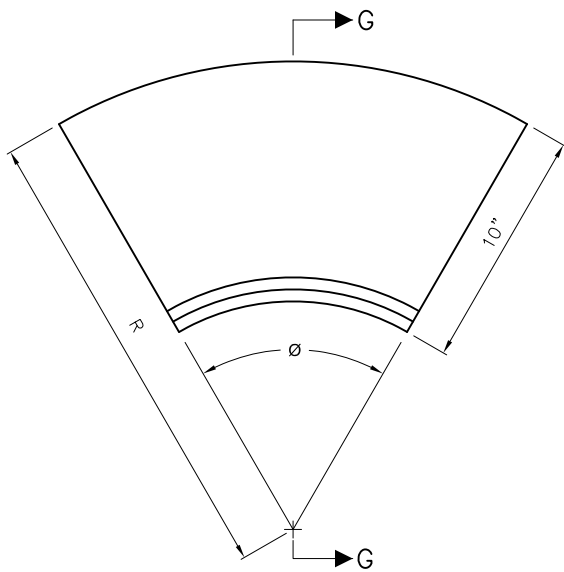


RADIAL CURB

UNIT	RADIUS	CURB RETURN ANGLE(ϕ)MULTIPLE
R1	1'-3"	45°00'
R2	1'-10"	30°00'
R3	2'-6"	22°30'
R4	5'-0"	11°27.54'
R5	10'-0"	5°43.77'

FOR RADII GREATER THAN 10'-0" USE SEGMENTS OF STRAIGHT BLOCK CURB

RADIUS CURB TABLE

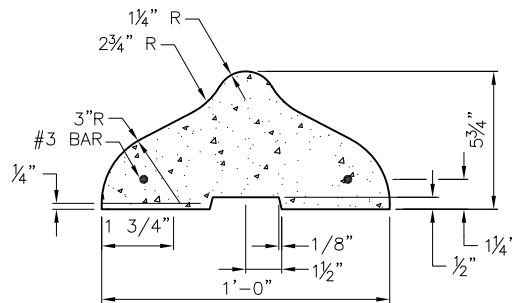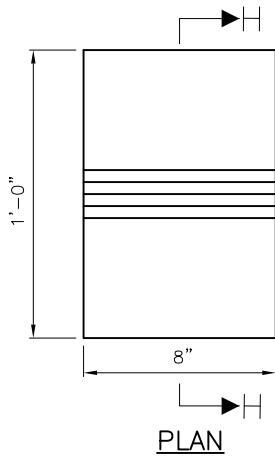

**8" STRAIGHT BLOCK CURB
(DUAL SLOPED)**


REF STD SPEC SEC 8-07




City of Seattle

NOT TO SCALE

**8" BLOCK AND RADIAL
TRAFFIC CURB**

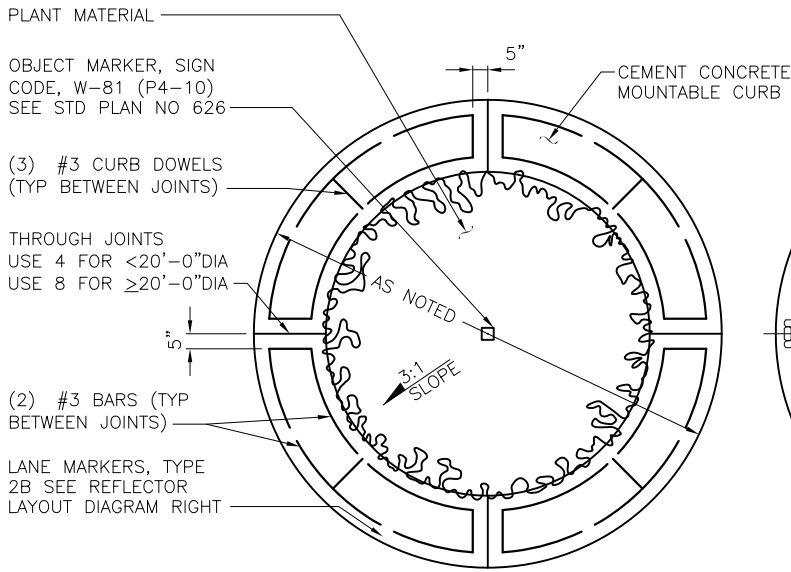

TYPICAL TRAFFIC CIRCLE

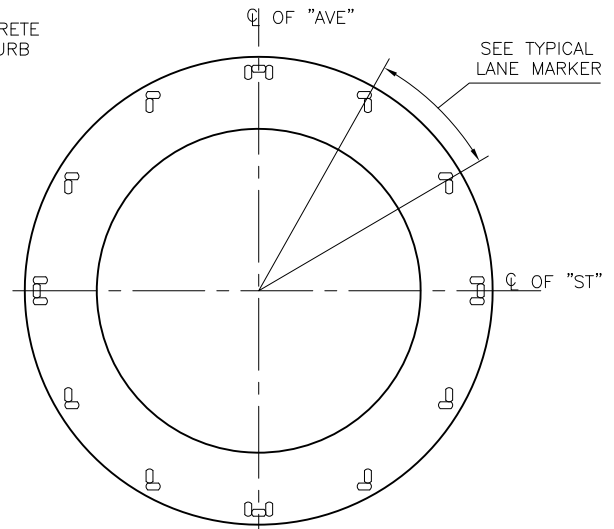


TRAFFIC CIRCLE REFLECTOR LAYOUT

SPACING CHART

DIAMETER OF CIRCLE	DEGREE OF SPACING
$\le 12'-0''$	EVERY 45°
$\le 20'-0''$	EVERY 30°
$> 20'-0''$	EVERY 22 1/2°


(FACING VEHICLE APPROACHES)

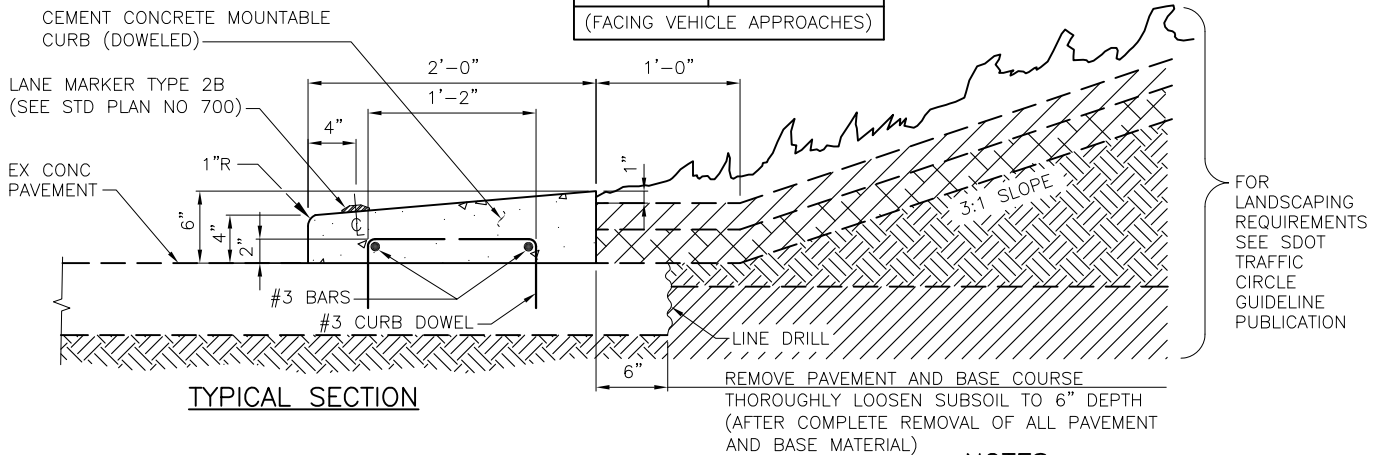


TYPICAL SECTION

NOTES:

1. DIMENSIONS ABOVE PAVEMENT EXTENSION TO MATCH SECTION DETAILED ELSEWHERE ON THIS STD PLAN
2. EXTEND CURB DEPTH TO MATCH ADJACENT ASPHALT THICKNESS OR 7" WHICHEVER IS GREATER

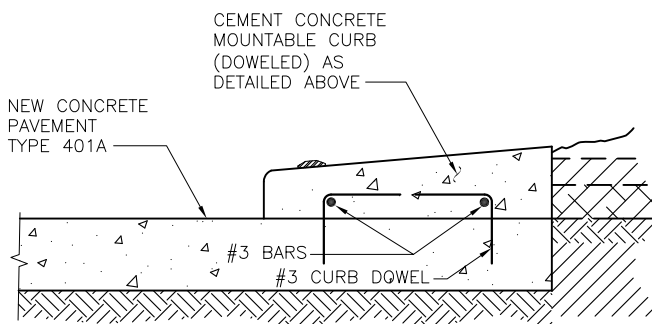

SEE TYP SECTION ABOVE FOR DIMENSIONS

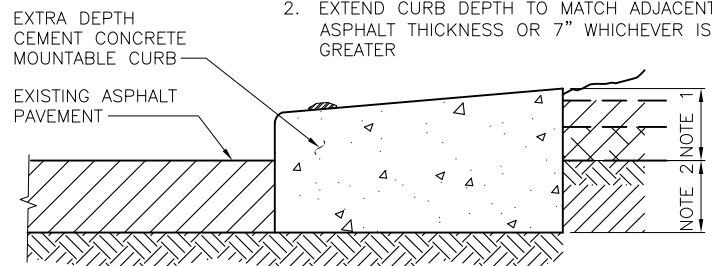

TYPICAL SECTIONS



REF STD SPEC SEC 8-02, 8-04, 8-08



City of Seattle


NOT TO SCALE

TRAFFIC CIRCLE DETAILS

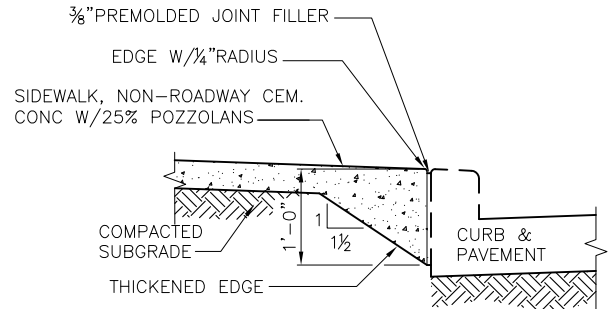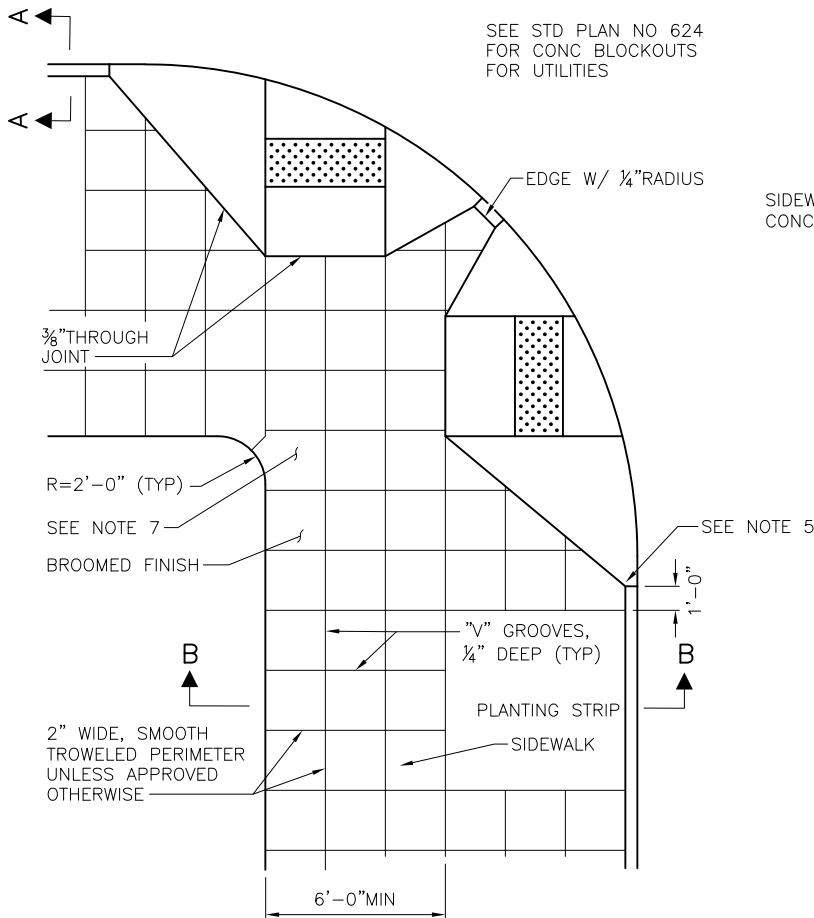

THROUGH JOINT @ SECTION A-A
UNLESS CURB IS MONOLITHIC WITH SIDEWALK

TYPICAL SIDEWALK & CURB RAMP DETAIL

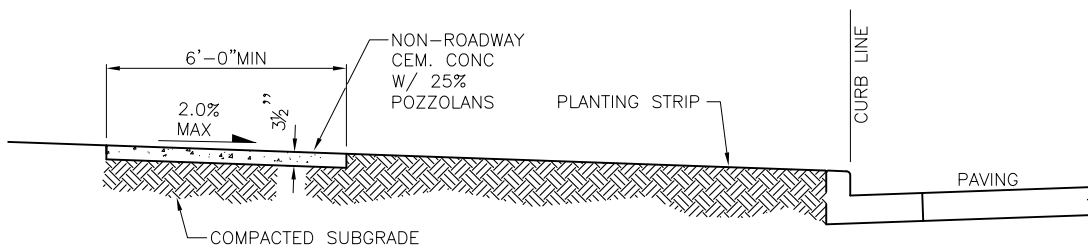

SECTION B-B

NOTES:

1. 3/8" THROUGH AND CONTRACTION JOINTS MUST BE LOCATED AS REQUIRED BY SECTION 8-14.3(6).
2. SAWCUT SCORING MUST MATCH PATTERN IN ADJACENT EXISTING SIDEWALK OR MUST BE A 2' SQUARE SCORING PATTERN UNLESS OTHERWISE OTHERWISE APPROVED BY THE ENGINEER.
3. FOR CURB RAMPS, SEE STANDARD PLAN NO 422.
4. FOR TREE PITS, SEE STANDARD PLAN NO 424.
5. 12" MINIMUM BETWEEN EDGE OF RAMP WING AND PLANTING STRIP IS DESIRABLE.
6. ALL SIDEWALK MUST BE NON-ROADWAY CEM CONC W/ 25% POZZOLANS.
7. 6'-0" MINIMUM CONTINUOUS SIDEWALK MUST BE MAINTAINED AROUND CORNERS.


REF STD SPEC SEC 8-14



City of Seattle

NOT TO SCALE

CONCRETE SIDEWALK DETAILS

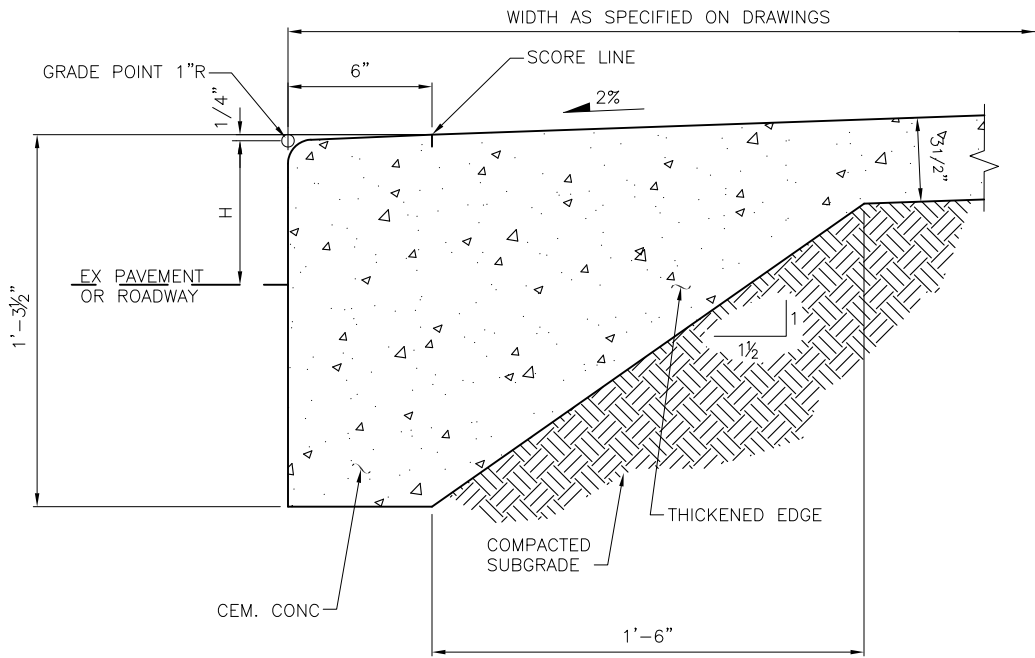

NOTE:
 "H" MUST BE 6" FROM FINISHED ROADWAY
 GRADE UNLESS OTHERWISE SPECIFIED

REF STD SPEC SEC 8-14



City of Seattle




NOT TO SCALE

**SIDEWALK WITH
 MONOLITHIC CURB**


NOTES:

1. RAMP CENTERLINE MUST BE RADIAL/PERPENDICULAR TO THE ALIGNMENT OF THE FACE OF CURB.
2. THE SLOPE ON THE LANDING MUST BE A MINIMUM OF 0.5% IN ANY ONE DIRECTION AND MUST NOT EXCEED 2% IN ANY DIRECTION. UPPER LANDING AT THE TOP OF THE CURB RAMP MUST MATCH THE FULL WIDTH OF THE RAMP AND MUST HAVE A MINIMUM DEPTH OF 4'-0". IF THE LANDING IS LIMITED AT THE BACK-OF-SIDEWALK BY A PERMANENT VERTICAL BARRIER, THE DEPTH OF THE TURNING SPACE MUST BE 5'-0" MINIMUM, MEASURED PARALLEL TO THE RUN OF THE CURB RAMP.
3. WINGS MUST HAVE A MAXIMUM SLOPE OF 10%. WINGS MUST HAVE A BRUSHED FINISH PARALLEL TO THE CURB. THE CONCRETE WALK THICKENED EDGE ALONG THE CURB MUST CONTINUE THROUGH EACH WING.
4. RAMP SURFACE MUST HAVE A HEAVY BROOM BRUSHED SURFACE PARALLEL TO THE CURB.
5. REFER TO DETAILS 422K AND 422L FOR GENERAL NOTES AND TYPICAL SECTIONS.
6. RAMP WIDTH MUST BE 5'-0" MINIMUM WHEN SIDE CURB IS USED ON BOTH SIDES INSTEAD OF WINGS.


2% MAX
 = MAX SLOPE IN EITHER DIRECTION

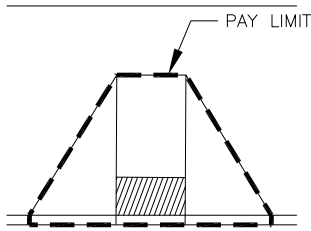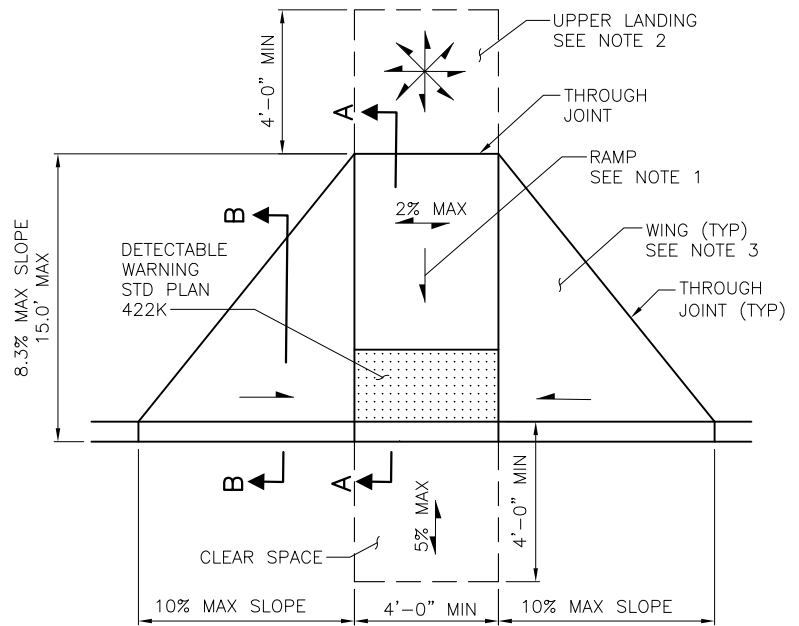

PAY LIMITS

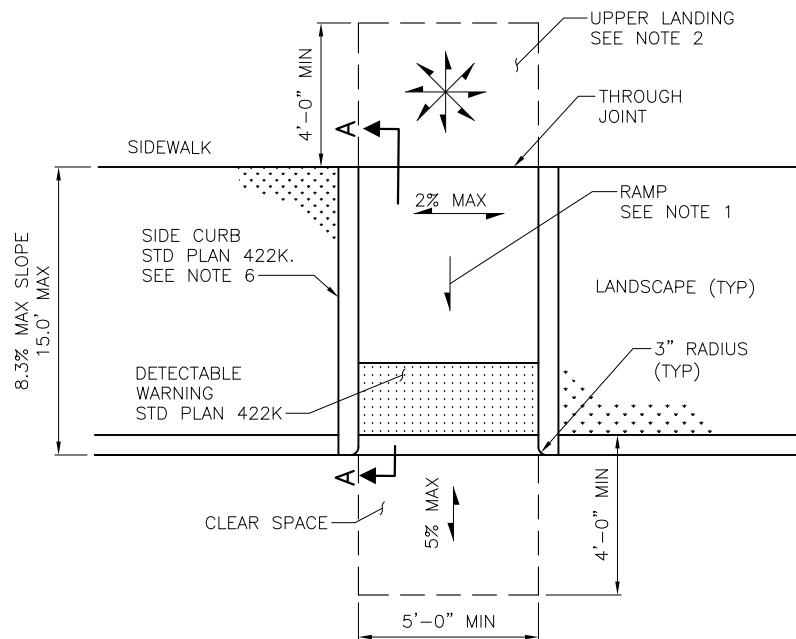

PERPENDICULAR CURB RAMPS
 (TYPE 422A)

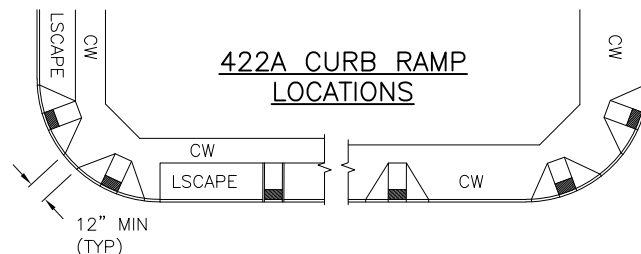

REF STD SPEC SEC 8-14



City of Seattle



NOT TO SCALE

CURB RAMP DETAILS



NOTES:

1. RAMP CENTERLINE(S) MUST BE PARALLEL TO THE ALIGNMENT OF THE FACE OF CURB. THE WIDTH OF THE RAMP MUST BE 6'-0" (5'-0" MINIMUM).
2. RAMP CENTERLINE MUST BE RADIAL/PERPENDICULAR TO THE ALIGNMENT OF THE FACE OF CURB.
3. THE SLOPE ON THE LANDING MUST BE A MINIMUM OF 0.5% IN ANY ONE DIRECTION AND MUST NOT EXCEED 2% IN ANY DIRECTION. UPPER LANDING AT THE TOP OF THE CURB RAMP MUST MATCH THE FULL WIDTH OF THE RAMP AND MUST HAVE A MINIMUM DEPTH OF 4'-0". IF THE LANDING IS LIMITED AT THE BACK-OF-SIDEWALK BY A PERMANENT VERTICAL BARRIER, THE DEPTH OF THE TURNING SPACE MUST BE 5'-0" MINIMUM, MEASURED PARALLEL TO THE RUN OF THE CURB RAMP.
4. RAMP SURFACE MUST HAVE A HEAVY BROOM BRUSHED SURFACE RADIAL/PERPENDICULAR TO THE CURB.
5. REFER TO DETAILS 422K AND 422L FOR GENERAL NOTES AND TYPICAL SECTIONS.


2% MAX
 = MAX SLOPE IN EITHER DIRECTION



PAY LIMITS

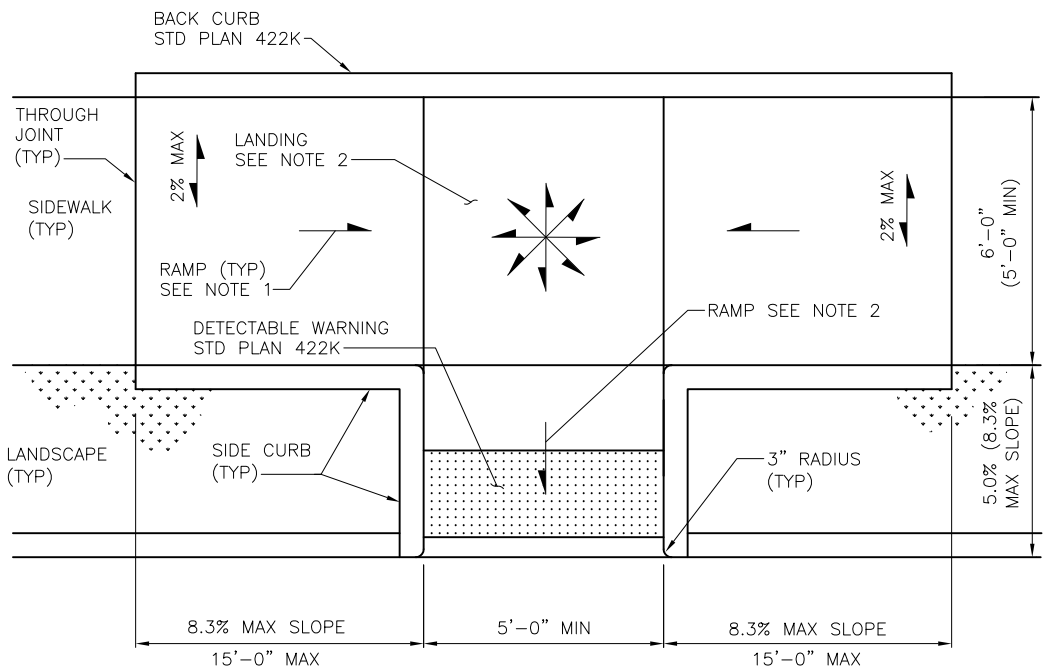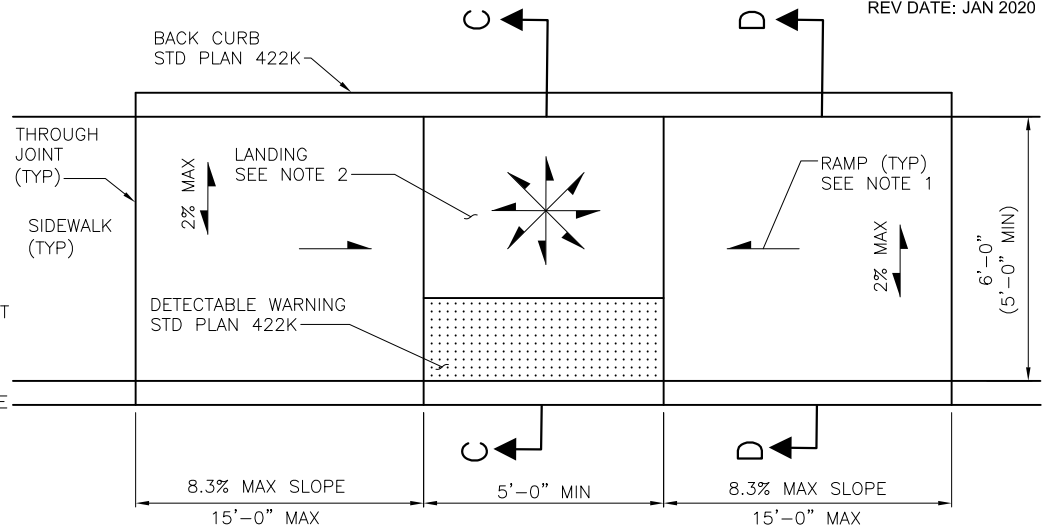

PARALLEL CURB RAMPS
(TYPE 422B)

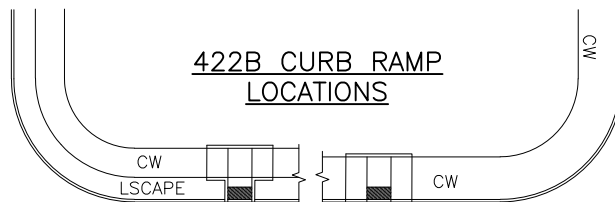

REF STD SPEC SEC 8-14





City of Seattle

NOT TO SCALE


CURB RAMP DETAILS

NOTES:


1. RAMP CENTERLINE MUST BE PARALLEL TO THE ALIGNMENT OF THE FACE OF CURB. THE WIDTH OF THE RAMP MUST BE 6'-0" (5'-0" MINIMUM).
2. THE SLOPE ON THE LANDING MUST BE A MINIMUM OF 0.5% IN ANY ONE DIRECTION AND MUST NOT EXCEED 2% IN ANY DIRECTION. UPPER LANDING AT THE TOP OF THE CURB RAMP MUST MATCH THE FULL WIDTH OF THE RAMP AND MUST HAVE A MINIMUM DEPTH OF 4'-0". IF THE LANDING IS LIMITED AT THE BACK-OF-SIDEWALK BY A PERMANENT VERTICAL BARRIER, THE DEPTH OF THE TURNING SPACE MUST BE 5'-0" MINIMUM, MEASURED PARALLEL TO THE RUN OF THE CURB RAMP.
3. RADIAL TILE MUST BE USED, CUTTING OR ALTERING DETECTABLE WARNING SURFACES MUST BE FIRST APPROVED BY THE ENGINEER.
4. RAMP SURFACE MUST HAVE A HEAVY BROOM BRUSHED SURFACE, RADIAL/PERPENDICULAR TO THE CURB.
5. REFER TO DETAILS 422k AND 422l FOR GENERAL NOTES AND TYPICAL SECTIONS.

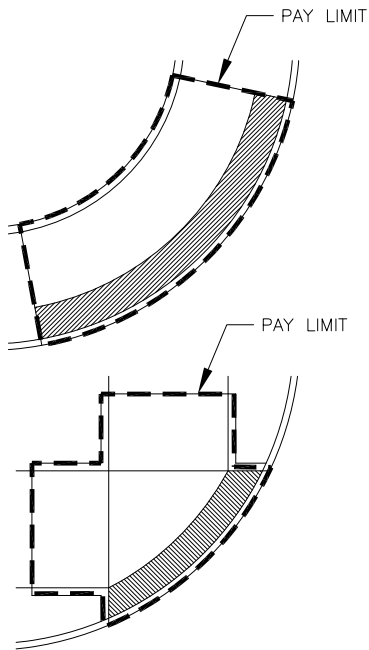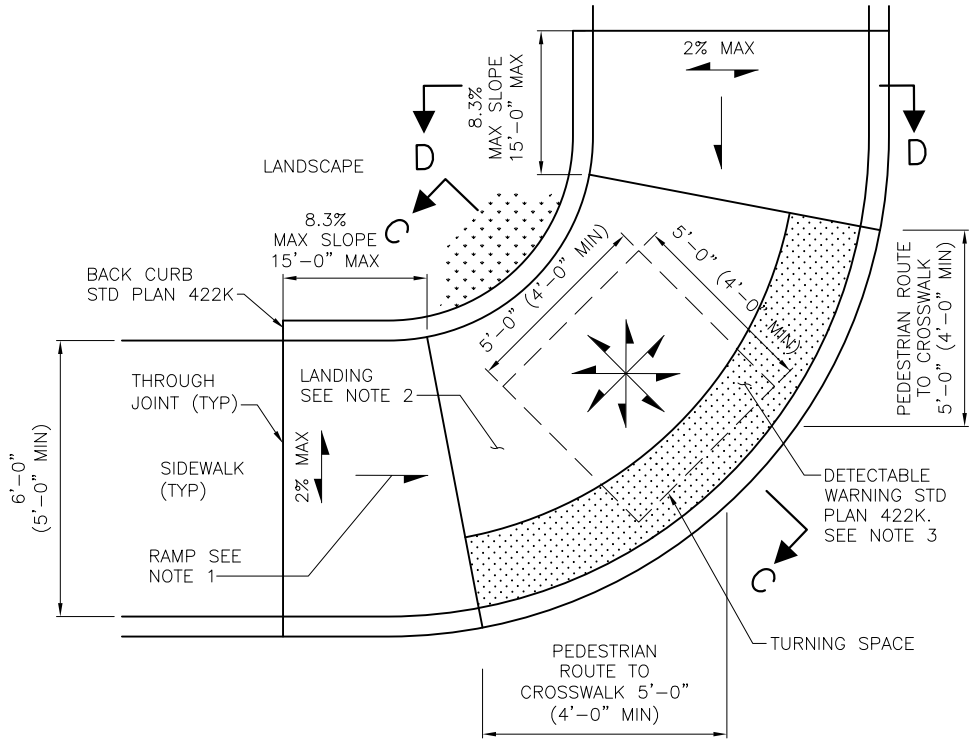

PAY LIMITS

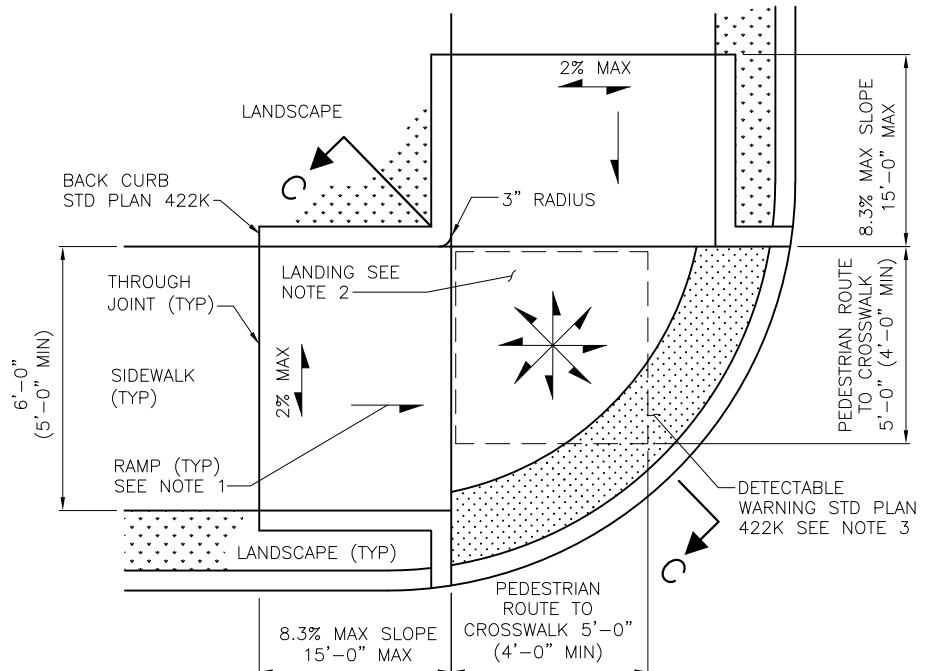

PARALLEL CURB RAMPS (CORNER)
(TYPE 422c)

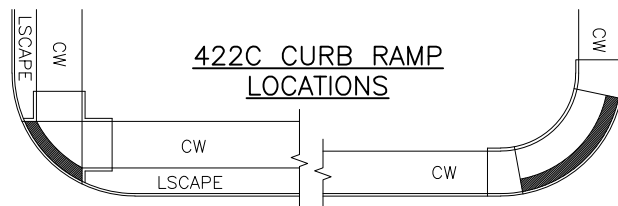

REF STD SPEC SEC 8-14




City of Seattle

NOT TO SCALE


CURB RAMP DETAILS

NOTES:


1. RAMP CENTERLINE MUST BE PARALLEL TO CROSSWALK AND/OR THE SIDEWALK.
2. THE SLOPE ON THE LANDING MUST BE A MINIMUM OF 0.5% IN ANY ONE DIRECTION AND MUST NOT EXCEED 2% IN ANY DIRECTION. UPPER LANDING AT THE TOP OF THE CURB RAMP MUST MATCH THE FULL WIDTH OF THE RAMP AND MUST HAVE A MINIMUM DEPTH OF 4'-0". IF THE LANDING IS LIMITED AT THE BACK-OF-SIDEWALK BY A PERMANENT VERTICAL BARRIER, THE DEPTH OF THE TURNING SPACE MUST BE 5'-0" MINIMUM, MEASURED PARALLEL TO THE RUN OF THE CURB RAMP.
3. WINGS MUST HAVE A MAXIMUM SLOPE OF 10%. WINGS MUST HAVE A BRUSHED FINISH PARALLEL TO THE CURB. THE CONCRETE WALK THICKENED EDGE ALONG THE CURB MUST CONTINUE THROUGH EACH WING.
4. WING ON THE OPEN SIDE OF THE CURB RAMP MUST HAVE A MINIMUM SLOPE OF 5% TO ASSIST PEDESTRIANS WITH VISUAL IMPAIRMENTS WHERE THE DETECTABLE WARNING SURFACE IS OFFSET FROM THE CURB LINE.
5. RAMP SURFACE MUST HAVE A HEAVY BROOM BRUSHED FINISH PERPENDICULAR TO THE PATH OF TRAVEL.
6. REFER TO DETAILS 422k AND 422l FOR GENERAL NOTES AND TYPICAL SECTIONS.

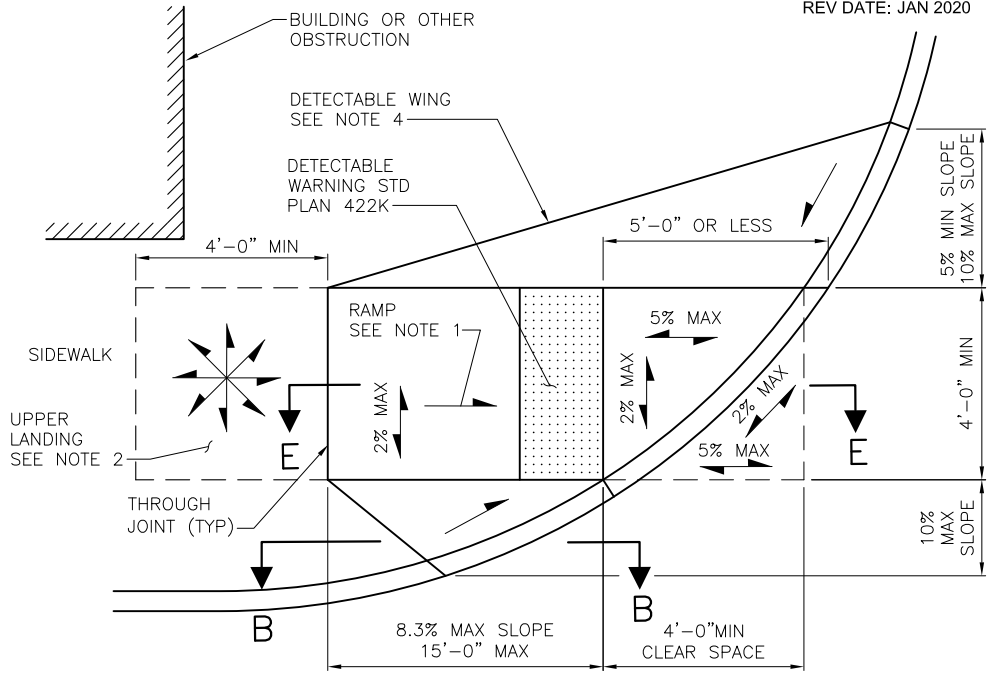


2% MAX
 = MAX SLOPE IN EITHER DIRECTION

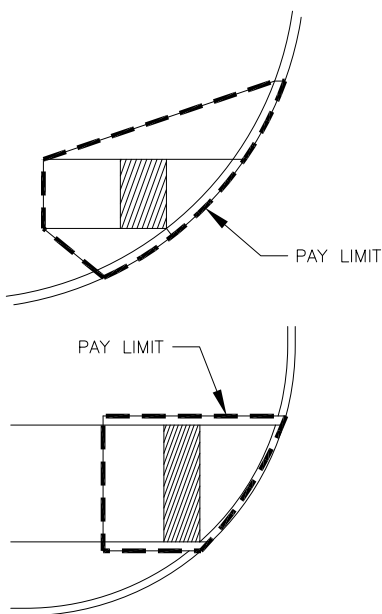

PAY LIMITS

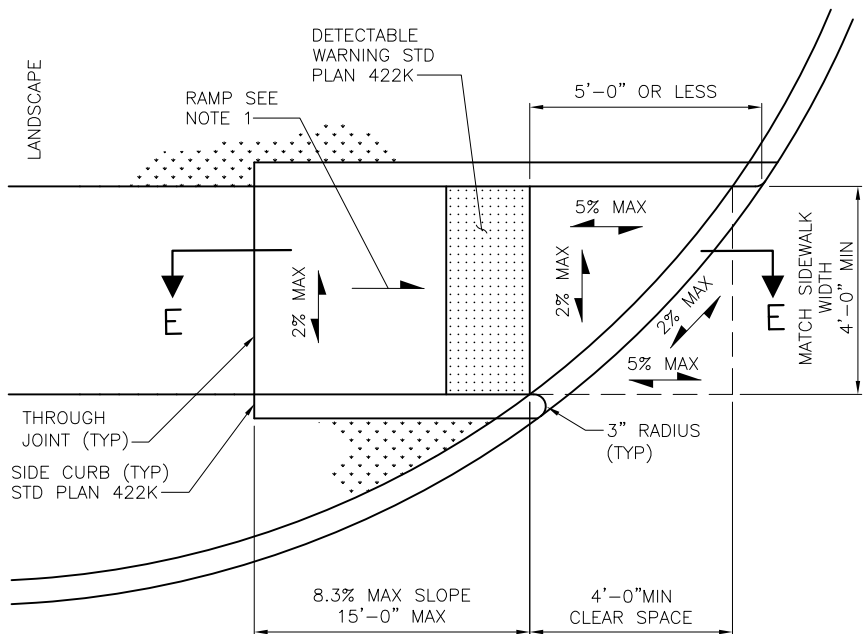

DIRECTIONAL CURB RAMPS
(TYPE 422D)

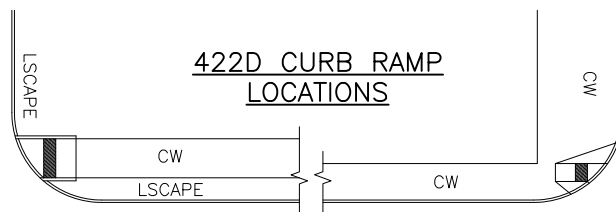

REF STD SPEC SEC 8-14



City of Seattle



NOT TO SCALE

CURB RAMP DETAILS



NOTES:

1. RAMP CENTERLINE MUST BE PARALLEL TO CROSSWALK AND/OR THE SIDEWALK.
2. THE SLOPE ON THE LANDING MUST BE A MINIMUM OF 0.5% IN ANY ONE DIRECTION AND MUST NOT EXCEED 2% IN ANY DIRECTION. UPPER LANDING AT THE TOP OF THE CURB RAMP MUST MATCH THE FULL WIDTH OF THE RAMP AND MUST HAVE A MINIMUM DEPTH OF 4'-0". IF THE LANDING IS LIMITED AT THE BACK-OF-SIDEWALK BY A PERMANENT VERTICAL BARRIER, THE DEPTH OF THE TURNING SPACE MUST BE 5'-0" MINIMUM, MEASURED PARALLEL TO THE RUN OF THE CURB RAMP.
3. WINGS MUST HAVE A MAXIMUM SLOPE OF 10%. WINGS MUST HAVE A BRUSHED FINISH PARALLEL TO THE CURB. THE CONCRETE WALK THICKENED EDGE ALONG THE CURB MUST CONTINUE THROUGH EACH WING.
4. WHERE THE SETBACK FROM THE BOTTOM OF THE CURB RAMP TO THE BACK OF CURB LINE EXCEEDS 5'-0", THE DETECTABLE WARNING SURFACE MUST BE INSTALLED AT THE BACK OF CURB (NOT AT THE BOTTOM OF RAMP). RADIAL TILE MUST BE USED. CUTTING OR ALTERING DETECTABLE WARNING SURFACE MUST BE FIRST APPROVED BY THE ENGINEER.
5. DIRECTIONAL CURB RAMP WITH LARGE SETBACK FROM BACK OF CURB TO BOTTOM OF THE CURB RAMP ARE NOT PREFERRED DESIGNS BUT MAY BE USED IF NECESSARY DUE TO EXISTING SITE CONSTRAINTS.
6. STRAIGHT SECTIONS OF DETECTABLE WARNING SURFACE IS PERMITTED AS AN ALTERNATE. IF USED, THERE MUST BE 2" MAXIMUM FROM THE DETECTABLE WARNING SURFACE TO THE BACK OF CURB AT ANY POINT.
7. RAMP SURFACE MUST HAVE A HEAVY BROOM BRUSHED FINISH PERPENDICULAR TO THE PATH OF TRAVEL.
8. REFER TO DETAILS 422K AND 422L FOR GENERAL NOTES AND TYPICAL SECTIONS.


2% MAX
= MAX SLOPE IN EITHER DIRECTION

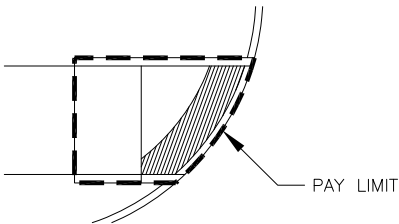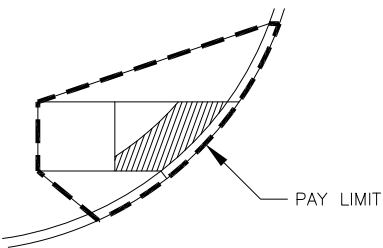

PAY LIMITS

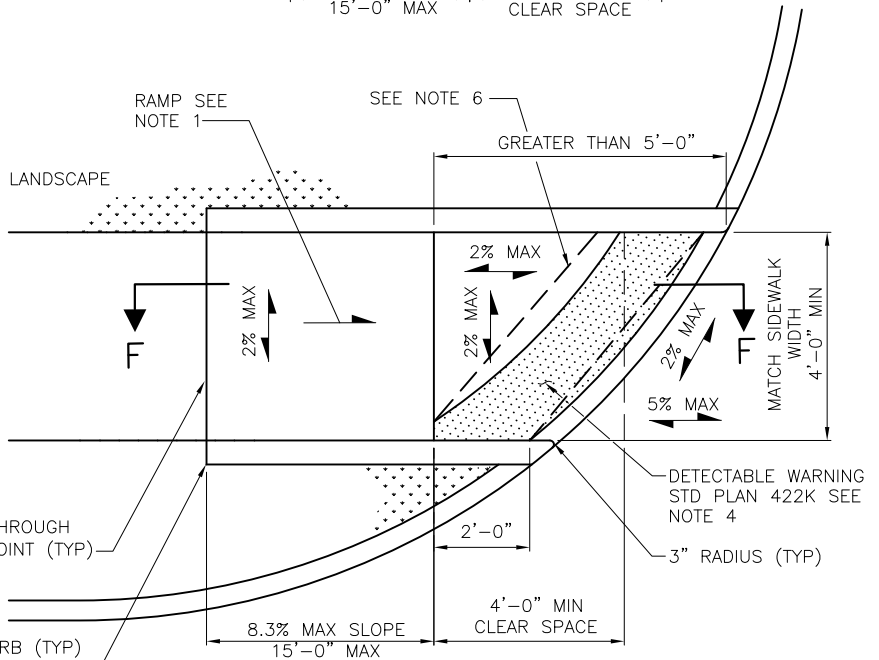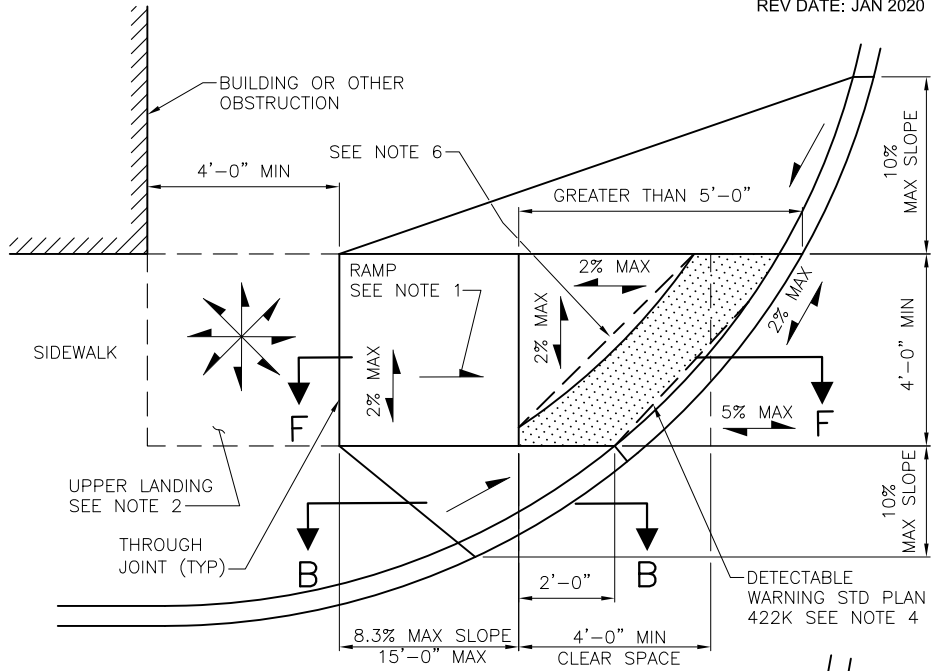

DIRECTIONAL CURB RAMPS
(TYPE 422E)

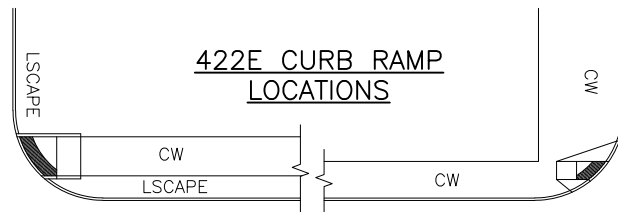

REF STD SPEC SEC 8-14




City of Seattle

NOT TO SCALE

CURB RAMP DETAILS


NOTES:

1. RAMP CENTERLINE MUST BE RADIAL/PERPENDICULAR TO THE ALIGNMENT OF THE FACE OF CURB.
2. THE SLOPE ON THE LANDING MUST BE A MINIMUM OF 0.5% IN ANY ONE DIRECTION AND MUST NOT EXCEED 2% IN ANY DIRECTION. UPPER LANDING AT THE TOP OF THE CURB RAMP MUST MATCH THE FULL WIDTH OF THE RAMP AND MUST HAVE A MINIMUM DEPTH OF 4'-0". IF THE LANDING IS LIMITED AT THE BACK-OF-SIDEWALK BY A PERMANENT VERTICAL BARRIER, THE DEPTH OF THE TURNING SPACE MUST BE 5'-0" MINIMUM, MEASURED PARALLEL TO THE RUN OF THE CURB RAMP.
3. CLEAR SPACE AT THE BOTTOM OF THE RAMP MUST BE 5'-0" MINIMUM IN WIDTH AND MUST EXTEND A MINIMUM OF 4'-0' BEYOND THE RAMP LOWER GRADE BREAK. THE CLEAR SPACE MUST FALL WHOLLY WITHIN THE LEGAL CROSSWALK, MARKED OR UNMARKED. THE CLEAR SPACE MUST FIT BEHIND LINES EXTENDING FROM THE FACE OF CURB RUNNING PARALLEL TO EACH ROADWAY. THERE IS NO ALLOWABLE EXEMPTION FOR MINIMUM CLEAR SPACE REQUIREMENTS AT SHARED DIAGONAL PERPENDICULAR CURB RAMP.
4. WINGS MUST HAVE A MAXIMUM SLOPE OF 10%. WINGS MUST HAVE A BRUSHED FINISH PARALLEL TO THE CURB. THE CONCRETE WALK THICKENED EDGE ALONG THE CURB MUST CONTINUE THROUGH EACH WING.
5. RAMP SURFACE MUST HAVE A HEAVY BROOM BRUSHED SURFACE PARALLEL TO THE CURB.
6. REFER TO DETAILS 422K AND 422L FOR GENERAL NOTES AND TYPICAL SECTIONS.

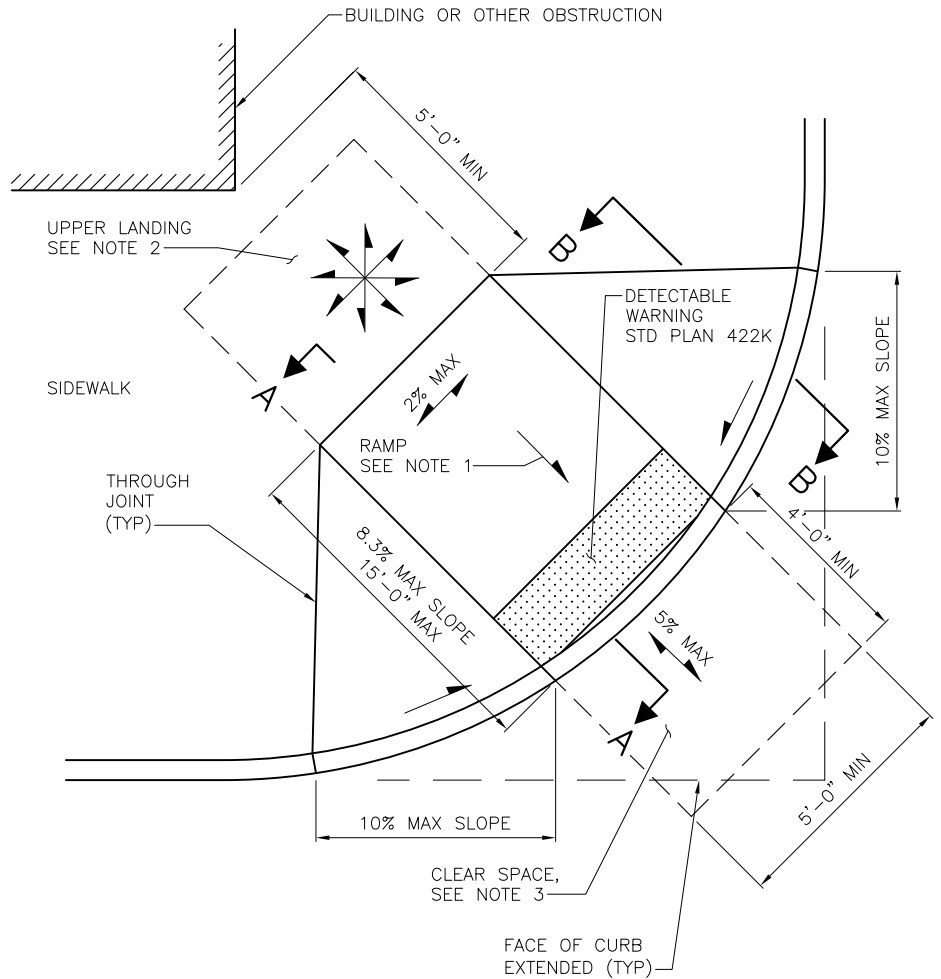


2% MAX
 ↔ = MAX SLOPE IN EITHER DIRECTION

SHARED DIAGONAL PERPENDICULAR CURB RAMP
 (TYPE 422F)

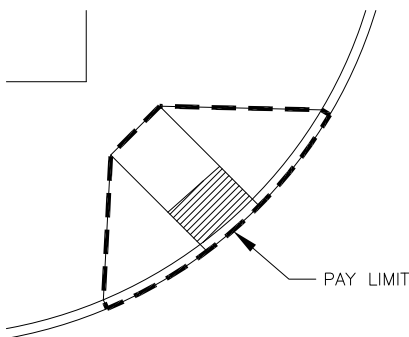

PAY LIMITS

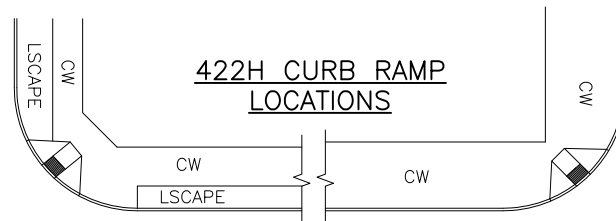

REF STD SPEC SEC 8-14




City of Seattle

NOT TO SCALE



CURB RAMP DETAILS

NOTES:

1. THE SIDEWALK MUST TRANSITION DOWN TO THE ROADWAY WITH A MAXIMUM RUNNING SLOPE OF 5%. THE CROSS SLOPE ON THE TRANSITION MUST NOT EXCEED 2% AT ANY POINT.
2. A BYPASS ROUTE MUST BE PROVIDED AT THE TOP OF THE BLENDED TRANSITION WITH A MINIMUM WIDTH OF 6'-0" (5'-0" MIN). THE CROSS SLOPE OF THE BYPASS ROUTE MUST BE A MINIMUM OF 0.5% IN ANY DIRECTION AND MUST NOT EXCEED 2% IN ANY DIRECTION.
3. RADIAL TILE MUST BE USED, CUTTING OR ALTERING DETECTABLE WARNING SURFACES MUST BE FIRST APPROVED BY THE ENGINEER.
4. WINGS MUST HAVE A MAXIMUM SLOPE OF 10%. WINGS MUST HAVE A BRUSHED FINISH PARALLEL TO THE CURB. THE CONCRETE WALK THICKENED EDGE ALONG THE CURB MUST CONTINUE THROUGH EACH WING.
5. BLENDED TRANSITION SURFACE MUST HAVE A HEAVY BROOM BRUSHED SURFACE RADIAL/PERPENDICULAR TO THE CURB.
6. REFER TO DETAILS 422K AND 422L FOR GENERAL NOTES AND TYPICAL SECTION B.

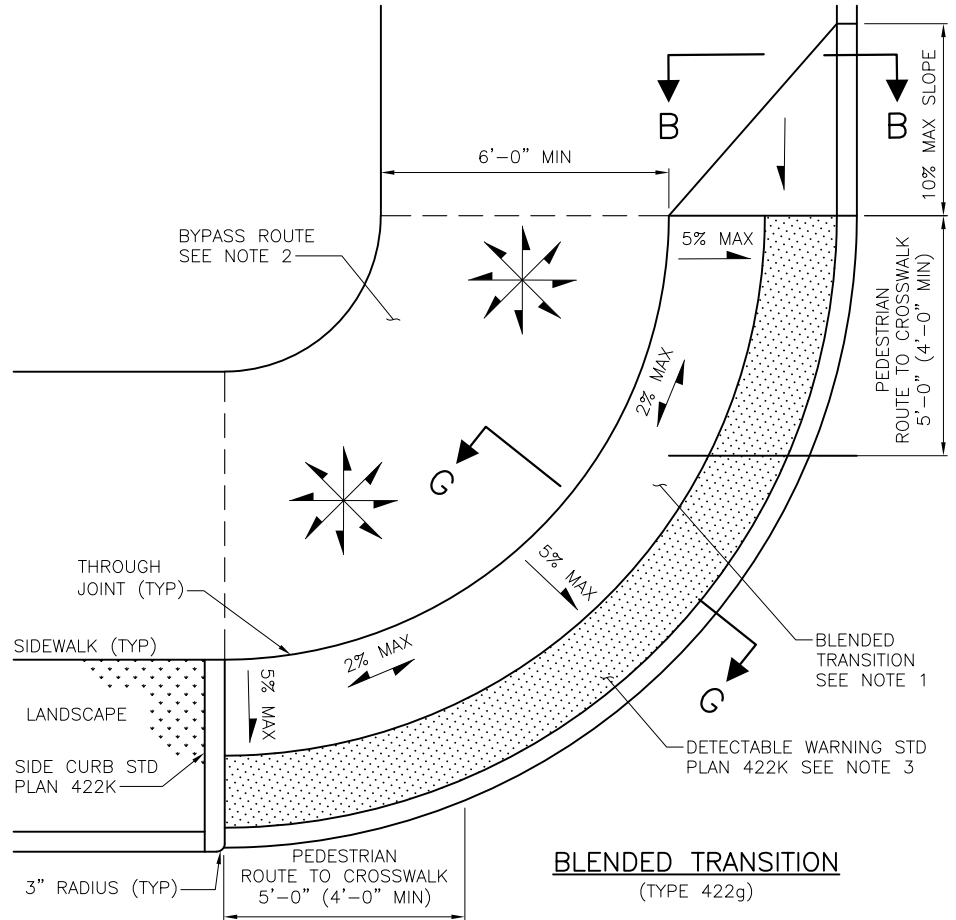


2% MAX
= MAX SLOPE IN EITHER DIRECTION

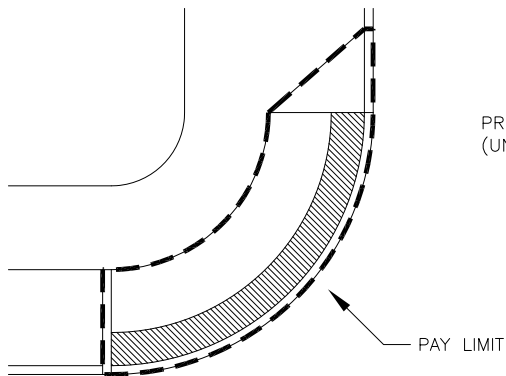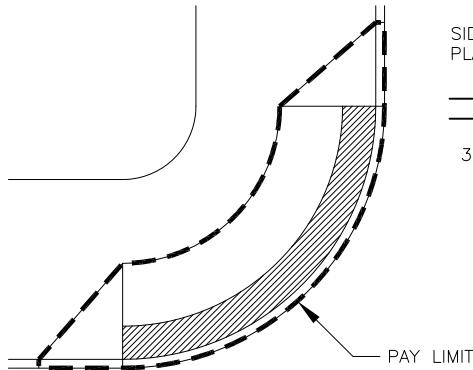


PAY LIMITS

BLENDED TRANSITION
(TYPE 422g)

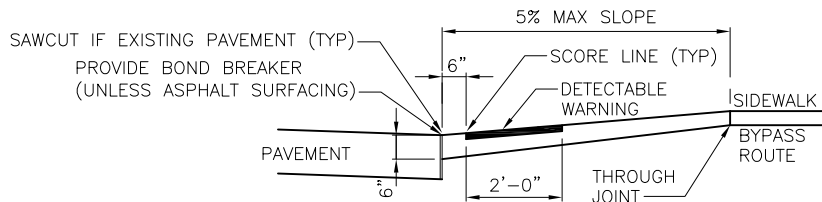


SECTION G-G

CURB MONOLITHIC WITH RAMP. NEW PAVEMENT BLOCKED OUT FULL DEPTH. EXISTING PAVEMENT REMOVED AT FACE OF CURB

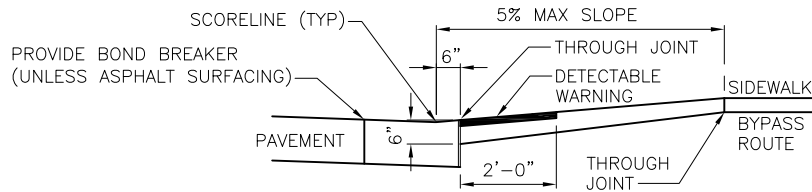

SECTION G-G

DEPRESSED CURB & GUTTER SEPARATE FROM RAMP.

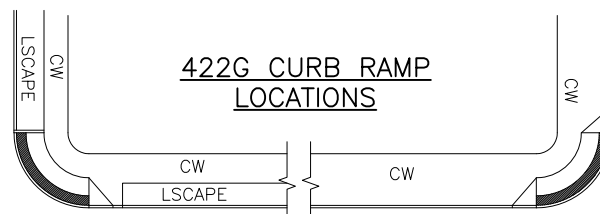

REF STD SPEC SEC 8-14



City of Seattle




NOT TO SCALE

CURB RAMP DETAILS

NOTES:

1. SIZE, SHAPE, AND/OR DIMENSIONS OF CHANNELIZING ISLANDS OR PEDESTRIAN REFUGE ISLANDS MAY VARY. DETAILS SHOWN ARE INTENDED TO SHOW MINIMUM REQUIRED CLEARANCES AND DETECTABLE WARNING SURFACE PLACEMENT LOCATIONS.
2. ACCESS THROUGH CHANNELIZING ISLANDS OR PEDESTRIAN REFUGE ISLANDS MAY BE CUT-THROUGH OR ACCESS MAY BE PROVIDED USING STANDARD CURB RAMP DETAILS.
3. AT PEDESTRIAN REFUGE ISLANDS, DETECTABLE WARNING IS NOT TO BE INSTALLED IF THE REFUGE AREA IS LESS THAN 6'-0" IN DEPTH (IN THE DIRECTION OF TRAVEL).
4. PROVIDE A MINIMUM 4'-0" WIDTH x 4'-0" DEPTH CLEAR SPACE FOR ACCESS FROM THE CHANNELIZING ISLAND OR PEDESTRIAN REFUGE ISLAND FOR EACH CROSSWALK.

2% MAX
 MAX SLOPE IN EITHER DIRECTION

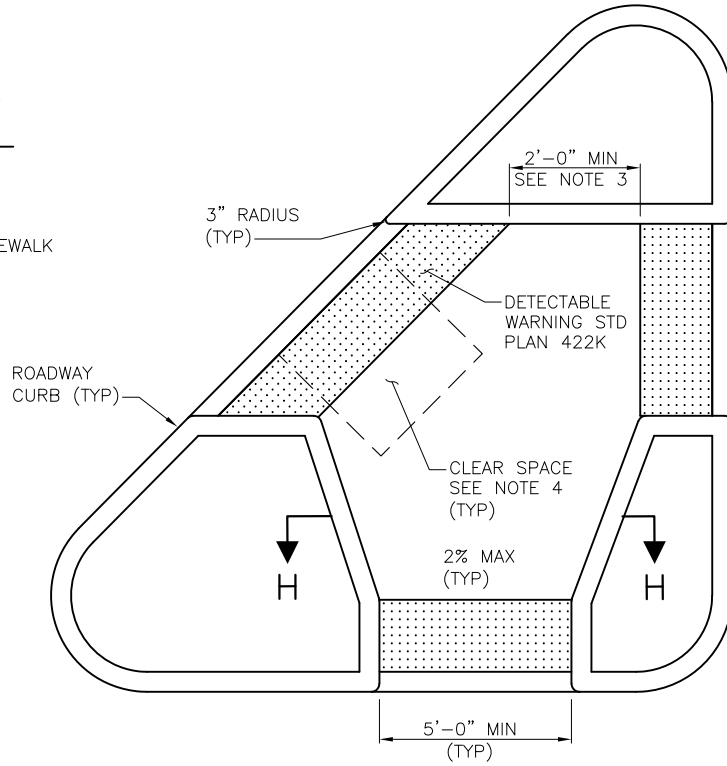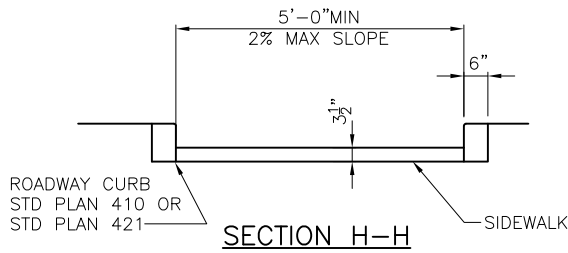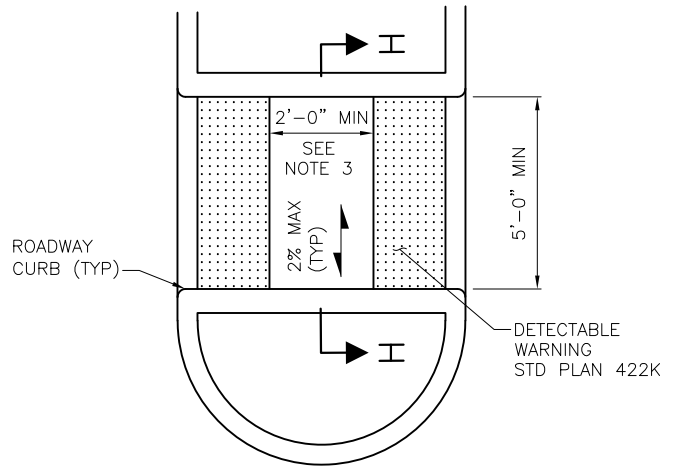

ISLAND CUT-THROUGHS
(TYPE 422H)

REF STD SPEC SEC 8-14



City of Seattle

NOT TO SCALE

CURB RAMP DETAILS


CURB RAMP GENERAL NOTES:

1. TWO CURB RAMP MUST BE INSTALLED AT EACH CORNER UNLESS OTHERWISE DIRECTED BY ENGINEER. SHARED DIAGONAL PERPENDICULAR RAMP MUST NOT BE INSTALLED UNLESS ALL OTHER DESIGN OPTIONS ARE UNABLE TO BE CONSTRUCTED DUE TO EXISTING SITE CONSTRAINTS.
2. CURB RAMP MUST BE AS CLOSELY ALIGNED WITH THE SIDEWALK AND THE PEDESTRIAN STREET CROSSING SERVED AS POSSIBLE.
3. CURB RAMP MUST BE CONSTRUCTED WITH COMPANION RAMP ON OPPOSITE SIDE OF THE ROADWAY WHERE NO RAMP IS PROVIDED UNLESS OTHERWISE DIRECTED BY ENGINEER.
4. RAMP MUST TYPICALLY HAVE A MAXIMUM RUNNING SLOPE OF 8.3% AND A MINIMUM WIDTH OF 4'-0" UNLESS OTHERWISE DIRECTED BY ENGINEER. THE CROSS SLOPE OF RAMP MUST BE A MAXIMUM OF 2%. CURB RAMP ARE NOT REQUIRED TO EXCEED A LENGTH OF 15 FEET UNLESS OTHERWISE DIRECTED BY ENGINEER.*
5. GRADE BREAKS AT THE TOP AND THE BOTTOM OF CURB RAMP RUNS MUST BE PERPENDICULAR TO THE PATH OF TRAVEL. CURB RAMP RUNS ARE DEFINED BY RUNNING SLOPES THAT EXCEED 5% BUT ARE NO MORE THAN 8.3%. SURFACES ABUTTING AT CURB RAMP GRADE BREAKS MUST BE FLUSH.
6. AREAS ADJACENT TO CURB RAMP OR CURB RAMP LANDINGS USABLE BY PEDESTRIANS MUST COMPLY WITH STANDARD PLAN SIDEWALK SLOPE LIMITS OR A CURB RAMP WING MUST BE PROVIDED AS SHOWN IN THE APPLICABLE CURB RAMP DETAILS. THE INSTALLATION OF CURBED EDGES IS NOT REQUIRED BUT MAY BE USED AT THE SIDES OR BACKS OF CURB RAMP OR CURB RAMP LANDING WHERE THE ADJACENT SURFACE IS LANDSCAPED OR OTHERWISE NOT USABLE BY PEDESTRIANS.
7. THE COUNTER SLOPE OF THE GUTTER OR THE STREET AT THE BOTTOM OF CURB RAMP RUNS MUST BE 5% MAXIMUM. IF TURNING OR CHANGE OF ORIENTATION IS REQUIRED WITHIN THE PEDESTRIAN CROSSING AT THE BOTTOM OF CURB RAMP RUNS, THE SLOPE MUST BE 2% MAXIMUM IN ANY DIRECTION FOR A MINIMUM 4'-0" WIDTH X 4'-0" DEPTH MEASURED FROM THE RAMP BOTTOM GRADE BREAK.
8. CURB RAMP WITH RUNS THAT TERMINATE AT THE ENTRANCE TO THE PEDESTRIAN STREET CROSSING MUST HAVE A CLEAR SPACE AT THE BOTTOM OF THE RAMP. "CLEAR SPACE" IS DEFINED AS A NAVIGABLE 4'-0" BY 4'-0" SPACE, EXTENDING FROM THE RAMP LOWER GRADE BREAK, THAT FALLS WHOLLY WITHIN THE LEGAL CROSSWALK, MARKED OR UNMARKED, AND OUTSIDE THE PARALLEL VEHICULAR TRAFFIC LANE.
9. A 4'-0" MINIMUM WIDTH UNOBSTRUCTED PEDESTRIAN ACCESS ROUTE MUST BE PROVIDED FROM EACH CURB RAMP, BLENDED TRANSITION, OF FLUSH TRANSITION TO THE LEGAL CROSSWALK THAT IS SERVED, MARKED OR UNMARKED, AND LOCATED OUTSIDE THE PARALLEL VERTICAL TRAFFIC LANE.
10. DETECTABLE WARNING MUST BE PROVIDED AT CURB RAMP AND AT


LOCATIONS WHERE THE SIDEWALK AND ROADWAY ARE FLUSH. THE DETECTABLE WARNING SURFACE MUST HAVE A TRUNCATED DOME PATTERN AS SHOWN, WITH A MINIMUM DEPTH OF 2'-0", AND MUST BE PLACED AT THE BACK OF CURB BUT NO MORE THAN 8" FROM THE FACE OF CURB FOR MONOLITHIC CURBS OR ATYPICAL CURB WIDTHS. DETECTABLE WARNING MUST MATCH THE WIDTH OF THE RAMP RUN OR THE OPENING WHERE THE SIDEWALK AND ROADWAY ARE FLUSH. THE TRUNCATED DOMES ON THE DETECTABLE WARNING SURFACE SHOULD ALIGN WITH THE CURB RAMP RUN OR THE DIRECTION OF TRAVEL. DOMES MAY BE ON A RADIAL GRID PATTERN WHERE THE DETECTABLE WARNING SURFACE IS PLACED AT CURB RADII.

11. DETECTABLE WARNING COLOR MUST BE "FEDERAL SAFETY YELLOW", UNLESS OTHERWISE DIRECTED BY ENGINEER.
12. DETECTABLE WARNING SURFACES SHOULD GENERALLY NOT BE CUT OR ALTERED TO FIT UNLESS THERE IS NO ALTERNATIVE AVAILABLE. IF REQUIRED, CUT OR ALTER THE DETECTABLE WARNING SURFACE PER THE MANUFACTURER'S DIRECTIONS. DETECTABLE WARNING SURFACES PLACED AT CURB RADII MUST MATCH THE CURB RADII WITHOUT GAPS OR INCONSISTENCIES IN PLACEMENT.
13. AVOID LOCATING HANDHOLES, UTILITY CASTINGS, OR ANY OTHER SURFACE OBSTRUCTIONS IN THE CURB RAMP RUN(S) OR LANDING(S). IF NECESSARY DUE TO EXISTING CONSTRAINTS, HANDHOLES, UTILITY CASTINGS, OR OTHER SURFACE OBSTRUCTIONS MAY BE LOCATED WITHIN A RAMP RUN, LANDING, OR TURNING SPACE BUT MUST ADHERE TO SURFACE REQUIREMENTS. LEVEL CHANGES BETWEEN SURFACES MUST NOT EXCEED 1/4" OR 1/2" WITH A 1:2 BEVEL. GAPS BETWEEN SURFACES OR GRATINGS MAY NOT EXCEED 1/2". SURFACES MUST BE FIRM, STABLE, AND SLIP RESISTANT.
14. HANDHOLES, UTILITY CASTINGS, OR OTHER SURFACE OBSTRUCTIONS MUST NOT REDUCE THE REQUIRED DEPTH OF DETECTABLE WARNING.
15. POLES, HYDRANTS AND OTHER ABOVE GROUND OBSTRUCTIONS MUST HAVE A MINIMUM LATERAL CLEARANCE OF 1'-0" FROM RAMP RUN(S) OR LANDING(S).
16. ALL CHANGES IN LEVEL ACROSS JOINTS MUST BE FLUSH. ANY DIFFERENCE IN ELEVATION OF 3/16 INCH OR GREATER MUST BE REPAIRED OR REPLACED.
17. CURB RAMP ARE DESIGNED TO ENSURE THAT WATER DOES NOT ACCUMULATE ON RAMP SURFACES. THE CONTRACTOR MUST CHECK GRADE LINES AND GUTTER FLOW LINE PRIOR TO CONSTRUCTION. IF THE CHECK REVEALS THAT SITE CONDITIONS WOULD RESULT IN PONDING, OR WOULD CONFLICT WITH OBTAINING THE GRADES AT THE BOTTOM OF CURB RAMP OR AT CURB RAMP LOWER LANDINGS AS SHOWN ON THE DRAWINGS OR PLANS, THE CONTRACTOR MUST NOTIFY THE ENGINEER IMMEDIATELY AND STOP WORK ON THE CURB RAMP UNTIL DIRECTED TO CONTINUE BY THE ENGINEER.


* IT IS RECOMMENDED THAT CURB RAMP RUNNING SLOPES BE DESIGNED TO 7.5% MAX. AND CURB RAMP LANDINGS BE DESIGNED TO 1.5% MAX TO ALLOW FOR A LIMITED MARGIN OF ERROR DURING CONSTRUCTION.

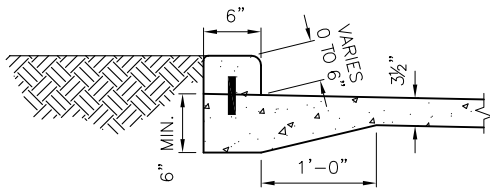


SIDE/BACK CURB - DOWELED

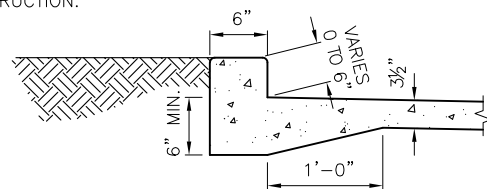

SIDE/BACK CURB - MONOLITHIC

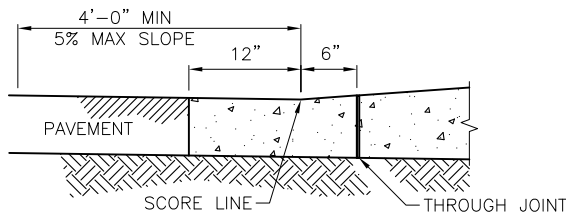

DEPRESSED CURB AND GUTTER DETAIL

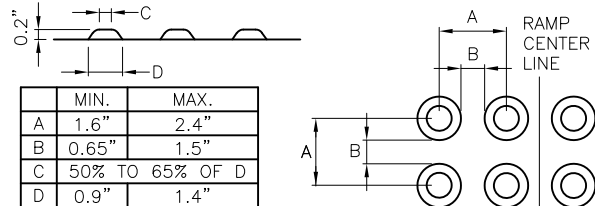

REF STD SPEC SEC 8-14


DETECTABLE WARNING TRUNCATED DOMES PATTERN



City of Seattle


NOT TO SCALE

CURB RAMP DETAILS

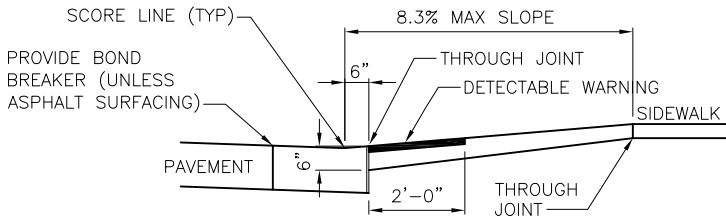


SECTION A-A

DEPRESSIONED CURB & GUTTER SEPARATE FROM RAMP.

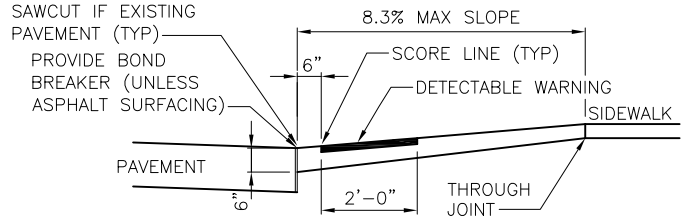


SECTION A-A


CURB MONOLITHIC WITH RAMP. NEW PAVEMENT BLOCKED OUT FULL DEPTH. EXISTING PAVEMENT REMOVED AT FACE OF CURB

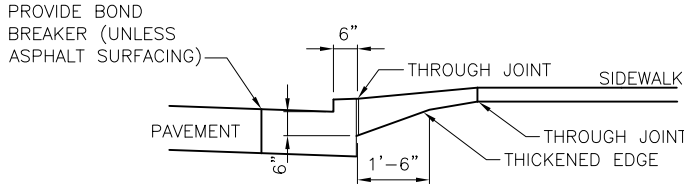

SECTION B-B

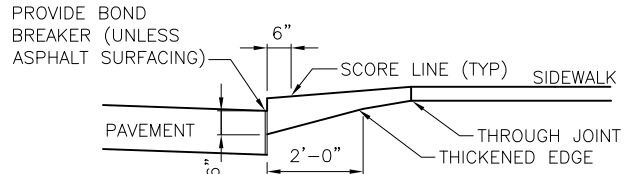


SECTION B-B

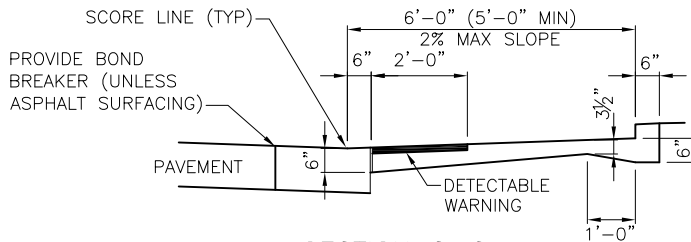


SECTION C-C

DEPRESSIONED CURB & GUTTER SEPARATE FROM RAMP.

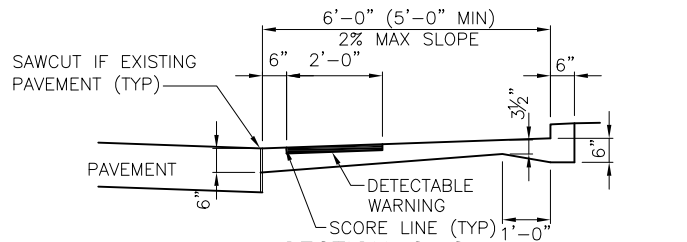


SECTION C-C


CURB MONOLITHIC WITH RAMP. NEW PAVEMENT BLOCKED OUT FULL DEPTH. EXISTING PAVEMENT REMOVED AT FACE OF CURB

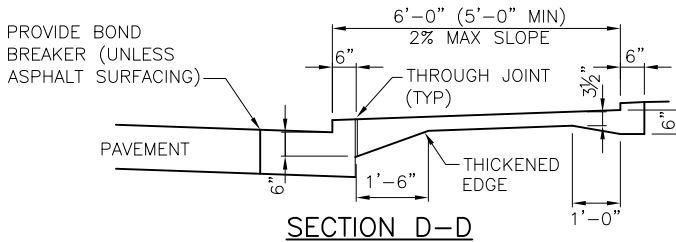

SECTION D-D

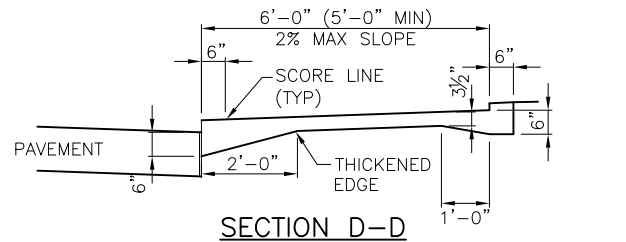


SECTION D-D

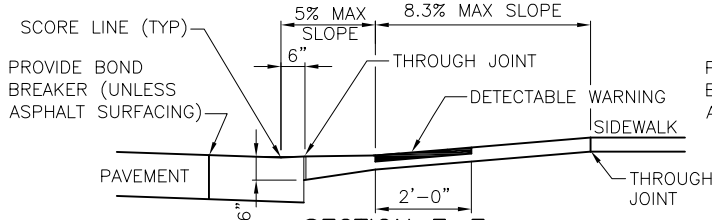


SECTION E-E

DEPRESSIONED CURB & GUTTER SEPARATE FROM RAMP.

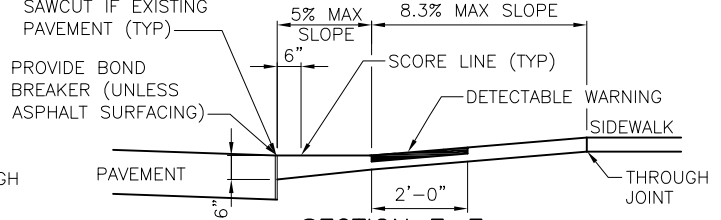


SECTION E-E

CURB MONOLITHIC WITH RAMP. NEW PAVEMENT BLOCKED OUT FULL DEPTH. EXISTING PAVEMENT REMOVED AT FACE OF CURB

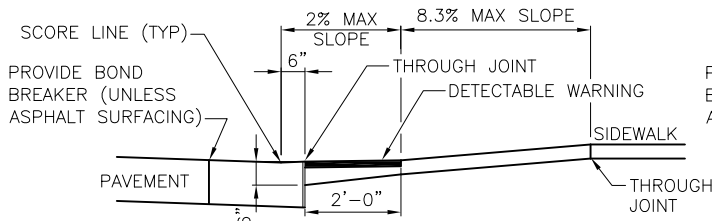

SECTION F-F

DEPRESSIONED CURB & GUTTER SEPARATE FROM RAMP

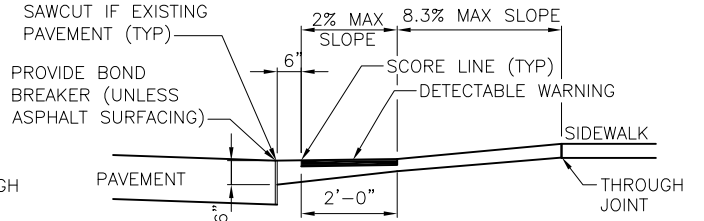

SECTION F-F

CURB MONOLITHIC WITH RAMP. NEW PAVEMENT BLOCKED OUT FULL DEPTH. EXISTING PAVEMENT REMOVED AT FACE OF CURB


REF STD SPEC SEC 8-14




City of Seattle

NOT TO SCALE

CURB RAMP SECTIONS

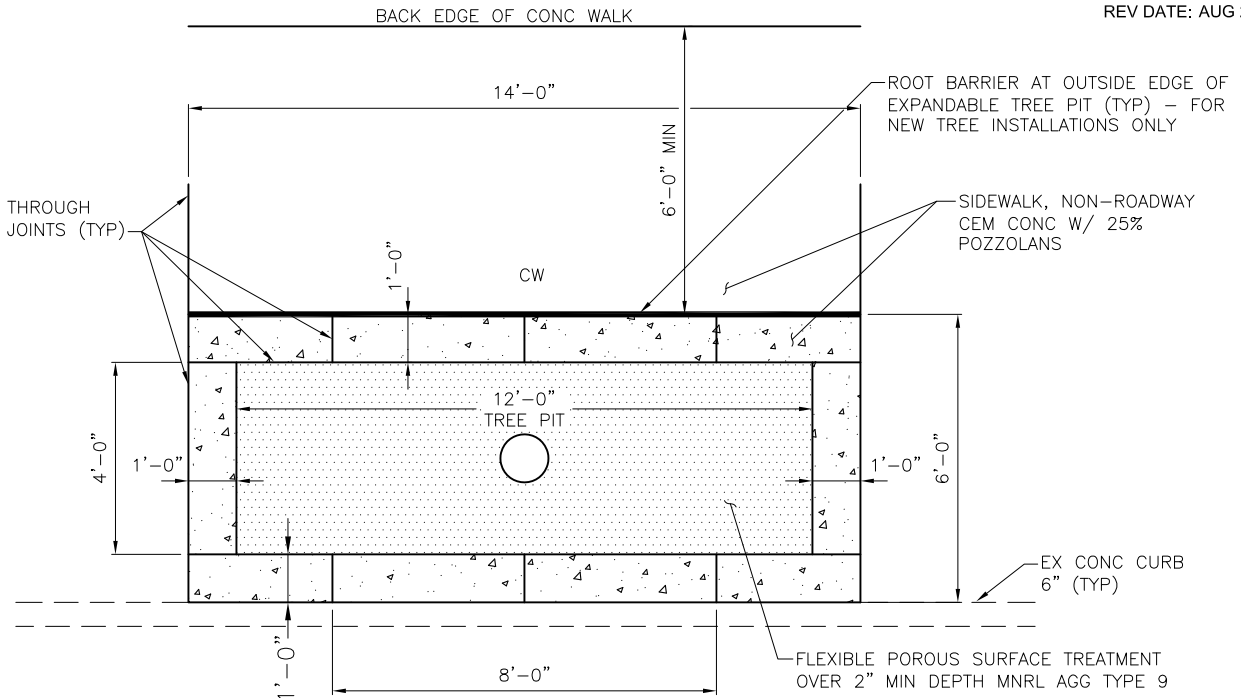

TYPE A

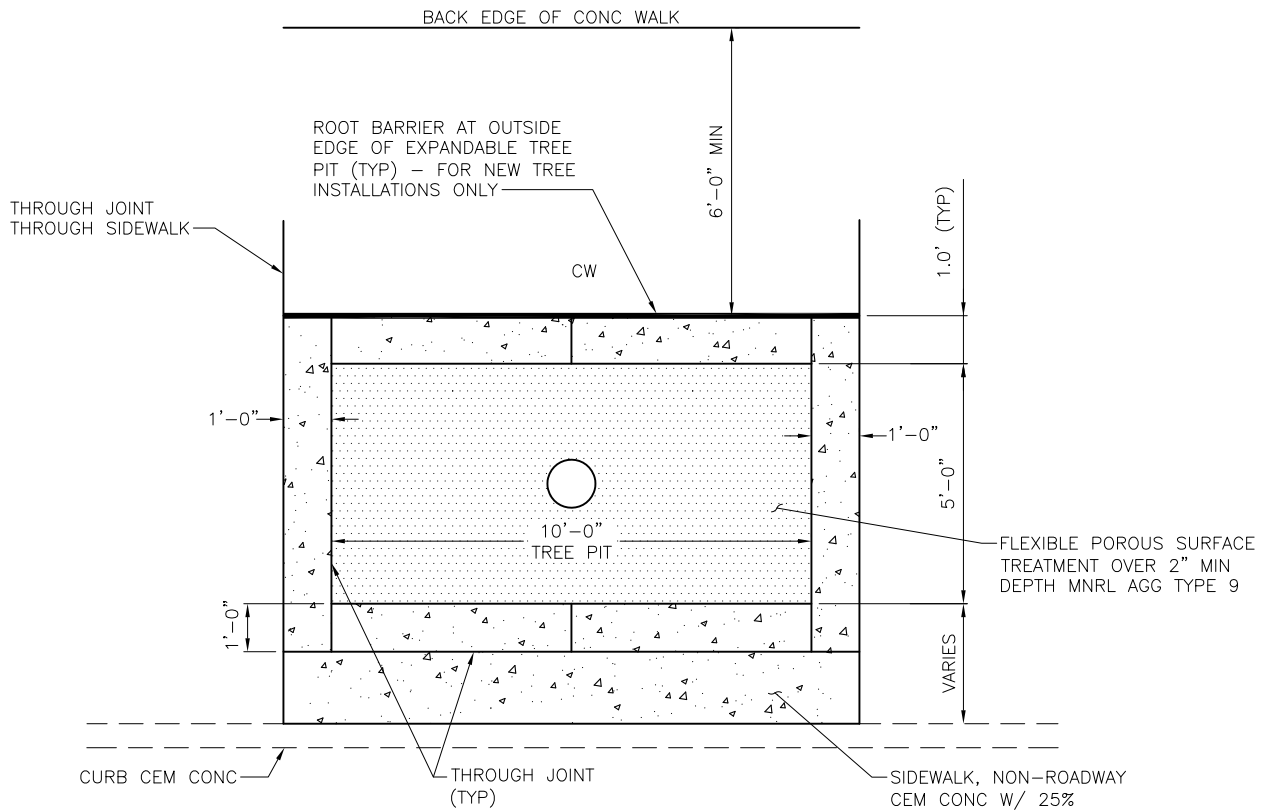

TYPE B

NOTES:

1. SEE STD PLAN 420 FOR CW SCORING DETAILS.
2. INSTALL ROOT BARRIER PER STANDARD PLAN NO 100a.
3. WHEN INSTALLING NEW TREE PITS IN EXISTING SIDEWALK, REMOVE SIDEWALK TO FULL PANEL WIDTH. INSTALL TREE PIT AS SHOWN ON THIS DETAIL.


REF STD SPEC SEC 8-02, 8-14



City of Seattle

NOT TO SCALE

EXPANDABLE TREE PIT DETAIL

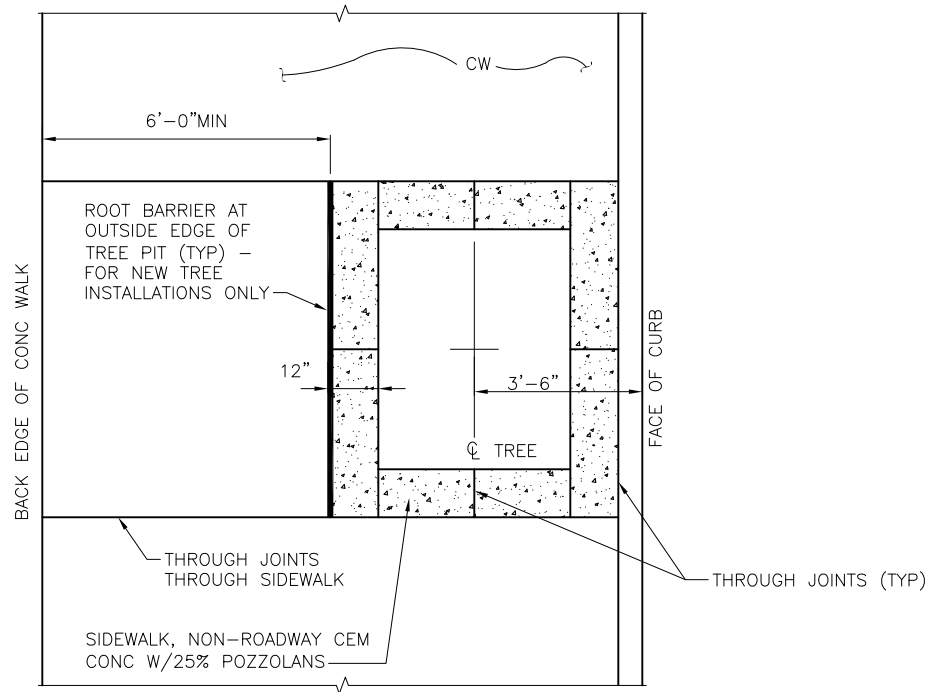

FOR ADDITIONAL SIDEWALK SCORING REQUIREMENTS
SEE STD PLAN NO 420

TYPE C

TREE PIT DIMENSIONAL REQUIREMENTS:

- 24 SQ FT MIN TREE PIT SIZE
- 3'-0" MIN REQ'D BETWEEN TREE ϕ & FACE OF CURB
- 2'-0" MIN REQ'D BETWEEN TREE ϕ & CONC SIDEWALK
- 6'-0" MIN CONC WALKING SURFACE

NOTES:

1. INSTALLATIONS REQUIRING LESS THAN STANDARD MIN CLEARANCES MUST BE ALLOWED ONLY WITH APPROVAL BY THE ENGINEER.
2. INSTALL ROOT BARRIER AS NOTED. SEE STANDARD PLAN NO 100a.
3. SEE STD PLAN NO 420 FOR CW SCORING DETAILS.
4. WHEN INSTALLING NEW TREE PITS IN EXISTING SIDEWALK, REMOVE SIDEWALK TO FULL PANE WIDTH. INSTALL TREE PIT AS SHOWN ON THIS DETAIL.


REF STD SPEC SEC 8-02, 8-14




City of Seattle

NOT TO SCALE


TREE PIT DETAIL

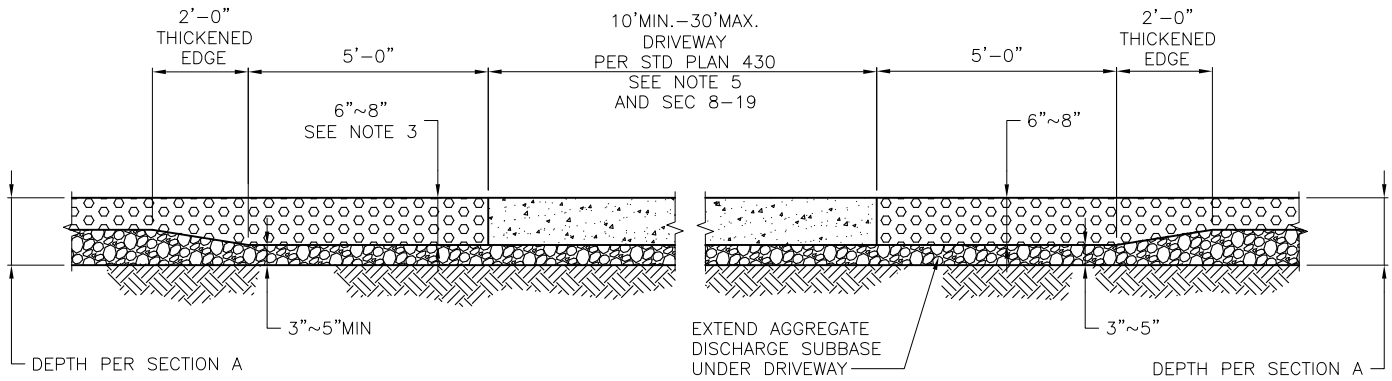

PERVIOUS CONC CEM SIDEWALK DEPTH TRANSITION AT DRIVEWAYS PROFILE VIEW

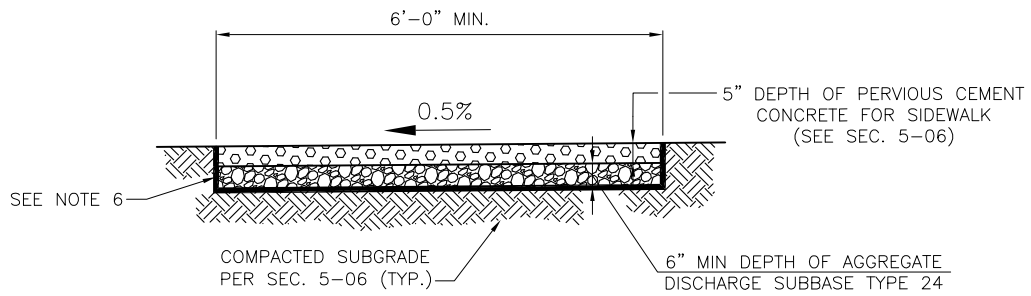

PERVIOUS CONC SECTION A

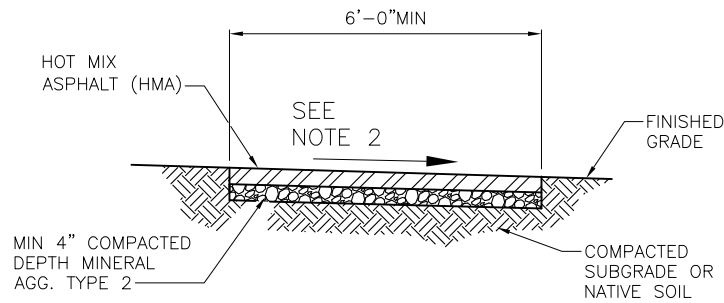

HOT MIX ASPHALT PAVEMENT SIDEWALK SECTION

NOTES:

1. DEPTHS SHOWN FOR PAVEMENT SECTIONS ARE COMPACTED DEPTH.
2. SIDEWALK DEPTH AT DRIVEWAY TO MATCH DRIVEWAY PAVEMENT DEPTH.
3. DEPTH OF POROUS CEMENT CONCRETE FOR DRIVEWAYS MUST BE 8" MIN.
4. 6% MAX. PERVIOUS CEMENT CONCRETE PROFILE GRADE.
5. WHERE PERVIOUS CONCRETE IS SHOWN ON PLANS FOR ALLEY, PERVIOUS CONCRETE MUST BE 8" WITH 3" AGGREGATE DISCHARGE SUBBASE.
6. APPLY SEPARATION GEOTEXTILE SEC. 9-37, ON BOTTOM AND SIDES. EXTEND GEOTEXTILE ABOVE PERVIOUS CONCRETE FOR SIDEWALK PAVEMENT. AFTER PAVEMENT HAS CURED AND ADJACENT FINISHED GRADE HAS BEEN STABILIZED, CUT SEPARATION GEOTEXTILE AT FINISHED GRADE (TYP.)
7. CONTRACTION JOINTS FOR PERVIOUS CONCRETE SIDEWALKS MUST BE PLACED AT A MAXIMUM OF 15 FT ON CENTER SPACING.


REF STD SPEC SEC 5-04, 5-06




City of Seattle

NOT TO SCALE


ALTERNATIVE WALKWAYS

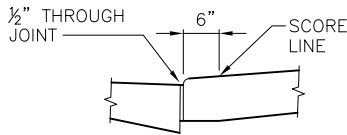


DETAIL B
DRIVEWAY W/ MONOLITHIC CURB & APPROACH

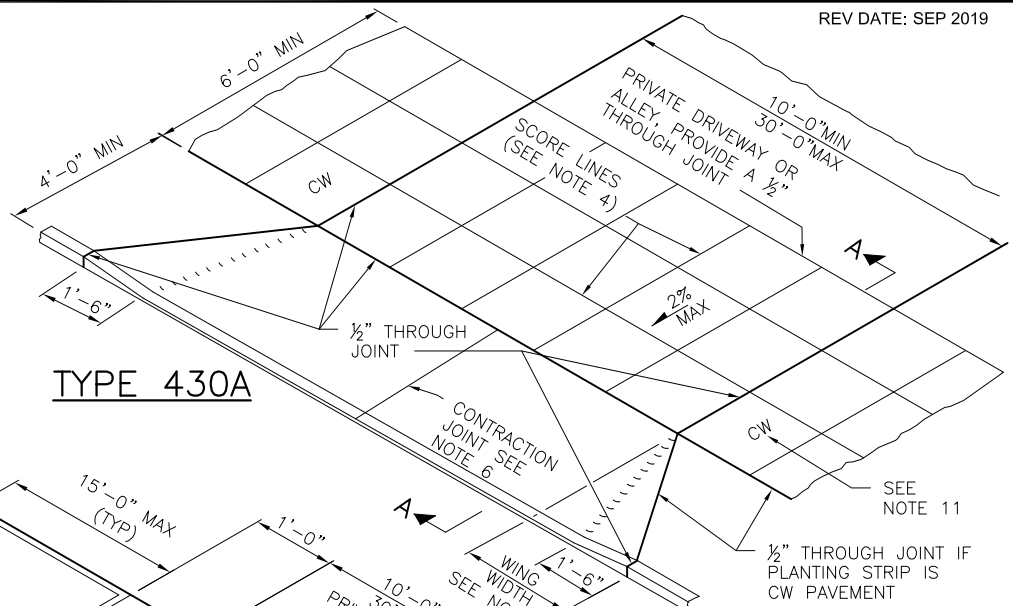

TYPE 430A

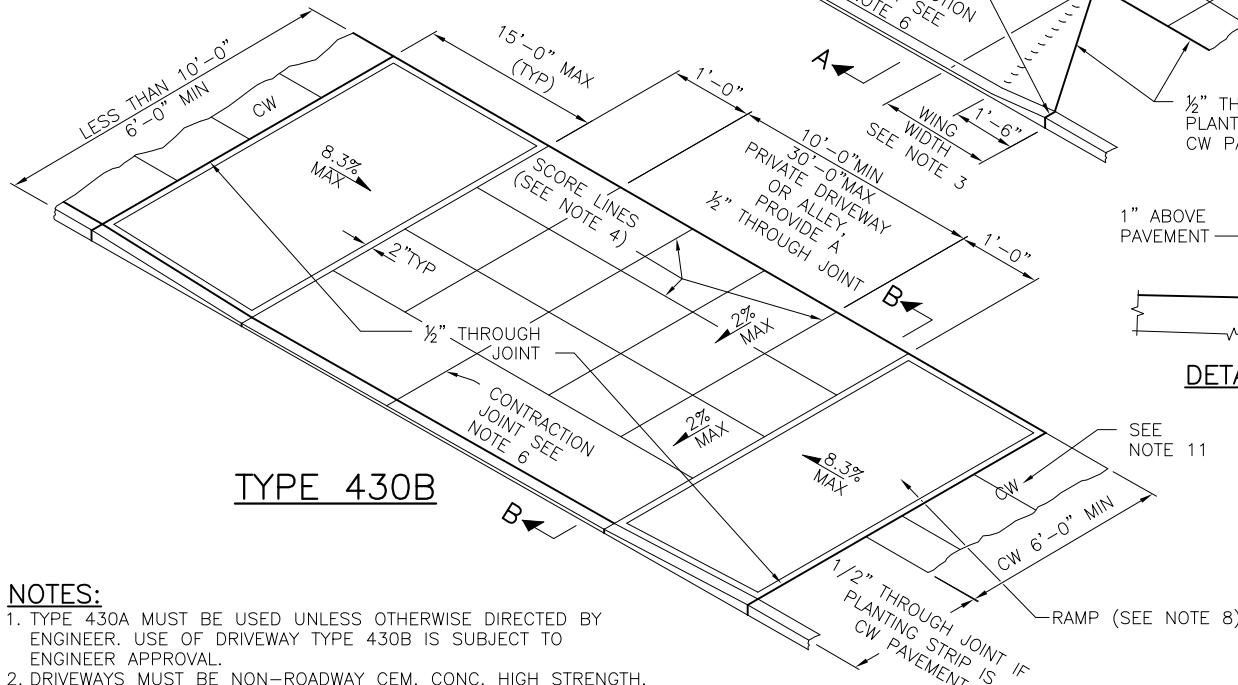


TYPE 430B

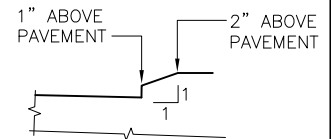


DETAIL A

NOTES:

1. TYPE 430A MUST BE USED UNLESS OTHERWISE DIRECTED BY ENGINEER. USE OF DRIVEWAY TYPE 430B IS SUBJECT TO ENGINEER APPROVAL.
2. DRIVEWAYS MUST BE NON-ROADWAY CEM. CONC. HIGH STRENGTH.
3. WING WIDTH ON ARTERIAL STREETS WHERE TRAVEL LANE IS NEXT TO THE CURB MUST BE 5'-0". OTHERWISE, WING WIDTH MUST BE 2'-6".
4. "V" GROOVE SCORING MUST MATCH PATTERN IN ADJACENT EXISTING SIDEWALK.
5. FOR CONCRETE DRIVEWAY CONSTRUCTED WITH CONCRETE SIDEWALK, SEE STANDARD PLAN NO 431.
6. CONCRETE DRIVEWAYS WITH A WIDTH GREATER THAN 15'-0" MUST HAVE A 3/8" TRANSVERSE CONTRACTION JOINT NEAR THE CENTERLINE OF DRIVEWAY. SEE DETAIL SECTION C-C STANDARD PLAN NO 420.
7. FOR TYPE 430A CROSS-SLOPE IN THE 6'-0" MINIMUM WIDE AREA CONNECTING TO CW ON EACH SIDE OF THE DRIVEWAY MUST BE MAXIMUM 2% AND MINIMUM 0.5%. FOR TYPE 430B, CROSS-SLOPE OF THE DRIVEWAY BETWEEN THE TWO RAMP SECTIONS MUST BE MAXIMUM 2% AND MINIMUM 0.5%. DRIVEWAY ON THE PRIVATE SIDE OF THE CW MAY BE SLOPED AS NEEDED TO MATCH EXISTING SITE CONDITIONS.
8. RAMP MUST HAVE A MAXIMUM SLOPE OF 8.3% AND A MINIMUM WIDTH OF 6'-0". THE CROSS SLOPE OF THE RAMP MUST BE MAXIMUM OF 2.0%. RAMP SURFACE MUST HAVE A HEAVY BROOM BRUSHED SURFACE PERPENDICULAR TO THE CURB.
9. ALL CHANGES IN LEVEL ACROSS JOINTS MUST BE FLUSH WITH A MAXIMUM DIFFERENCE IN ELEVATION OF 3/16 INCH.
10. ALL SLOPE GRADES MUST BE MEASURED OFF THE HORIZON-LINE. IF EXISTING SITE CONDITIONS CONFLICT WITH OBTAINING GRADES SHOWN, THE CONTRACTOR MUST MAKE MINIMUM ADJUSTMENTS TO THE GRADES TO ACCOMMODATE EXISTING SITE CONDITIONS, ADJUSTMENTS ARE SUBJECT TO ENGINEER APPROVAL.
11. CONCRETE WALKWAY OUTSIDE OF THE DRIVEWAY CROSSING MAY BE PERVERIOUS.
12. PROTECT ADJACENT PANELS FROM DAMAGE DUE TO UNDERMINING DURING EXCAVATION & PLACEMENT OF SUBGRADE. SEE SPEC SECTION 1-07.13.

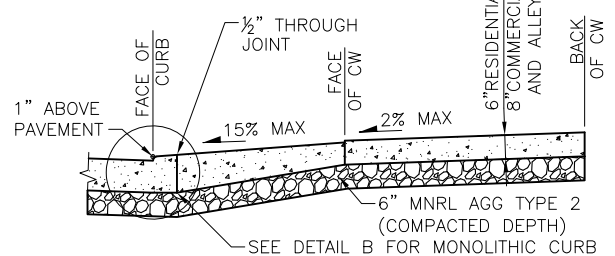

SECTION A-A

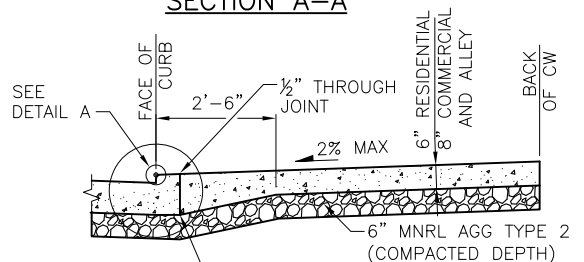

SECTION B-B



REF STD SPEC SEC 8-19



City of Seattle

NOT TO SCALE

TYPE 430A & 430B DRIVEWAYS

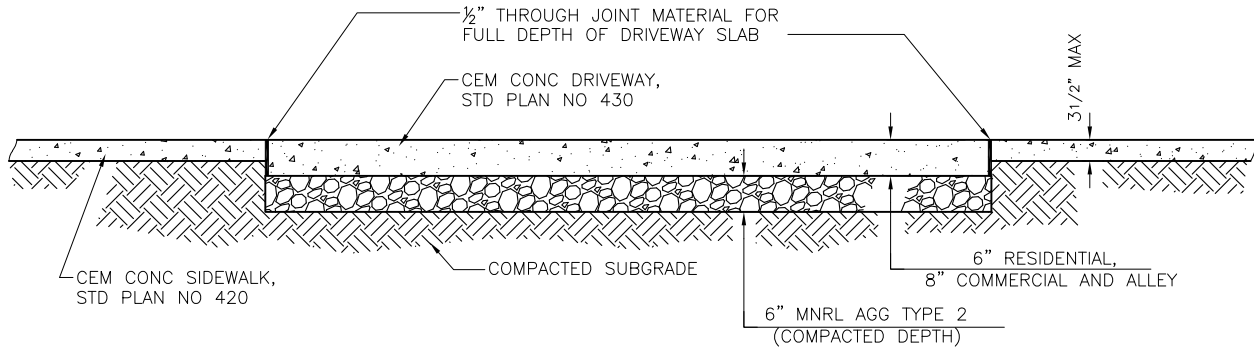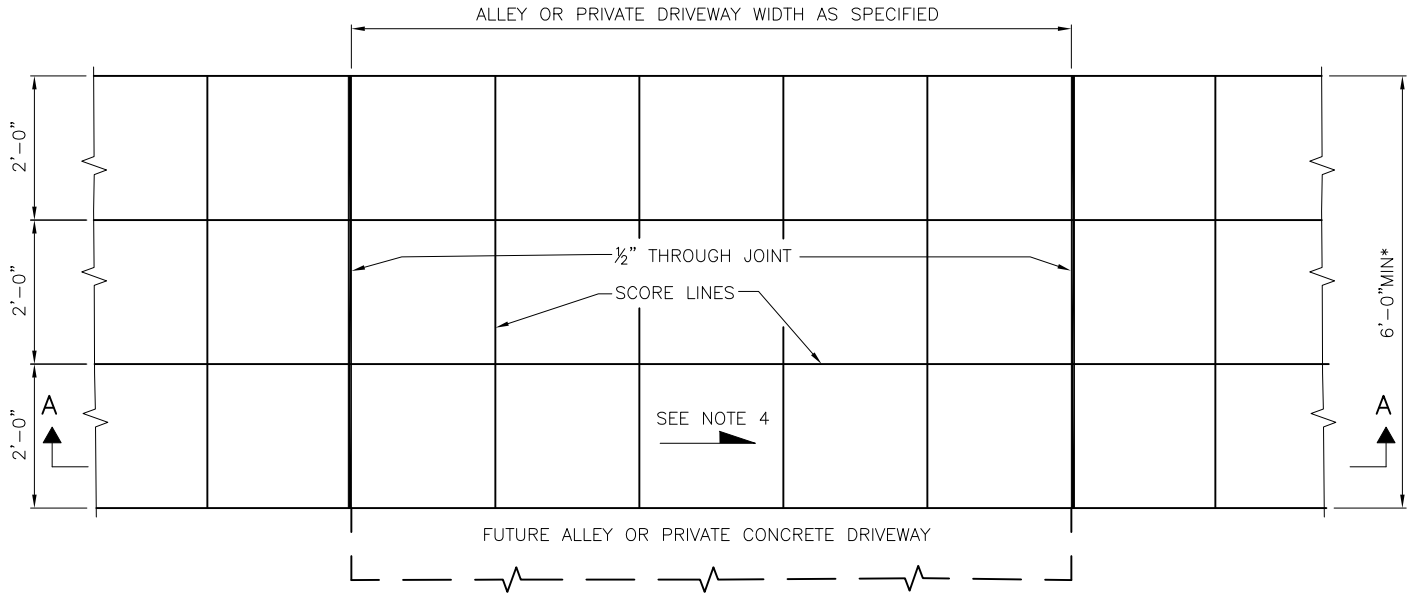

SECTION A-A

* UNLESS OTHERWISE APPROVED BY SDOT.

NOTES:

1. DRIVEWAY WIDTH GREATER THAN 15'-0" AND LESS THAN OR EQUAL TO 30' MUST HAVE TRANSVERSE CONSTRUCTION JOINTS AT IT'S CENTER.
2. DRIVEWAY GREATER THAN 30'-0" REQUIRES SDOT APPROVAL AND MUST HAVE TRANSVERSE CONTRACTION JOINTS EVENLY PLACED SO THE DISTANCE BETWEEN CONTRACTION JOINTS, OR BETWEEN THE EDGE THROUGH JOINTS AND CONTRACTION JOINTS IS NOT GREATER THAN 15'-0".
3. PROVIDE SCORE LINES PER STD PLAN NO 420 AND THE DRAWINGS.
4. THE SURFACE MUST BE BRUSHED IN THE TRANSVERSE DIRECTION IN RELATION TO THE CENTERLINE OF THE DRIVEWAY OR ALLEY WITH A FIBER HAIR BRUSH OR OTHER APPROVED BRUSH TYPE.
5. PROTECT ADJACENT PANELS FROM DAMAGE DUE TO UNDERMINING DURING EXCAVATION & PLACEMENT OF SUBGRADE. SEE SPEC SECTION 1-07.13.


REF STD SPEC SEC 8-14, 8-19



City of Seattle

NOT TO SCALE


**CEMENT CONCRETE DRIVEWAY
PLACED WITH CEMENT
CONCRETE SIDEWALK**

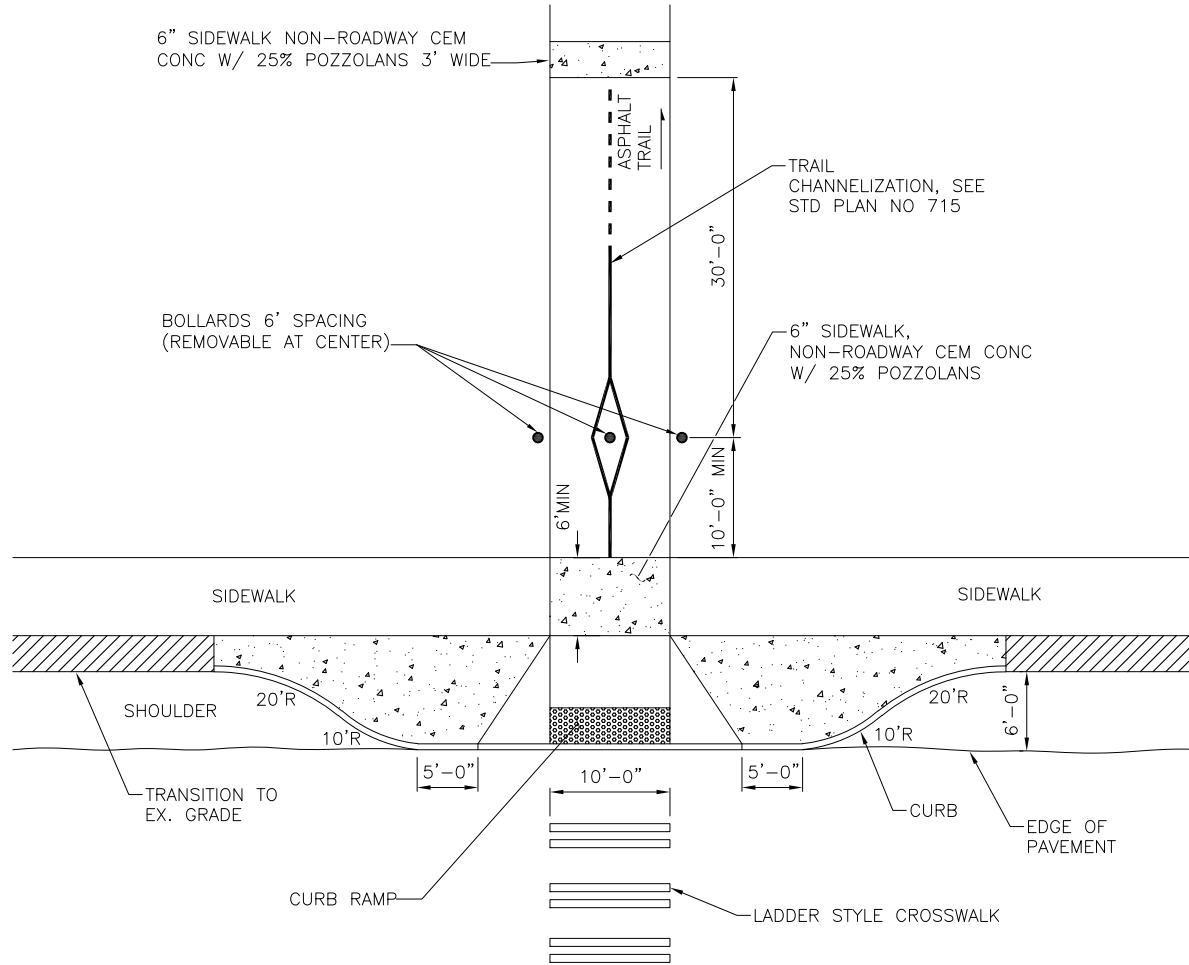

MULTI PURPOSE TRAIL AT ARTERIAL STREET W/BULB-OUT (TYP)

NOTES:

1. FOR CURB RAMP AND DETECTABLE WARNING DETAILS SEE STANDARD PLAN NO 422 (SERIES).
2. FOR CROSSWALK DETAILS SEE STANDARD PLAN NO 712.
3. FOR BOLLARD DETAIL SEE STANDARD PLAN NO 463.
4. ASPHALT TRAIL CROSS SLOPE MINIMUM 1%, MAXIMUM 2%.
5. CEMENT CONCRETE WARNING PAD THICKNESS TO MATCH ASPHALT THICKNESS OR MINIMUM 6" THICK WHICHEVER IS GREATER.
6. CRUSHED ROCK ON EDGE OF TRAIL AS NEEDED TO DISBURSE DRAINAGE FLOW.
7. ALL CHANGES IN LEVEL ACROSS JOINTS MUST BE FLUSH WITH A MAXIMUM DIFFERENCE IN ELEVATION OF $\frac{3}{16}$ INCH.
8. ALL SLOPE GRADES MUST BE MEASURED OFF THE HORIZON-LINE. IF EXISTING SITE CONDITIONS CONFLICT WITH OBTAINING GRADES SHOWN, THE CONTRACTOR MUST MAKE MINIMUM ADJUSTMENTS TO THE GRADES TO ACCOMMODATE EXISTING SITE CONDITIONS, ADJUSTMENTS ARE SUBJECT TO APPROVAL BY THE ENGINEER.
9. ALL CEMENT CONCRETE WARNING PADS MUST BE BRUSHED FINISHED AND "V" GROOVED TO MATCH PATTERN IN ADJACENT OR NEARBY SIDEWALKS.

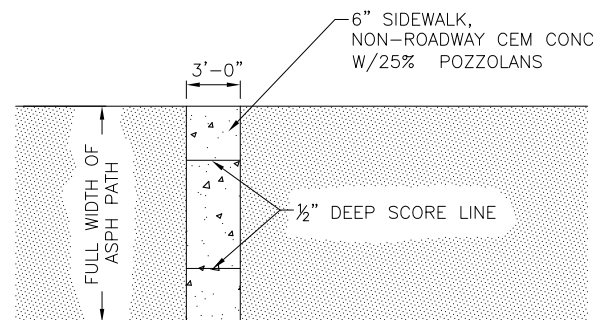


REF STD SPEC SEC



City of Seattle

NOT TO SCALE

MULTI-PURPOSE TRAIL
AT STREET CROSSING

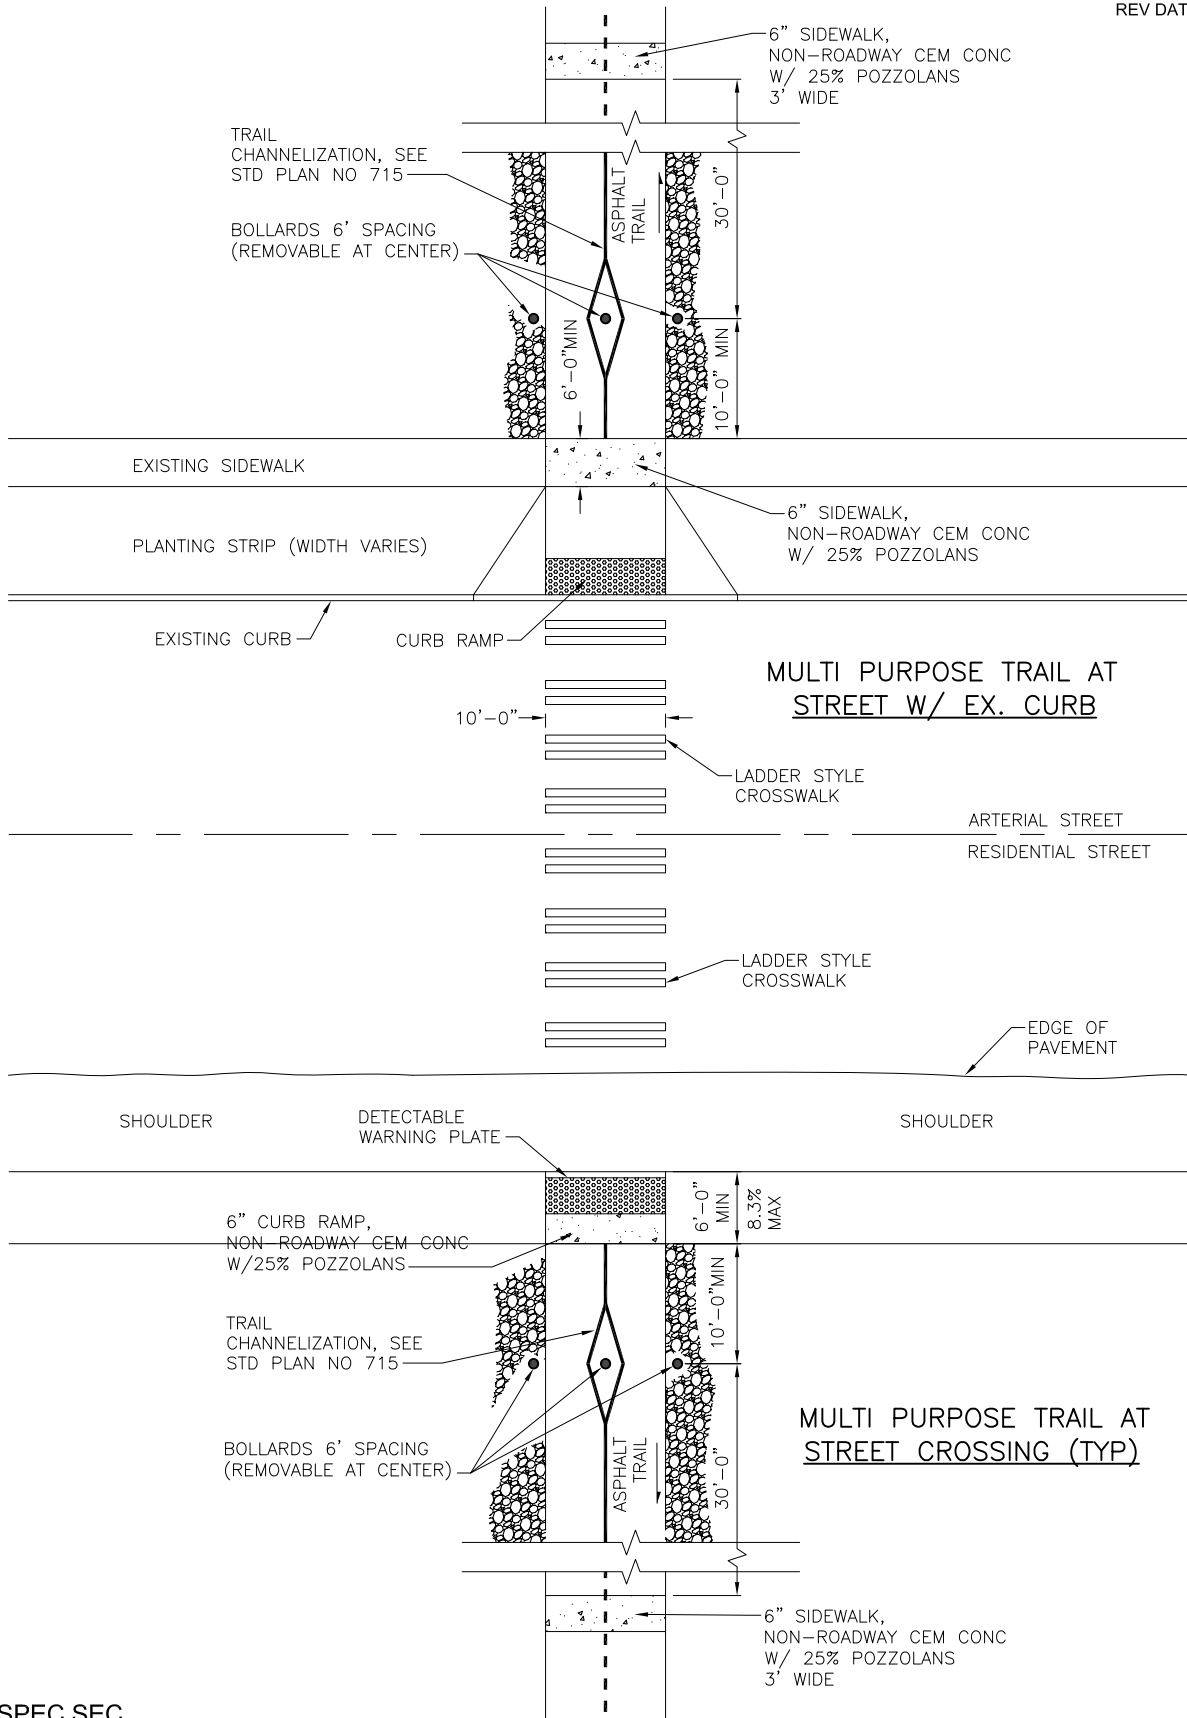



REF STD SPEC SEC



City of Seattle


NOT TO SCALE

MULTI-PURPOSE TRAIL AT STREET CROSSING

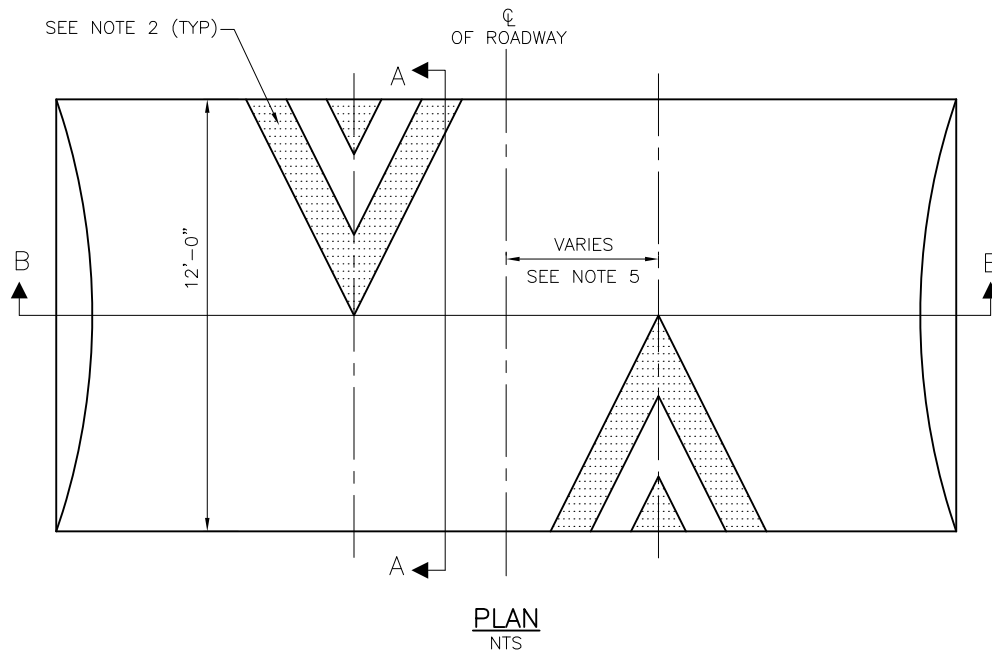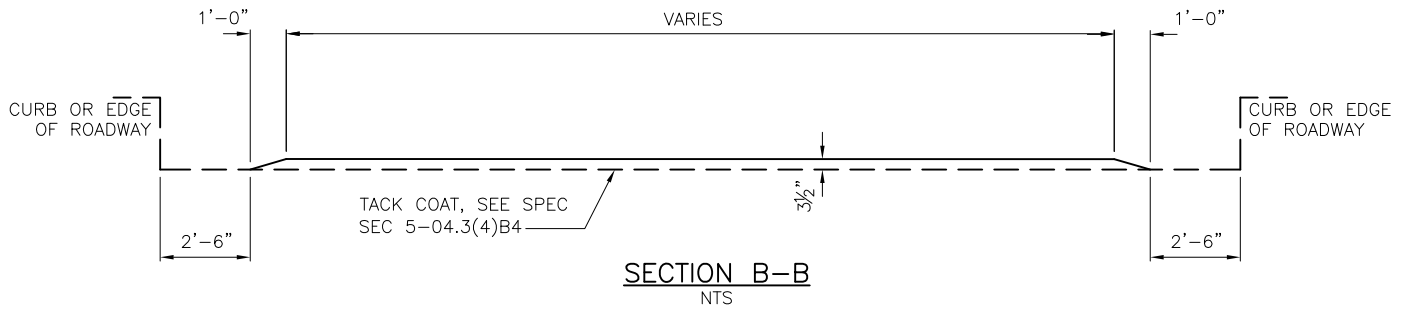

NOTES:

1. SPEED HUMP MUST BE HMA CL 3/8"
2. CHEVRON SYMBOL PER STD PLAN NO 728A
3. TOLERANCE AT CENTER IS 1/2"
4. PARABOLIC SHAPE MUST BE MAINTAINED
5. CHEVRON MUST BE CENTERED IN THE TRAVEL WAY AND MISSING THE WHEEL PATH
6. SEAL ALL EDGES WHERE NEW ASPHALT MEETS EXISTING PER 5-04.3(10)B
7. SEALING MATERIALS MUST MEET 9-02.1(8)

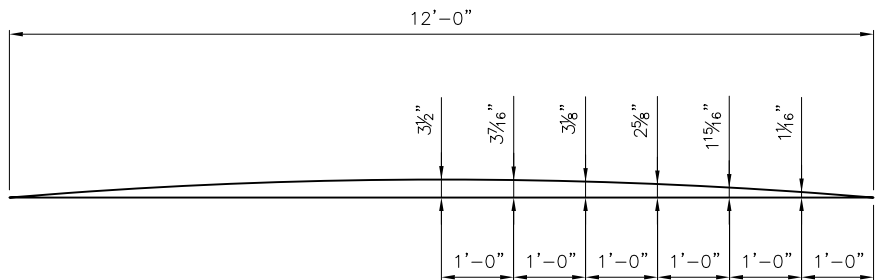



REF STD SPEC SEC 5-04



City of Seattle



NOT TO SCALE

SPEED HUMP

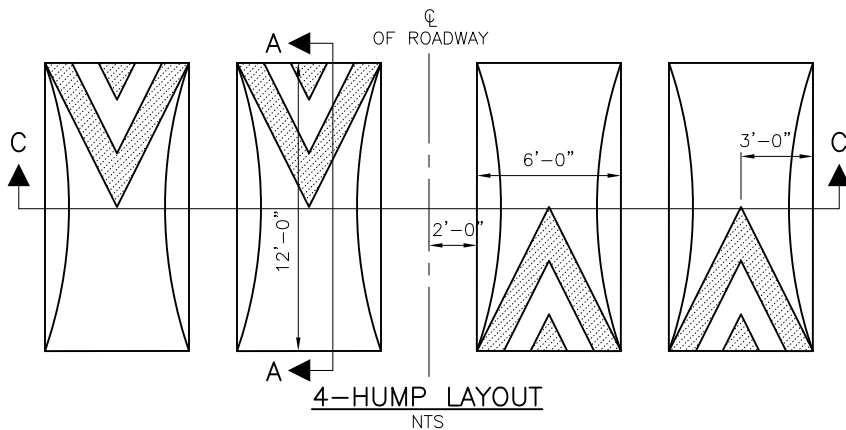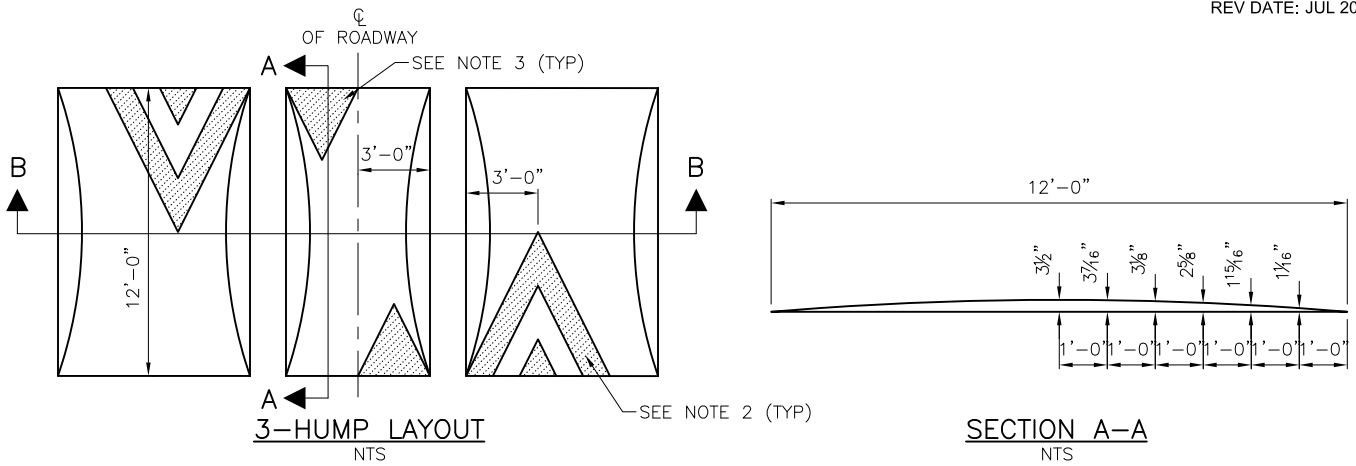

NOTES:

1. CUSHION MUST BE HMA CL 3/8"
2. CHEVRON SYMBOL PER STD PLAN NO 728A
3. TRIANGLE SYMBOL PER STD PLAN NO 728B
4. TOLERANCE AT CENTER IS 1/2"
5. PARABOLIC SHAPE MUST BE MAINTAINED

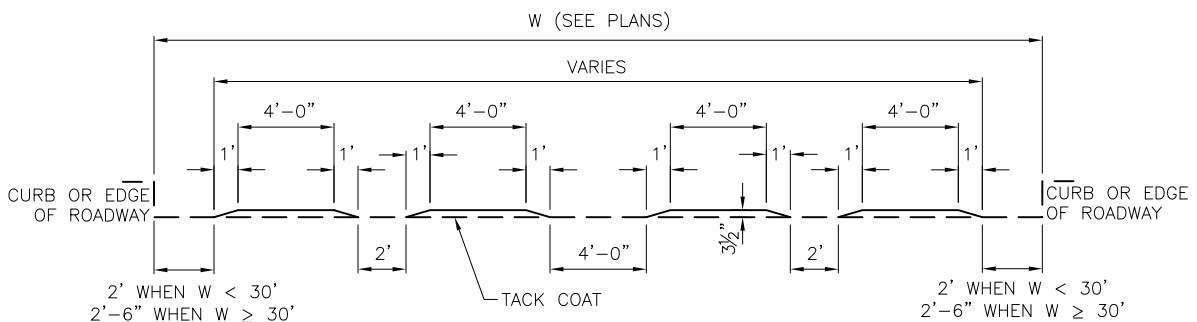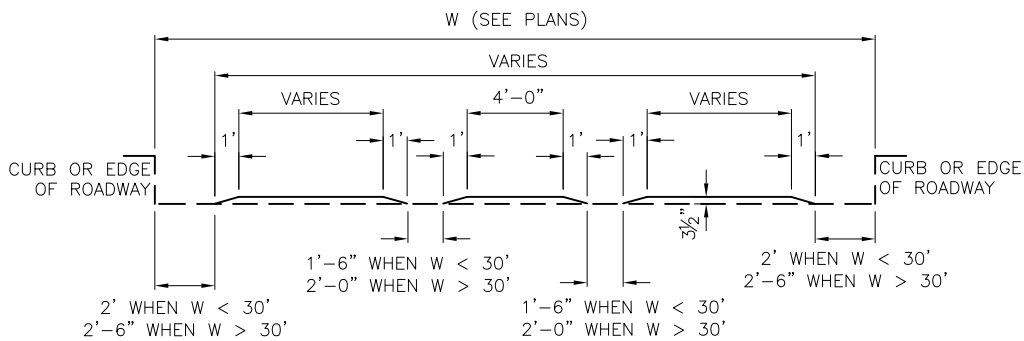


REF STD SPEC SEC 5-04



City of Seattle

NOT TO SCALE

SPEED CUSHION

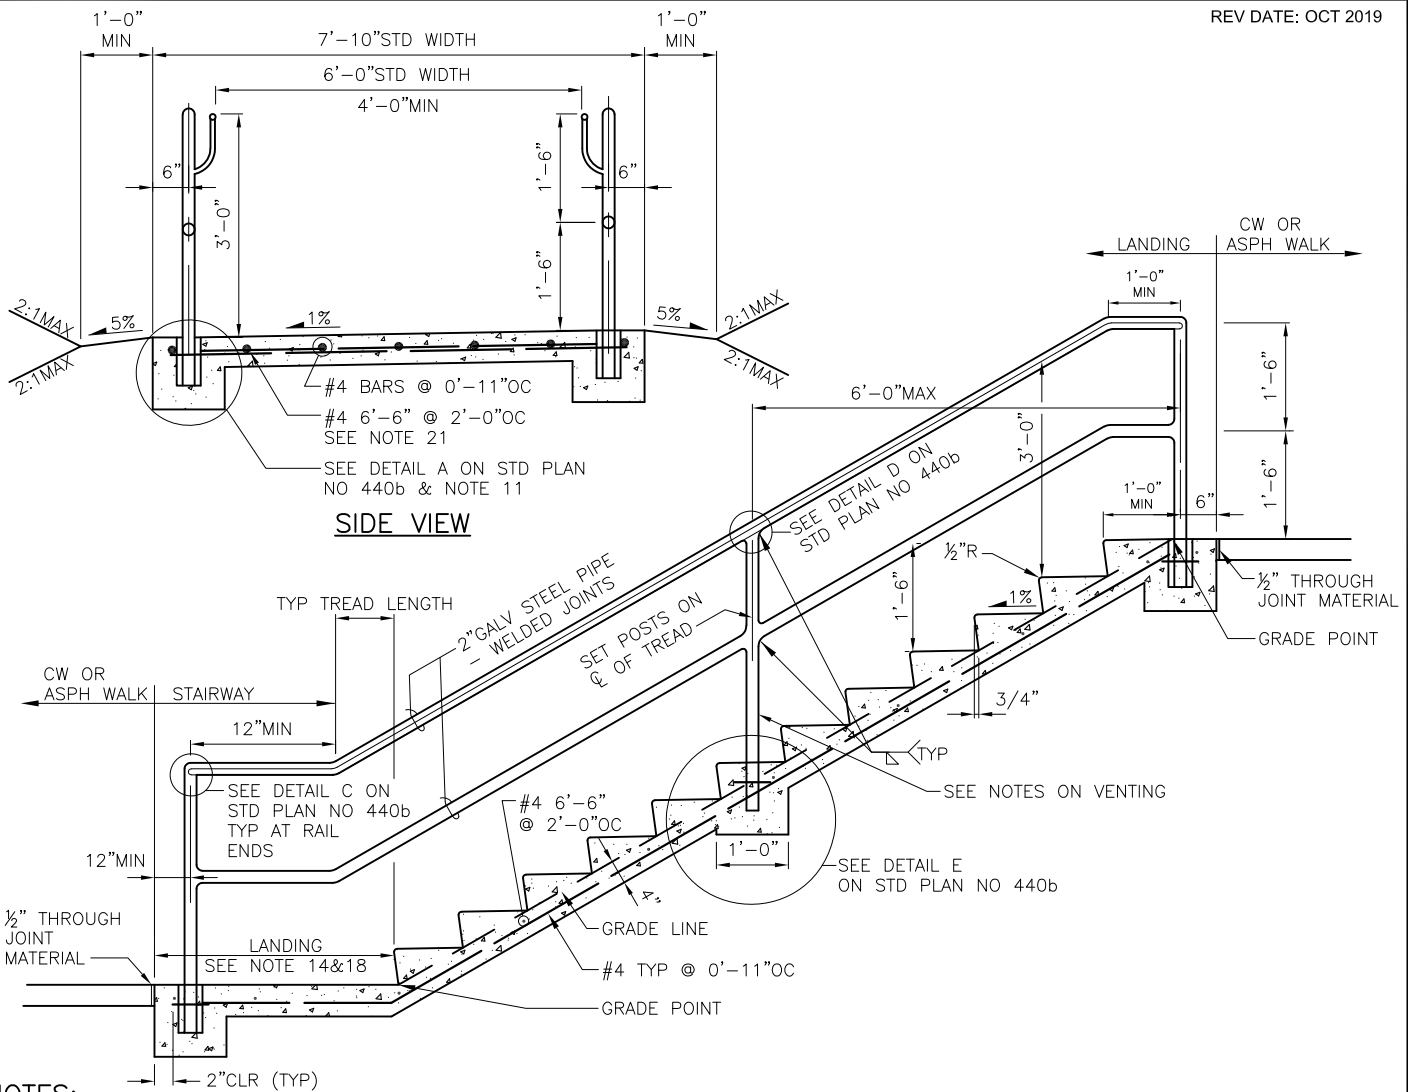

NOTES:

1. FLIGHTS OF STAIRS MUST HAVE MAX VERTICAL RISE OF 12' BEFORE A LANDING.
2. AVOID FEWER THAN 2 RISERS PER FLIGHT.
3. STEPS IN FLIGHT MUST HAVE UNIFORM TREAD RUNS AND UNIFORM RISER HEIGHTS WITH TOLERANCE OF $\pm 3/8"$.
4. TREADS MUST BE 11" MIN, 12" MAX. RISERS MUST BE 5" MIN, 7" MAX.
5. LANDINGS BETWEEN FLIGHTS OF RISERS MUST HAVE SAME WIDTH AS STEPS AND A MIN LENGTH OF 4'-0".
6. STAIRWAYS WITH 1 OR MORE RISERS MUST HAVE HANDRAILS ON BOTH SIDES.
7. HANDRAILS MUST BE CONTINUOUS ACROSS LANDINGS BETWEEN FLIGHTS OF STEPS.
8. ALL STEEL MUST BE HOT DIPPED GALVANIZED.
9. PIPE MATERIAL MUST BE ASTM A53 AND ROUND BAR ASTM A36.
10. REINFORCING STEEL MUST BE ASTM A615 GR 60.
11. FOR FORMAL DRAINAGE PICK-UP SEE DETAIL B ON STD PLAN NO 440b (THIS IS OPTIONAL AND MUST BE CALLED OUT ON DRAWINGS).
12. PIPE DIAMETERS SHOWN CORRESPOND TO PIPE "SHAPE" AS DEFINED IN AMERICAN INSTITUTE OF STEEL CONSTRUCTION MANUAL.
13. CONCRETE CLASS CL3000.
14. LANDINGS MUST BE 0.5% MIN FOR A MIN LENGTH OF 4', ADJACENT SIDEWALK MAY BE PART OF LANDING IF SLOPE CRITERIA AND SETBACKS FROM HANDRAILS ARE MET.
15. TREAD SURFACE MUST HAVE GROOVES AT THE NOSE FOR TRACTION.
16. IF LANDING IS ELEVATED, LANDING MUST HAVE VERTICAL RAILING PER RIGHT OF WAY IMPROVEMENT MANUAL.
17. STAIRWAYS DEVIATING FROM STANDARD PLAN TO ACCOMMODATE BICYCLE FEATURES MAY BE USED PER STD PLAN NO 440C OR 440D.
18. DIMENSION FROM THE BOTTOM LANDING RAILING TO THE NOSE OF THE TREAD MUST BE 12" MIN + 1 TREAD LENGTH.
19. HANDRAIL GRIPPING SURFACE AND ADJACENT SURFACES MUST BE FREE FROM SHARP OR ABRASIVE ELEMENTS AND MUST HAVE ROUNDED EDGES.
20. BOTTOM HANDRAIL EXTENSION MUST EXTEND ONE TREAD LENGTH MINIMUM PARALLEL TO THE SLOPE OF THE STAIR BEYOND BOTTOM STAIR NOSING.
21. TOP HANDRAIL EXTENSION MUST EXTEND HORIZONTALLY ABOVE LANDING 12" MINIMUM BEYOND TOP STAIR NOSING.
22. REBAR SIZING AND SPACING MAY CHANGE FOR WIDER OR NARROWER STAIRWAYS.
23. EXTERNAL VENT HOLES MUST BE AS CLOSE TO THE WELD AS POSSIBLE AND MUST BE 25% THE SIZE OF THE I.D. OF THE PIPE, BUT NOT LESS THAN $3/8"$ IN DIA.
24. VENT HOLES IN END SECTIONS OR IN SIMILAR SECTIONS MUST BE $1/2"$ IN DIA.
25. ENDS MUST BE LEFT COMPLETELY OPEN. ANY DEVICE USED FOR FIELD-ERECTION THAT PREVENTS FULL OPENINGS ON ENDS OF HORIZONTAL RAILS AND VERTICAL LEGS MUST BE GALVANIZED SEPARATELY AND ATTACHED AFTER GALVANIZING.


REF STD SPEC SEC 8-18




City of Seattle

NOT TO SCALE

**CEMENT CONCRETE
STAIRWAY & HANDRAIL**

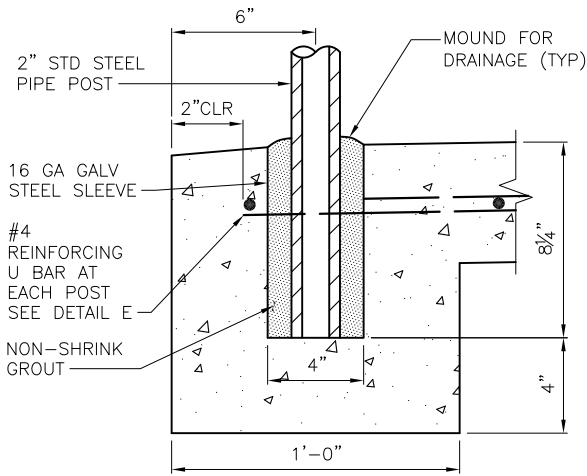


DETAIL A

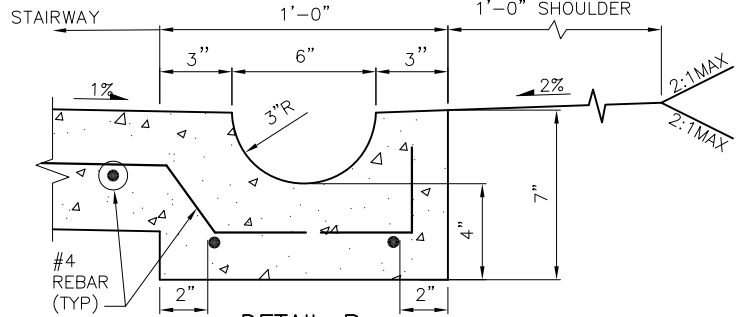


DETAIL B


SEE NOTE 11 ON STD PLAN NO 440a

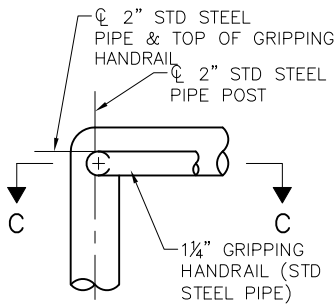

DETAIL C
HAND GRIP TERMINATION

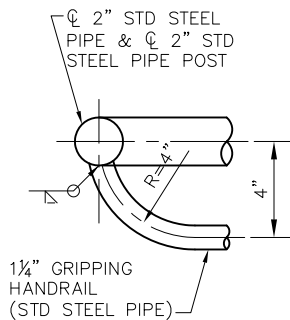

SECTION C-C

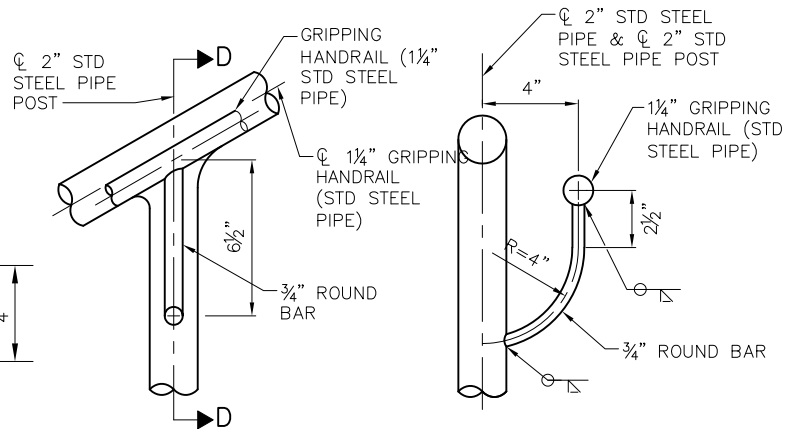


DETAIL D


SECTION D-D

NOTE:


PIPE DIAMETERS SHOWN CORRESPOND TO PIPE "SHAPE" AS DEFINED IN AMERICAN INSTITUTE OF STEEL CONSTRUCTION MANUAL.

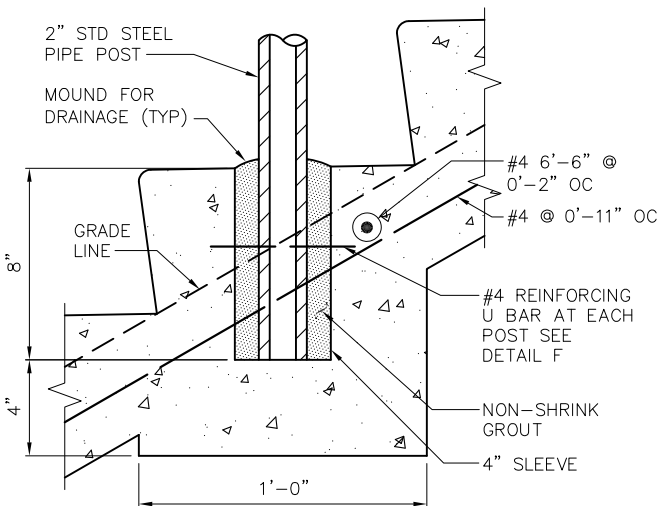

DETAIL E

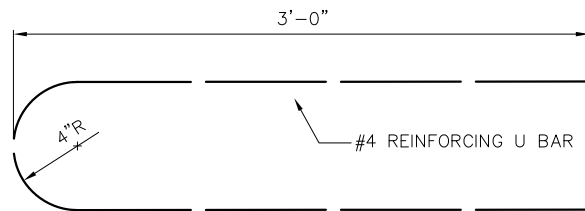

DETAIL F

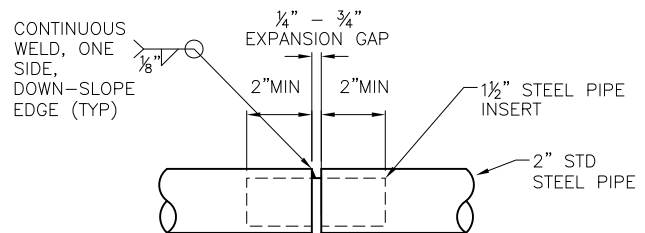

DETAIL G
SLIP JOINT




REF STD SPEC SEC 8-18



City of Seattle


NOT TO SCALE

CEMENT CONCRETE
STAIRWAY & HANDRAIL

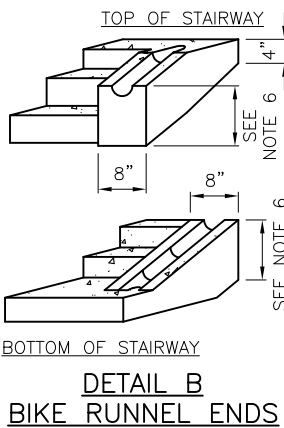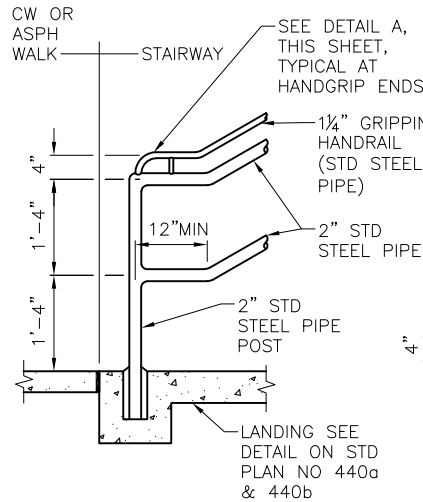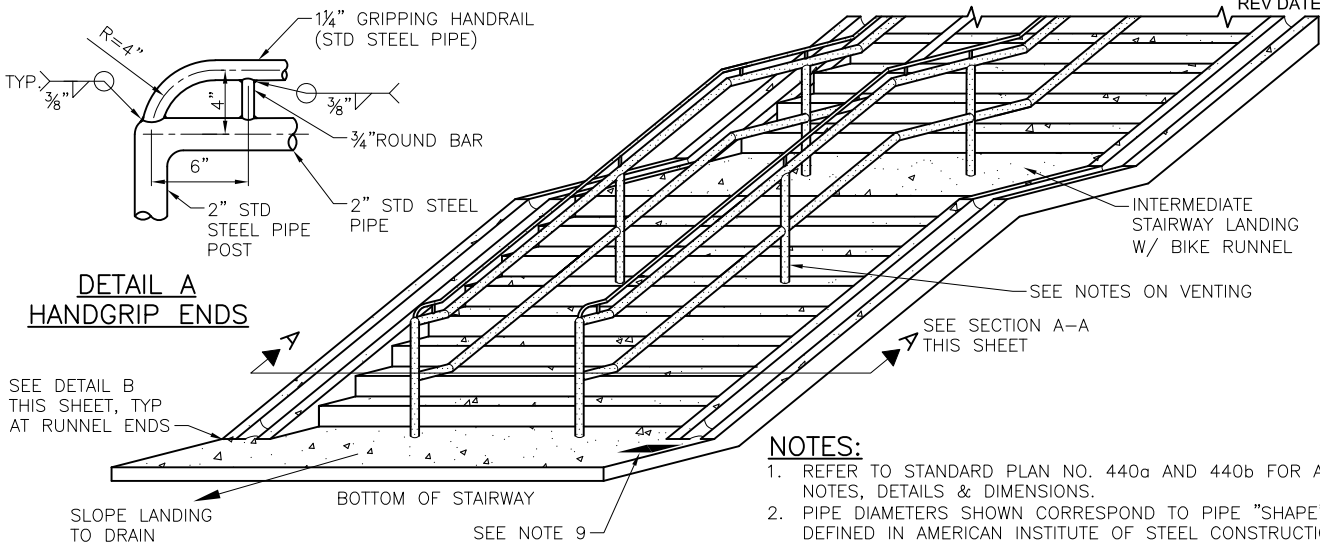

- NOTES:**
1. REFER TO STANDARD PLAN NO. 440a AND 440b FOR ADDITIONAL NOTES, DETAILS & DIMENSIONS.
 2. PIPE DIAMETERS SHOWN CORRESPOND TO PIPE "SHAPE" AS DEFINED IN AMERICAN INSTITUTE OF STEEL CONSTRUCTION MANUAL.
 3. FIELD WELDED AND GROUND SURFACES MUST BE CLEANED AND COATED WITH ZINC SPRAY TO A MIN. OF 3 MILS, DRY PAINT THICKNESS.
 4. DIMENSIONS SHOWN ON ONE SIDE OF THE SECTION VIEW ARE TYPICAL TO THE OTHER SIDE, UNLESS NOTED OTHERWISE.
 5. DISTANCE BETWEEN HANDGRIP SUPPORTS MUST NOT EXCEED 6'-0".
 6. BIKE RUNNEL SLAB THICKNESS VARIES WITH STEP RISER HEIGHT. MIN. 10.5", MAX. 12.5"
 7. RUNNEL LIP HEIGHT 1.5" ABOVE STEP NOSING AND LANDING.
 8. INTERMEDIATE STAIR LANDINGS THAT INTERSECT OTHER STAIRS OR WALKS MUST BE AT LEAST 6' LONG TO ALLOW FOR A MIN. 4' OF CLEAR AREA WITHOUT RUNNEL & RAIL.
 9. STAMP CONCRETE AT TOP AND BOTTOM OF RUNNEL. SEE CONCRETE STAMP DETAIL STD PLAN NO 440d.
 10. LONG STAIRWAYS OR STAIRWAYS WITH SIGHT OBSTRUCTIONS TO CYCLISTS MUST HAVE SIDEWALK BREAKS TO ALLOW ONCOMING CYCLISTS PASSAGE. LOCATIONS OF SIDEWALK BREAKS TO BE DETERMINED BY ENGINEER.
 11. ANY CONSTRUCTION OUTSIDE OF RUNNEL MUST ALLOW ENOUGH CLEARANCE FOR BIKE PEDALS AND HANDLEBARS FROM INTERFERING WITH MOVEMENT.
 12. EXTERNAL VENT HOLES MUST BE AS CLOSE TO THE WELD AS POSSIBLE AND MUST BE 25% THE SIZE OF THE I.D. OF THE PIPE, BUT NOT LESS THAN 3/8" IN DIA.
 13. VENT HOLES IN END SECTIONS OR IN SIMILAR SECTIONS MUST BE 1/2" IN DIA.
 14. ENDS MUST BE LEFT COMPLETELY OPEN. ANY DEVICE USED FOR FIELD-ERECTION THAT PREVENTS FULL OPENINGS ON ENDS OF HORIZONTAL RAILS AND VERTICAL LEGS MUST BE GALVANIZED SEPARATELY AND ATTACHED AFTER GALVANIZING.

RAIL ENDS DETAIL

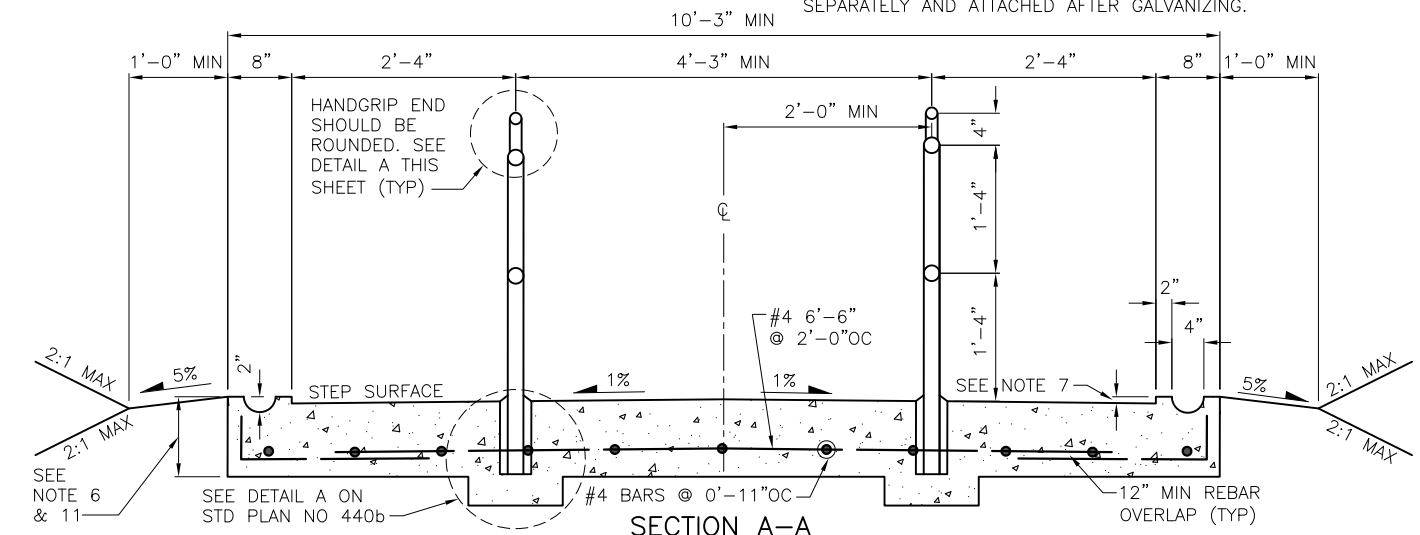


REF STD SPEC SEC 8-18



City of Seattle

NOT TO SCALE


**CEMENT CONCRETE
STAIRWAY & BIKE RUNNEL**

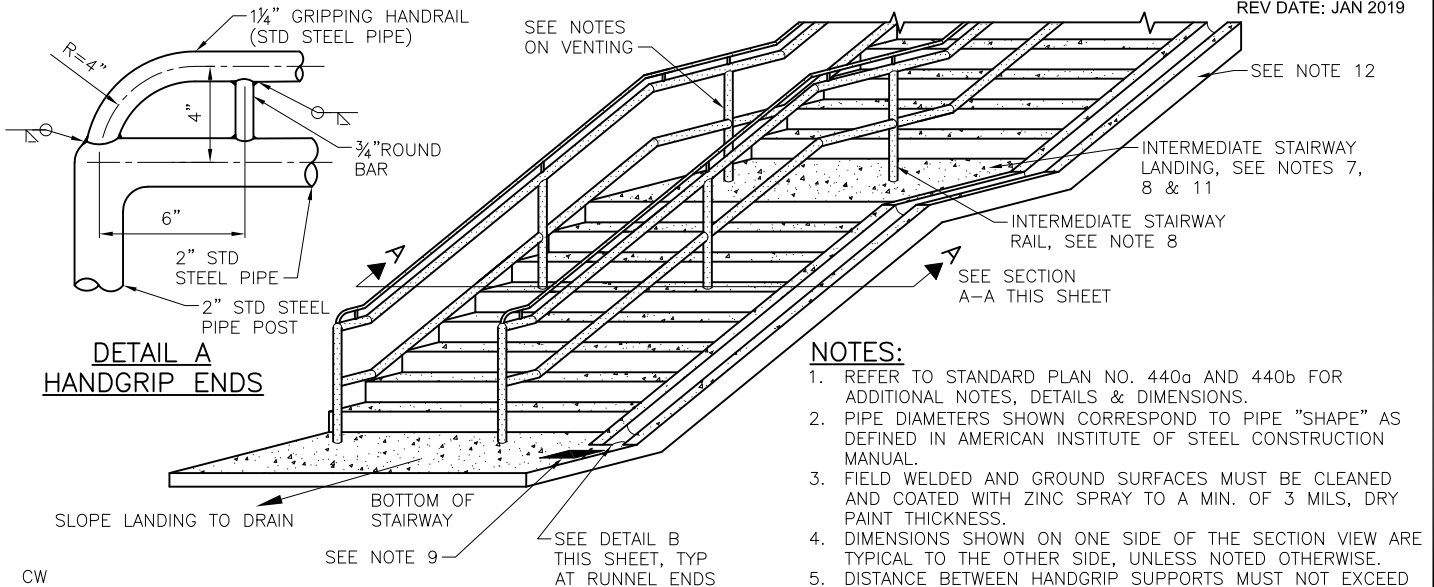


**DETAIL A
HANDGRIP ENDS**

NOTES:


1. REFER TO STANDARD PLAN NO. 440a AND 440b FOR ADDITIONAL NOTES, DETAILS & DIMENSIONS.
2. PIPE DIAMETERS SHOWN CORRESPOND TO PIPE "SHAPE" AS DEFINED IN AMERICAN INSTITUTE OF STEEL CONSTRUCTION MANUAL.
3. FIELD WELDED AND GROUND SURFACES MUST BE CLEANED AND COATED WITH ZINC SPRAY TO A MIN. OF 3 MILS, DRY PAINT THICKNESS.
4. DIMENSIONS SHOWN ON ONE SIDE OF THE SECTION VIEW ARE TYPICAL TO THE OTHER SIDE, UNLESS NOTED OTHERWISE.
5. DISTANCE BETWEEN HANDGRIP SUPPORTS MUST NOT EXCEED 6'.
6. BIKE RUNNEL SLAB THICKNESS VARIES WITH STEP RISER HEIGHT. MIN. 10.5", MAX. 12.5"
7. RUNNEL LIP HEIGHT 1.5" ABOVE STEP NOSING AND LANDING.
8. LANDINGS THAT INTERSECT OTHER STAIRS OR WALKS MUST BE AT LEAST 6' LONG TO ALLOW FOR A MIN. 4' OF CLEAR AREA WITHOUT RUNNEL & RAIL.
9. STAMP CONCRETE AT TOP AND BOTTOM OF RUNNEL. SEE CONCRETE STAMP DETAIL.
10. RUNNEL LOCATION MUST BE ON EITHER SIDE OF STAIRWAY AS DETERMINED BY ENGINEER.
11. LONG STAIRWAYS OR STAIRWAYS WITH SIGHT OBSTRUCTIONS TO CYCLISTS MUST HAVE SIDEWALK BREAKS TO ALLOW ONCOMING CYCLISTS PASSAGE. LOCATIONS OF SIDEWALK BREAKS TO BE DETERMINED BY ENGINEER.
12. ANY CONSTRUCTION OUTSIDE OF RUNNEL MUST ALLOW ENOUGH CLEARANCE FOR BIKE PEDALS AND HANDLEBARS FROM INTERFERING WITH MOVEMENT.
13. EXTERNAL VENT HOLES MUST BE AS CLOSE TO THE WELD AS POSSIBLE AND MUST BE 25% THE SIZE OF THE I.D. OF THE PIPE, BUT NOT LESS THAN 3/8" IN DIA.
14. VENT HOLES IN END SECTIONS OR IN SIMILAR SECTIONS MUST BE 1/2" IN DIA.
15. ENDS MUST BE LEFT COMPLETELY OPEN. ANY DEVICE USED FOR FIELD-ERECTION THAT PREVENTS FULL OPENINGS ON ENDS OF HORIZONTAL RAILS AND VERTICAL LEGS MUST BE GALVANIZED SEPARATELY AND ATTACHED AFTER GALVANIZING.

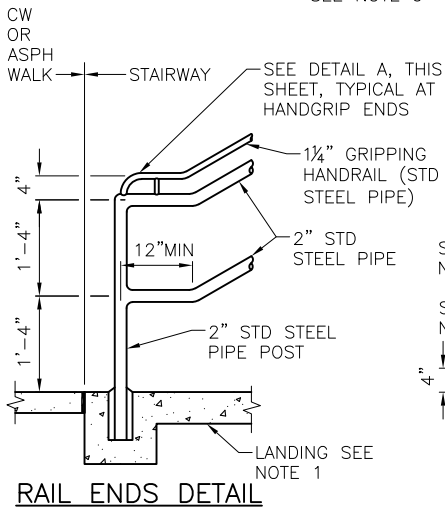


RAIL ENDS DETAIL

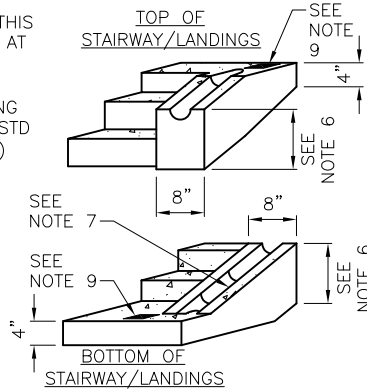

**DETAIL B
BIKE RUNNEL ENDS**

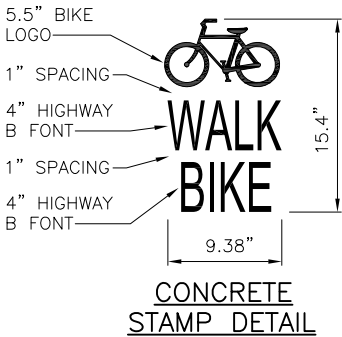

**CONCRETE
STAMP DETAIL**

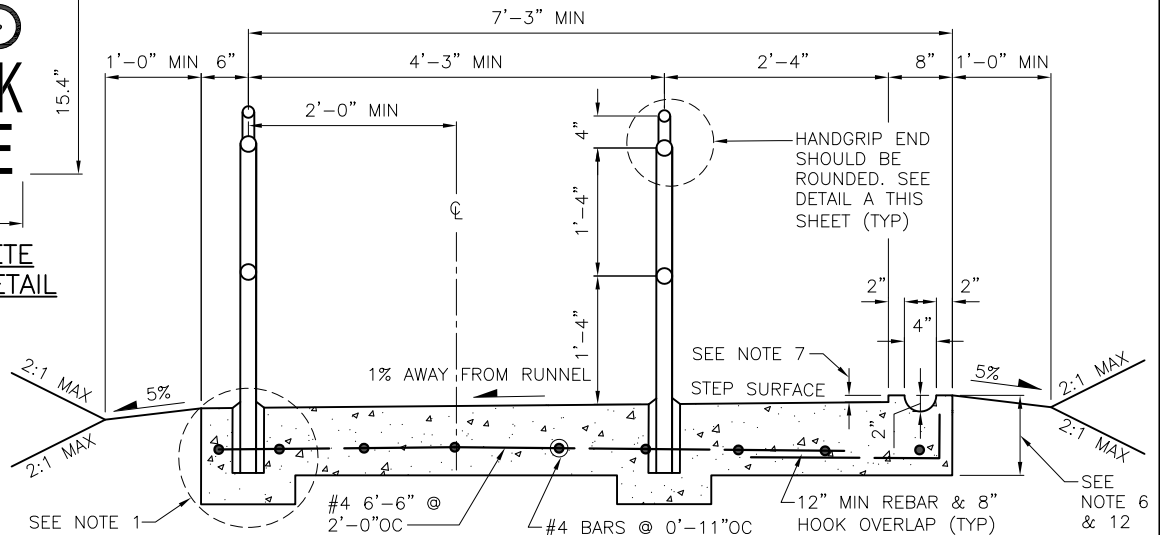

SECTION A-A


REF STD SPEC SEC 8-18




City of Seattle

NOT TO SCALE

**CEMENT CONCRETE
STAIRWAY & SINGLE BIKE RUNNEL**

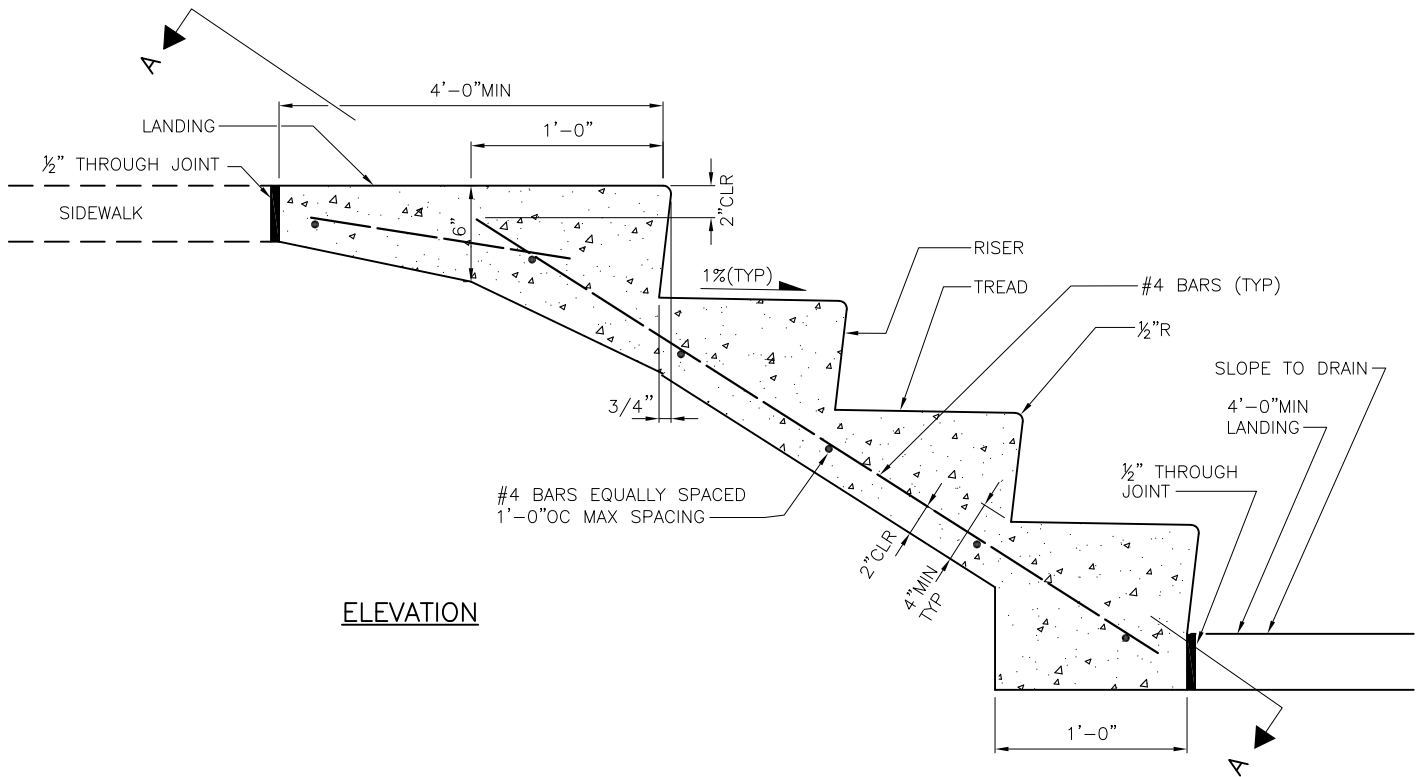

ELEVATION

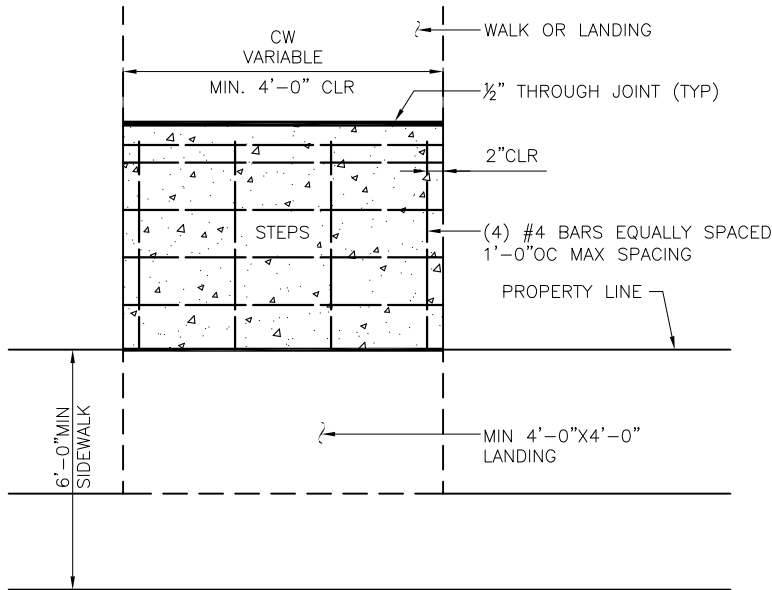

SECTION A-A

NOTES:

1. CEMENT CONCRETE MUST BE CL 3000 TROWEL FINISH
2. NUMBER OF STEPS MUST SUIT INDIVIDUAL CONDITIONS WITH UNIFORM TREAD AND RISER DIMENSIONS AS FOLLOWS:
TREADS MUST BE 11"MIN - 1'-0"MAX
RISERS MUST BE 5"MIN - 7"MAX
3. STEP WIDTH MUST MATCH WIDTH OF EXISTING WALK, BUT MUST BE NO LESS THAN 2'-6" WIDE
4. STAIRWAYS WITH 1 OR MORE RISERS MUST INCLUDE A HANDRAIL ON BOTH SIDES. SEE STD PLAN NO 440
5. REINFORCING STEEL ASTM A 615 GR60
6. TREAD SLOPES OUTWARD @1%



REF STD SPEC SEC 8-18




City of Seattle

NOT TO SCALE


CEMENT CONCRETE STEPS

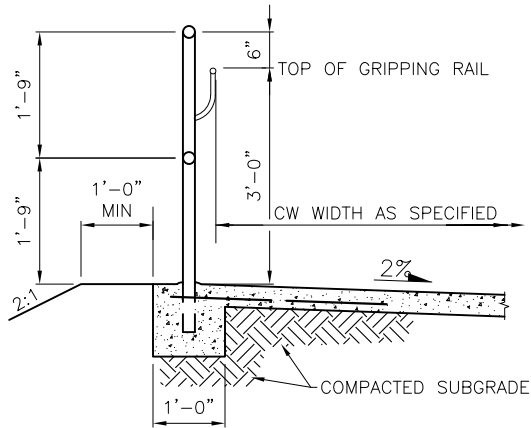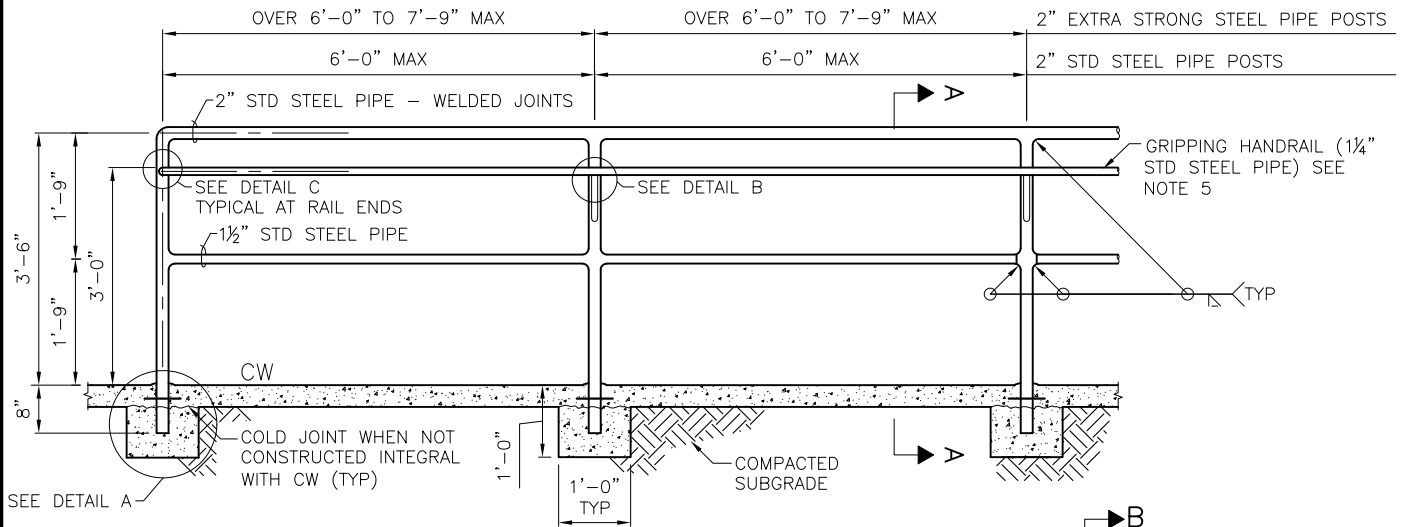

SECTION A-A

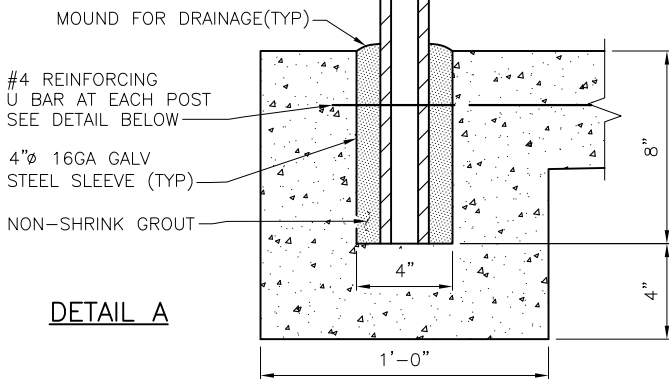


DETAIL A

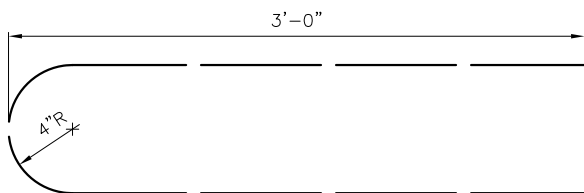


DETAIL D

NOTES:


1. RAILING MUST BE HOT DIP GALVANIZED AFTER FABRICATION.
2. ALL POSTS MUST BE PLUMB AND RAILS PARALLEL TO THE GROUND.
3. PIPE MATERIAL MUST CONFORM TO ASTM A 53.
4. REINFORCING STEEL ASTM A 706 GR 60.
5. IF THE CONCRETE WALK SLOPE IS 5% OR GREATER A GRIPPING HANDRAIL IS REQUIRED. GRIPPING HANDRAILS ON RAMPS (SLOPE EXCEEDS 5%) MUST EXTEND HORIZONTALLY A MINIMUM OF 12" BEYOND TOP AND BOTTOM OF RAMP RUNS.
6. PIPE DIAMETERS SHOWN CORRESPOND TO PIPE "SHAPE" AS DEFINED IN AMERICAN INSTITUTE OF STEEL CONSTRUCTION MANUAL.

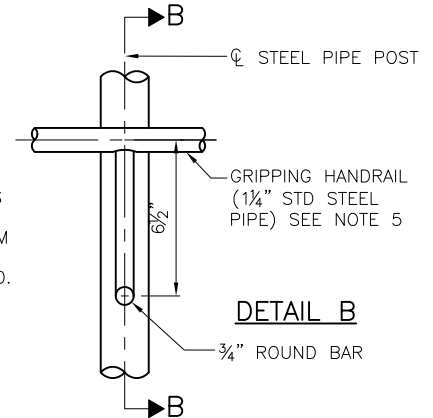


DETAIL B

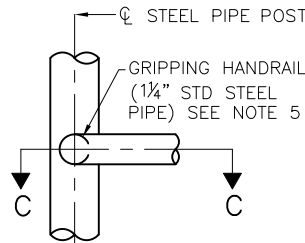

DETAIL C

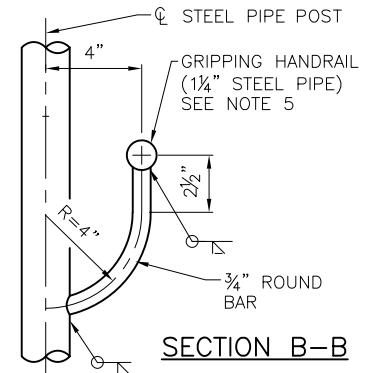

SECTION B-B

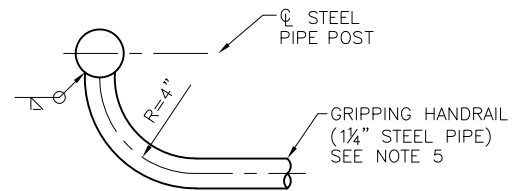

SECTION C-C


REF STD SPEC SEC 8-14, 8-18



City of Seattle

NOT TO SCALE

STEEL PIPE HANDRAIL

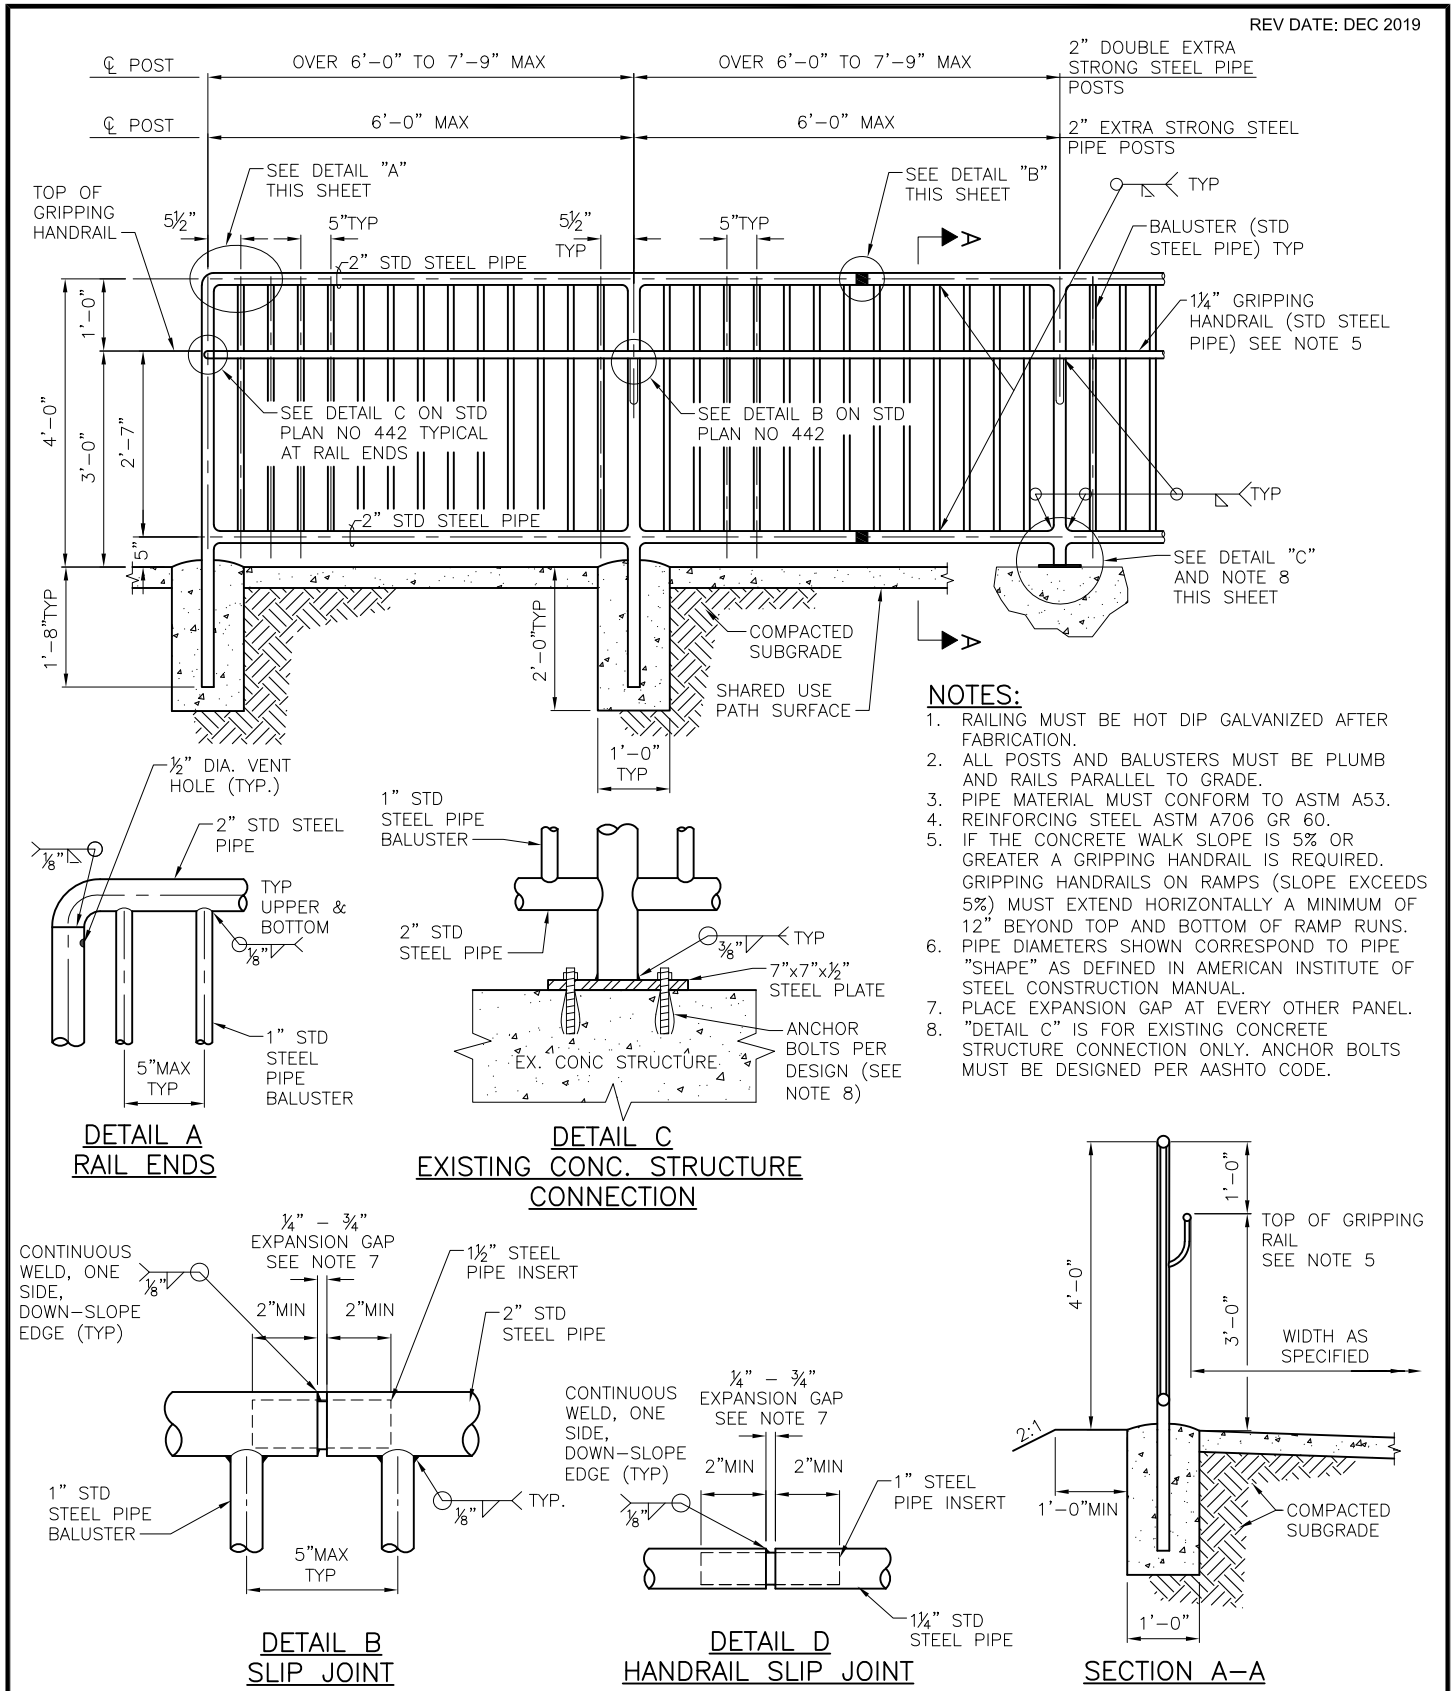


NOTES:


1. RAILING MUST BE HOT DIP GALVANIZED AFTER FABRICATION.
2. ALL POSTS AND BALUSTERS MUST BE PLUMB AND RAILS PARALLEL TO GRADE.
3. PIPE MATERIAL MUST CONFORM TO ASTM A53.
4. REINFORCING STEEL ASTM A706 GR 60.
5. IF THE CONCRETE WALK SLOPE IS 5% OR GREATER A GRIPPING HANDRAIL IS REQUIRED. GRIPPING HANDRAILS ON RAMP (SLOPE EXCEEDS 5%) MUST EXTEND HORIZONTALLY A MINIMUM OF 12" BEYOND TOP AND BOTTOM OF RAMP RUNS.
6. PIPE DIAMETERS SHOWN CORRESPOND TO PIPE "SHAPE" AS DEFINED IN AMERICAN INSTITUTE OF STEEL CONSTRUCTION MANUAL.
7. PLACE EXPANSION GAP AT EVERY OTHER PANEL.
8. "DETAIL C" IS FOR EXISTING CONCRETE STRUCTURE CONNECTION ONLY. ANCHOR BOLTS MUST BE DESIGNED PER AASHTO CODE.

DETAIL A
RAIL ENDS


DETAIL C
EXISTING CONC. STRUCTURE CONNECTION

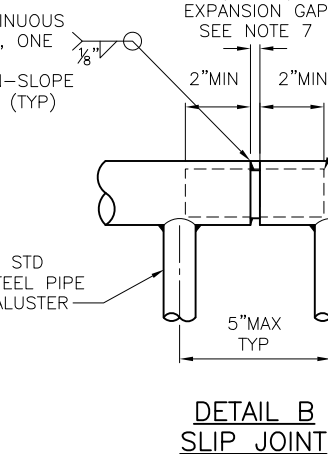

DETAIL B
SLIP JOINT

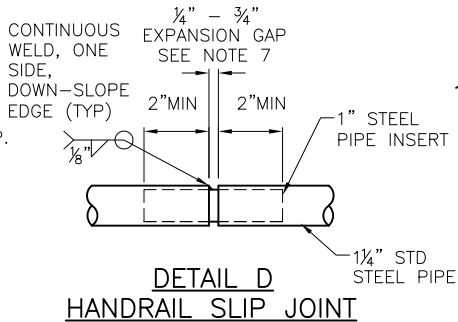

DETAIL D
HANDRAIL SLIP JOINT

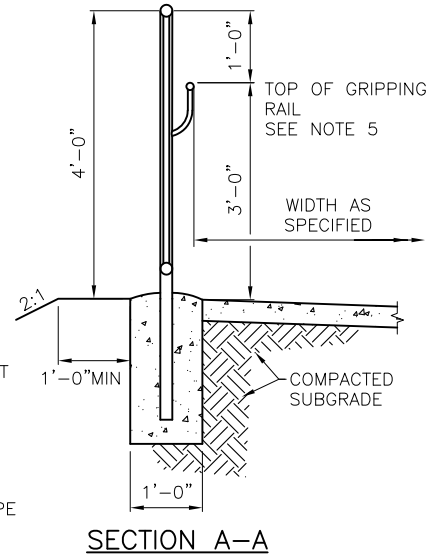

SECTION A-A


REF STD SPEC SEC 8-18




City of Seattle

NOT TO SCALE


PEDESTRIAN RAILING

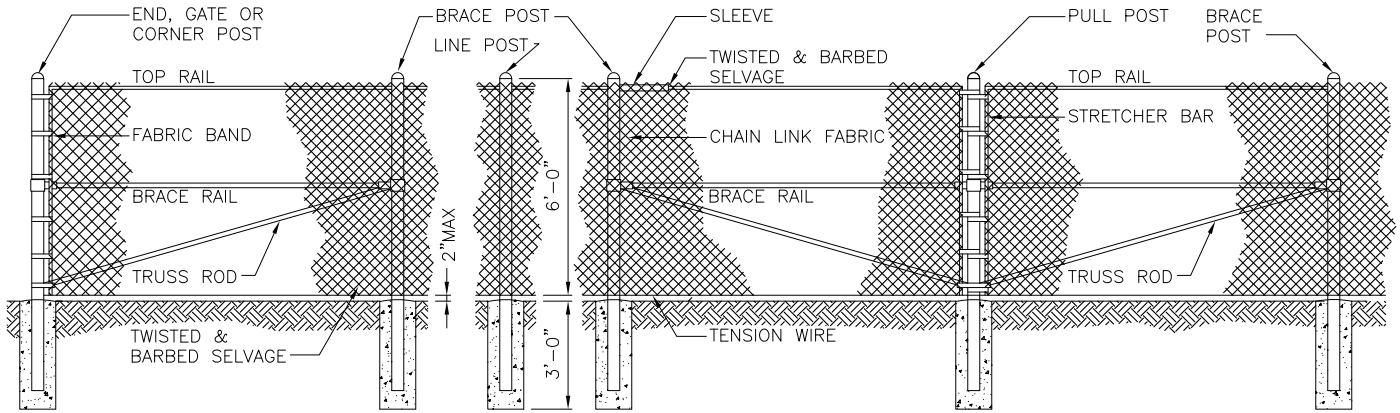


CHAIN LINK FENCE TYPE 1

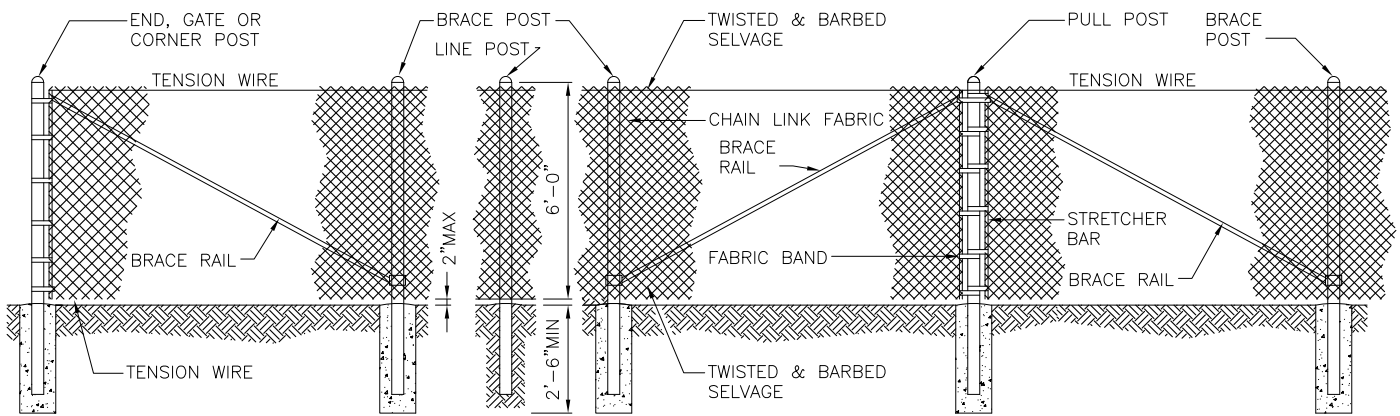

CHAIN LINK FENCE TYPE 3

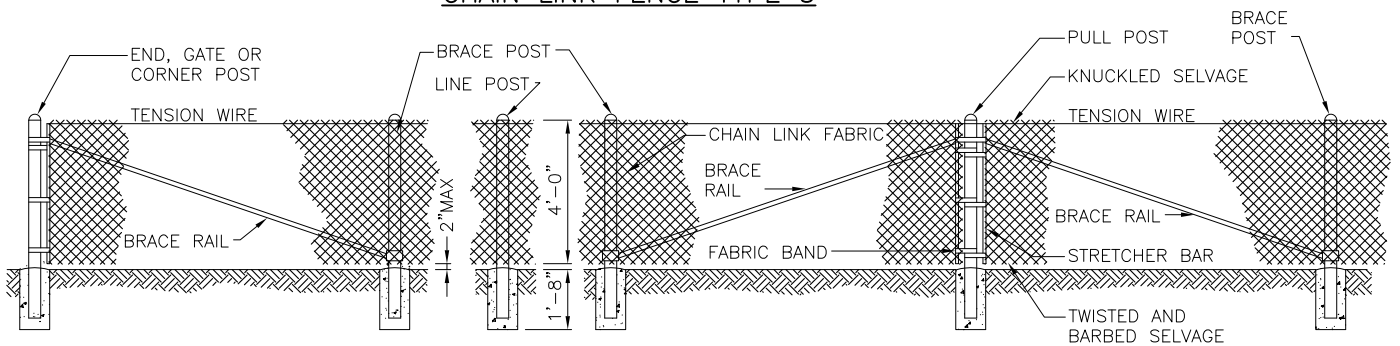

CHAIN LINK FENCE TYPE 4

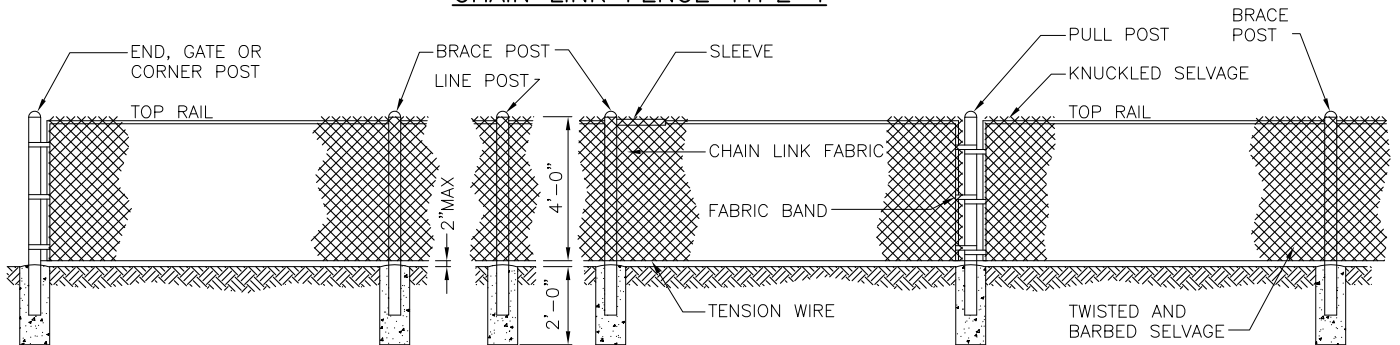

CHAIN LINK FENCE TYPE 6


REF STD SPEC SEC 8-12



City of Seattle

NOT TO SCALE

CHAIN LINK FENCE

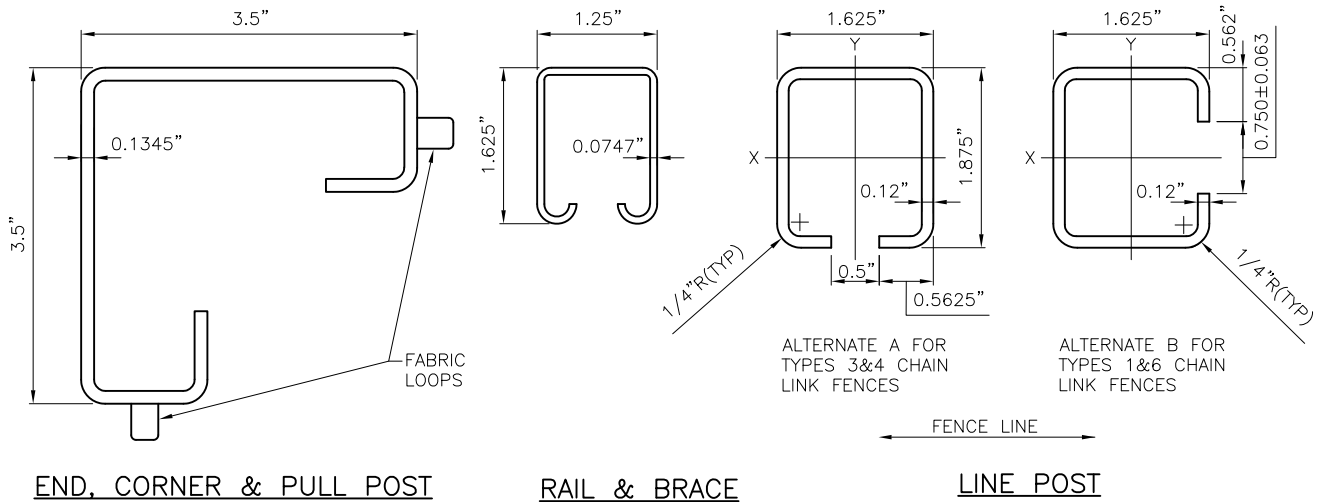

ROLL FORMED SECTIONS

MEMBER

TYPE	BRACE RAIL & TOP RAIL						LINE & BRACE POST					
	ROUND		H-COLUMN		ROLL FORMED		ROUND		H-COLUMN		ROLL FORMED	
	ID PIPE INCHES	WEIGHT PER FT POUNDS	SIZE INCHES	WEIGHT PER FT POUNDS	SIZE INCHES	WEIGHT PER FT POUNDS	ID PIPE INCHES	WEIGHT PER FT POUNDS	SIZE INCHES	WEIGHT PER FT POUNDS	SIZE INCHES	WEIGHT PER FT POUNDS
1	1.25	2.27	1.25X1.62	1.35	1 5/8 X 1/4	1.35	2	3.65	2 1/4	4.0		
3							1 1/2	2.72	1 7/8	2.72	1 5/8 X 1 1/8	2.34
4							1 1/2	2.72	1 7/8	2.72	1 5/8 X 1 1/8	2.34
6							1.25X1.62	1.35	2	3.65	2 1/4	4.0

MEMBER

TYPE	END, CORNER & PULL POSTS				GATE POST ROUND		ALL POSTS LENGTH
	ROUND		H-COLUMN		SIZE INCHES	WEIGHT PER FT POUNDS	
	ID PIPE INCHES	WEIGHT PER FT POUNDS	SIZE INCHES	WEIGHT PER FT POUNDS			
1	2 1/2	5.79	3 1/2 X 3 1/2	5.14	3 1/2	9.1	8'-8"
3	2	3.65					8'-8"
4	2	3.65					5'-6"
6	2 1/2	5.79					5'-6"

NOTES:

1. ALL CONCRETE POST BASES MUST BE 10" MINIMUM DIAMETER, CL3000
2. POSTS MUST BE SPACED AT 10'-0" MAXIMUM INTERVALS UNLESS OTHERWISE DIRECTED BY THE ENGINEER
3. TOP OR BOTTOM TENSION WIRES MUST BE PLACED WITHIN THE LIMITS OF THE FIRST FULL FABRIC WEAVE
4. THE ILLUSTRATIVE DETAIL SHOWN HEREON MUST NOT BE CONSTRUED AS LIMITING TO HARDWARE DESIGN OR POST SELECTION FOR ANY PARTICULAR FENCE TYPE
5. CONCRETE OR GROUT AROUND POST AT GROUND LINE MUST BE MOUNDED FOR DRAINAGE


REF STD SPEC SEC 8-12



City of Seattle

NOT TO SCALE

CHAIN LINK FENCE

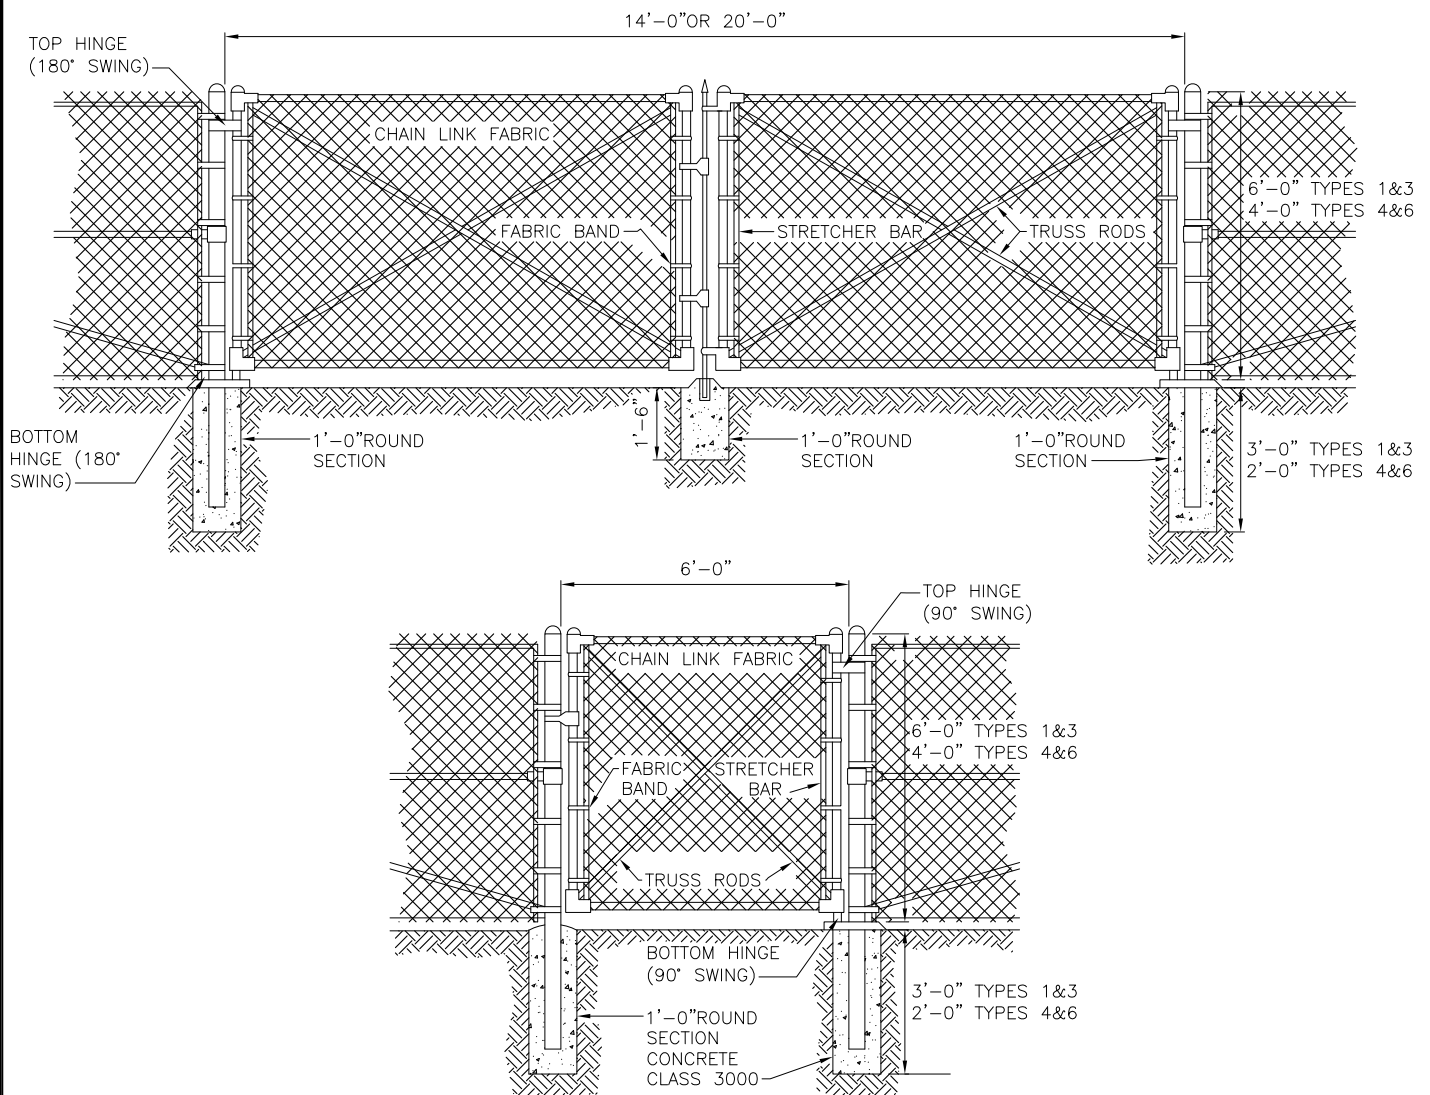

NOTES:

1. FENCE FABRIC MUST BE SECURED TO GATE FRAMES WITH KNUCKLED SELVAGE ALONG TOP EDGE FOR TYPES 4&6 CHAIN LINK FENCE INSTALLATIONS
2. MINIMUM POST LENGTH:
 TYPES 1&3: 8'-8"
 TYPES 4&6: 5'-6"
3. CONCRETE OR GROUT AROUND POST AT GROUND LINE MUST BE MOUNDED FOR DRAINAGE


REF STD SPEC SEC 8-12




City of Seattle

NOT TO SCALE

CHAIN LINK GATES

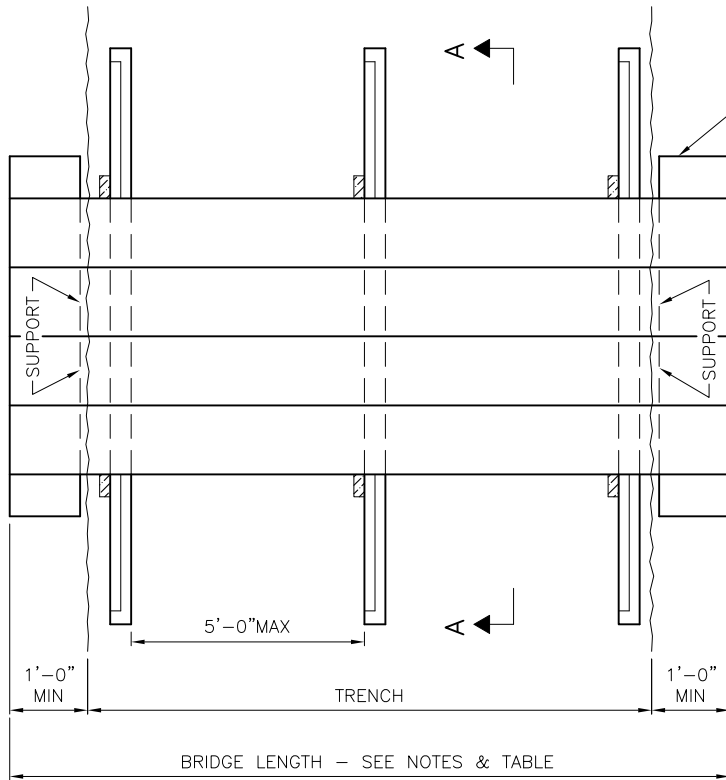

6"X12"X5'-0" SILL
TYP BOTH ENDS

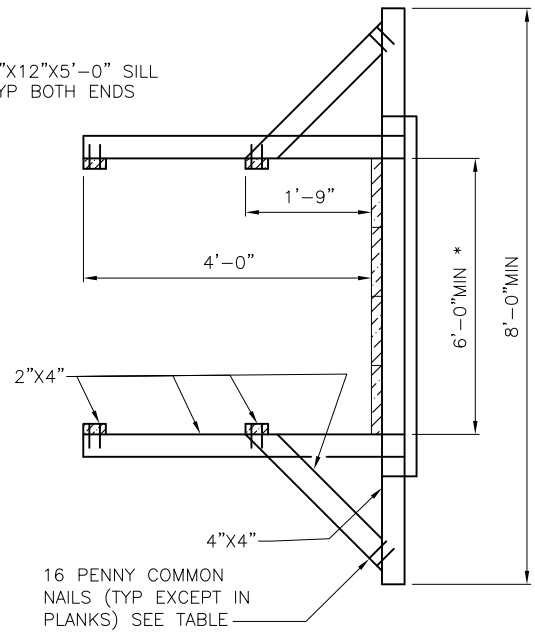


SECTION A-A

* UNLESS APPROVED BY SEATTLE DEPARTMENT OF TRANSPORTATION

NOTES:

1. IF THE SLOPE OF THE TEMPORARY CROSSING IS 5% OR GREATER, A GRIPPING HANDRAIL MUST BE ADDED THAT COMPLIES WITH ADA STANDARDS.
2. ENDS OF THE TEMPORARY CROSSING MUST BE SLOPED TO ALLOW ADA ACCESS.
3. SURFACE OF WALKWAY MUST BE SKID RESISTANT.
4. THE RAMP MUST BE CONSTRUCTED OF TEMPORARY PAVEMENT OR COMPACTED GRAVEL EMBANKMENT OR AS APPROVED BY ENGINEER.
5. THE TEMPORARY WALKWAY COULD BE RECESSED FOR THE WALKING SURFACE TO BE FLUSH WITH ADJOINING GRADE.

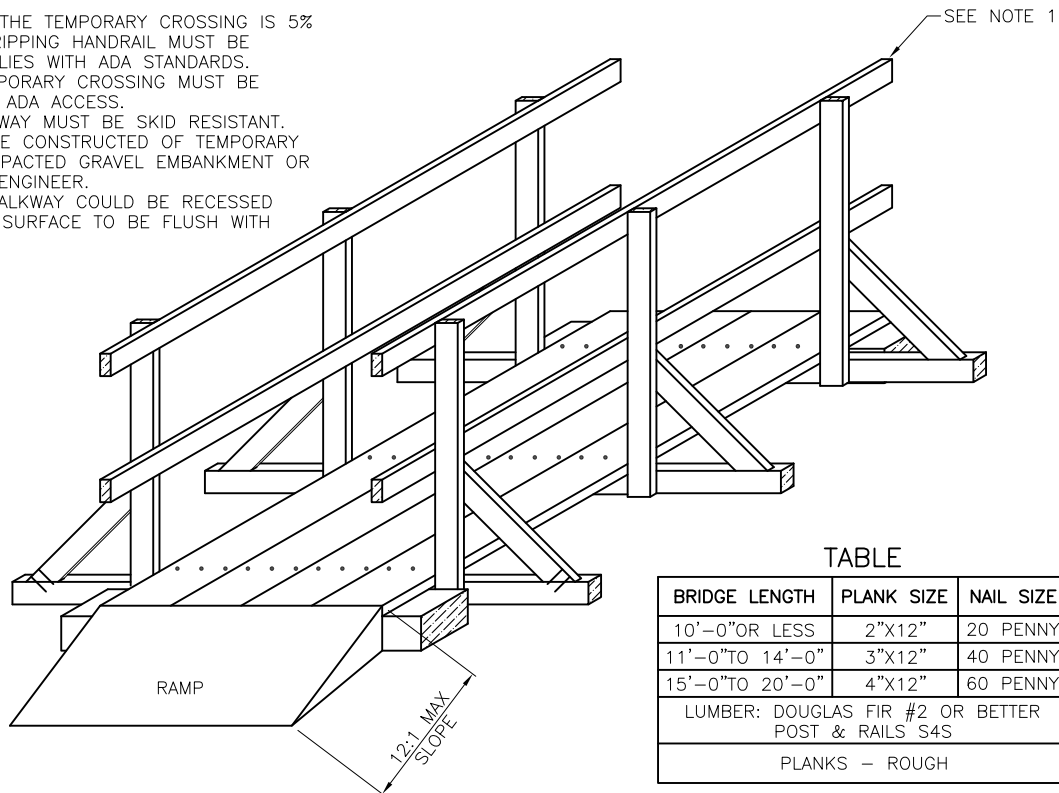

TABLE

BRIDGE LENGTH	PLANK SIZE	NAIL SIZE
10'-0" OR LESS	2"X12"	20 PENNY
11'-0" TO 14'-0"	3"X12"	40 PENNY
15'-0" TO 20'-0"	4"X12"	60 PENNY
LUMBER: DOUGLAS FIR #2 OR BETTER POST & RAILS S4S		
PLANKS - ROUGH		


REF STD SPEC SEC 1-07.23



City of Seattle

NOT TO SCALE

TEMPORARY PEDESTRIAN WALKWAY

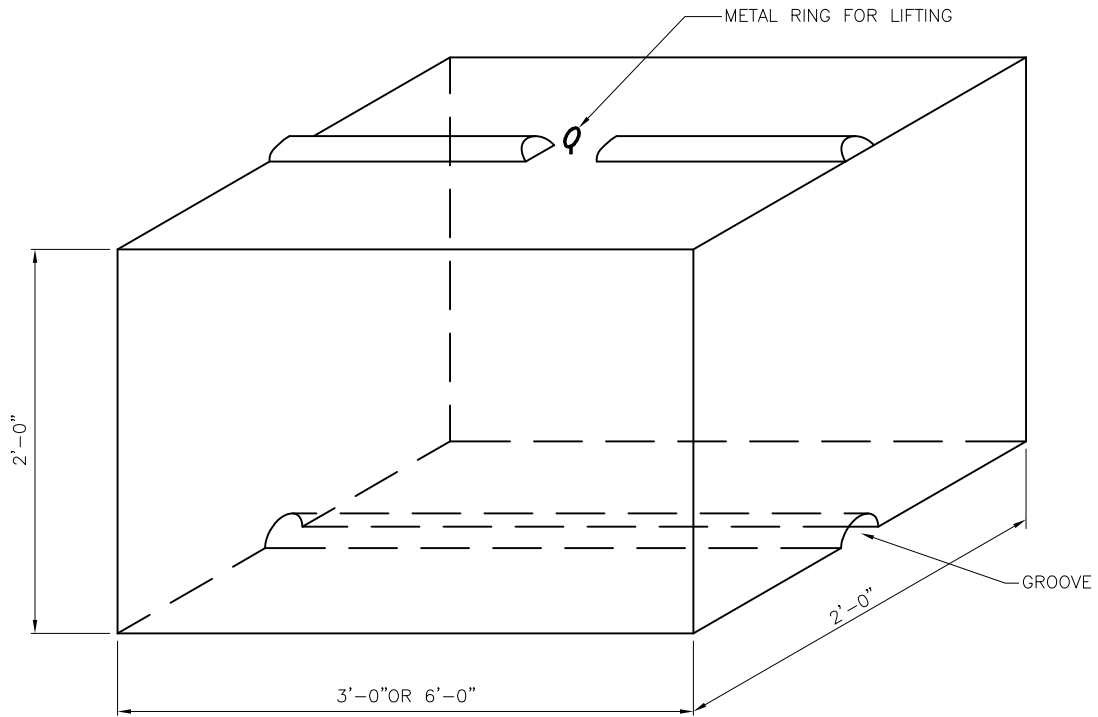

CONCRETE TONGUE & GROOVE BLOCK


REF STD SPEC SEC




City of Seattle

NOT TO SCALE


ECOLOGY BLOCK, CONCRETE

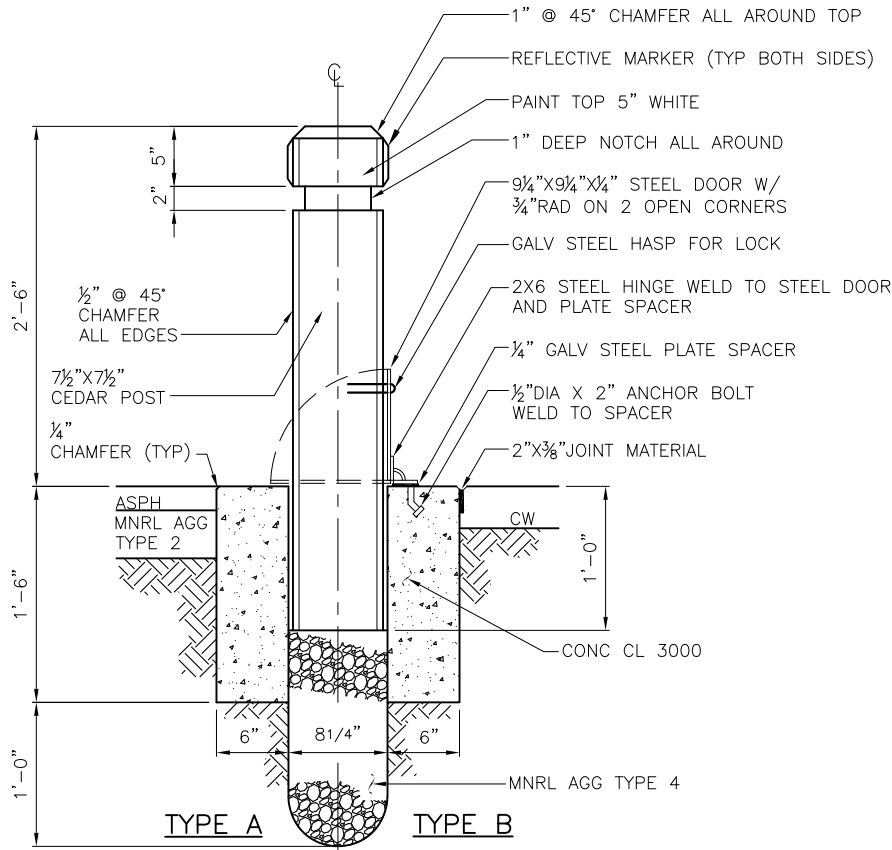

REMOVABLE BOLLARDS

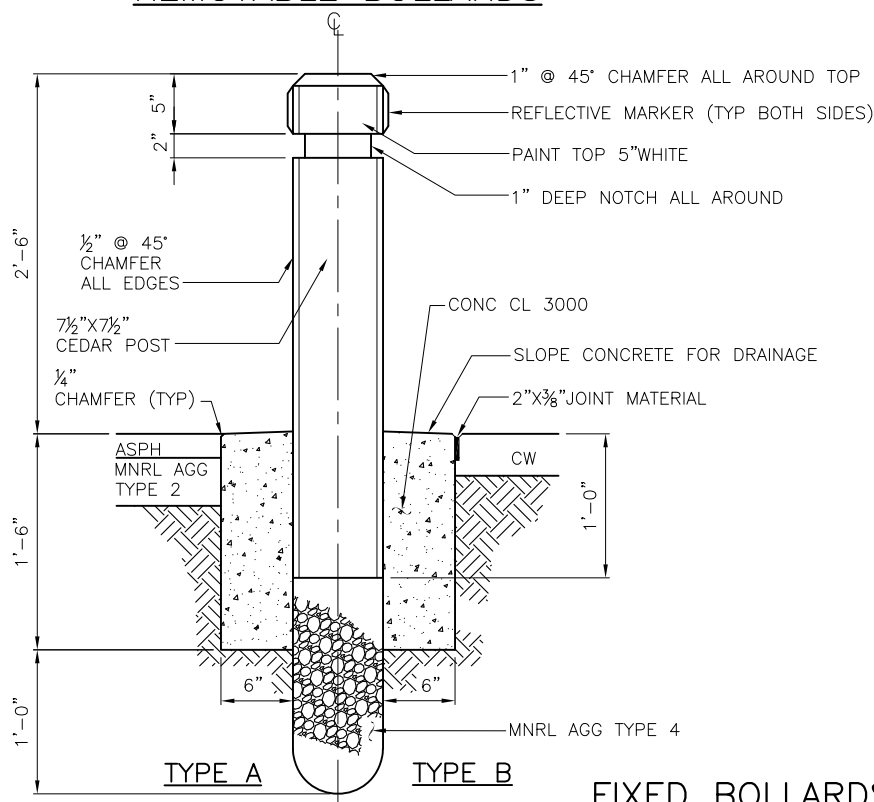

FIXED BOLLARDS

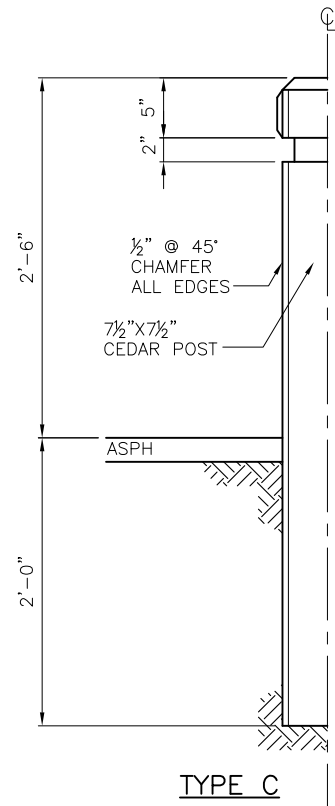

TYPE C




REF STD SPEC SEC 8-02



City of Seattle




NOT TO SCALE

FIXED & REMOVABLE WOOD BOLLARD

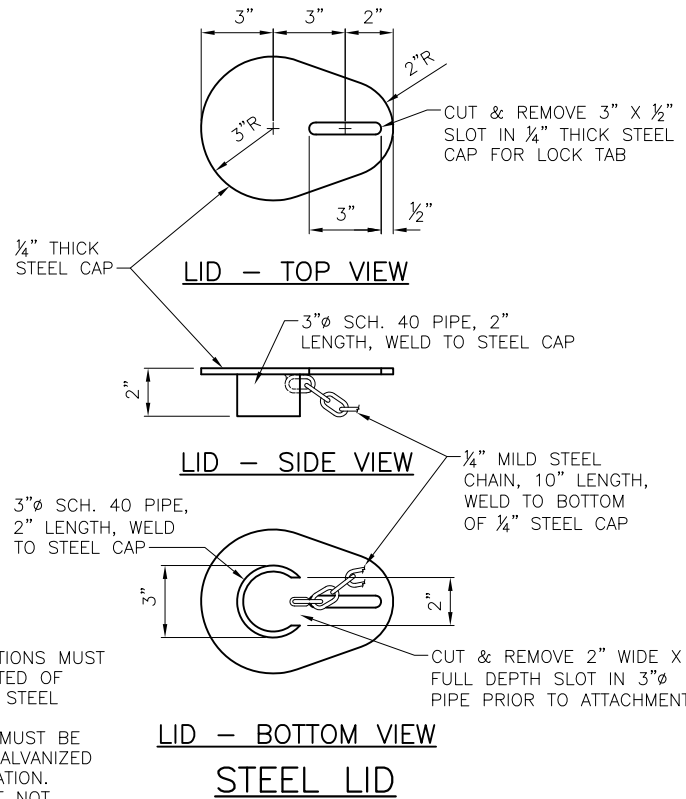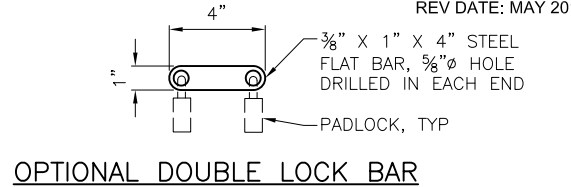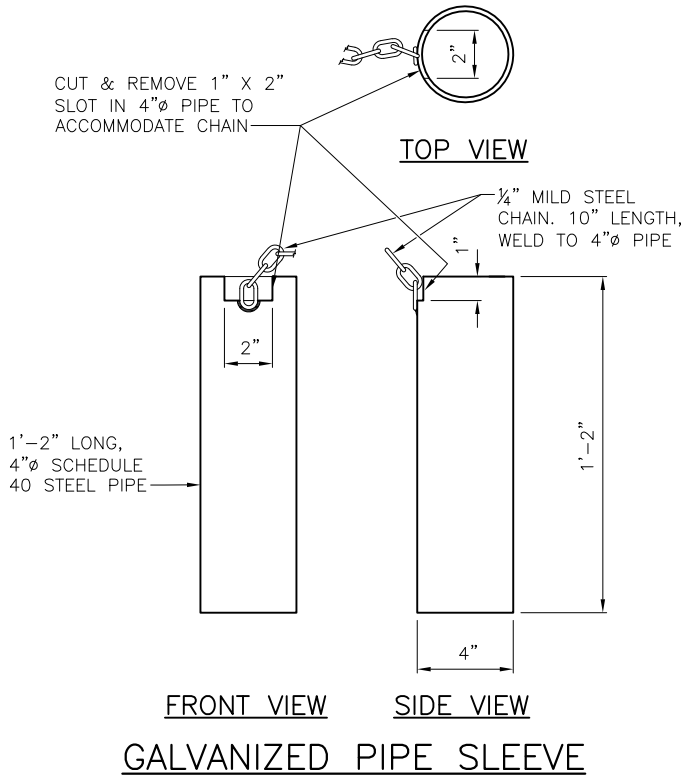

NOTES:

1. ALL PIPE SECTIONS MUST BE CONSTRUCTED OF SCHEDULE 40 STEEL PIPE AND ALL COMPONENTS MUST BE HOT DIPPED GALVANIZED AFTER FABRICATION.
2. BOLLARD MUST NOT EXCEED 50 LBS.

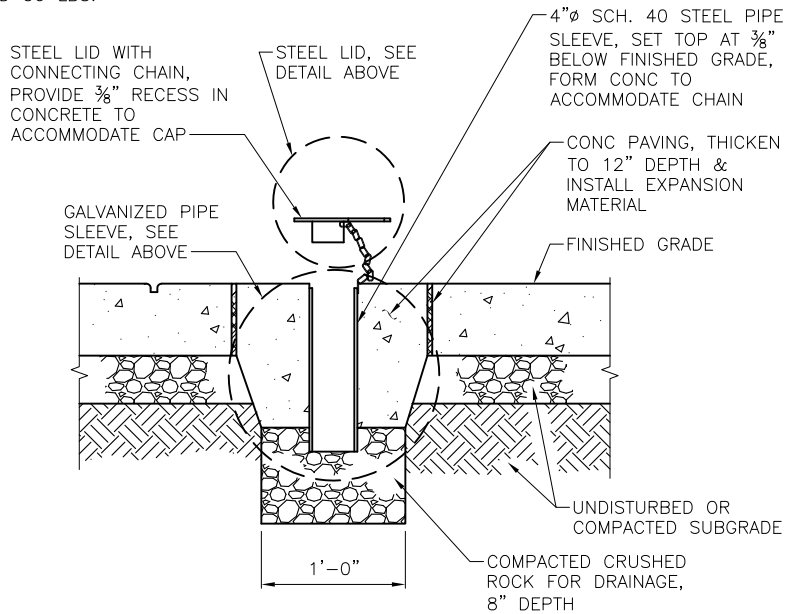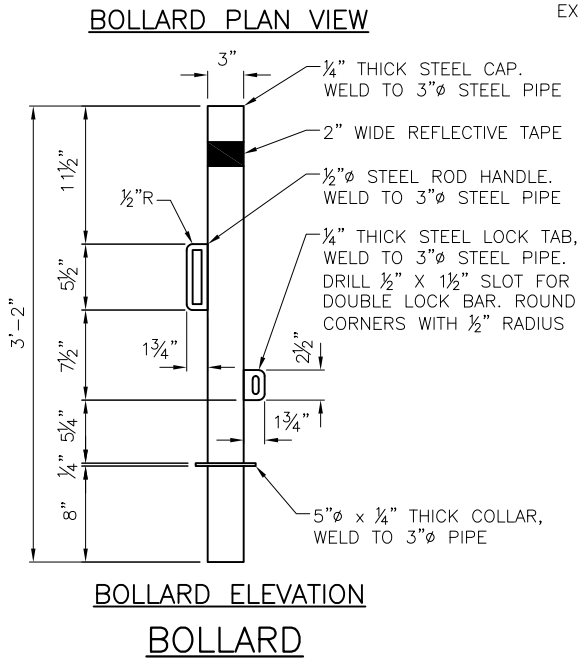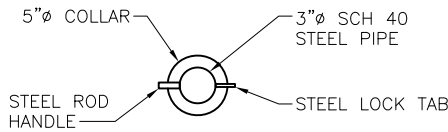


REF STD SPEC SEC 8-02



City of Seattle

NOT TO SCALE

REMOVABLE STEEL BOLLARD

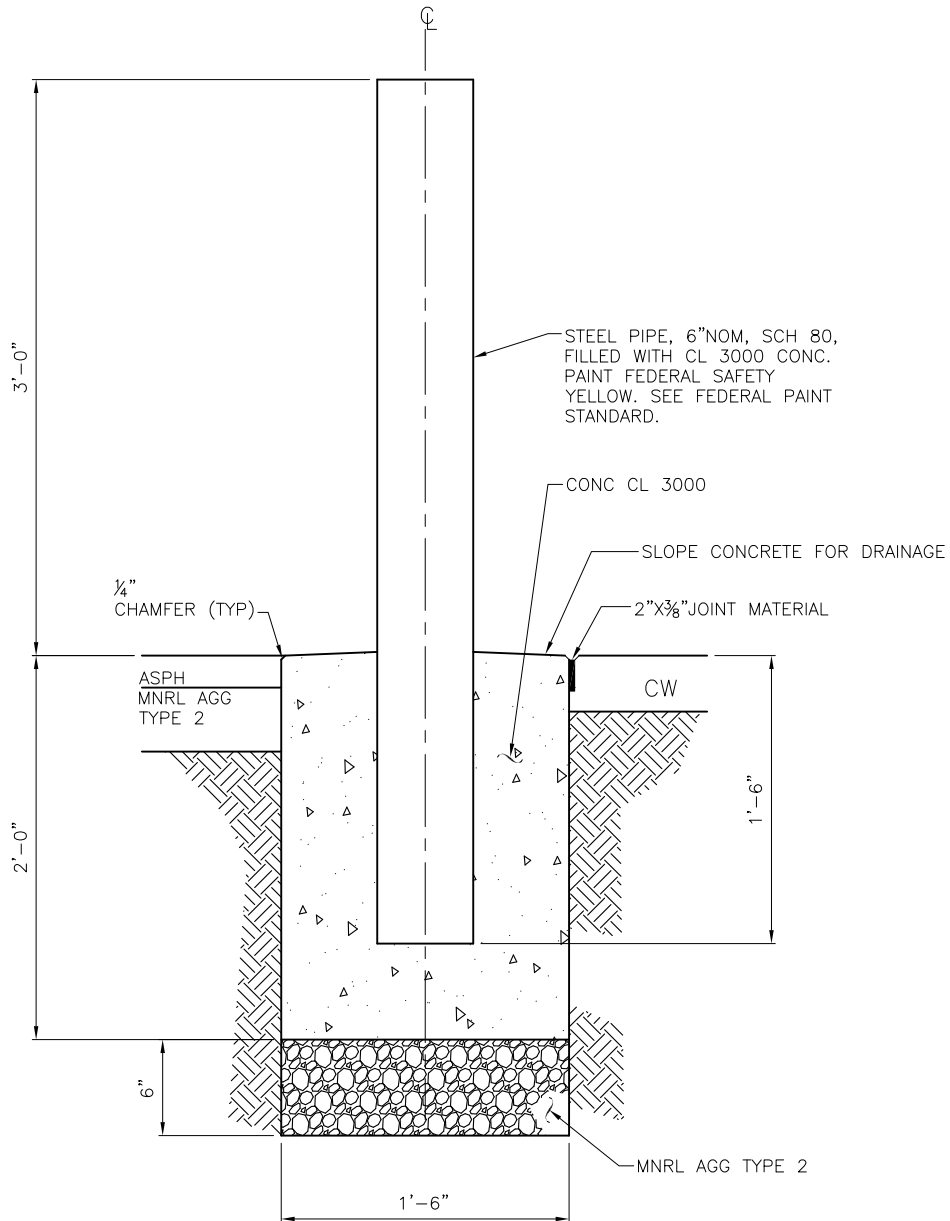


REF STD SPEC SEC 8-02



City of Seattle

NOT TO SCALE

FIXED STEEL BOLLARD


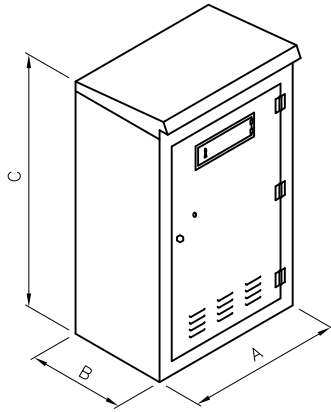


NOTES:

1. UNLESS OTHERWISE SPECIFIED, TRAFFIC SIGNAL CONTROLLER CABINET MUST BE FURNISHED BY THE CITY
2. UNLESS OTHERWISE SPECIFIED, EXACT CABINET DIMENSIONS & ANCHOR BOLT LOCATIONS MUST BE PROVIDED BY THE TRAFFIC SIGNAL SHOP
3. PLACE CABINET DOOR ON SIDEWALK SIDE OF FOUNDATION
4. SEAL CABINET TO FOUNDATION WITH GREY OR CLEAR SILICONE TO PREVENT MOISTURE FROM ENTERING THE CABINET
5. CABINET FOUNDATIONS INSTALLED IN A LANDSCAPE AREA MUST INCLUDE A CONCRETE SIDEWALK MAINTENANCE PAD ON THE SDOT DOOR SIDE OF THE FOUNDATION, SEE STD SPEC SEC 8-32.3(2)B

DIMENSION	TYPE II	TYPE III	VI
A	30"	44"	44"
B	17"	25 1/2"	25 1/2"
C	38" TO 52"	50" TO 58"	64 3/4" TO 67 1/2"

SIGNAL CONTROLLER CABINET-TYPES II, III, VI

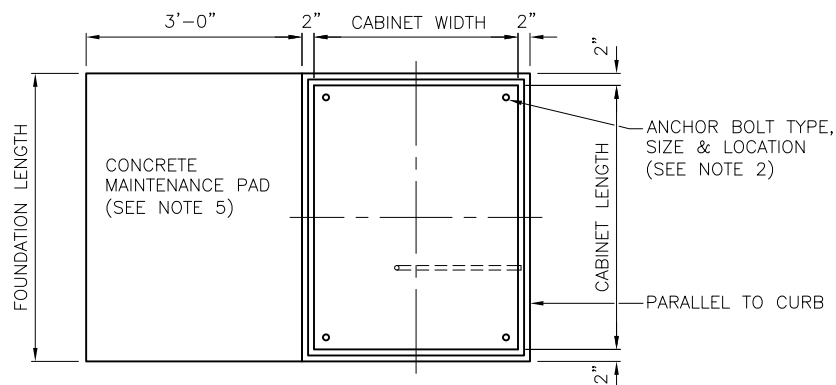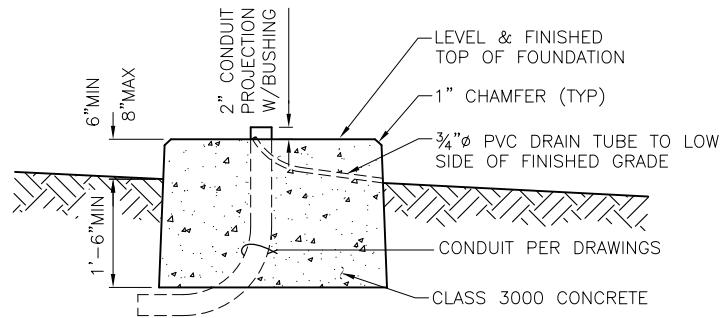

SIGNAL CONTROLLER FOUNDATION

SEE STD PLANS NO 500b & 500c FOR CONDUIT LAYOUT


REF STD SPEC SEC 8-31, 8-32




City of Seattle

NOT TO SCALE

SIGNAL CONTROLLER CABINET & FOUNDATION

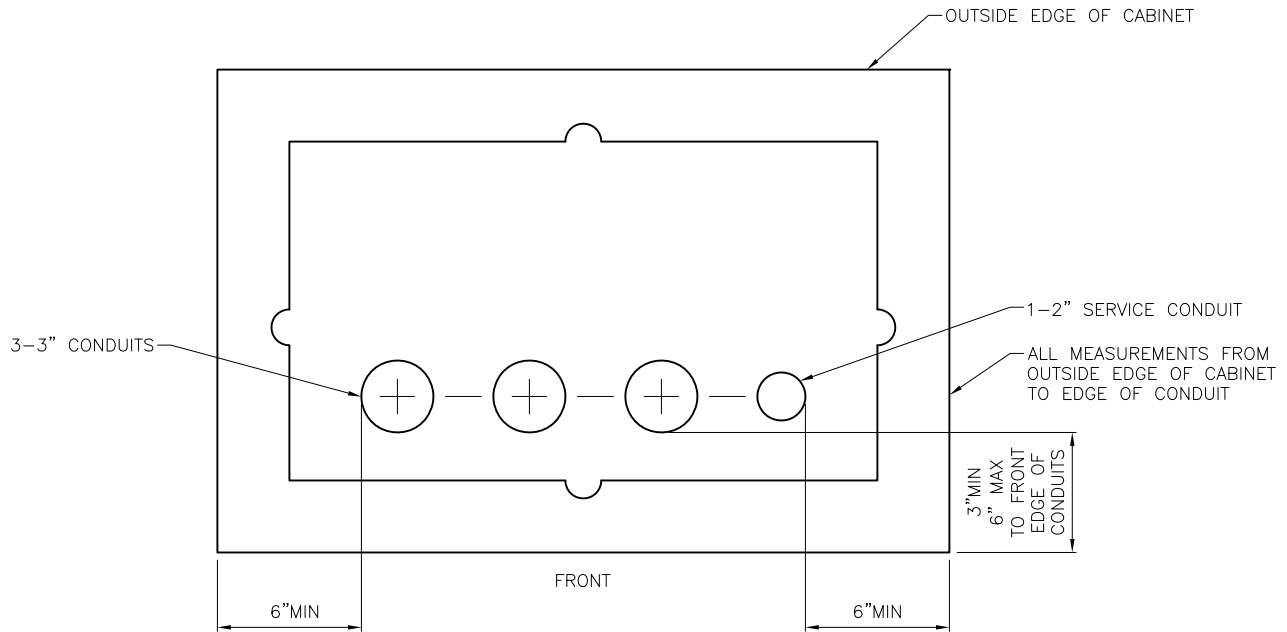

CONDUIT LAYOUT – TYPE II SIGNAL CONTROLLER FOUNDATION

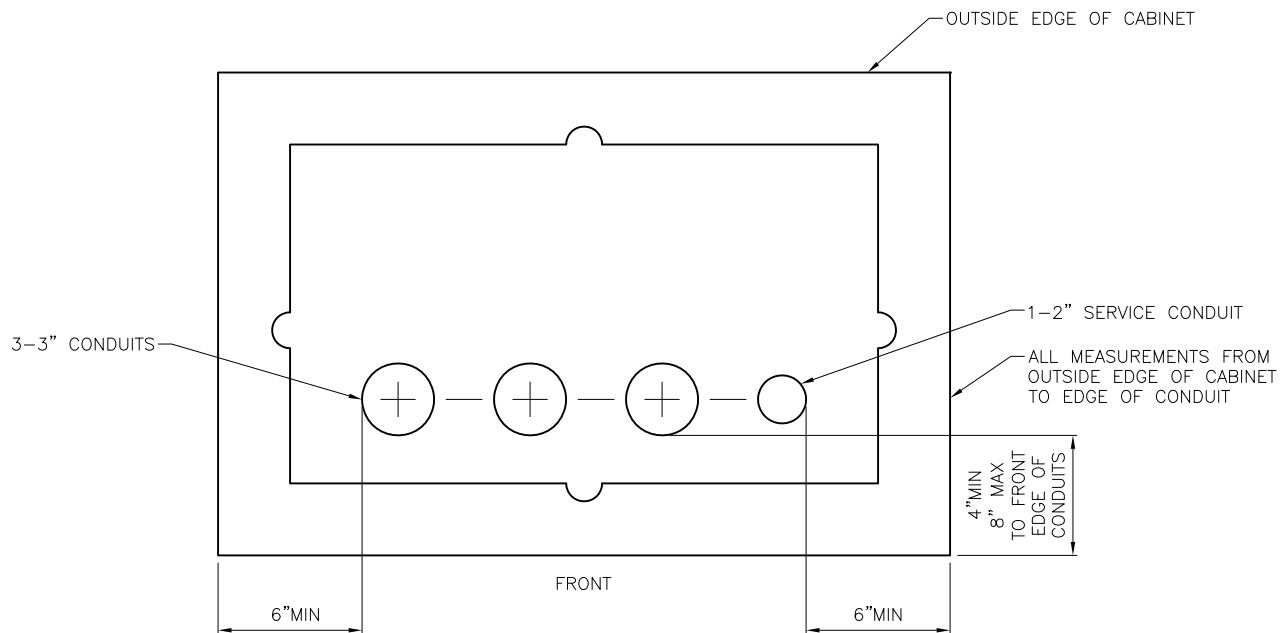

CONDUIT LAYOUT – TYPE III/VI SIGNAL CONTROLLER FOUNDATION


REF STD SPEC SEC 8-31, 8-32



City of Seattle

NOT TO SCALE

**SIGNAL CONTROLLER
FOUNDATION CONDUIT LAYOUT**

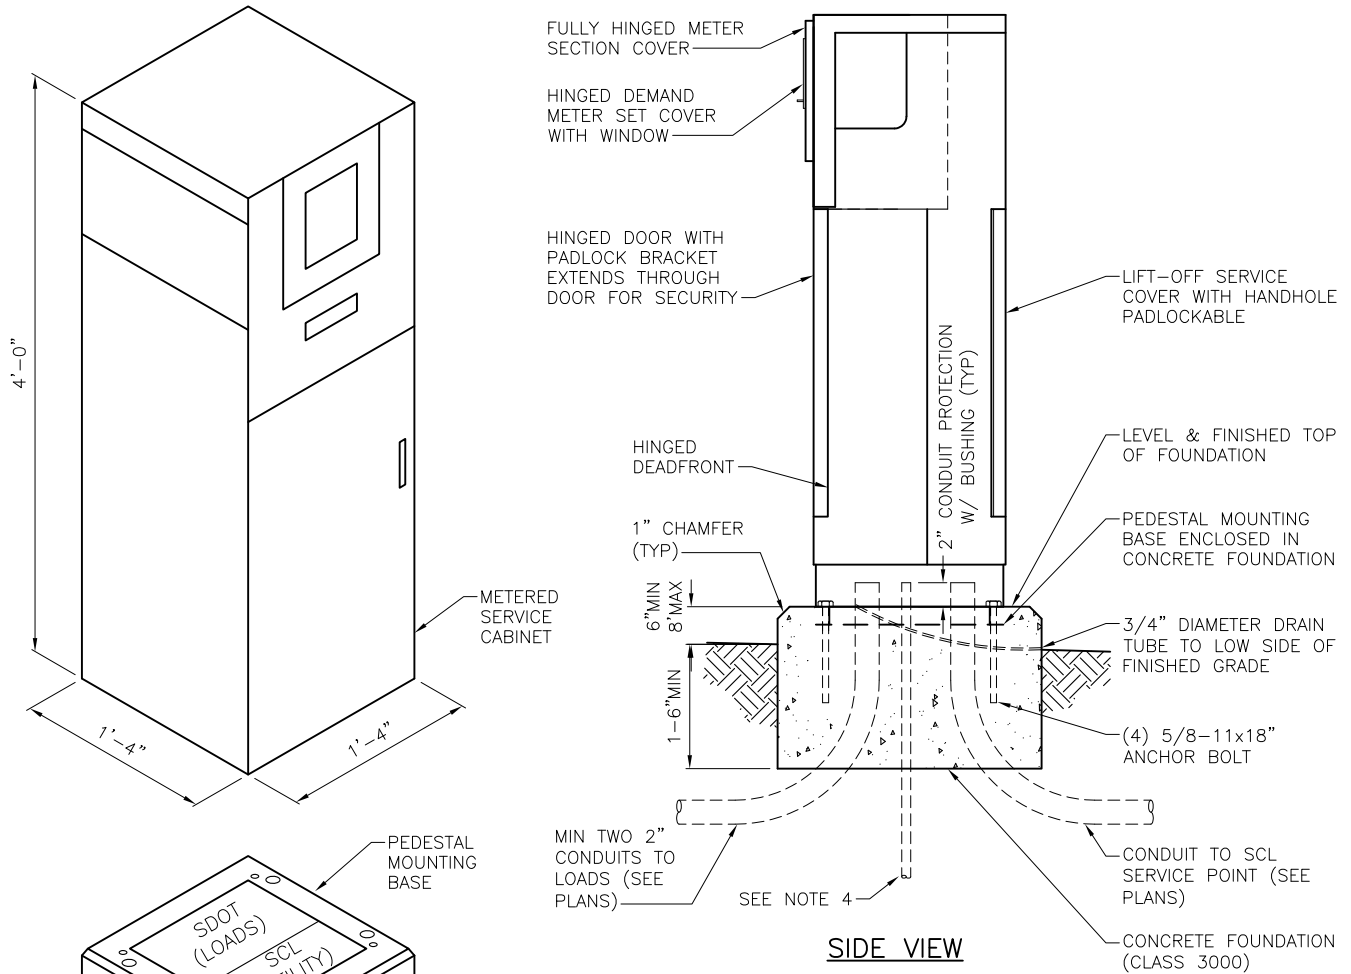


ISOMETRIC VIEW

SIDE VIEW

NOTES:

1. 36" MINIMUM CLEARANCE MUST BE REQUIRED IN FRONT OF BOTH FRONT AND BACK CABINET DOOR.
2. SEAL CABINET TO FOUNDATION WITH GREY OR CLEAR SILICON TO PREVENT MOISTURE FROM ENTERING THE CABINET.
3. EXACT SERVICE CABINET DIMENSIONS, ANCHOR BOLT LOCATIONS AND PEDESTAL MOUNTING HOLES MUST BE PROVIDED BY THE MANUFACTURER.
4. GROUND ROD 3/4"x120" COPPER CLAD WITH GROUND ROD CLAMP. A SECOND GROUND MUST BE INSTALLED A MINIMUM 8' AWAY IN A GROUND ROD HANDHOLE AS PER CITY OF SEATTLE STANDARD PLAN NO 550b. COORDINATE WITH ELECTRICAL INSPECTOR FOR LOCATION. INSTALL #4 AWG COPPER GROUND WIRE BETWEEN CABINET FOUNDATION AND GROUND ROD HANDHOLE.
5. CABINET FOUNDATIONS INSTALLED IN A LANDSCAPE AREA MUST INCLUDE A CONCRETE SIDEWALK MAINTENANCE PAD ON THE SDOT DOOR SIDE OF THE FOUNDATION, SEE STD SPEC SEC 8-32.3(2)B

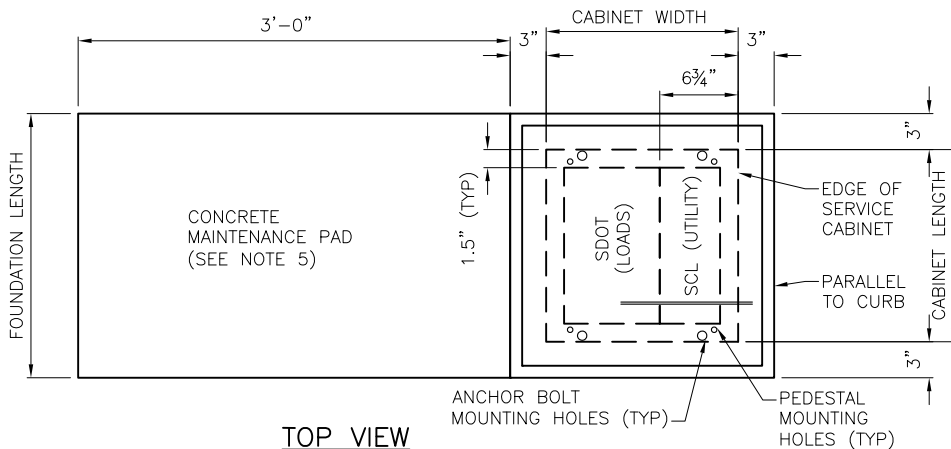

TOP VIEW

REF STD SPEC SEC 8-31, 8-32





City of Seattle

NOT TO SCALE

**SERVICE CABINET
FOUNDATION DETAIL**

NOTES:

1. FOR SIGNAL CONTROLLER DIMENSIONS AND OTHER REQUIREMENTS, SEE STD PLAN NO. 500a.
2. FOR SERVICE CABINET DIMENSIONS AND OTHER REQUIREMENTS, SEE STD PLAN NO 501a.
3. SEAL CABINETS TO FOUNDATION WITH GREY OR CLEAR SILICON TO PREVENT MOISTURE FROM ENTERING THE CABINET.
4. THE SERVICE CABINET MUST BE PLACED ON THE OPPOSITE SIDE OF THE CONTROLLER CABINET FROM THE UPS.
5. CABINET FOUNDATIONS INSTALLED IN A LANDSCAPE AREA MUST INCLUDE A CONCRETE SIDEWALK MAINTENANCE PAD ON THE SDOT DOOR SIDE OF THE FOUNDATION, SEE STD SPEC SEC 8-32.3(2)B

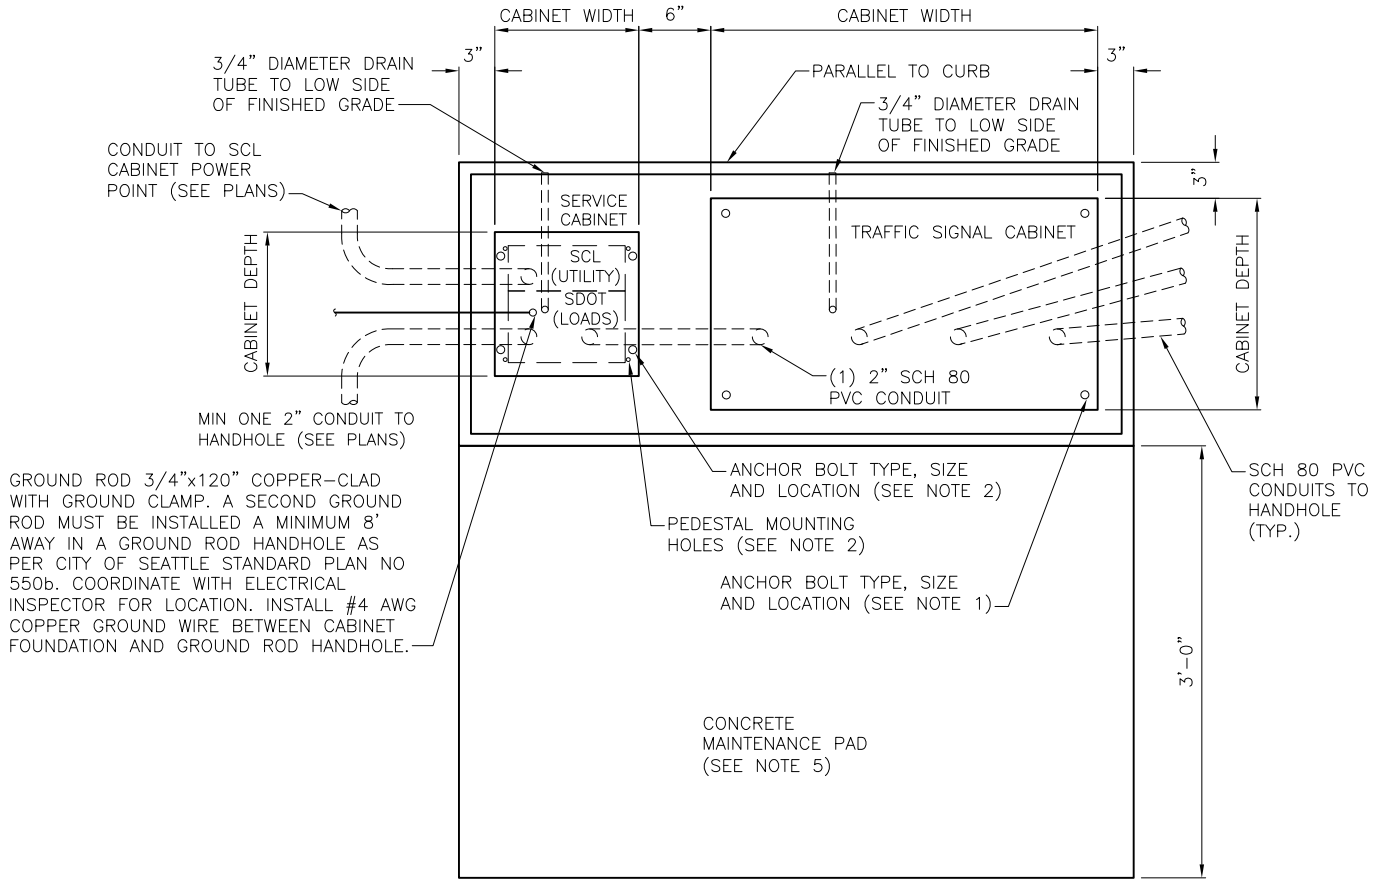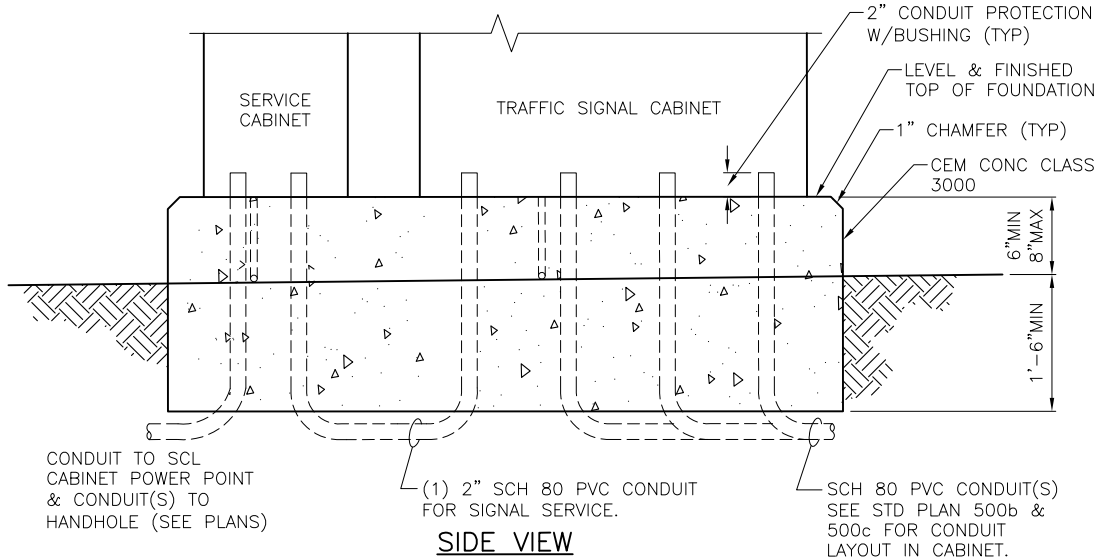

JOINT SIGNAL CONTROLLER/SERVICE CABINET FOUNDATION DETAIL
NOT TO SCALE


REF STD SPEC SEC 8-31, 8-32



City of Seattle


NOT TO SCALE

**JOINT SIGNAL CONTROLLER/
SERVICE CABINET
FOUNDATION DETAIL**

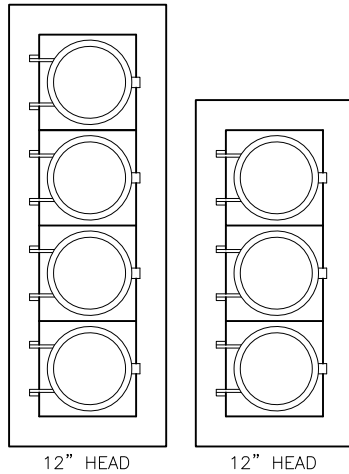


TYPICAL SIGNAL FACES

W/ TUNNEL VISORS &
5" BACKPLATE (LOUVERED)
1" YELLOW, DIAMOND GRADE RETRO
REFLECTIVE TAPE

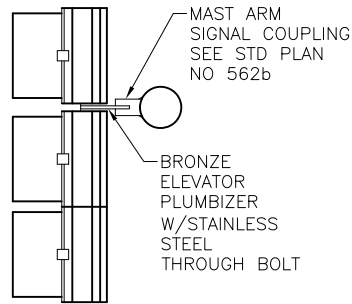


MAST ARM MOUNTING

SEE NOTE 1

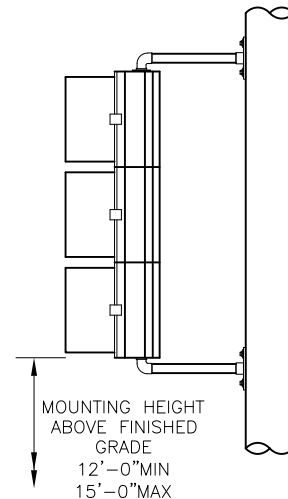

BRACKET MOUNTING


FOR SIGNAL HEAD BRACKET ASSEMBLY
SEE STD PLAN NO 511

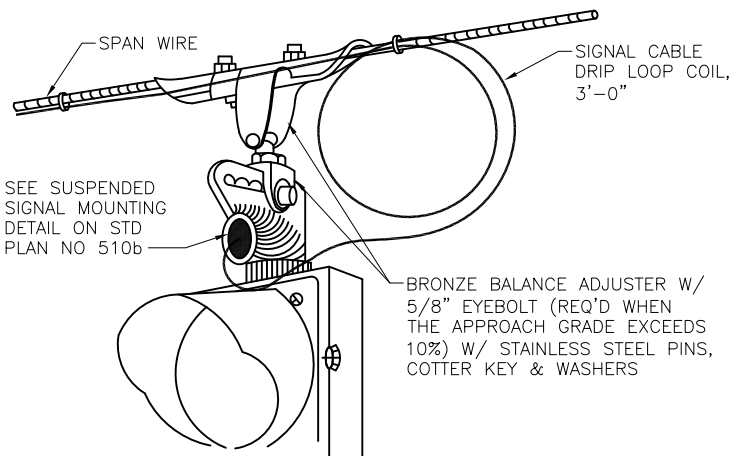

SIGNAL HANGER DETAIL

SEE SUSPENDED
SIGNAL MOUNTING
DETAIL ON STD
PLAN NO 510b


BRONZE BALANCE ADJUSTER W/
5/8" EYEBOLT (REQ'D WHEN
THE APPROACH GRADE EXCEEDS
10%) W/ STAINLESS STEEL PINS,
COTTER KEY & WASHERS

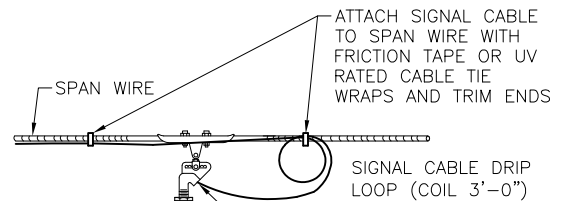

SPAN MOUNTING

NOTES:

1. VERTICAL CLEARANCE: 17' MIN TO ROADWAY 19'-0" MAX (ON TRUCK ROUTES USE 18' TO 19')
2. BACKPLATES HAVE BEEN OMITTED FROM VARIOUS VIEWS FOR CLARITY

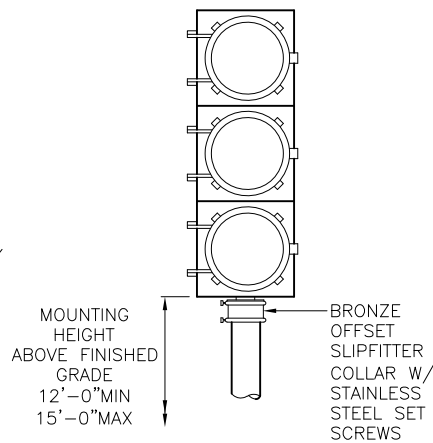

PEDESTAL TOP MOUNTING

FOR PEDESTAL SEE STD PLAN NO 524


REF STD SPEC SEC 8-31



City of Seattle

NOT TO SCALE

VEHICULAR SIGNAL MOUNTING

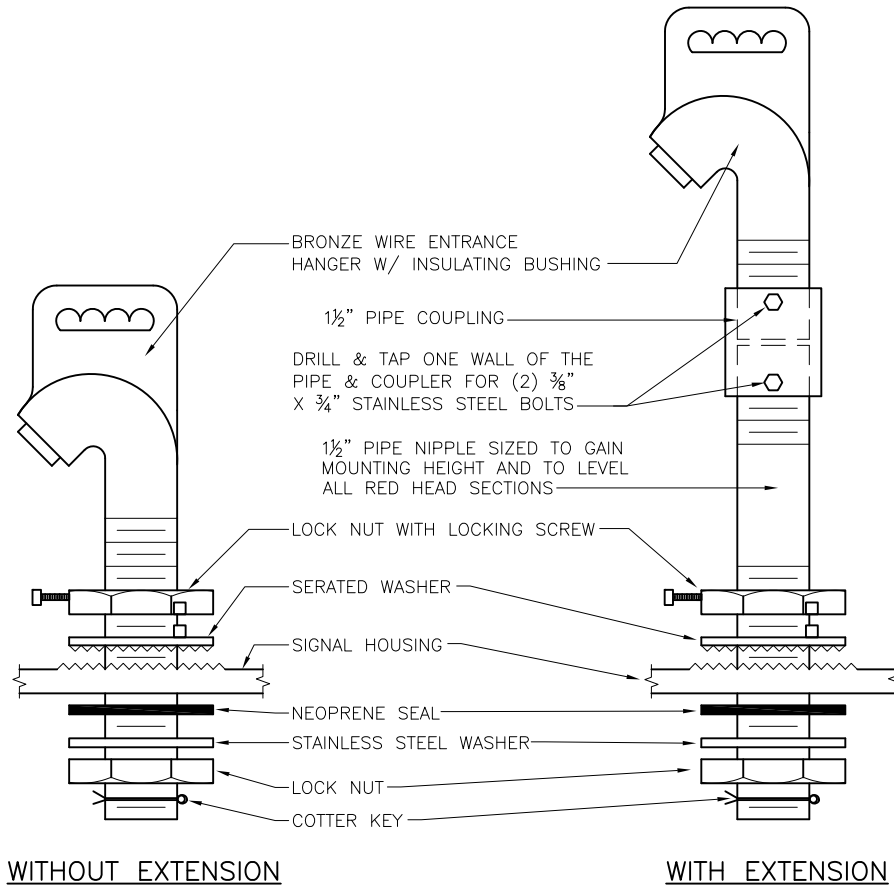

SUSPENDED SIGNAL MOUNTING DETAIL


REF STD SPEC SEC 8-31



City of Seattle

NOT TO SCALE

VEHICULAR SIGNAL MOUNTING

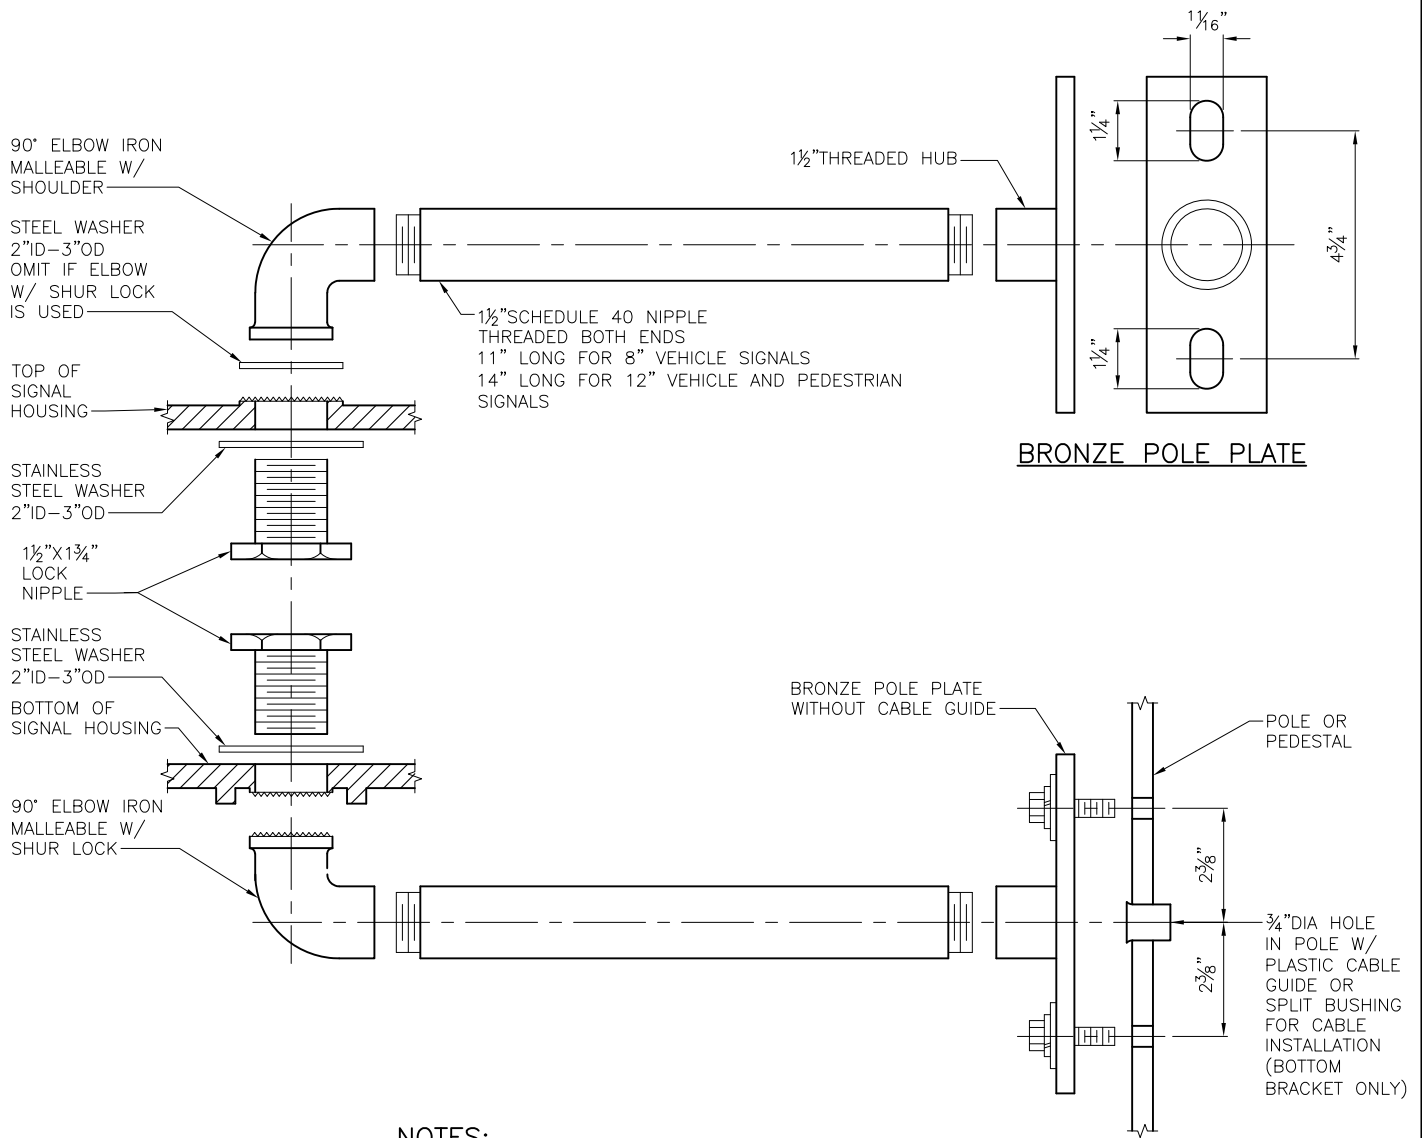

NOTES:

1. ¾"x1½" BOLT, ¾" LOCK WASHER, 7/16"x1¾" WASHER 4 OF EACH REQUIRED PER ASSEMBLY; ALL STAINLESS STEEL.
2. MOUNTING MUST BE AS FOLLOWS:
 - ON METAL POLES THINNER THAN 7 GAUGE, USE ¾" STAINLESS STEEL RIVNUTS.
 - ON METAL POLES 7 GAUGE OR THICKER, DRILL AND TAP FOR ¾" BOLT (STAINLESS STEEL RIVNUTS OPTIONAL).
 - ON POLES FILLED OR MADE WITH CONCRETE USE ¾"x2½" MIN STUD BOLT ANCHORS, SLEEVE TYPE.
 - ON WOOD POLES USE 1½"x2½" LAG BOLTS.


REF STD SPEC SEC 8-31




City of Seattle

NOT TO SCALE

SIGNAL HEAD BRACKET ASSEMBLY

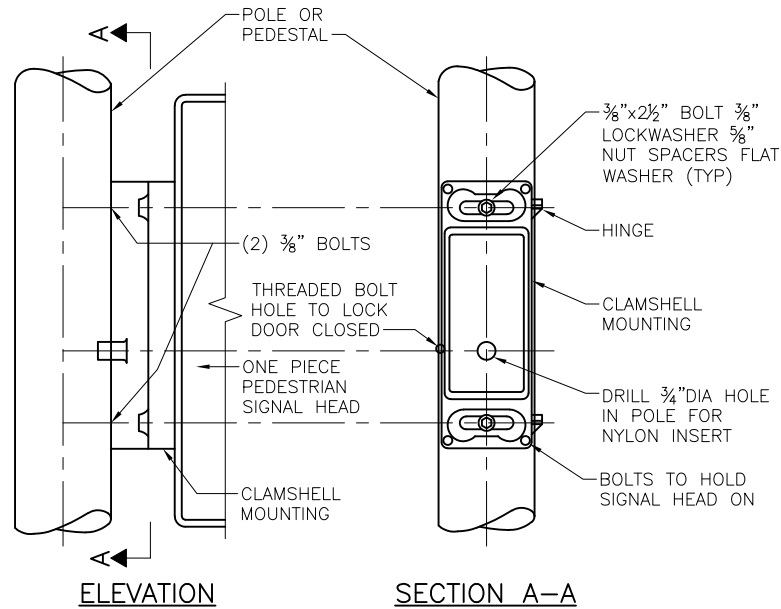

ELEVATION SECTION A-A
METAL POLE MOUNT

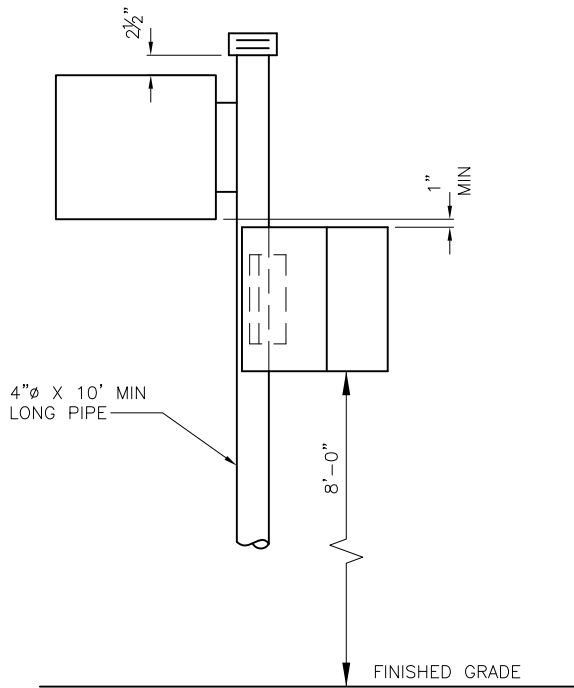

PEDESTAL MOUNT

NOTES:

1. BOLT AND WASHERS MUST BE STAINLESS STEEL PER ASTM A 563 DH AND ASTM F 436
2. MOUNTING MUST BE AS FOLLOWS:
 - ON METAL POLES THINNER THAN 7 GAUGE, USE 3/8" STAINLESS STEEL RIVNUTS
 - ON METAL POLES 7 GAUGE OR THICKER, DRILL AND TAP FOR 3/8" BOLT (STAINLESS STEEL RIVNUTS OPTIONAL)
 - ON POLES FILLED WITH OR MADE FROM CONCRETE USE 3/8"x2 1/2" STUD BOLT ANCHORS WITH HEX NUT
3. FOR STREET NAME SIGN PEDESTAL INSTALLATION, SEE STD PLAN NO 623


REF STD SPEC SEC 8-31



City of Seattle

NOT TO SCALE

PEDESTRIAN SIGNAL
CLAMSHELL MOUNTING

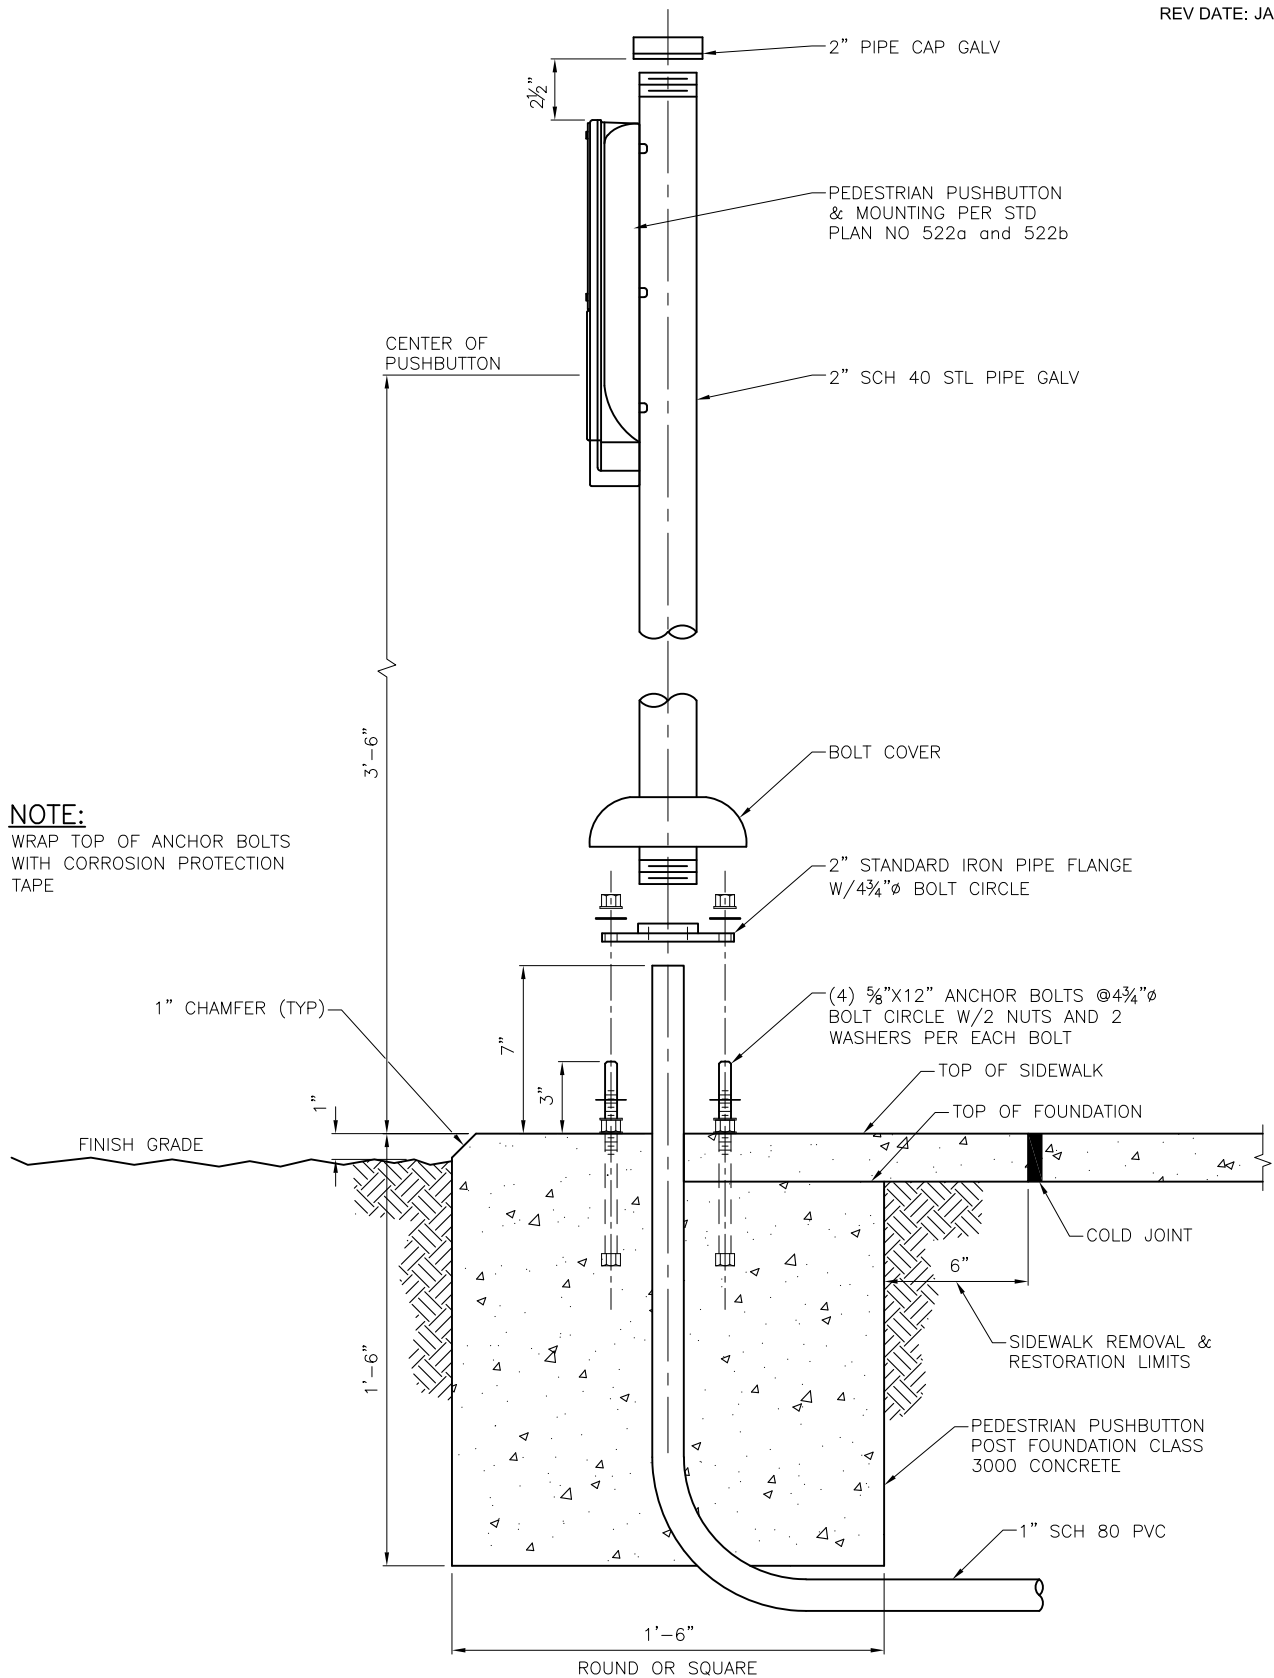


REF STD SPEC SEC 8-31, 8-32




City of Seattle

NOT TO SCALE

PEDESTRIAN PUSHBUTTON POST & FOUNDATION

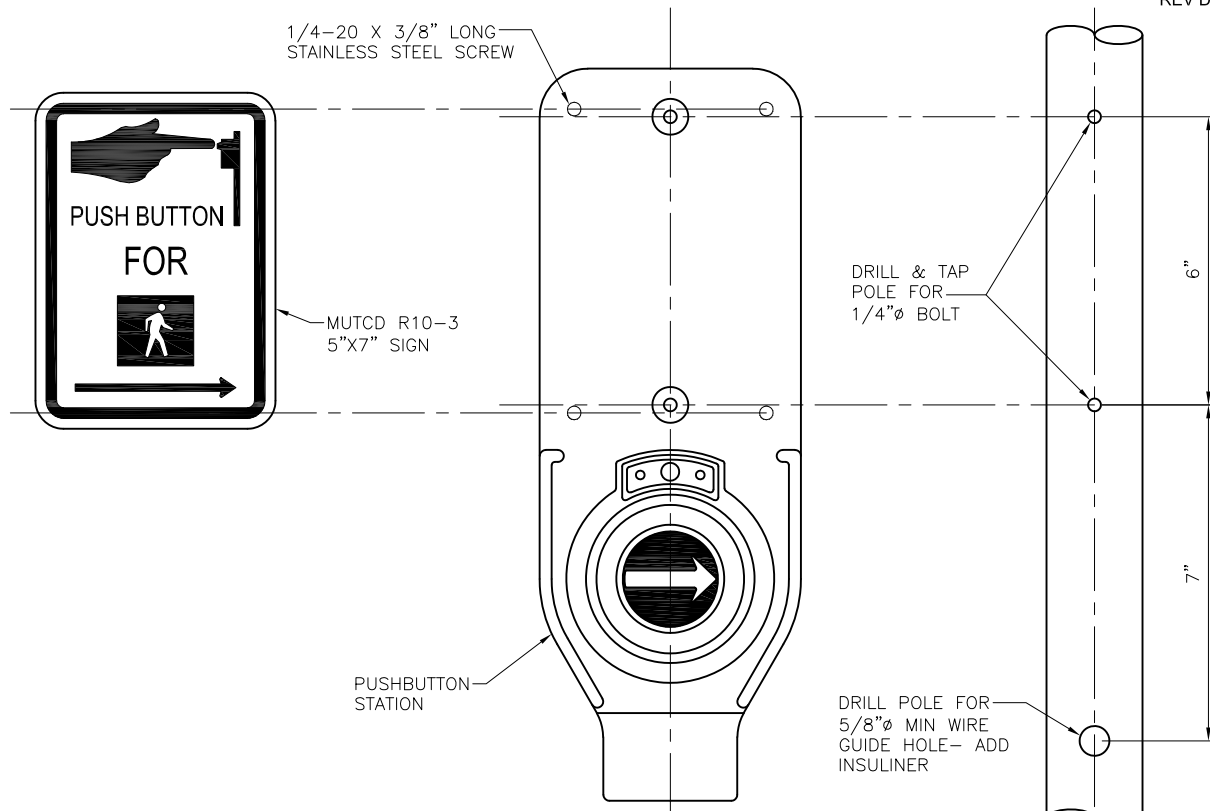

FRONT VIEWS

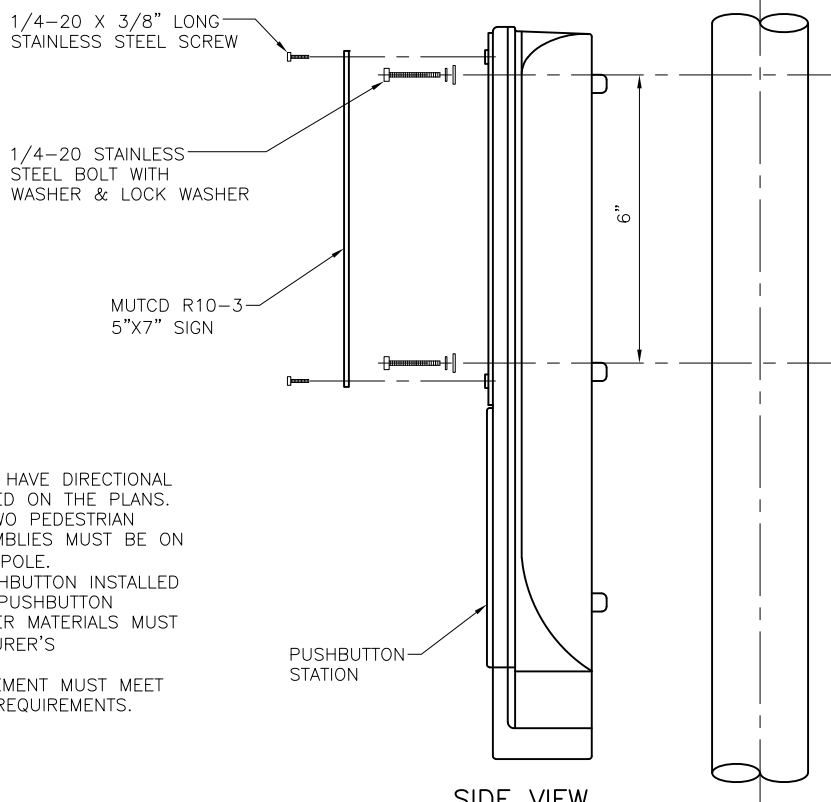

SIDE VIEW

NOTES:

1. PUSHBUTTON MUST HAVE DIRECTIONAL ARROW AS SPECIFIED ON THE PLANS.
2. INSTALLATION OF TWO PEDESTRIAN PUSHBUTTON ASSEMBLIES MUST BE ON A 4"Ø OR LARGER POLE.
3. DETAIL SHOWS PUSHBUTTON INSTALLED ON METAL POLE. PUSHBUTTON INSTALLED ON OTHER MATERIALS MUST BE PER MANUFACTURER'S RECOMMENDATION.
4. PUSHBUTTON PLACEMENT MUST MEET MUTCD AND SDOT REQUIREMENTS.



REF STD SPEC SEC 8-31



City of Seattle

NOT TO SCALE

ACCESSIBLE PEDESTRIAN
SIGNAL (APS)
PED. PUSHBUTTON ASSEM.

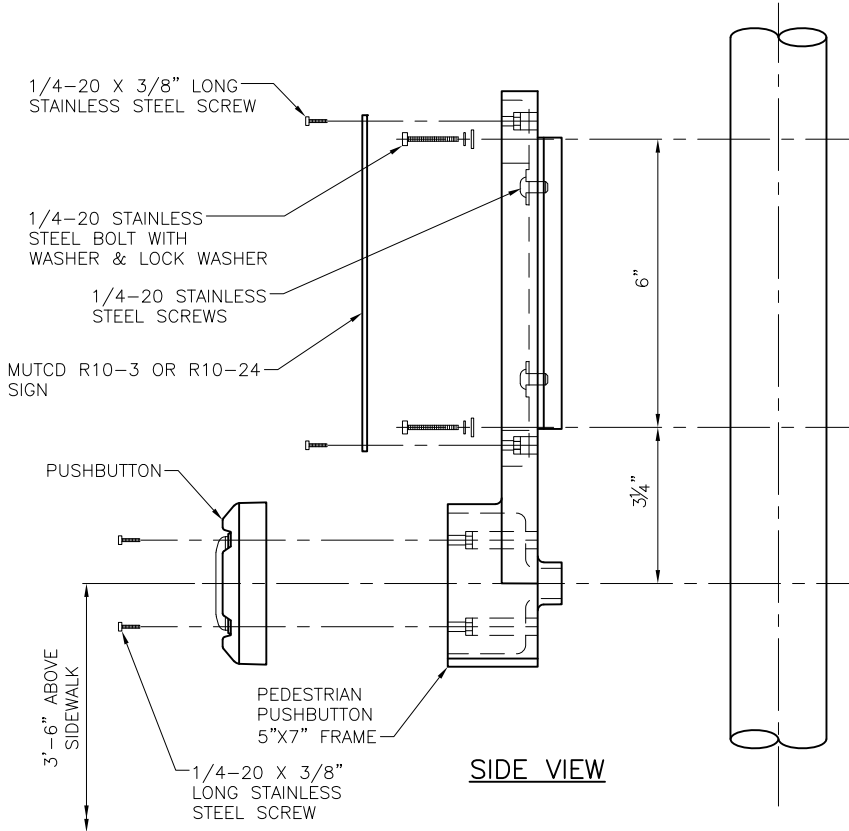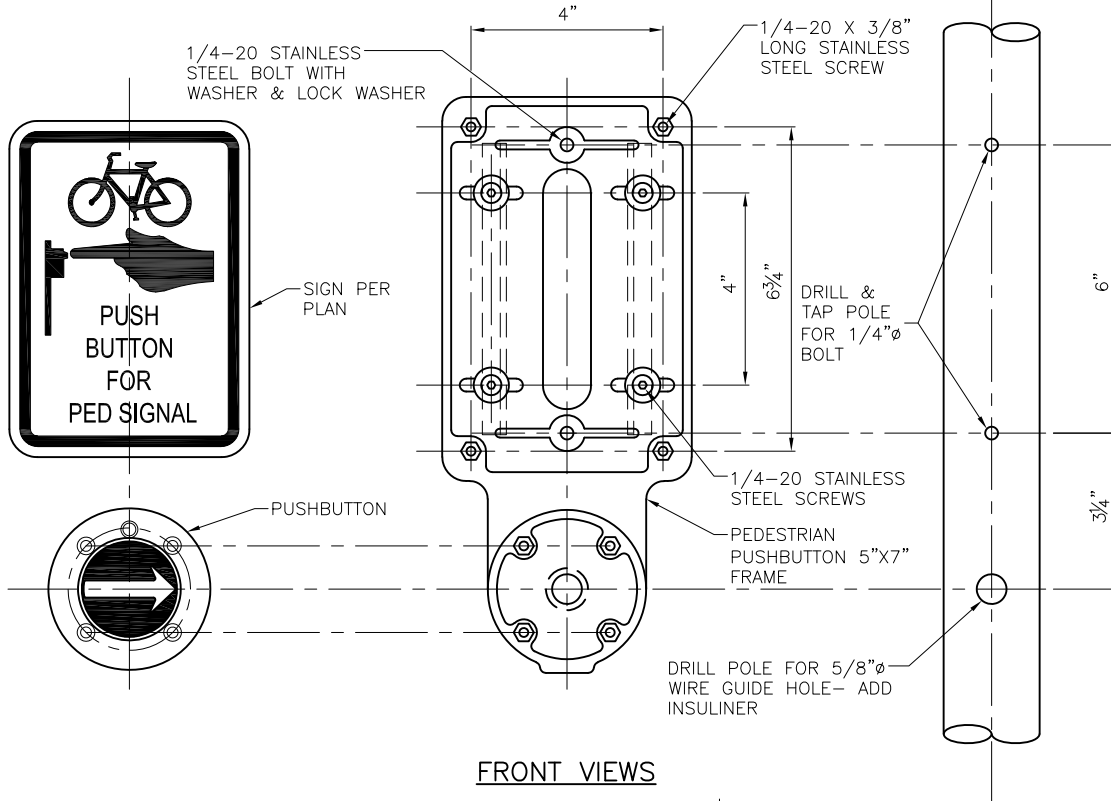

NOTES:

1. PUSHBUTTON MUST HAVE DIRECTIONAL ARROW AS SPECIFIED ON THE PLANS.
2. INSTALLATION OF TWO PEDESTRIAN PUSHBUTTON ASSEMBLIES MUST BE ON A 4"Ø OR LARGER POLE.
3. DETAIL SHOWS PUSHBUTTON INSTALLED ON METAL POLE. PUSHBUTTON INSTALLED ON OTHER MATERIALS MUST BE PER MANUFACTURER'S RECOMMENDATION.
4. THIS PUSHBUTTON ASSEMBLY MUST NOT BE INSTALLED FOR PEDESTRIAN USE UNLESS APPROVED BY THE ENGINEER.


REF STD SPEC SEC 8-31



City of Seattle

NOT TO SCALE



BICYCLE PUSHBUTTON ASSEMBLY

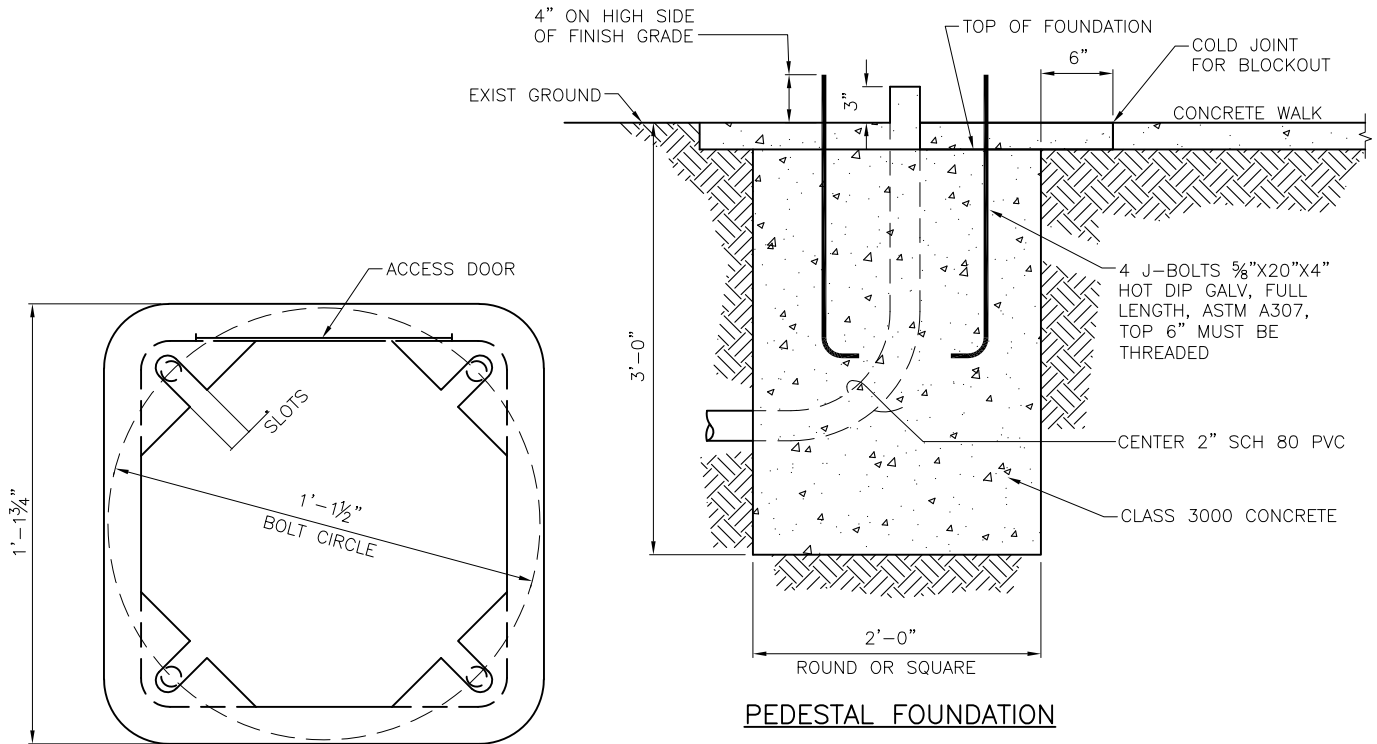

BOTTOM VIEW

NOTES:

1. 3'-0" MIN CLEARANCE IS REQUIRED IN FRONT OF ACCESS DOOR.
2. A POLE AND BASE COLLAR ASSEMBLY IS REQUIRED FOR ALUMINUM PEDESTAL SHAFTS TALLER THAN 10'.

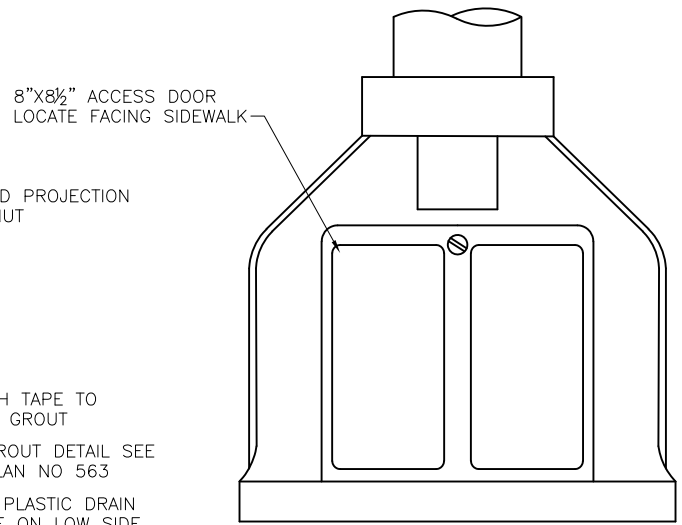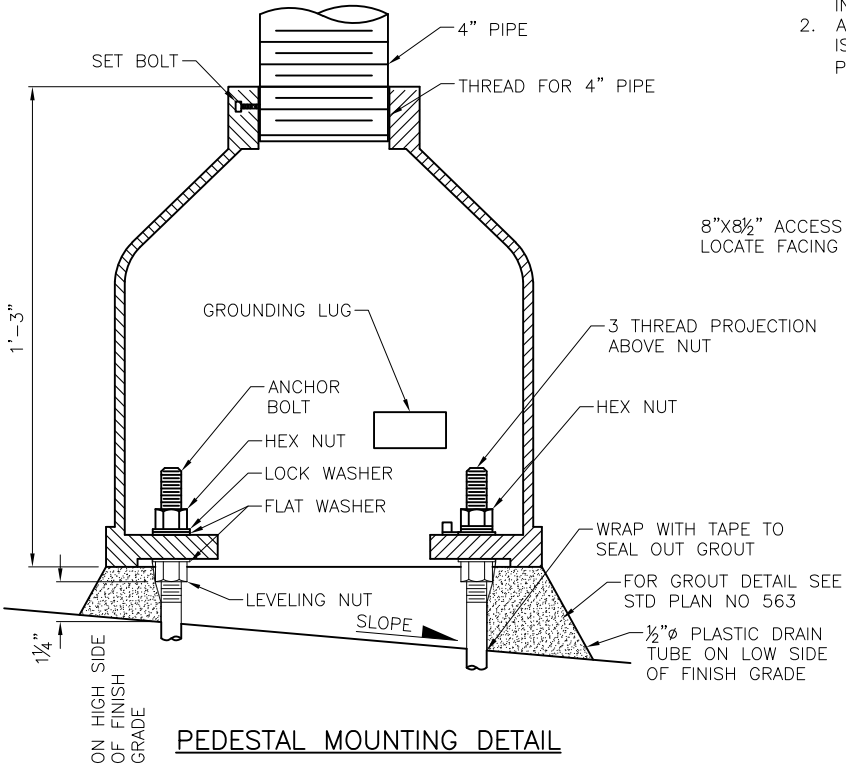

SQUARE BASE PEDESTAL

REF STD SPEC SEC 8-32



City of Seattle

NOT TO SCALE


PEDESTAL & FOUNDATION

TYPICAL SOLAR PANEL LOCATION WHERE SOLAR PANEL IS NOTED IN THE DRAWINGS. SIZE, MOUNTING AND HARDWARE MUST BE PER MANUFACTURER. SEE NOTES 1 & 4.

SIGNS MUST BE MOUNTED WITH STAINLESS STEEL BRACKET PER STD PLAN 616. PROVIDE MINIMUM CLEARANCE BETWEEN SIGN AND CURB OR ROADWAY EDGE PER STD PLAN 621A


(2) W11-15
 (2) LIGHT BAR
 (2) W16-7PL (24"x12") OR
 (2) W16-7PR (24"x12")
 PUSHBUTTON ASSEMBLY SIGN TO BE EITHER R10-25 OR R10-25C (9"x12"), AS NOTED IN DRAWINGS. PUSHBUTTON ASSEMBLY TO BE SIZED TO ACCOMMODATE SIGN. SEE NOTE 7

PEDESTAL POLE PER STD PLAN 524
 SURFACE AND FINISHED GRADE PER DRAWINGS

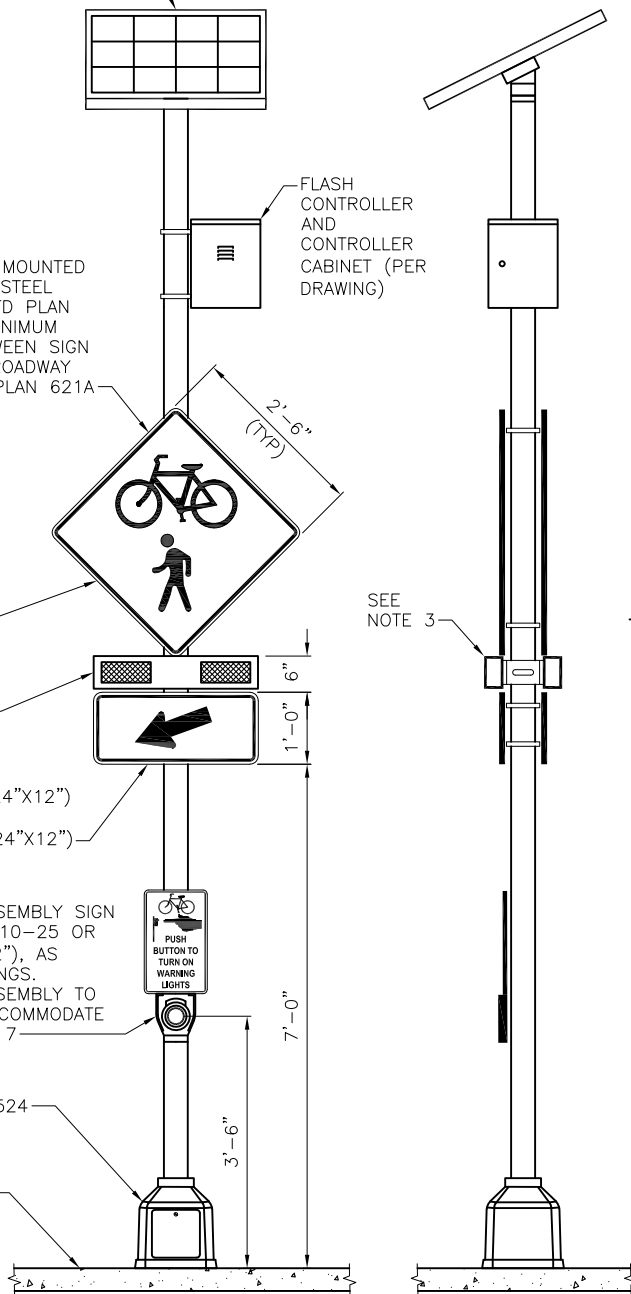

RECTANGULAR RAPID FLASHING BEACON

SIDE VIEW

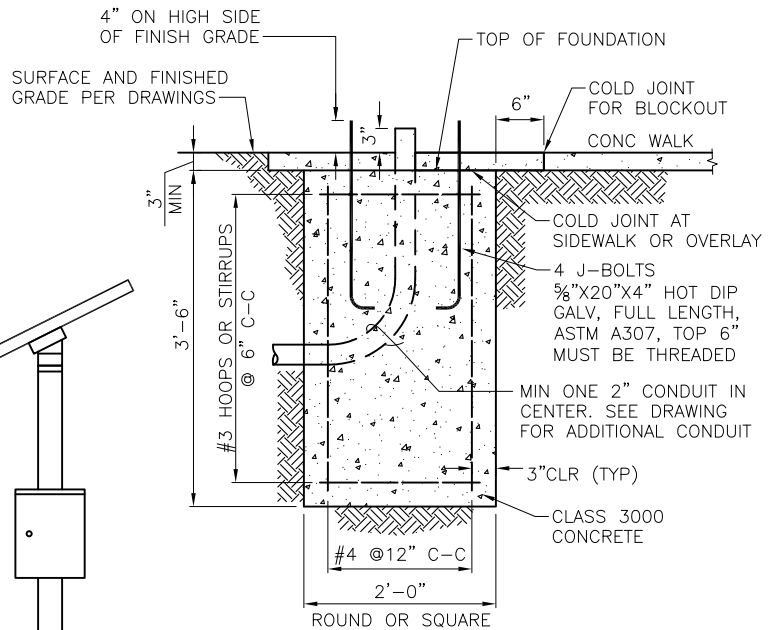

RRFB FOUNDATION

NOTES:

1. RECTANGULAR RAPID FLASHING BEACON MUST BE HARDWIRED TO A SERVICE CABINET UNLESS OTHERWISE NOTED IN THE DRAWINGS.
2. RECTANGULAR RAPID FLASHING BEACON MUST HAVE SIGNS AND LIGHT BAR ON BOTH SIDES OF PEDESTAL, AND BE ORIENTED TO FACE ONCOMING VEHICULAR TRAFFIC UNLESS NOTED OTHERWISE IN DRAWINGS.
3. (1) PEDESTRIAN LED INDICATION, 1/2" (MIN) WIDE X 1-3/4" (MIN) HIGH, MUST BE PROVIDED MOUNTED ON SIDE OF THE LIGHT BAR. PEDESTRIAN LED INDICATION MUST BE DIRECTED TOWARD CROSSWALK AND BE VISIBLE TO PEDESTRIANS IN THE CROSSWALK. WHERE RAPID FLASHING BEACON IS LOCATED IN A MEDIAN, OR SERVES MULTIPLE DIRECTIONS OF PEDESTRIAN TRAVEL, PEDESTRIAN LED INDICATION MUST BE PROVIDED ON BOTH SIDES OF LIGHT BAR.
4. IF A SOLAR PANEL IS INCLUDED ON THE POLE, USING THE STANDARD FOUNDATION SHOWN, THEN MOUNTING HEIGHT OF SOLAR PANEL MUST BE NO MORE THAN 17'-6".
5. FOUNDATION SOILS MUST BE FREE OF LANDFILL OR OTHER SETTLEMENT-PRONE MATERIAL AND GROUNDWATER.
6. ALL REINFORCING BARS MUST BE DEFORMED BILLET STEEL CONFORMING TO ASTM CLASS A706, GRADE 60.
7. PUSHBUTTON TO BE SUPPLIED WITH RECTANGULAR RAPID FLASHING BEACON.


REF STD SPEC SEC



City of Seattle

NOT TO SCALE

RECTANGULAR RAPID FLASHING BEACON

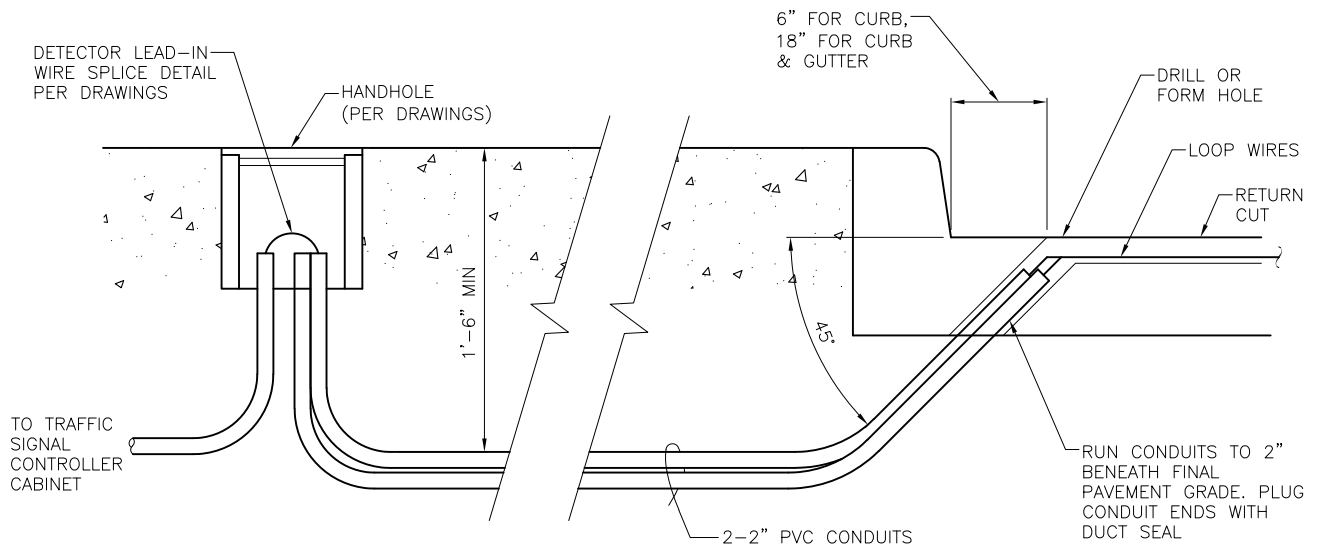

CURB/PAVEMENT ENTRANCE FOR DETECTOR LOOP WIRES

NOTES:

1. SHARP EDGE TOOLS MUST NOT BE USED IN PLACING CONDUCTORS IN SAW CUTS
2. EACH PAIR OF LOOP WIRES IN THE RETURN CUT MUST BE TWISTED A MINIMUM OF 3 TURNS PER FOOT AND MAY SHARE COMMON RETURN CUTS WITH OTHER TWISTED PAIRS MAX 3 LOOPS PER CUT.
3. TAPE LOOP WIRE A MINIMUM OF 2 TURNS AT EACH CORNER
4. REMOVE SHARP CORNER EDGES IN SAW CUTS WHERE LOOP WIRE WILL BE BENT AROUND
5. PERFORM RESISTANCE AND CONTINUITY TESTS PRIOR TO SEALING LOOP WIRES
6. COIL 5'-0" OF LOOP WIRE IN HANDHOLE


REF STD SPEC SEC 8-31




City of Seattle

NOT TO SCALE


DETECTOR LOOP LEAD-IN

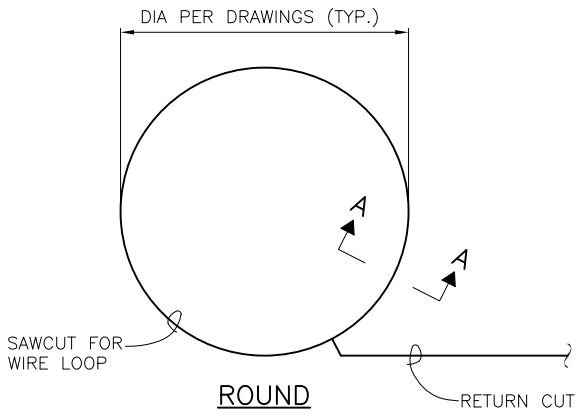

DIPOLE LOOP DETECTOR




WINDING
DETAIL

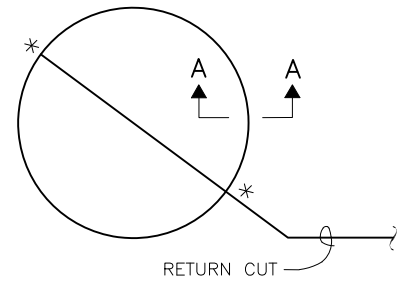


ROUND

QUADRIPOLE LOOP DETECTOR

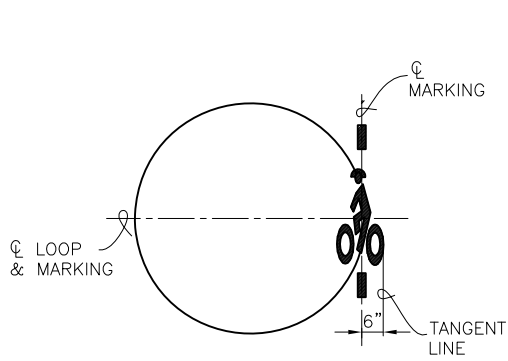

ROUND


BICYCLE DIPOLE

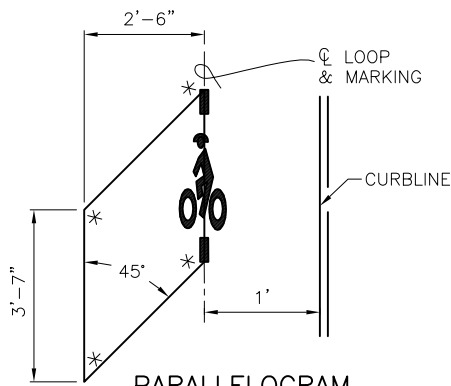

PARALLELOGRAM


***NOTE:**

OVERLAP CUT FOR FULL DEPTH AT CORNERS (TYP) CHIP 1" BACK THEN ROUND OFF CORNERS WHERE LOOP WIRE WILL BE BENT 90° OR LESS.

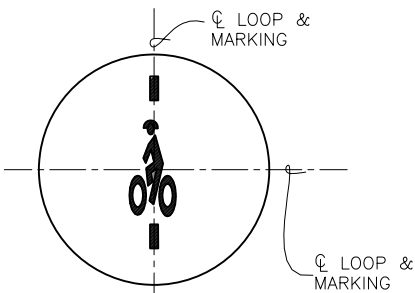


ROUND

BICYCLE QUADRIPOLE

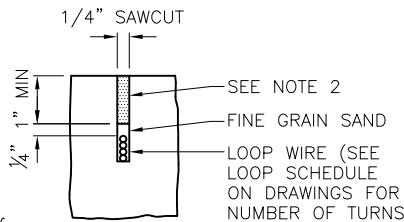

SECTION A-A

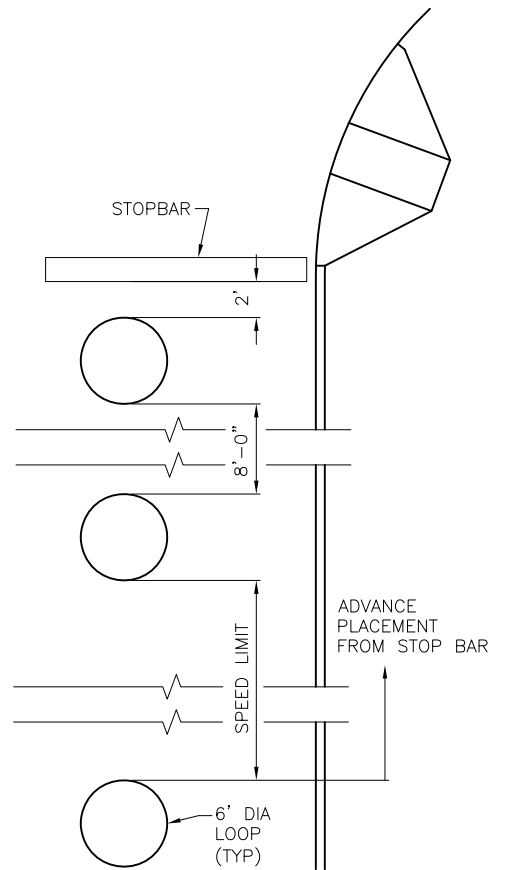

STANDARD LOOP SPACING

NOTES:

1. SEE STD PLAN NO 772 FOR BICYCLE DETECTOR PAVEMENT MARKER DETAIL.
2. FILL CUT AFTER VERTICAL PLACEMENT AND TESTING WITH HOT PAVING GRADE LIQUID ASPHALT ASTM D 312 TYPE III OR QUICK SETTING HIGH STRENGTH GROUT


REF STD SPEC SEC 8-31



City of Seattle

NOT TO SCALE

DETECTOR LOOP DETAILS

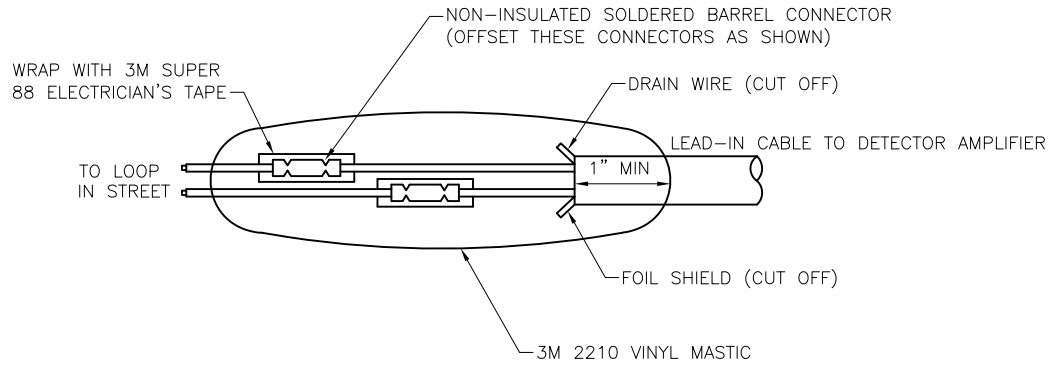

DETECTOR LEAD-IN WIRE SPLICE DETAIL

NOTE:

SOLDER CONNECTION AFTER CRIMPING


REF STD SPEC SEC 8-31



City of Seattle

NOT TO SCALE

DETECTOR LOOP WIRE &
SIGNAL CABLE SPLICE

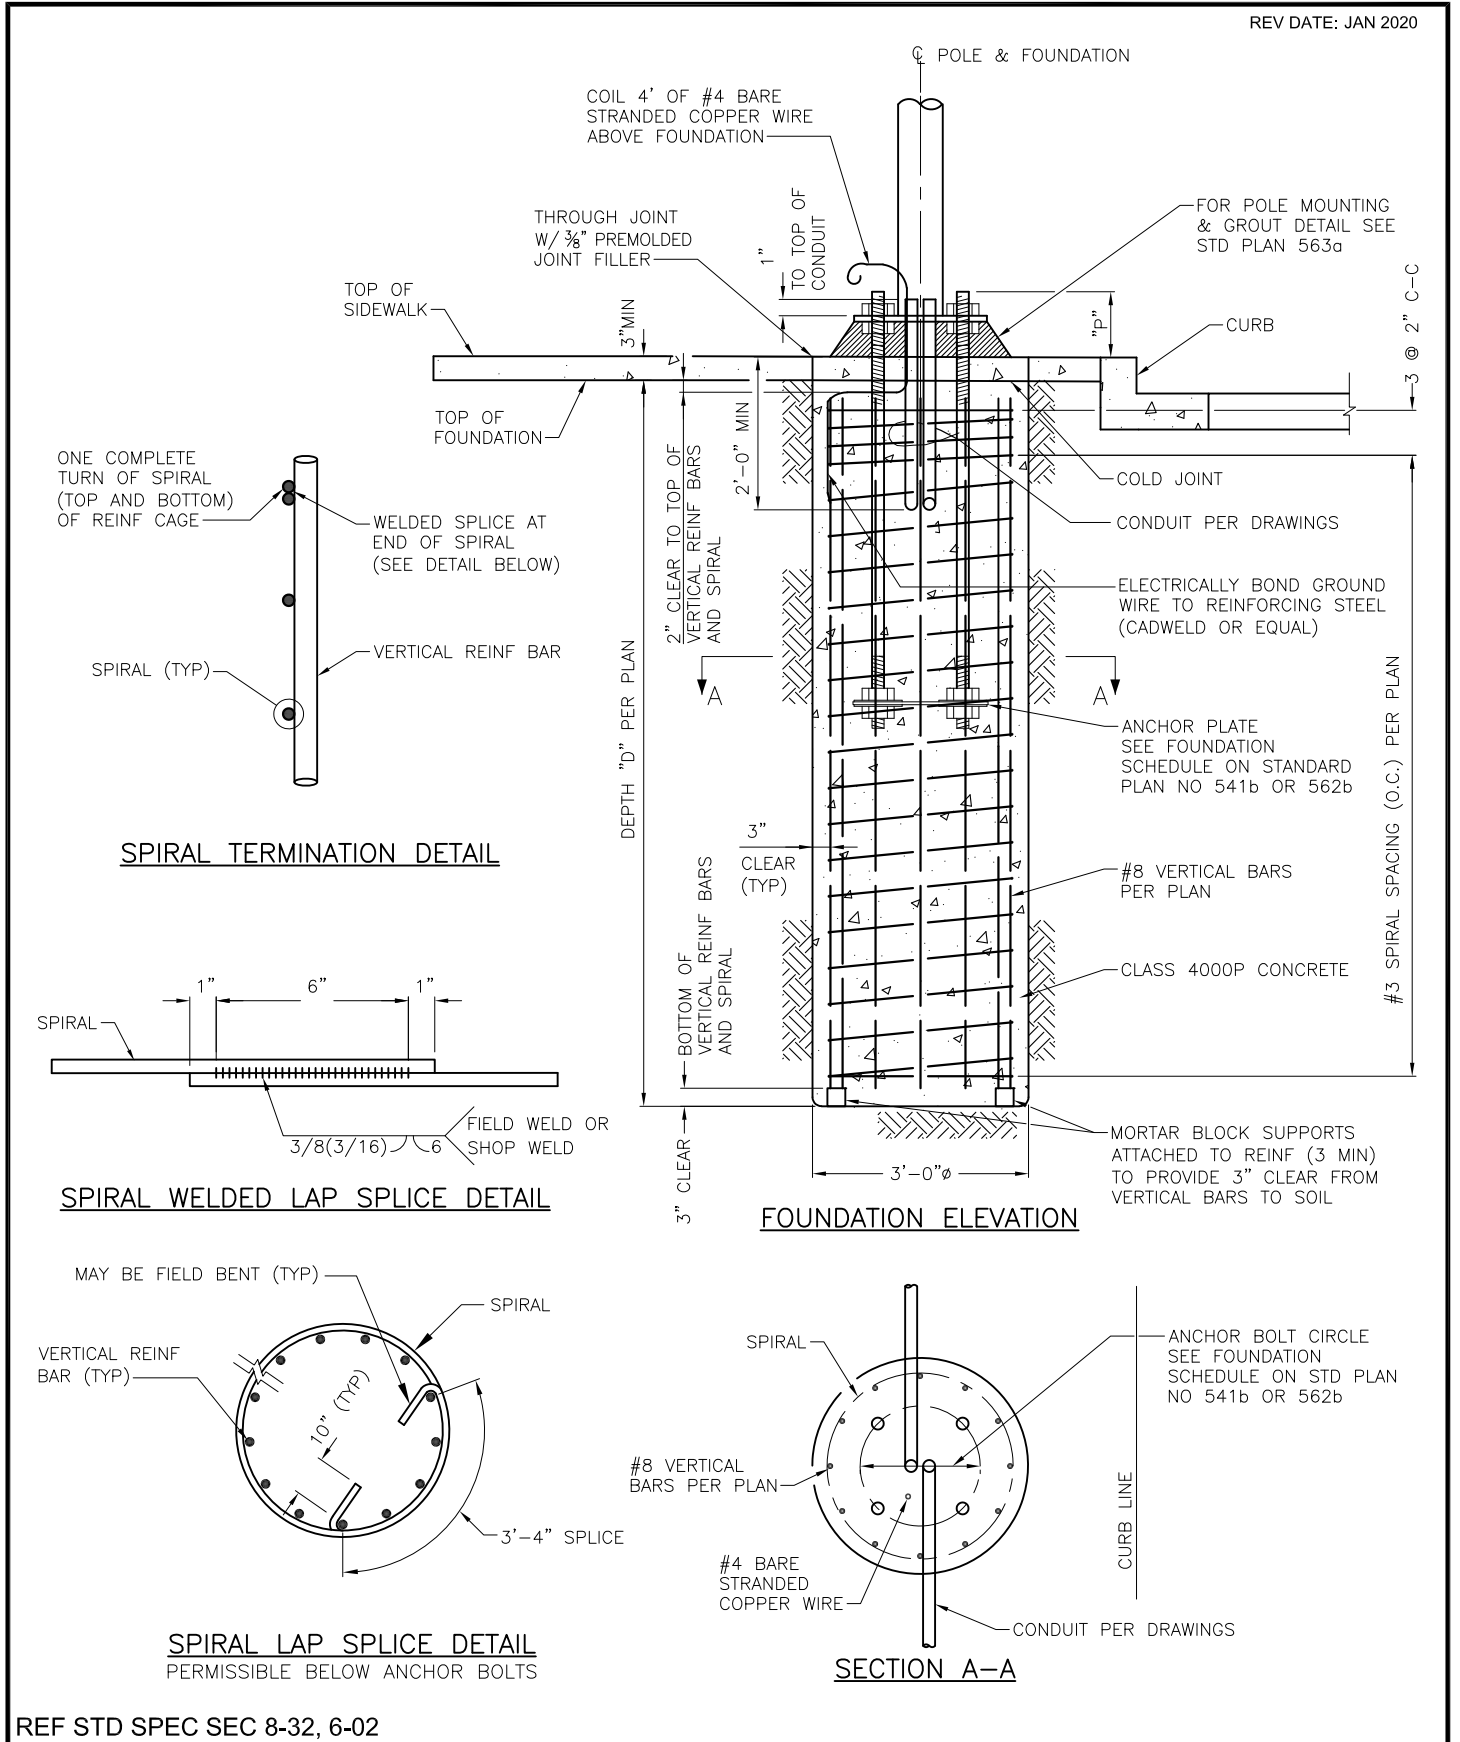

REF STD SPEC SEC 8-32, 6-02




City of Seattle

NOT TO SCALE


TRAFFIC SIGNAL POLE FOUNDATION DETAIL

FOUNDATION SCHEDULE							
POLE TYPE	PROJECTION	ANCHOR BOLTS (TOTAL 4 PER POLE)	ANCHOR PLATE DIMENSIONS				
	P		BOLT CIRCLE DIA	SIZE	BOLT HOLE	CENTER HOLE	CORNER RADIUS
T	7½"	1½" DIA X 60"	14½"	¾" X 16" X 16"	1⅝"	10"	1⅝"
V	9"	1¾" DIA X 72"	18"	¾" X 16" X 16"	1⅞"	12½"	1⅝"
X	10"	2" DIA X 72"	20"	¾" X 18" X 18"	2⅛"	14"	2"
Z	11½"	2½" DIA X 72"	22"	½" X 20" X 20"	2⅝"	15"	2¼"

FOUNDATION PER PLAN. WHERE POLE TYPE OTHER THAN NOTED ABOVE IS REQUIRED, REFER TO PLANS FOR ANCHOR BOLTS AND ANCHOR PLATE DIMENSIONS.

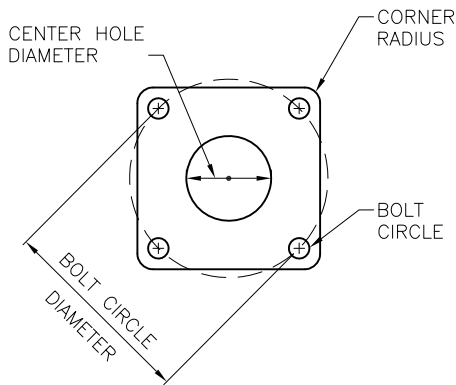

ANCHOR PLATE

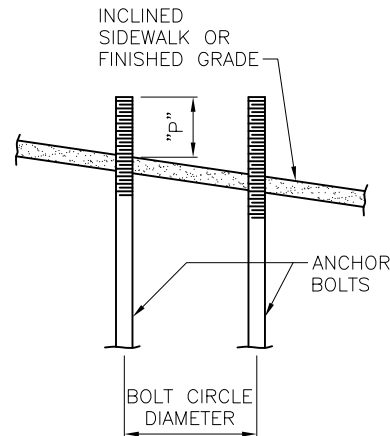

INCLINED CONDITION

NOTES:

1. CONCRETE MUST BE CLASS 4000P.
2. ANCHOR BOLTS FOR TYPE T,V,X AND Z MUST CONFORM TO ASTM F1554 GRADE 105 CLASS 2A THREADS INCLUDING SUPPLEMENTARY REQUIREMENTS S2 THROUGH S4. PROVIDE NUTS ACCORDING TO ASTM A536 HEAVY HEX GRADE DH AND NUTS PER ASTM F436.
3. ANCHOR PLATE: ASTM A36. HOT DIP GALVANIZED PER ASTM A123.
4. ALL REINFORCING BARS MUST BE DEFORMED BILLET STEEL CONFORMING TO ASTM CLASS A706, GRADE 60.
5. ANCHOR BOLTS MUST BE HOT DIP GALVANIZED PER ASTM F2329 INCLUDING NUTS & WASHERS (FULL LENGTH) WITH 18" OF THREADS ON TOP & 12" ON BOTTOM
6. TAPE THE TOP OF ANCHOR BOLTS WITH CORROSION PROTECTION TAPE PER STD SPEC SEC 8-32.3(2)A PRIOR TO POURING CONCRETE.
7. FOUNDATION DEPTH, REINFORCEMENT AND ANCHOR BOLTS MUST BE IN CONFORMANCE WITH "AASHTO STANDARD SPECIFICATIONS FOR STRUCTURAL SUPPORTS FOR HIGHWAY SIGNS, LUMINAIRES AND TRAFFIC SIGNALS" (6TH EDITION, 2013). DESIGN BASIC WIND SPEED IS 85 MPH AND RECURRENCE INTERVAL/DESIGN LIFE IS 50 YEARS


REF STD SPEC SEC 8-32




City of Seattle

NOT TO SCALE


**STRAIN POLE FOUNDATION
SCHEDULE & NOTES
(TYPE T, V, X & Z)**

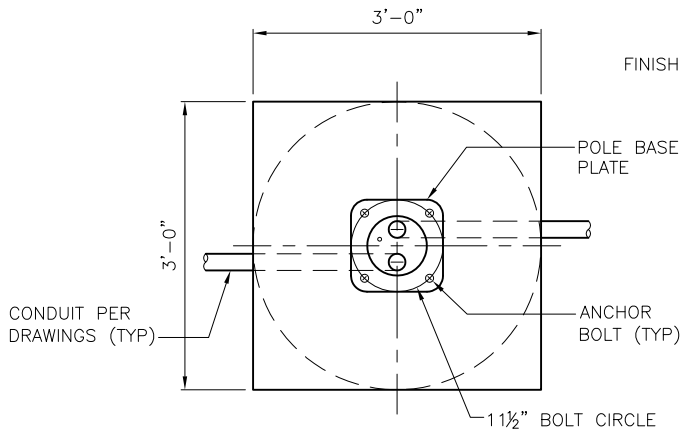


PLAN

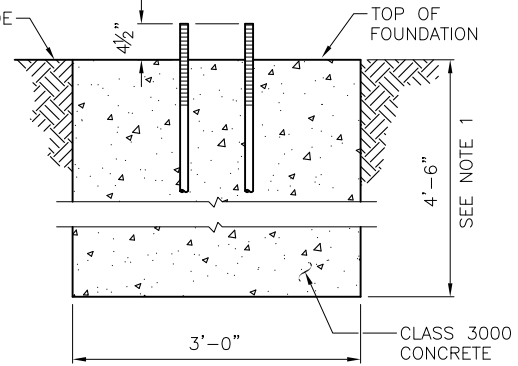

IN EARTH

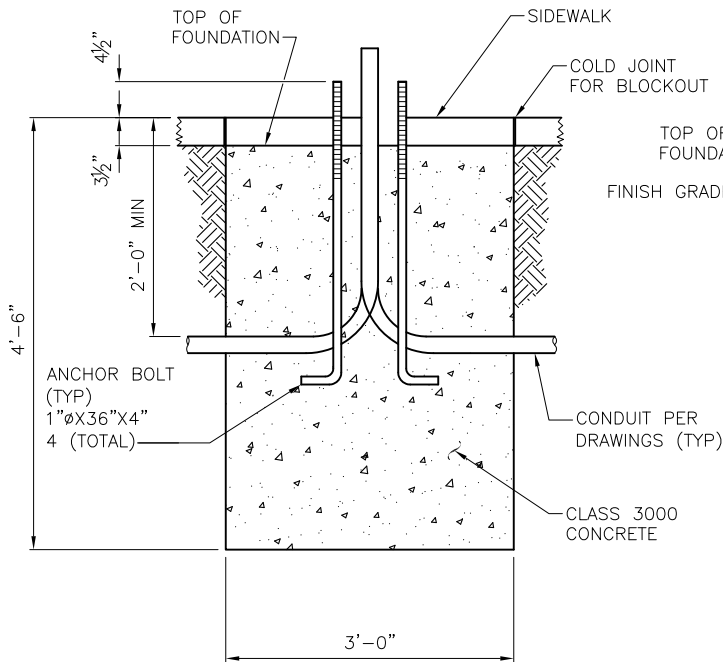

IN SIDEWALK

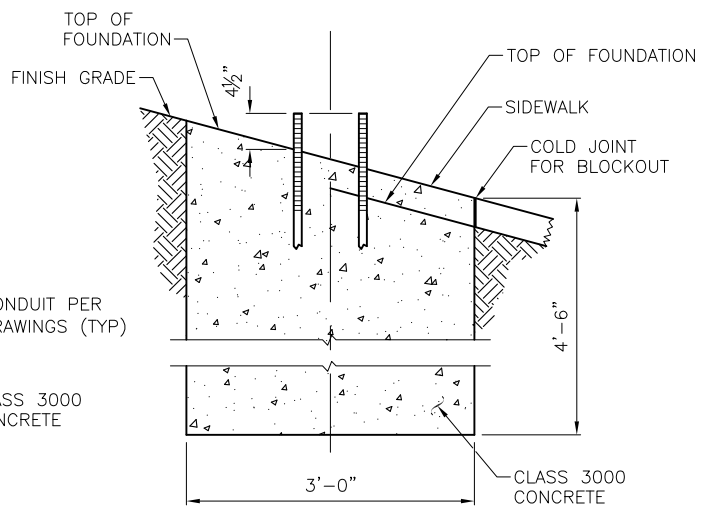

ON AN INCLINE

NOTES:

1. BOLT CIRCLE: 1 1/2" TYP
2. SEE SCL CONSTRUCTION STANDARD 1716.34 FOR POLE MOUNTING AND GROUT DETAIL
3. ANCHOR BOLTS MUST BE HOT DIP GALVANIZED ASTM A153 OR F2329, FULL LENGTH AND FABRICATED FROM ASTM F1554 OR A576 WITH 12" THREADS ON TOP


REF STD SPEC SEC 8-32




City of Seattle

NOT TO SCALE


STREET LIGHT
POLE FOUNDATIONS

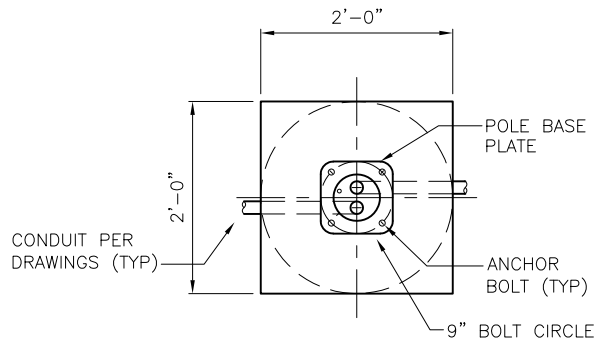


PLAN

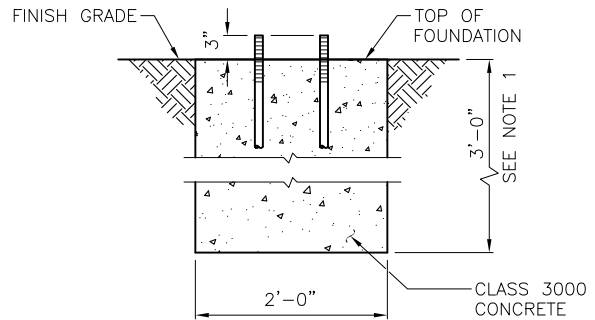

IN EARTH

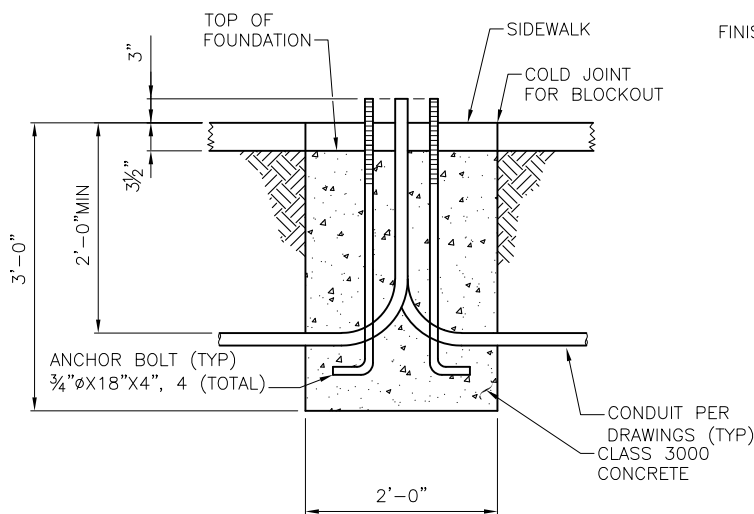

IN SIDEWALK

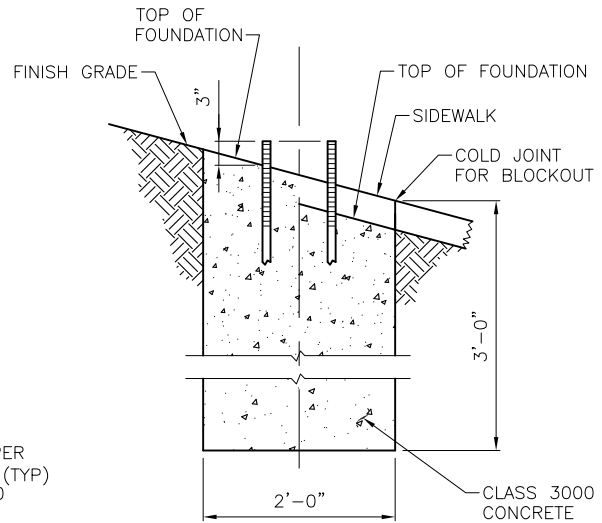

ON AN INCLINE

NOTES:

1. BOLT CIRCLE: 9" TYP
2. SEE SCL CONSTRUCTION STANDARD 1716.34 FOR POLE MOUNTING AND GROUT DETAIL
3. ANCHOR BOLTS MUST BE HOT DIP GALVANIZED TO ASTM A153 OR F2329, FULL LENGTH AND FABRICATED FROM ASTM F1554 OR A576 WITH 8" OF THREADS ON TOP
4. SEE SCL MATERIAL STANDARD 5756.09 FOR POLES
5. SEE SCL CONSTRUCTION STANDARD 1716.07 FOR STREETLIGHT HANDHOLE AND CONDUIT REQUIREMENTS.

REF STD SPEC SEC 8-32



City of Seattle

NOT TO SCALE


PEDESTRIAN STREET LIGHT
POLE FOUNDATIONS

NOTES:


1. THE COVER MUST HAVE 1/16" TO 1/8" CLEARANCE ON EACH EDGE WITHIN THE FRAME AFTER GALVANIZING.
2. THE GROUND ROD MUST EXTEND 4" ABOVE THE BOTTOM OF THE HANDHOLE OR MINERAL AGGREGATE.
3. TYPE 1, 2, 3, 5 & 6 HANDHOLE COVERS MUST HAVE "SDOT" OR "SL" ON THEM, AS APPROPRIATE.
4. TYPE 4 HANDHOLE MUST BE INSTALLED IN ROADWAYS, PARKING LOTS, ETC.
5. FOR PAVEMENT DEPTH GREATER THAN 7" USE FRAME EXTENSIONS (SEE STD PLAN NO 231) TO BRING THE COVER UP TO THE LEVEL OF THE FINISHED PAVEMENT WITHOUT EMBEDDING THE BOTTOM FLANGE OF THE CASTING IN THE PAVEMENT.
6. A 4' LENGTH OF #6 THWN OR THHN COPPER WIRE MUST BE SECURED FROM THE HANDHOLE COVER TO THE FRAME. BOND FROM FRAME LID, AND LID TO GROUND ROD.
7. ALL HANDHOLE COVERS AND FRAMES MUST HAVE A NON-SKID SURFACE (SEE STD SPEC SEC 9-34.6)
8. ALL HANDHOLES MUST HAVE A LOAD RATING OF H20.
9. GROUND ROD REQUIRED IN ALL STREETLIGHT HANDHOLES PER SCL CONSTR STD 1714.50
10. SEE SCL CONSTRUCTION STANDARD 1716.07 & SCL MATERIAL STD 7203.10 FOR STREETLIGHT HANDHOLE AND CONDUIT REQUIREMENTS.

HANDHOLE SCHEDULE


HANDHOLE TYPE	TOP UNIT INSIDE DIMENSION			EXTENSION UNIT(E)	COVER DIMENSIONS	
	L	W	H		L	W
1	10"	13"	12"	12"	17 7/8"	12 7/8"
2	28"	17"	12"	12"	27 7/8"	16 7/8"
3	36"	24"	12"	12"	35"	24"
4	24"Ø		VAR	NA	NA	NA
5	36"	24"	32"	NA	35"	24"
6	42"	42"	38 1/2"	NA	33 1/2"	33 3/4"
GRHH	8"Ø			NA		

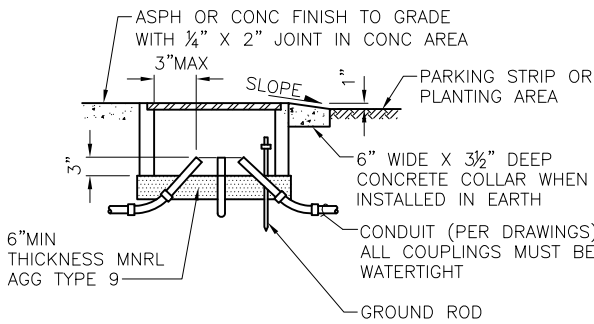


HANDHOLE INSTALLATION DETAIL

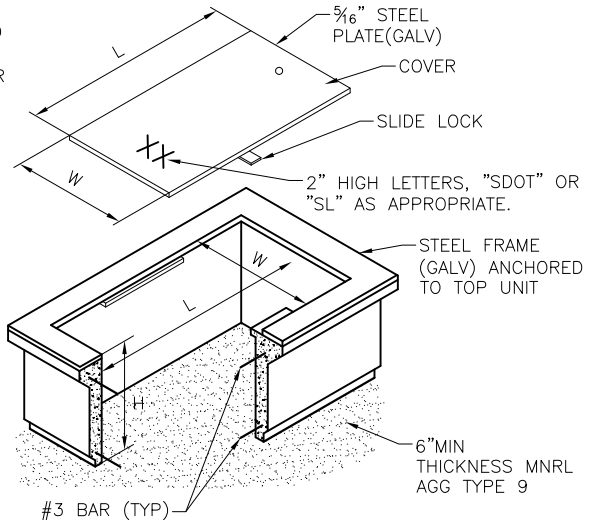


TYPE 1 & 2 HANDHOLE

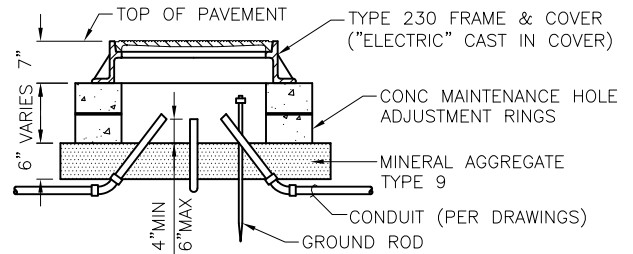

TYPE 4 HANDHOLE
 TRAFFIC BEARING

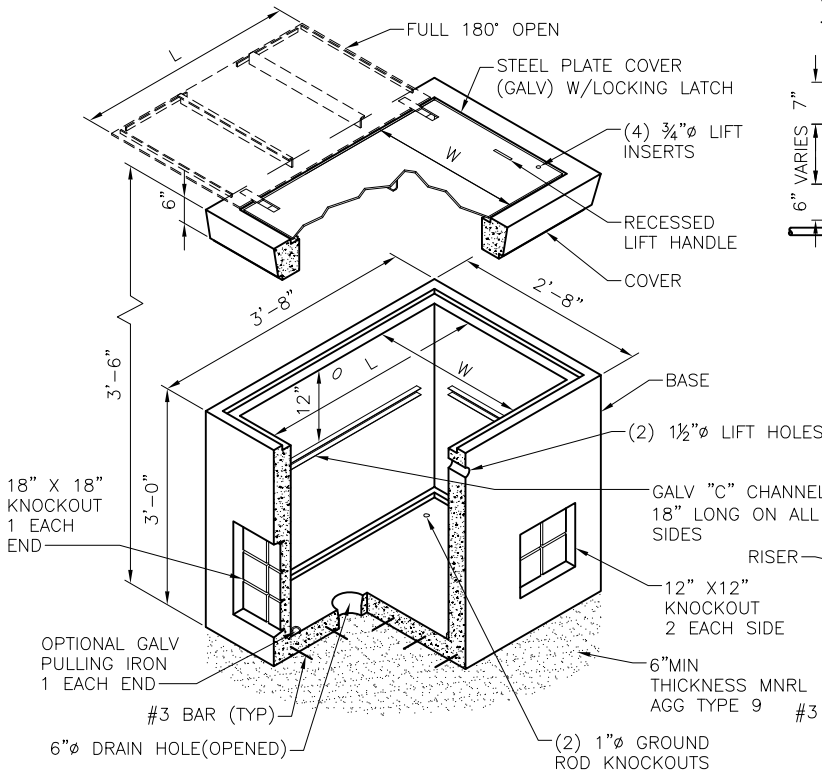

TYPE 5 HANDHOLE

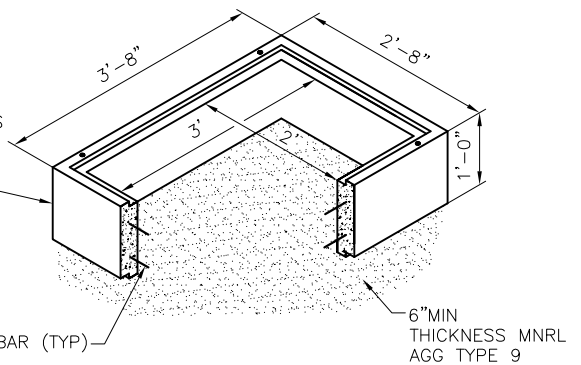

TYPE 3 HANDHOLE
 (COVER SAME AS TYPE 5)


REF STD SPEC SEC 8-33




City of Seattle

NOT TO SCALE

HANDHOLES

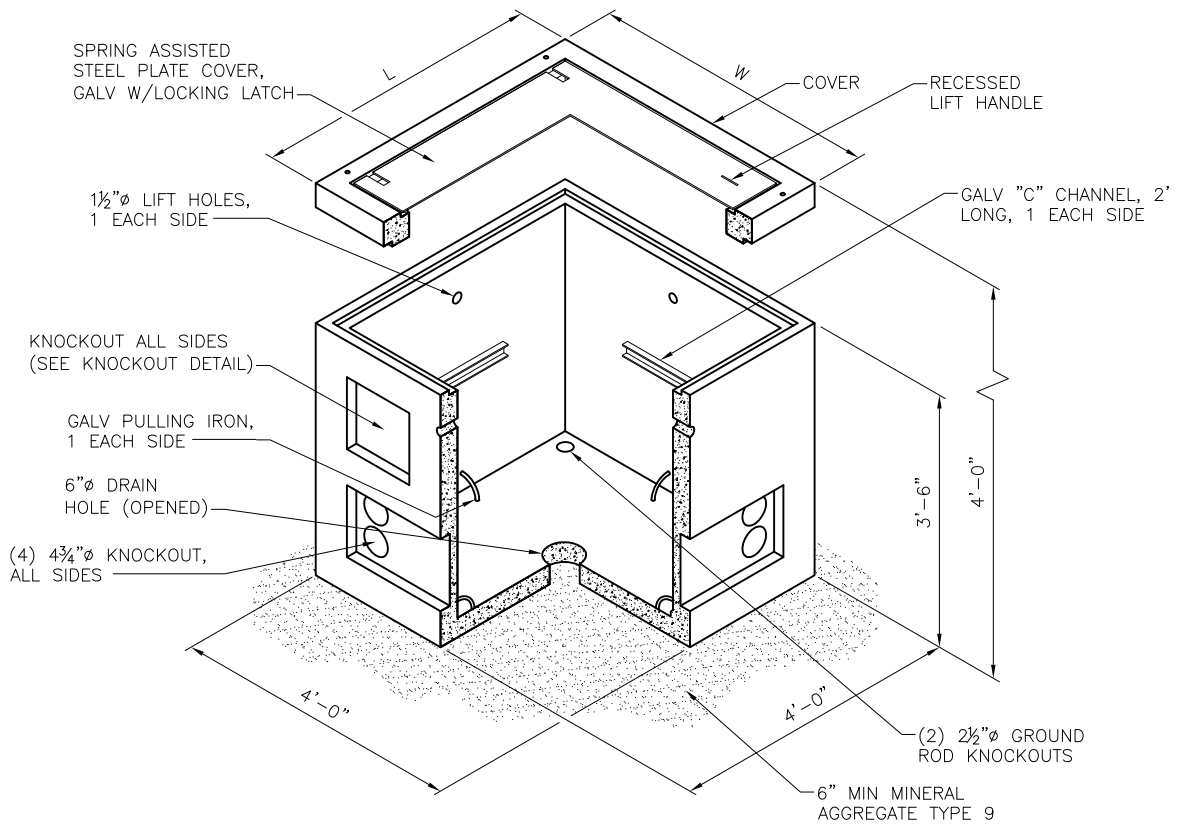

TYPE 6 HANDHOLE

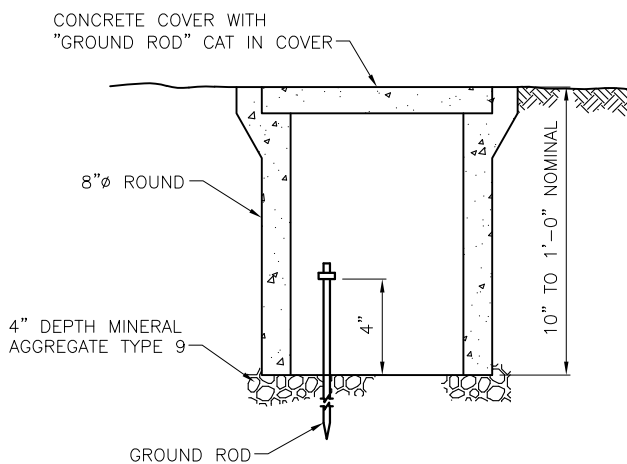

GROUND ROD HANDHOLE (GRHH)

NOTES:

1. ALL HANDHOLES MUST HAVE A H2O LOAD RATING.
2. ALL HANDHOLE COVERS AND FRAMES MUST HAVE A NON-SKID SURFACE (SEE STD SPEC SEC 9-34.6)

REF STD SPEC SEC 8-33



City of Seattle

NOT TO SCALE


HANDHOLES

NOTES:


1. ALL NON-DELIBERATE TRAFFIC PULL BOX COVERS MUST COMPLY WITH ALL TEST PROVISIONS OF ANSI/SCTE 77 2010 "SPECIFICATION FOR UNDERGROUND ENCLOSURE INTEGRITY", & MUST MEET THE TIER 15 APPLICATION. MARKING SHOWING THE TIER 15 RATING MUST BE EMBOSSED IN THE TOP SURFACE OF THE COVER.
2. ALL NON-DELIBERATE TRAFFIC PULL BOXES MUST COMPLY WITH ALL TEST PROVISIONS OF ANSI/SCTE 77 2012 "SPECIFICATION FOR UNDERGROUND ENCLOSURE INTEGRITY", & MUST MEET THE TIER 22 APPLICATION. MARKINGS SHOWING THE TIER 22 RATING MUST BE LABELED OR STENCILED ON THE INSIDE & OUTSIDE OF THE BOX.
3. ALL NON-DELIBERATE TRAFFIC PULL BOXES & COVERS MUST BE MADE OF POLYMER CONCRETE WITH FIBERGLASS REINFORCEMENT. THE BOX MUST HAVE CONTINUOUS FIBERGLASS CLOTH REINFORCEMENT ON THE INSIDE & OUTSIDE PERIMETERS. THE COVER MUST HAVE A MINIMUM OF TWO LAYERS OF FIBERGLASS CLOTH REINFORCEMENT.
4. ALL NON-DELIBERATE TRAFFIC PULL BOXES & COVERS MUST BE TESTED & CERTIFIED, MEETING ALL TEST PROVISIONS ON THE ANSI/SCTE 77, TO THE 66WF, MEETING ALL TEST PROVISIONS OF THE LATEST REVISION OF ANSI/SCTE 77.
5. PULL SLOTS MUST BE RATED FOR MINIMUM PULL OUT OF 3,000 POUNDS.
6. TYPE 4 HANDHOLE MUST BE INSTALLED IN ROADWAYS PARKING LOTS, ETC. ALL COVERS MUST BE COMPLETE WITH A MOLDED LOGO, MANUFACTURERS NAME & TIER RATING LOGO (NO GLUE IN LOGO). LOGO MUST READ "SDOT" OR "SL" UNLESS STATED OTHERWISE BY THE CITY OF SEATTLE.
7. THE GROUND ROD MUST EXTEND 4" ABOVE THE BOTTOM OF THE HANDHOLE OR MINERAL AGGREGATE.
8. FOR PAVEMENT DEPTH GREATER THAN 7" USE FRAME EXTENSIONS (SEE STD PLAN NO 231) TO BRING THE COVER UP THE THE LEVEL OF THE FINISHED PAVEMENT WITHOUT EMBEDDING THE BOTTOM FLANGE OF THE CASTING IN THE PAVEMENT.
9. A 4' LENGTH OF #6 THWN OR THHN COPPER WIRE MUST BE SECURED FROM THE HANDHOLE COVER TO THE FRAME. WITH A 4'-0" LENGTH FROM FRAME THAT CAN BE HOOKED UP TO A GROUND ROD.
10. ALL HANDHOLE COVERS AND FRAMES MUST HAVE A NON-SKID SURFACE (SCL MATERIAL STANDARD 7203.10)
11. SEE SCL CONSTRUCTION STANDARD 1716.07 FOR STREET HANDHOLE AND CONDUIT REQUIREMENTS.

HANDHOLE SCHEDULE


HANDHOLE TYPE	TOP UNIT INSIDE DIMENSION			EXTENSION UNIT(E) H	COVER DIMENSIONS	
	L	W	H		L	W
1	24"	13"	12"	12"	24"	13"
2	30"	17"	12"	12"	30"	17"
3	36"	24"	18"	12"	36"	24"
4	24"Ø	VAR	NA	NA	NA	NA
5	30"	48"	36"	NA	30"	48"
6	48"	48"	48"	NA	48"	48"
GRHH	8"Ø			NA		

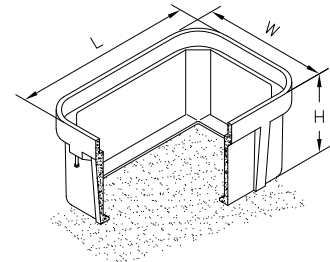

TYPE 3 HANDHOLE
(COVER SAME AS TYPE 5)

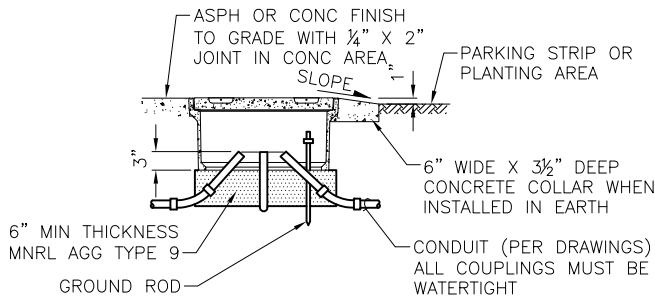

HANDHOLE INSTALLATION DETAIL

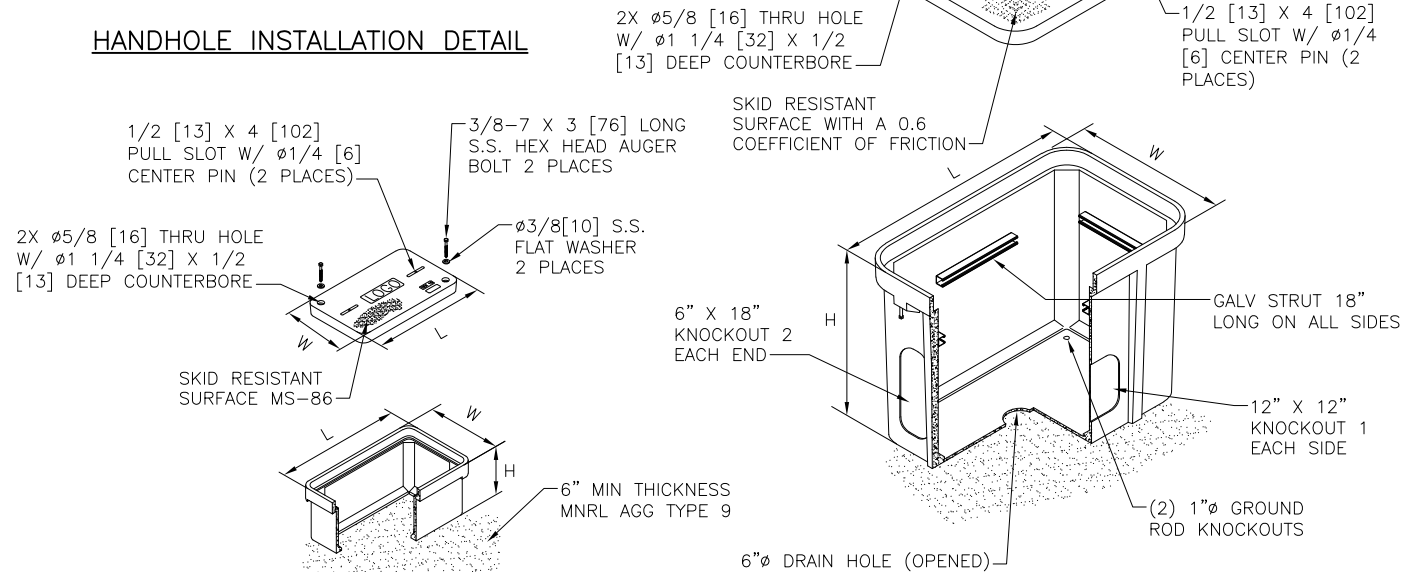

TYPE 1 & 2 HANDHOLE

TYPE 5 HANDHOLE


REF STD SPEC SEC 8-33



City of Seattle

NOT TO SCALE

POLYMER CONCRETE HANDHOLES

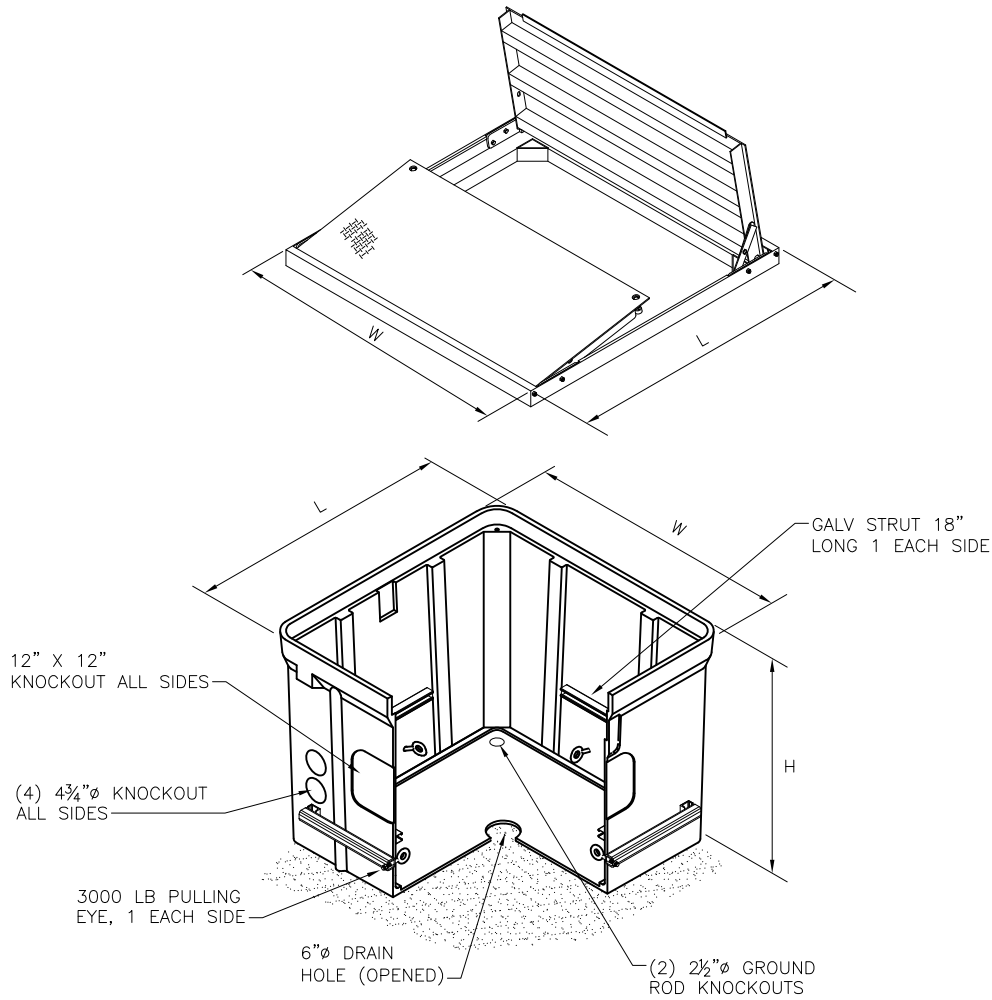

TYPE 6 HANDHOLE

NOTES:

1. FOR DETAILS NOT SHOWN, SEE STD PLAN NO 550b
2. ALL HANDHOLE COVERS AND FRAMES MUST HAVE A NON-SKID SURFACE (SEE STD SPEC SEC 9-34.6)


REF STD SPEC SEC 8-33



City of Seattle

NOT TO SCALE

POLYMER CONCRETE
HANDHOLES

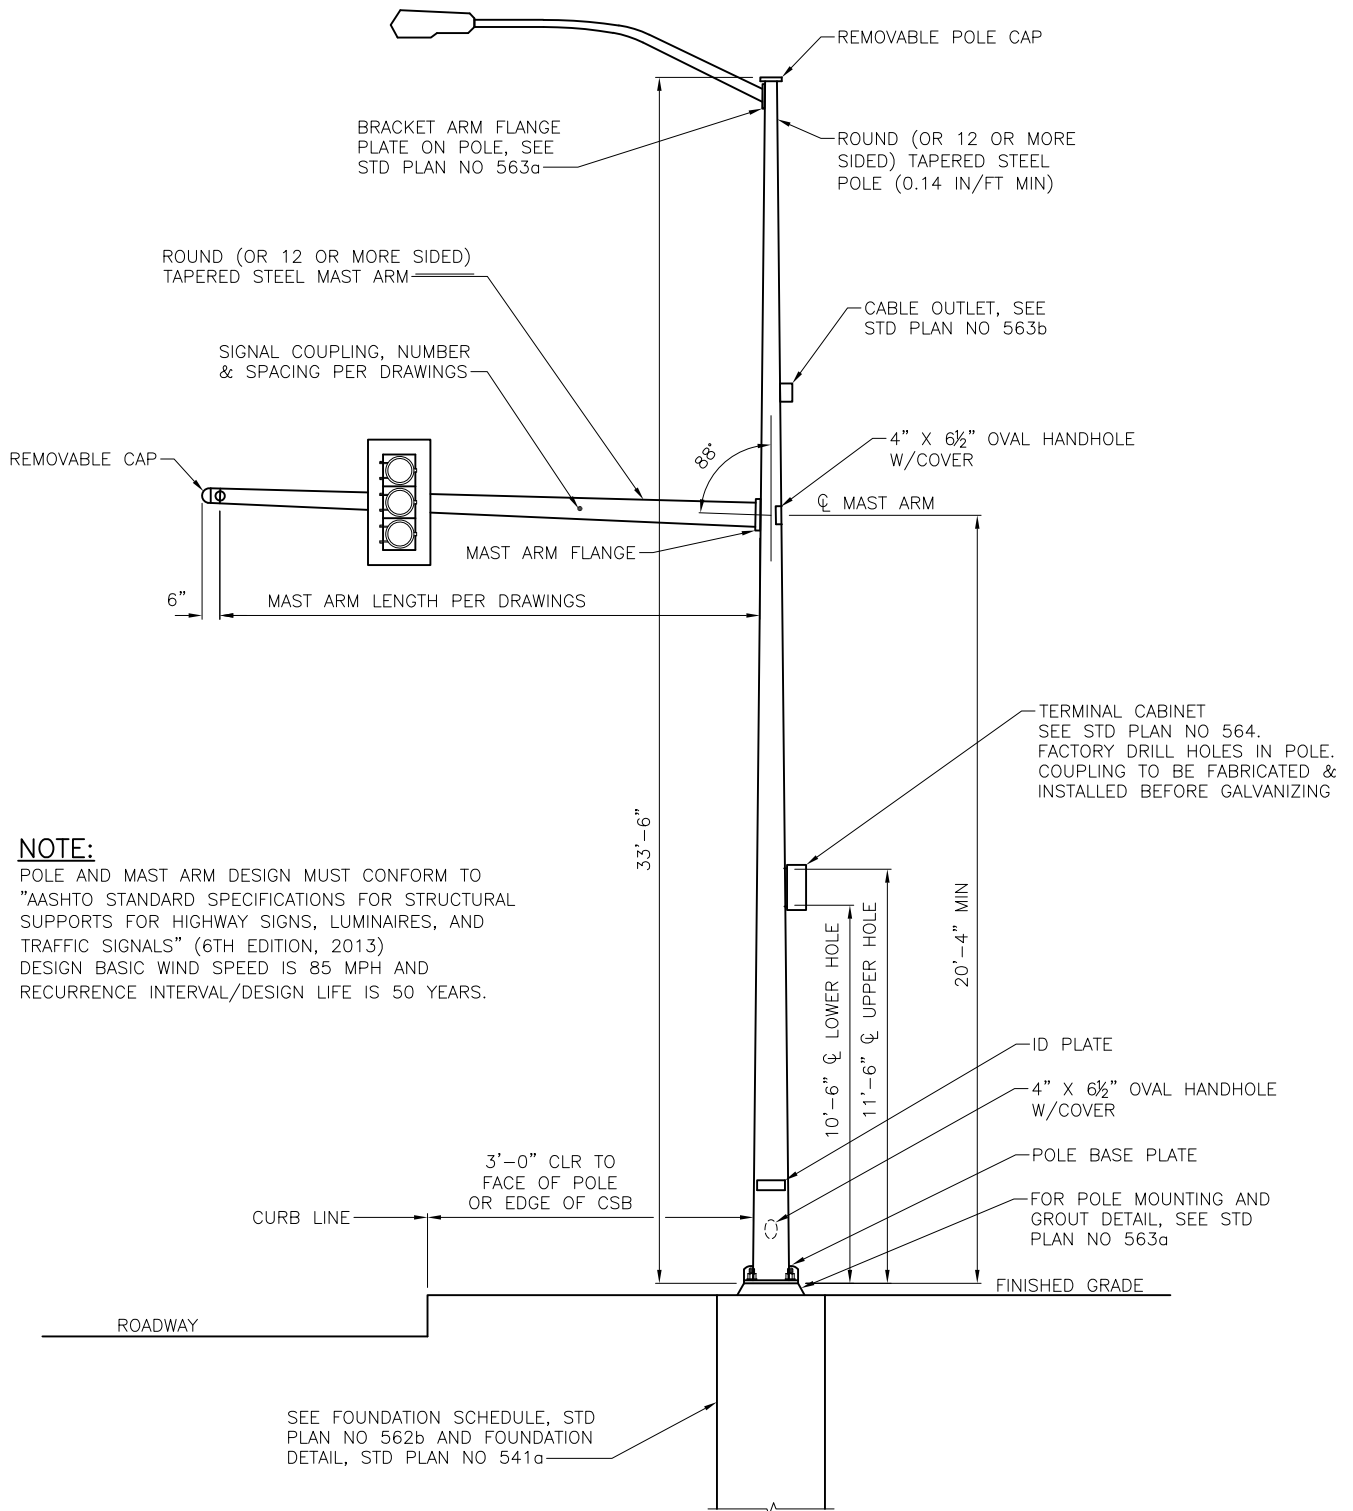


REF STD SPEC SEC 8-32




City of Seattle

NOT TO SCALE

STEEL MAST ARM POLE

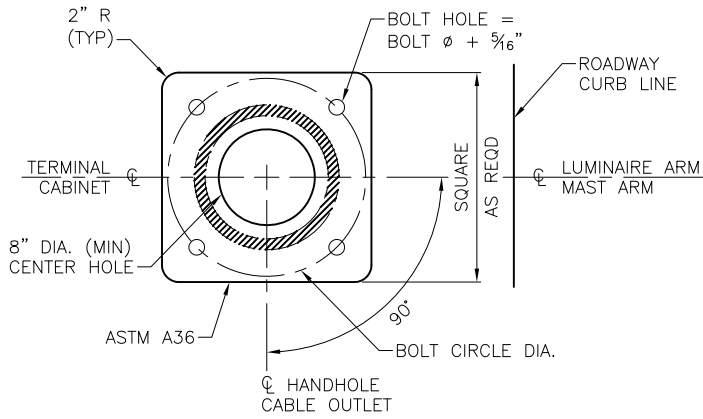


POLE BASE PLATE

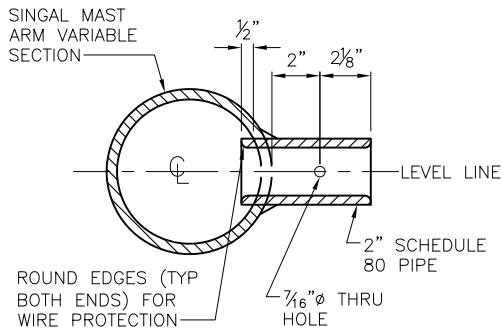


SIGNAL COUPLING

COUPLING TO BE FABRICATED & INSTALLED BEFORE GALVANIZING

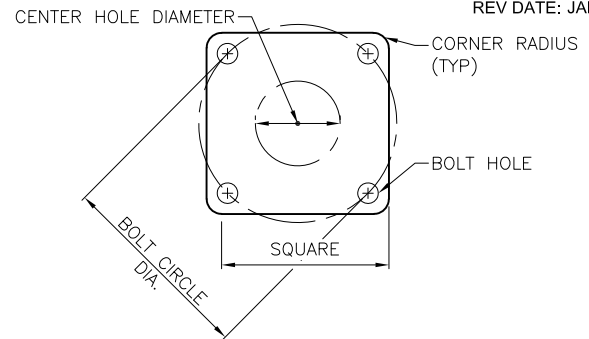

ANCHOR PLATE
PER FOUNDATION SCHEDULE

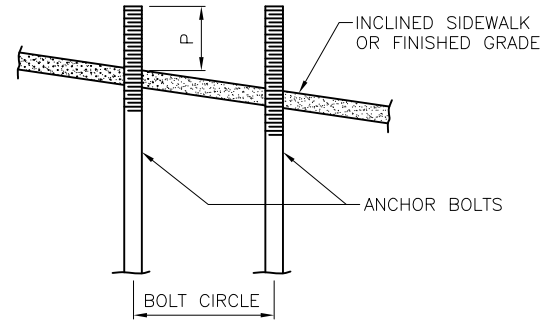

INCLINED CONDITION

POLE SCHEDULE			
MAST ARM LENGTH	POLE BASE PLATE		
	SQUARE	BOLT CIRCLE 'A'	BOLT HOLE
15'-0" TO 30'-0"	16" X 16"	14½"	1 13/16"
31'-0" TO 40'-0"	18" X 18"	16½"	2 1/8"
41'-0" TO 45'-0"	18" X 18"	18"	2 1/8"
46'-0" TO 60'-0"	20" X 20"	20"	2 5/8"

POLE FOUNDATION NOTES

1. CONCRETE MUST BE CLASS 4000P.
2. ANCHOR BOLTS MUST BE ASTM F1554 GRADE 105 CLASS 2A THREADS INCLUDING SUPPLEMENTARY REQUIREMENTS S2 THROUGH S4. NUTS: ASTM A563 HEAVY HEX GRADE DH. HARDENED STEEL WASHERS: ASTM F436.
3. BOTTOM ANCHOR PLATE: ASTM A36, HOT DIP GALVANIZED PER ASTM A123.
4. ALL REINFORCING BARS MUST BE DEFORMED BILLET STEEL CONFORMING TO ASTM CLASS A706, GRADE 60.
5. ANCHOR BOLTS MUST BE HOT DIP GALVANIZED PER ASTM F2329 INCLUDING NUTS & WASHERS (FULL LENGTH) WITH A MINIMUM OF 18" OF THREADS ON TOP & 12" ON BOTTOM.
6. TAPE THE TOP OF ANCHOR BOLTS WITH CORROSION PROTECTION TAPE PER STD SPEC SEC 8-32.3(2)A PRIOR TO POURING CONCRETE.
7. SEE STD PLAN NO 541a FOR FOUNDATION DETAILS.
8. FOUNDATION DEPTH, REINFORCEMENT AND ANCHOR BOLTS MUST BE IN CONFORMANCE WITH "AASHTO STANDARD SPECIFICATIONS FOR STRUCTURAL SUPPORTS FOR HIGHWAY SIGNS, LUMINAIRES AND TRAFFIC SIGNALS" (6TH EDITION, 2013). DESIGN BASIC WIND SPEED IS 85 MPH AND RECURRENCE INTERVAL/DESIGN LIFE IS 50 YEARS

FOUNDATION SCHEDULE							
MAST ARM LENGTH	ANCHOR BOLTS			ANCHOR PLATE DIMENSIONS			
	PROJECTION "P"	BOLT CIRCLE DIA	SIZE	SIZE	BOLT HOLE	CENTER HOLE	CORNER RADIUS
15'-0" TO 30'-0"	7½"	14½"	1½" X 60"	3/8" X 16" X 16"	1 5/8"	10"	1 5/8"
31'-0" TO 40'-0"	9"	16½"	1¾" X 72"	3/8" X 16" X 16"	1 7/8"	12½"	1 5/8"
41'-0" TO 45'-0"	9"	18"	1¾" X 72"	3/8" X 16" X 16"	1 7/8"	12½"	1 5/8"
46'-0" TO 60'-0"	10"	20"	2" X 72"	3/8" X 18" X 18"	2 1/8"	14"	2"

FOUNDATION DEPTH MUST BE PER PLANS.


REF STD SPEC SEC 8-32




City of Seattle

NOT TO SCALE

**STEEL MAST ARM POLE
FOUNDATION SCHEDULE & DETAIL
W/O METRO TROLLEY LOADS)**

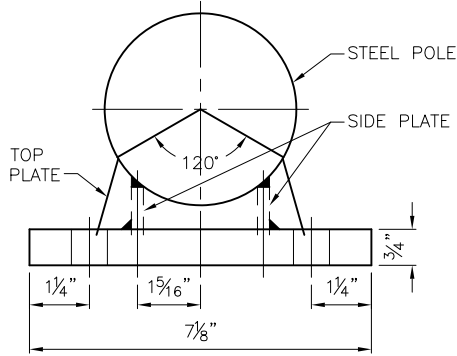


SECTION A-A

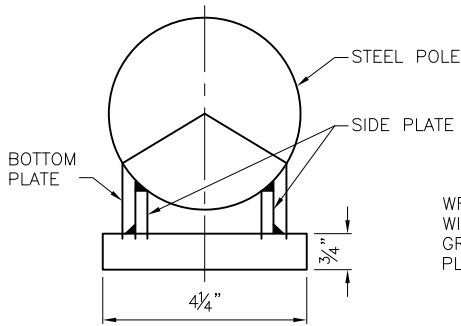


SECTION B-B

NOTE:
GROUT MUST BE PREMIXED,
NON-SHRINK AND NON-METALLIC

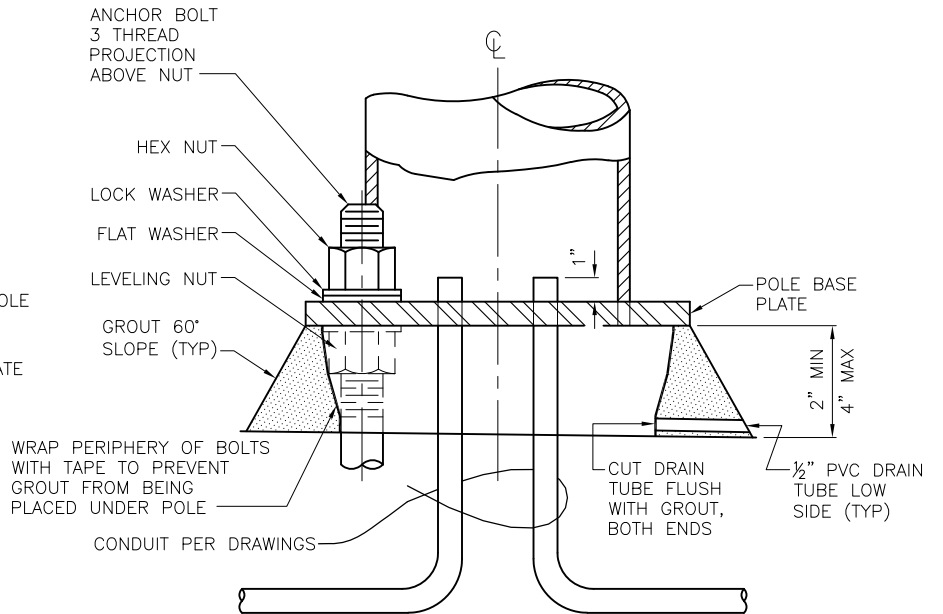


POLE MOUNTING & GROUT DETAIL

(EXCEPT FOR POLES W/CHIEF SEATTLE BASE)

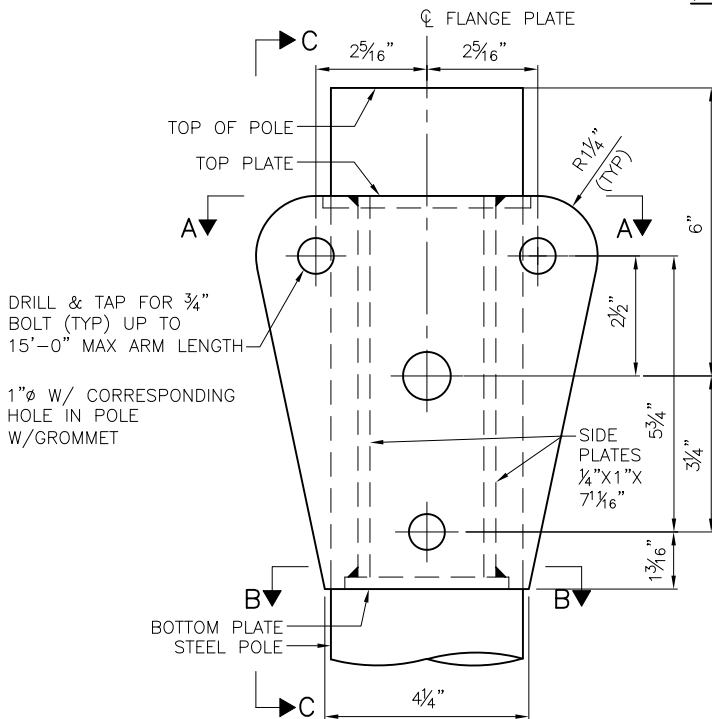

BRACKET ARM FLANGE
PLATE ON POLE

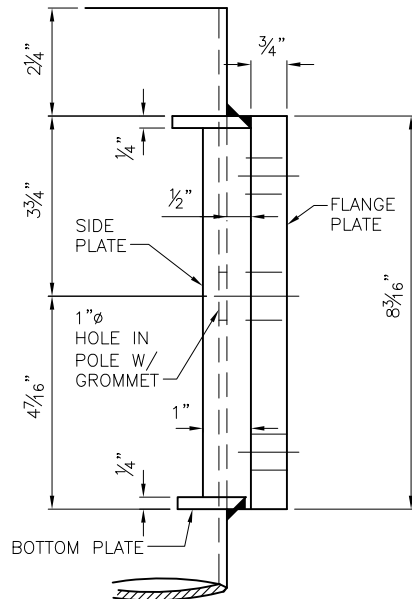

SECTION C-C

STRUCTURAL CARBON STEEL PLATES
MUST BE ASTM A36



REF STD SPEC SEC 8-32




City of Seattle

NOT TO SCALE


MISCELLANEOUS STEEL
POLE DETAILS

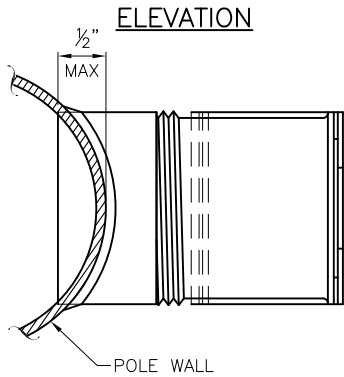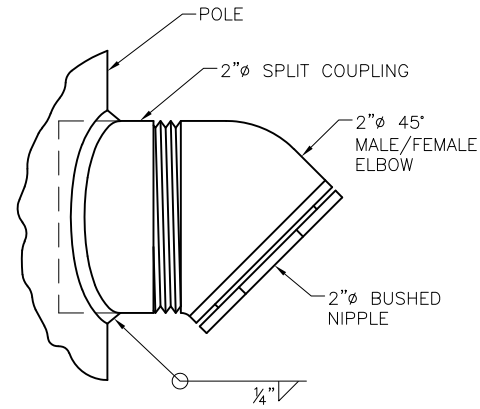


CABLE OUTLET DETAIL

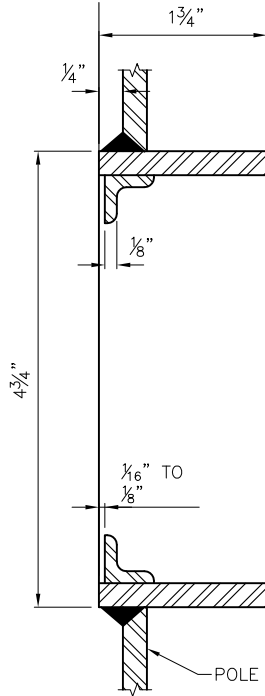

SECTION A-A

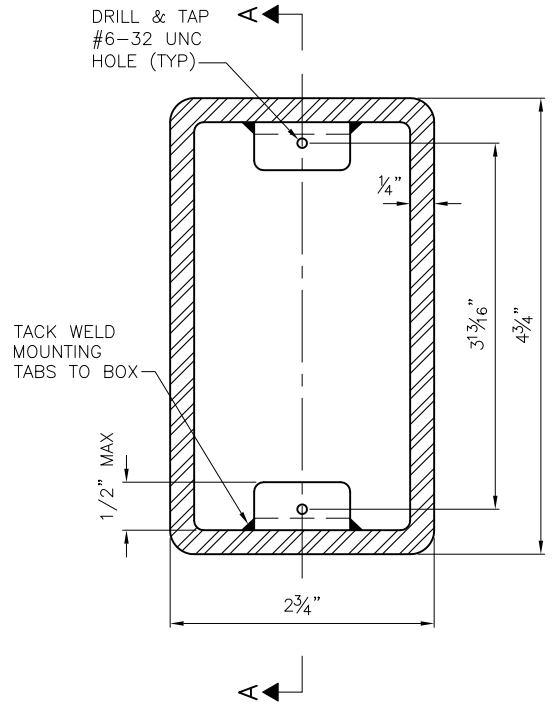

FESTOON OUTLET BOX

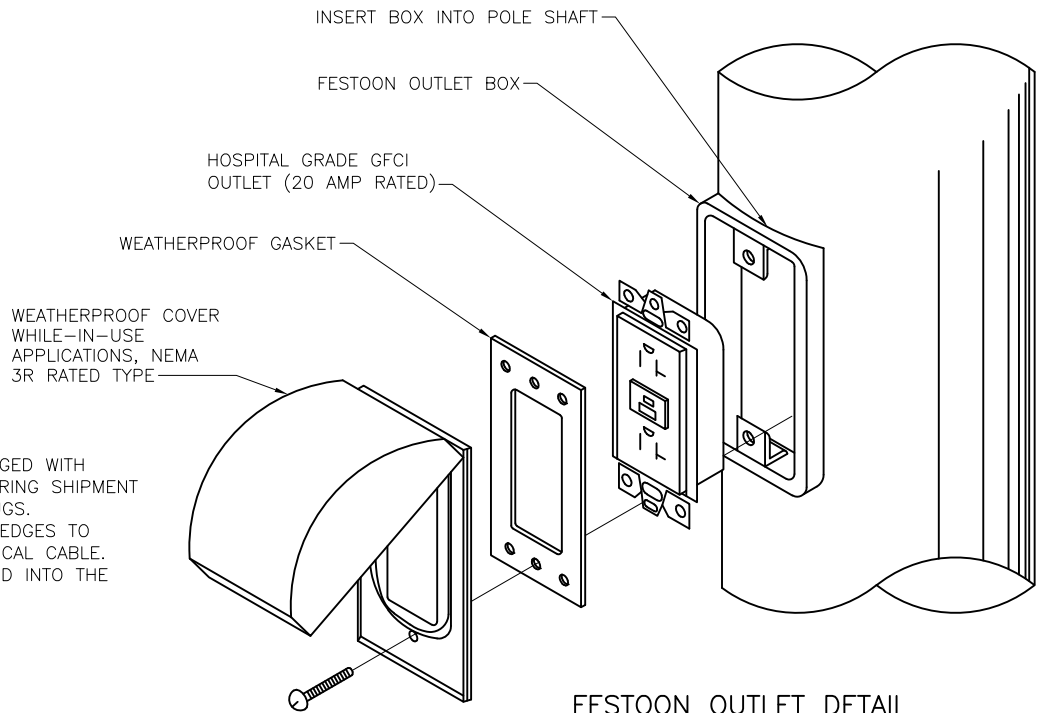

FESTOON OUTLET DETAIL (METAL POLES)

NOTES:

1. ALL OUTLETS MUST BE PLUGGED WITH THREADED INSERT PLUGS DURING SHIPMENT TO PREVENT DAMAGE TO PLUGS.
2. REMOVE BURRS AND SHARP EDGES TO PREVENT DAMAGE TO ELECTRICAL CABLE.
3. SPLIT COUPLING MUST EXTEND INTO THE POLE 1/2" MAX AS SHOWN.


REF STD SPEC SEC 8-30, 8-32



City of Seattle


NOT TO SCALE

MISCELLANEOUS STEEL POLE DETAILS

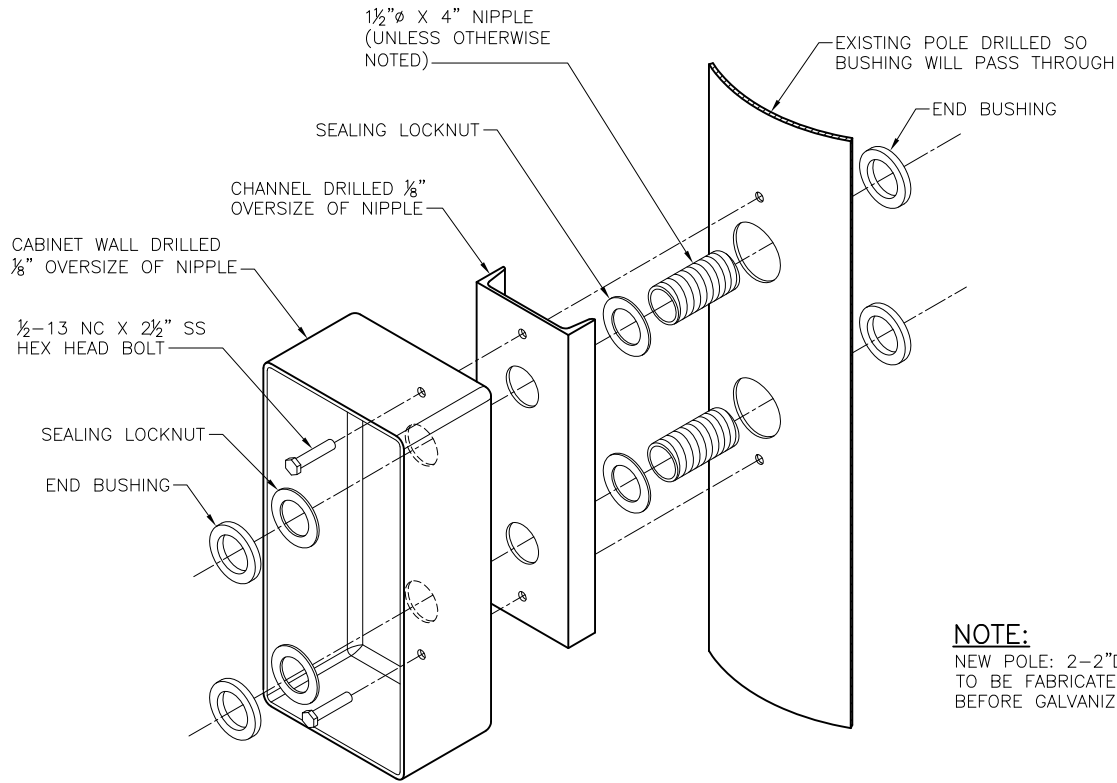

NOTE:
 NEW POLE: 2-2" DIA COUPLING
 TO BE FABRICATED & INSTALLED
 BEFORE GALVANIZING

WIREWAY ISOMETRIC DETAIL

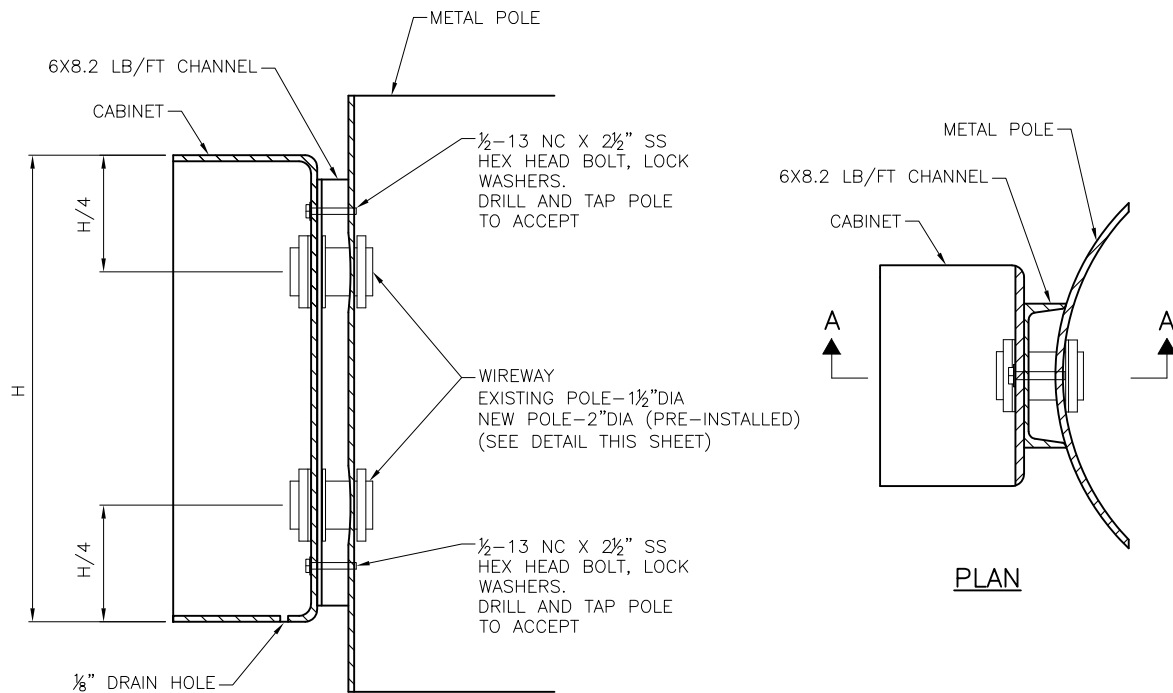

SECTION A-A

PLAN



REF STD SPEC SEC 8-32



City of Seattle

NOT TO SCALE

**TERMINAL CABINET
 POLE MOUNTING**

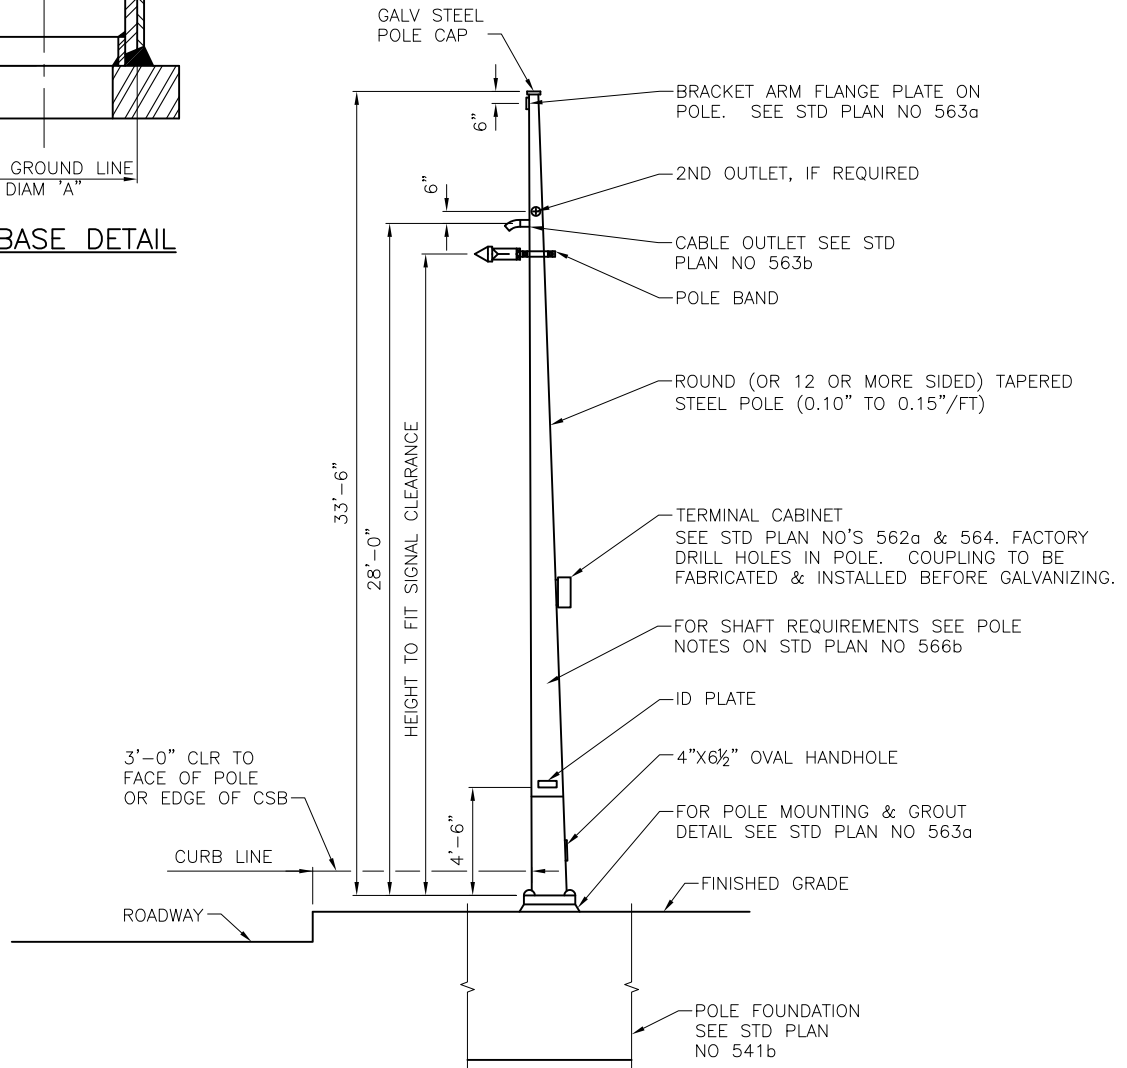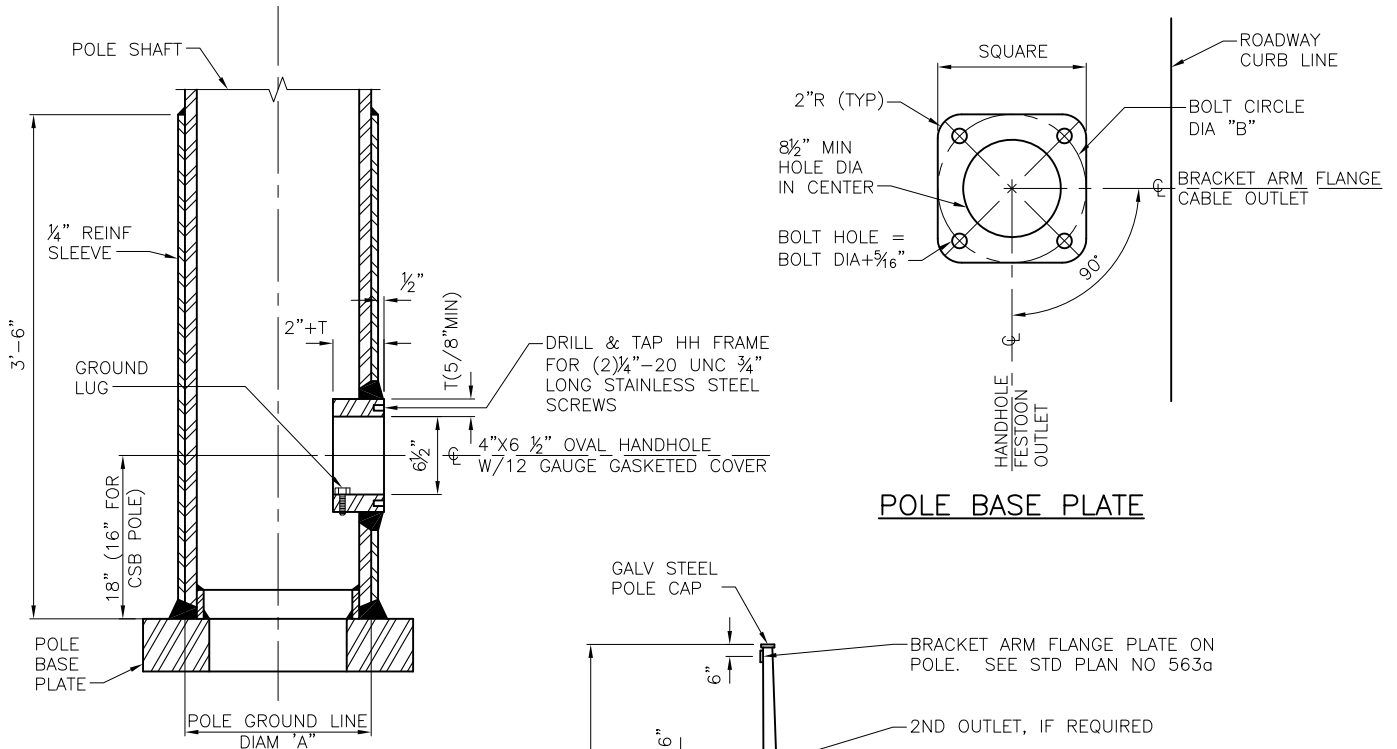

REF STD SPEC SEC 8-32



City of Seattle

NOT TO SCALE

STRAIN POLE DETAILS
(TYPE V, X & Z POLES)

POLE TYPE	POLE SCHEDULE						
	GROUND LINE DIA "A"		POLE BASE PLATE SIZE		BOLT CIRCLE DIA "B"	BOLT HOLE	ANCHOR BOLTS
	STD	CSB	STD	CSB			
V	12"	12"	1¾"X18"X18"	1¾"X23"X23"	18"	2¼"	1¾"DIA X 72"
X	14"	12½"	2"X20"X20"	2"X23"X23"	20"	2⅝"	2"DIA X 72"
Z	15"	--	2½"X23"X23"	--	22"	2⅞"	2½"DIA X 72"

NOTES:

1. POLE SHAFT AND REINFORCING SLEEVE: ASTM A572 GRADE 50, 60 OR 65 (Fy=50, 60 OR 65 KSI RESPECTIVELY) OR ASTM A595 GRADE A OR B (Fy=55 OR 60 KSI RESPECTIVELY).
2. BASE PLATE AND HANDHOLE REINFORCING RIM: ASTM A36 OR ASTM A572 GRADE 42. BASE PLATE Fy≥0.65 POLE SHAFT Fy THE BASE PLATE THICKNESS MAY BE REDUCED BY ¼" IF ASTM A572 GRADE 42 STEEL IS USED.
3. REINFORCING SLEEVE MUST BE FABRICATED FROM THE SAME MATERIAL AND YIELD STRENGTH AS THE POLE SHAFT.
4. POLE SHAFTS MUST HAVE NO MORE THAN TWO LONGITUDINAL WELDS IN EACH PLY.
5. MINIMUM SHAFT WALL THICKNESS OF EACH PLY MUST BE 0.239" (3 GAUGE). POLE MUST HAVE A MAXIMUM OF TWO PLYS NOT INCLUDING THE ¼" REINFORCING SLEEVE.
6. MAXIMUM SILICON CONTENT IN STEEL MUST BE 0.04%. SEE STD SPEC SECTION 9-33.1(3) FOR GENERAL GALVANIZING REQUIREMENTS.
7. POLE DIAMETER FOR 12 OR MORE SIDED POLES MUST BE MEASURED FROM THE POINT TO POINT DIMENSION.
8. POLES MUST MEET DEFLECTION CRITERIA STATED IN STD SPEC SECTION 9-33.2(2) WITH THE DEAD LOAD APPLIED AT 25' ABOVE GROUND LINE.
9. POLE STRENGTH MUST MEET REQUIREMENTS OF AASHTO STANDARD SPECIFICATIONS FOR STRUCTURAL SUPPORTS FOR HIGHWAY SIGNS, LUMINAIRES AND TRAFFIC SIGNALS (6TH EDITION, 2013). DESIGN WIND SPEED IS 85 MPH AND RECURRENCE INTERVAL/DESIGN LIFE IS 50 YEARS.


REF STD SPEC SEC 8-32, 9-33



City of Seattle

NOT TO SCALE

**STRAIN POLE DETAILS
(TYPE V, X, & Z POLES)**

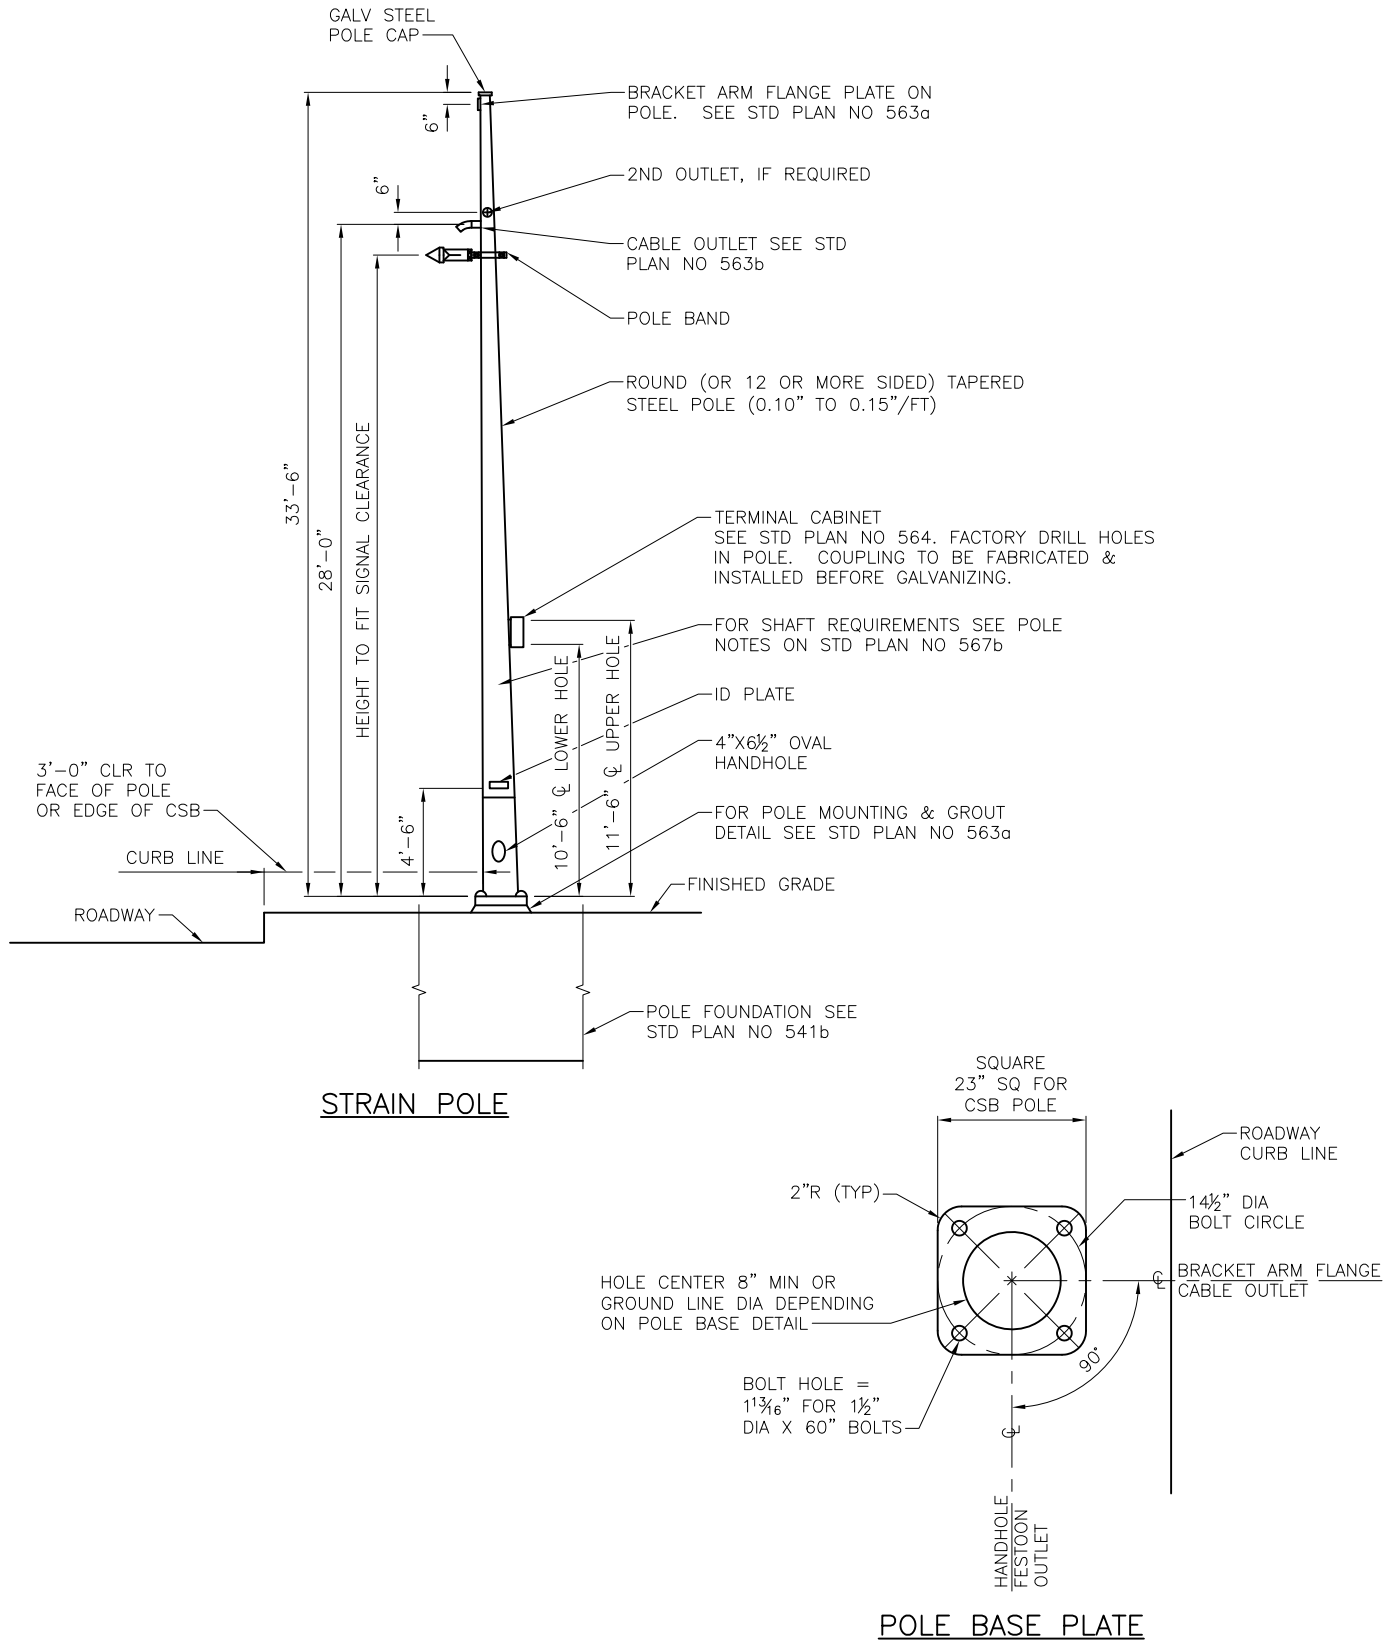

REF STD SPEC SEC 8-32




City of Seattle

NOT TO SCALE

**TYPE T STRAIN POLE DETAILS
TRAFFIC SIGNAL ONLY**

NOTES:

1. POLE STRENGTH MUST MEET REQUIREMENTS OF AASHTO STANDARD SPECIFICATIONS FOR STRUCTURAL SUPPORTS FOR HIGHWAY SIGNS, LUMINAIRES AND TRAFFIC SIGNALS (6TH EDITION, 2013). DESIGN WIND SPEED IS 85 MPH AND RECURRENCE INTERVAL/DESIGN LIFE IS 50 YEARS.
2. POLE SHAFT: ASTM A572 GRADE 50, 60 OR 65 (Fy=50, 60 OR 65 KSI RESPECTIVELY), OR ASTM A595 GRADE A OR B (Fy=55 OR 60 KSI RESPECTIVELY)
3. BASE PLATE AND HANDHOLE REINFORCING RIM: ASTM A36 OR ASTM A572 GRADE 42. BASE PLATE Fy ≥ 0.65 POLE SHAFT Fy THE BASE PLATE THICKNESS MAY BE REDUCED BY ¼" IF ASTM A572 GRADE 42 STEEL IS USED.
4. POLE SHAFTS MUST HAVE NO MORE THAN TWO LONGITUDINAL WELDS IN EACH PLY.
5. MINIMUM SHAFT WALL THICKNESS OF EACH PLY MUST BE 0.239" (3 GAUGE). POLE MUST HAVE A MAXIMUM OF TWO PLYS.
6. MAXIMUM SILICON CONTENT IN STEEL MUST BE 0.04%. SEE STD SPEC SECTION 9-33.1(3) FOR GENERAL GALVANIZING REQUIREMENTS.
7. POLE DIAMETER FOR 12 OR MORE SIDED POLES MUST BE MEASURED FROM THE POINT TO POINT DIMENSION.
8. POLES MUST MEET DEFLECTION CRITERIA STATED IN STD SPEC SECTION 9-33.2(2) WITH THE DEAD LOAD APPLIED AT 27' ABOVE GROUND LINE.
9. THE POLES MUST BE COMPACT AND MUST MEET THE REQUIREMENTS IN AASHTO SECTION 4, TABLE 1.4 1B(1).

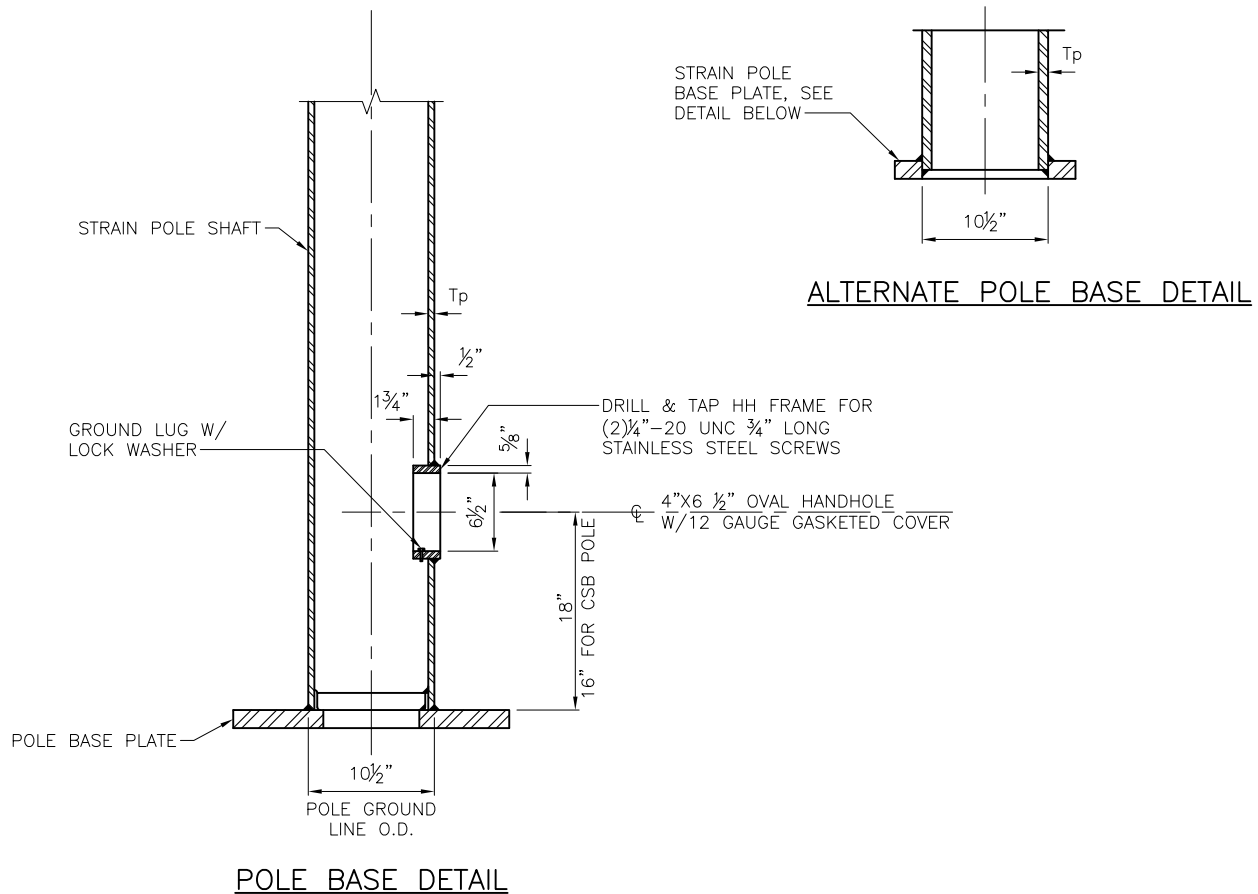


REF STD SPEC SEC 8-32, 9-33




City of Seattle

NOT TO SCALE


**TYPE T STRAIN POLE DETAILS
TRAFFIC SIGNAL ONLY**

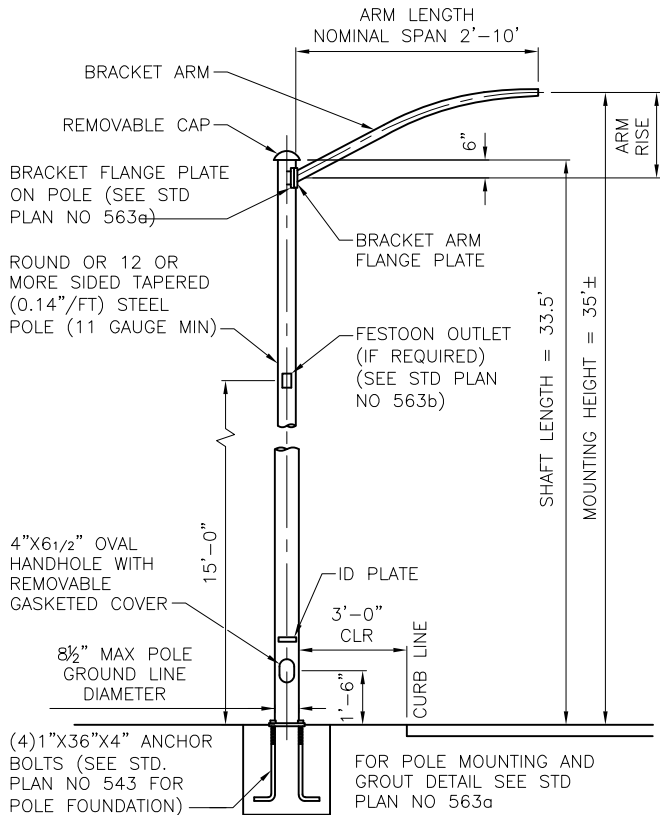

STEEL STREET LIGHT POLE

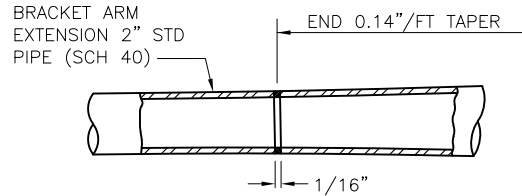


BRACKET ARM EXTENSION IF REQUIRED

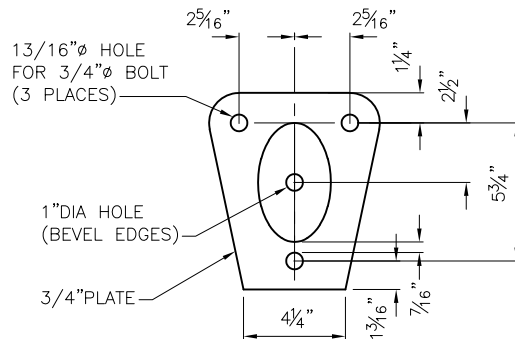


NOTE: FLANGE DIMENSIONS AND HOLE LOCATIONS MUST MATCH THOSE ON FLANGE PLATE ON POLE (SEE STD PLAN NO 563a)

BRACKET ARM FLANGE PLATE

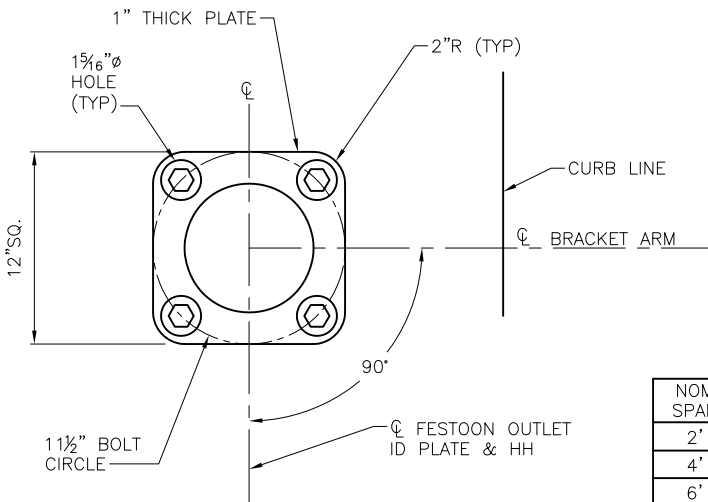

POLE BASE PLATE

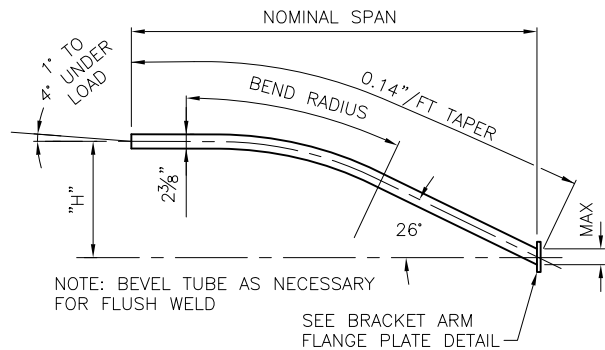

2' THRU 10' BRACKET ARMS

NOM SPAN	H*	BEND RADIUS	TUBE REQUIREMENT
2'	5 1/4"	-	2" STD PIPE
4'	12"	6'	11 GAUGE
6'	18"	9'	11 GAUGE
8'	24"	13'	11 GAUGE
10'	30"	15'	11 GAUGE

MATERIAL SPECIFICATION
 PLATE AND SHAPES: ASTM A36
 POLE SHAFTS: ASTM A570 GR 40 MIN.
 ANCHOR BOLTS: ASTM A307
 BRACKET ARM FLANGE PLATE BOLT: ASTM A325

NOTE:

- ALL OTHER ARM LENGTHS REQUIRE SCL REVIEW AND APPROVAL

* THESE DIMENSIONS ARE ONLY ILLUSTRATIVE OF THE GENERAL OUTLINE AND MATERIALS USED IN THE CONSTRUCTION OF THESE ARMS AND ARE NOT INTENDED TO EXCLUDE MANUFACTURER'S STANDARD PRODUCTS.


REF STD SPEC SEC 8-32



City of Seattle

NOT TO SCALE

STEEL STREET LIGHT POLE WITH BRACKET ARM

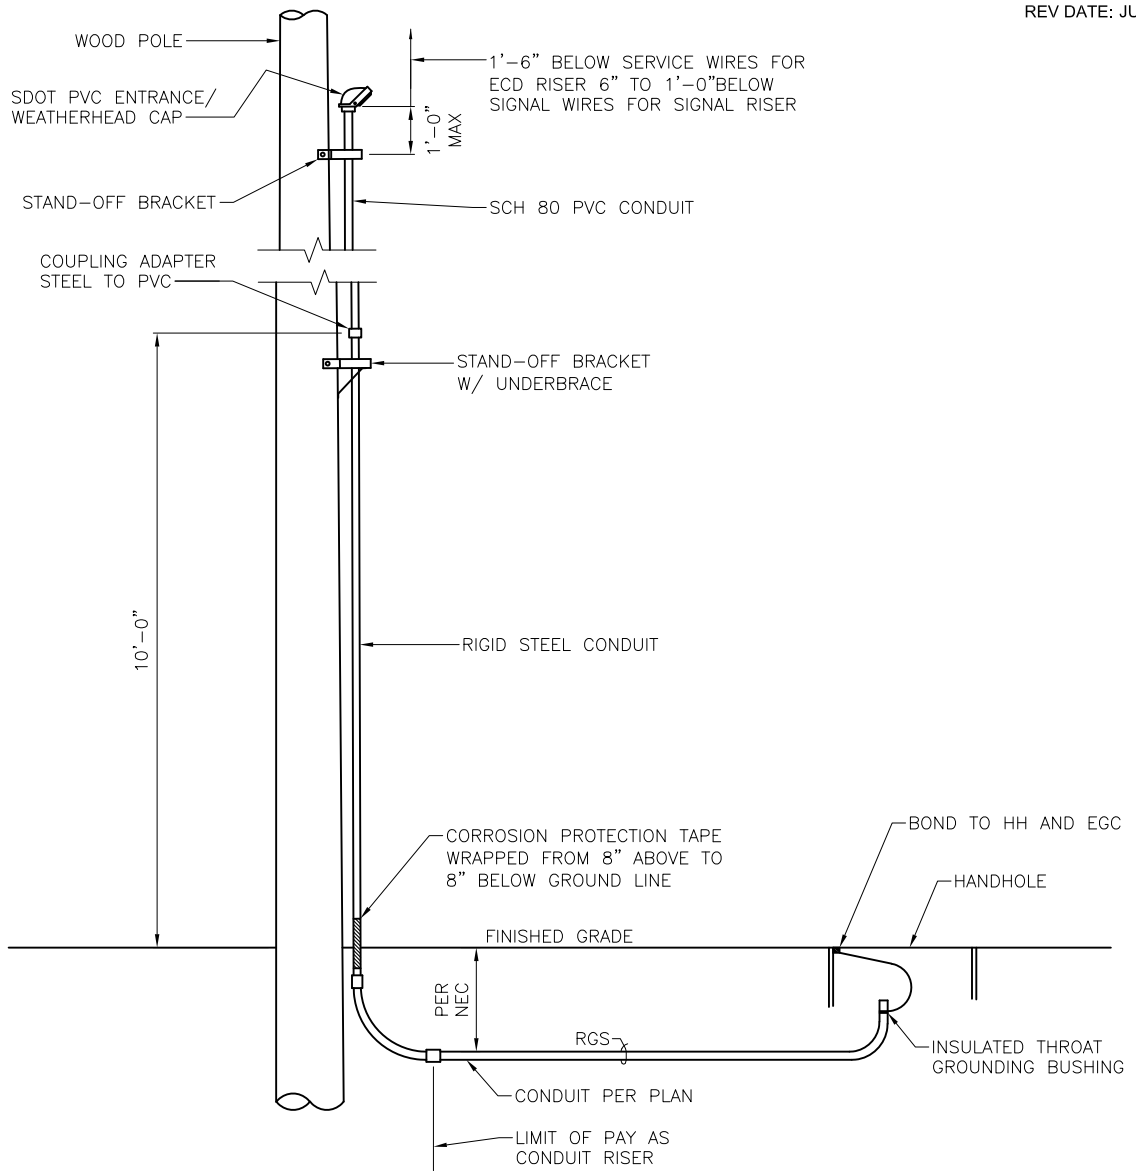

CONDUIT RISER (WITH STAND-OFF BRACKET*)

*WHEN THERE WILL BE ONLY ONE CONDUIT (1/2" OR SMALLER) ON THE POLE, TWO HOLE MALLEABLE IRON CLAMPS WITH DOUBLE HEADED NAILS MUST BE USED TO SECURE THE CONDUIT TO THE POLE IN LIEU OF THE STAND-OFF BRACKETS

NOTES:

1. ON POLES WITH EXISTING CONDUITS, NEW CONDUITS MUST BE INSTALLED IN ACCORDANCE WITH THIS STANDARD PLAN.
2. RIGID STEEL CONDUIT MUST BE GROUNDED JUST BELOW COUPLING, APPROXIMATELY 8'-0" TO 10'-0" ABOVE GROUND, AS SHOWN
3. ALL RISERS BONDED IN HH
4. THE GROUND WIRE MUST BE ONE CONTINUOUS LENGTH. INSERT THE GROUND WIRE FROM THE BOTTOM OF THE GROUND CLAMP & BEND OVER THE CLAMP BEFORE TIGHTENING
5. ALL STEEL HARDWARE MUST BE HOT DIPPED GALVANIZED AFTER FABRICATION PER ASTM A123
6. CONDUIT CLAMP SPACING MUST BE PER THE NEC WITH A MINIMUM OF TWO HOLE CLAMP PER 10'-0" LENGTH OF CONDUIT
7. SERVICE AND SIGNAL CONDUCTORS MUST NOT BE PLACED IN THE SAME CONDUIT.
8. WHEN POSSIBLE, RISER MUST BE INSTALLED ON DOWNSTREAM SIDE OF TRAFFIC
9. SEE SCL CONSTRUCTION STANDARD 1714.50 FOR STREETLIGHT HANDHOLE AND CONDUIT REQUIREMENTS & 0224.34 FOR STREETLIGHT CONDUIT RISERS.




REF STD SPEC SEC 8-33



City of Seattle

NOT TO SCALE

TRAFFIC CONDUIT RISER

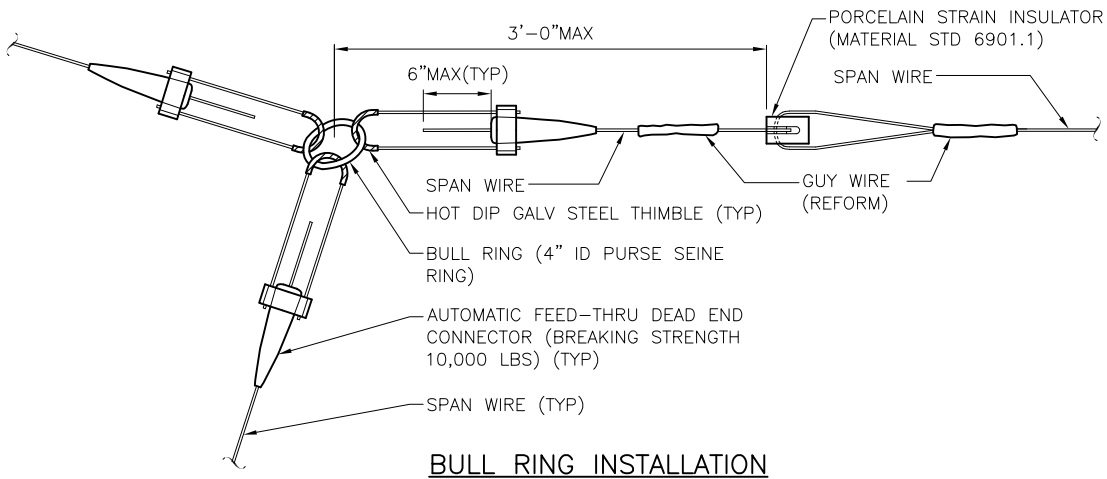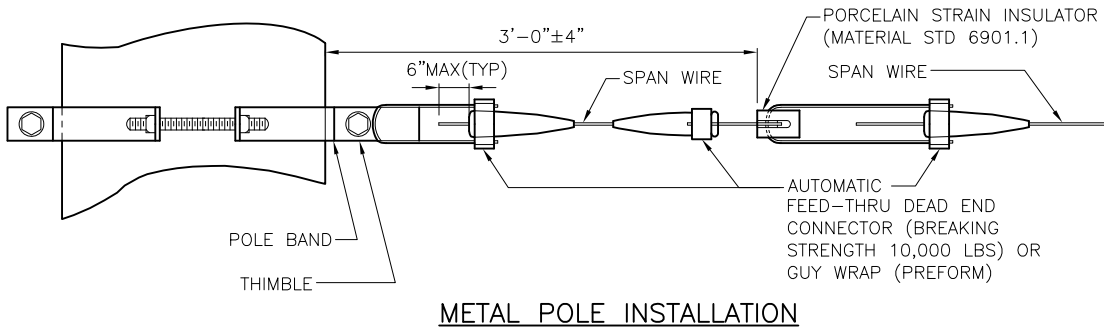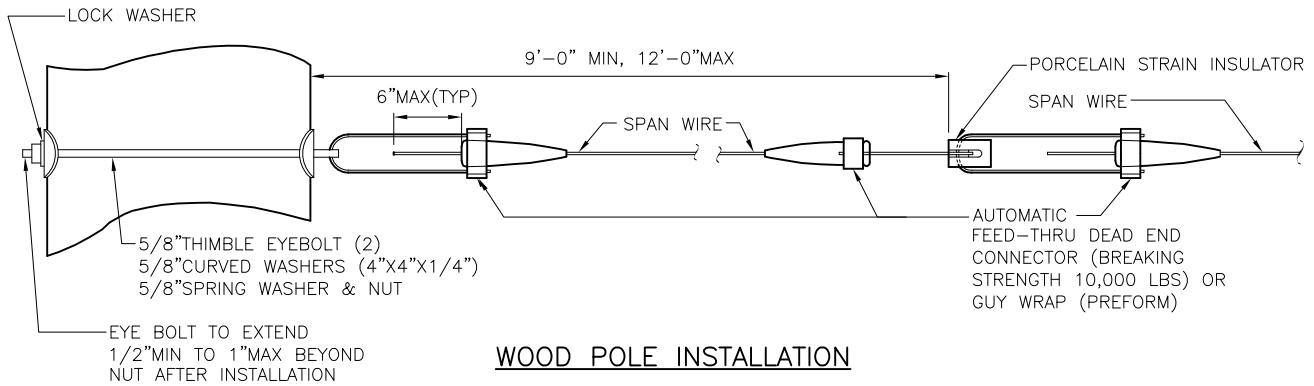

NOTES:

1. ALL STEEL HARDWARE TO BE HOT DIP GALVANIZED OR STAINLESS STEEL UNLESS OTHERWISE STIPULATED IN THE DRAWINGS.
2. SPAN WIRE MUST BE ALUMINUM COATED STEEL.
3. SPREAD THIMBLE TO FIT THE BAIL OF THE AUTOMATIC DEAD END.


REF STD SPEC SEC 8-21, SCL MATERIAL STANDARD 6901.1




City of Seattle

NOT TO SCALE

SPAN WIRE INSTALLATION

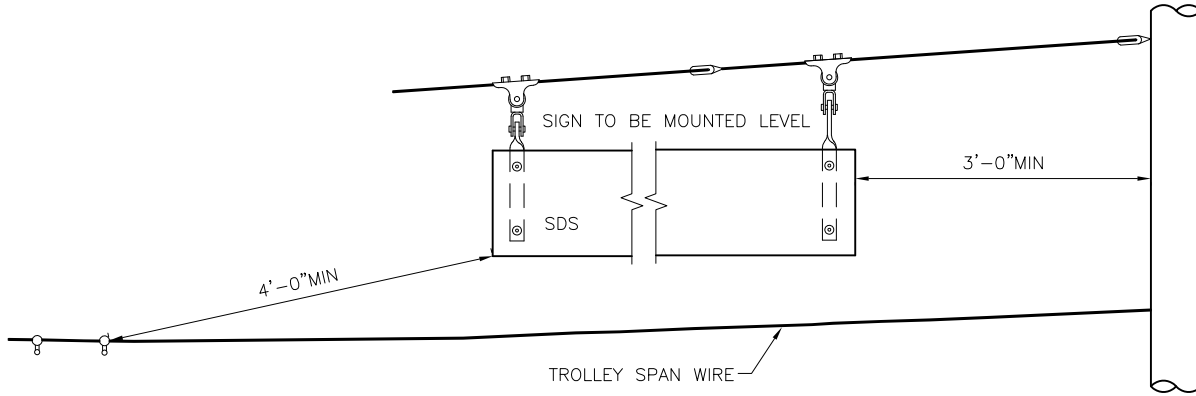

STREET DESIGNATION SIGN

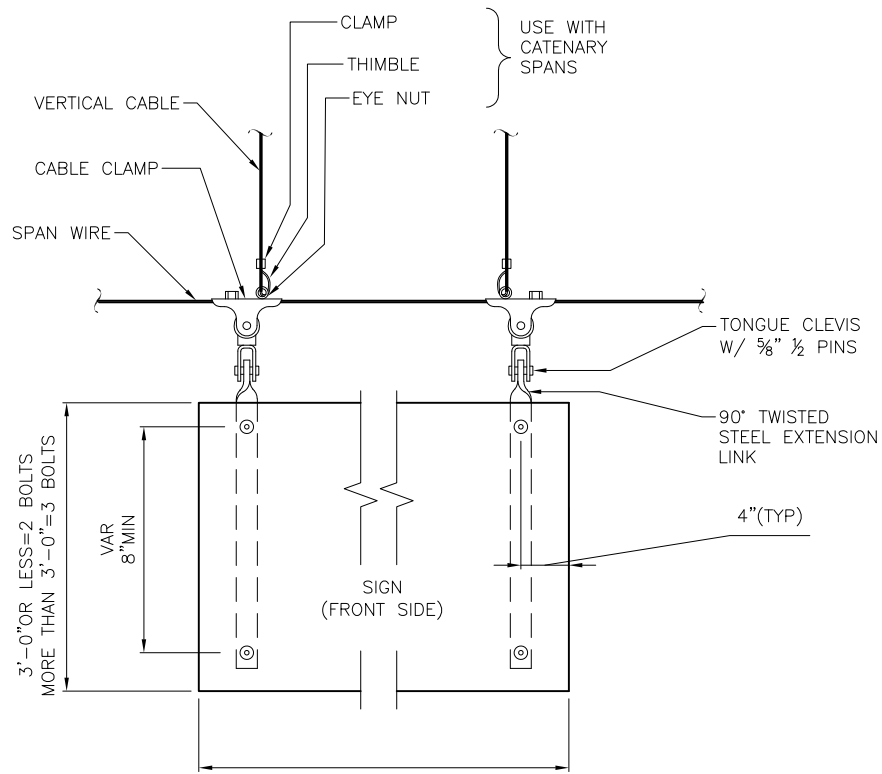

SPAN WIRE MOUNTED SIGN

NOTES:

1. ALL HARDWARE MUST BE STAINLESS STEEL. OTHER THAN HARDWARE MUST BE HOT DIP GALVANIZED.
2. NEOPRENE GASKETS MUST NOT BE USED FOR SPAN WIRE OR AERIAL CONNECTIONS.


REF STD SPEC SEC 8-21




City of Seattle

NOT TO SCALE

**OVERHEAD SIGNS
SPANWIRE MOUNTED**

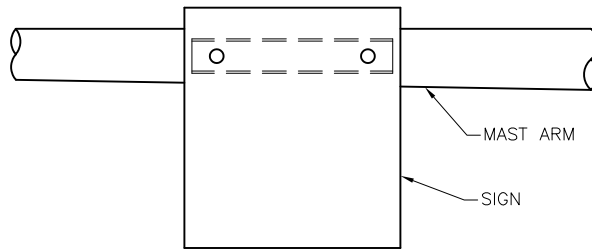

SIGN MOUNTING ON MAST ARM

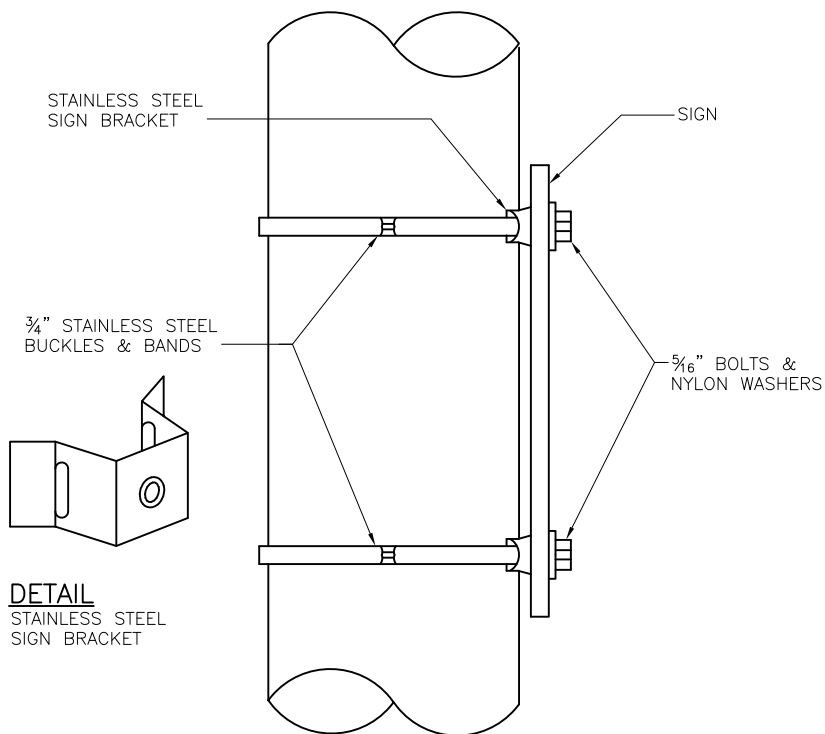

TEMPORARY SIGN MOUNTING ON METAL POLE

NOTES:

1. EXCEPT AS NOTED OTHERWISE, ALL HARDWARE MUST BE STAINLESS STEEL.
2. MOUNTING OF TRAFFIC SIGNS MUST BE AS FOLLOWS: ON METAL POLE THINNER THAN 7 GAUGE, USE 3/8" STAINLESS STEEL RIVNUTS ON METAL POLES 7 GAUGE OR THICKER, FOR 3/8" BOLT (STAINLESS STEEL RIVNUT OPTIONAL) ON POLES FILLED WITH OR MADE FROM CONCRETE, USE 3/8"x21/2"MIN STUD BOLT ANCHORS WITH HEX NUT.
3. FOR SIGN FEATURE, CONTACT TRAFFIC ENGINEER.


REF STD SPEC SEC 8-21



City of Seattle

NOT TO SCALE

**SIGN INSTALLATION
(NON-SPANWIRE MOUNTING)**

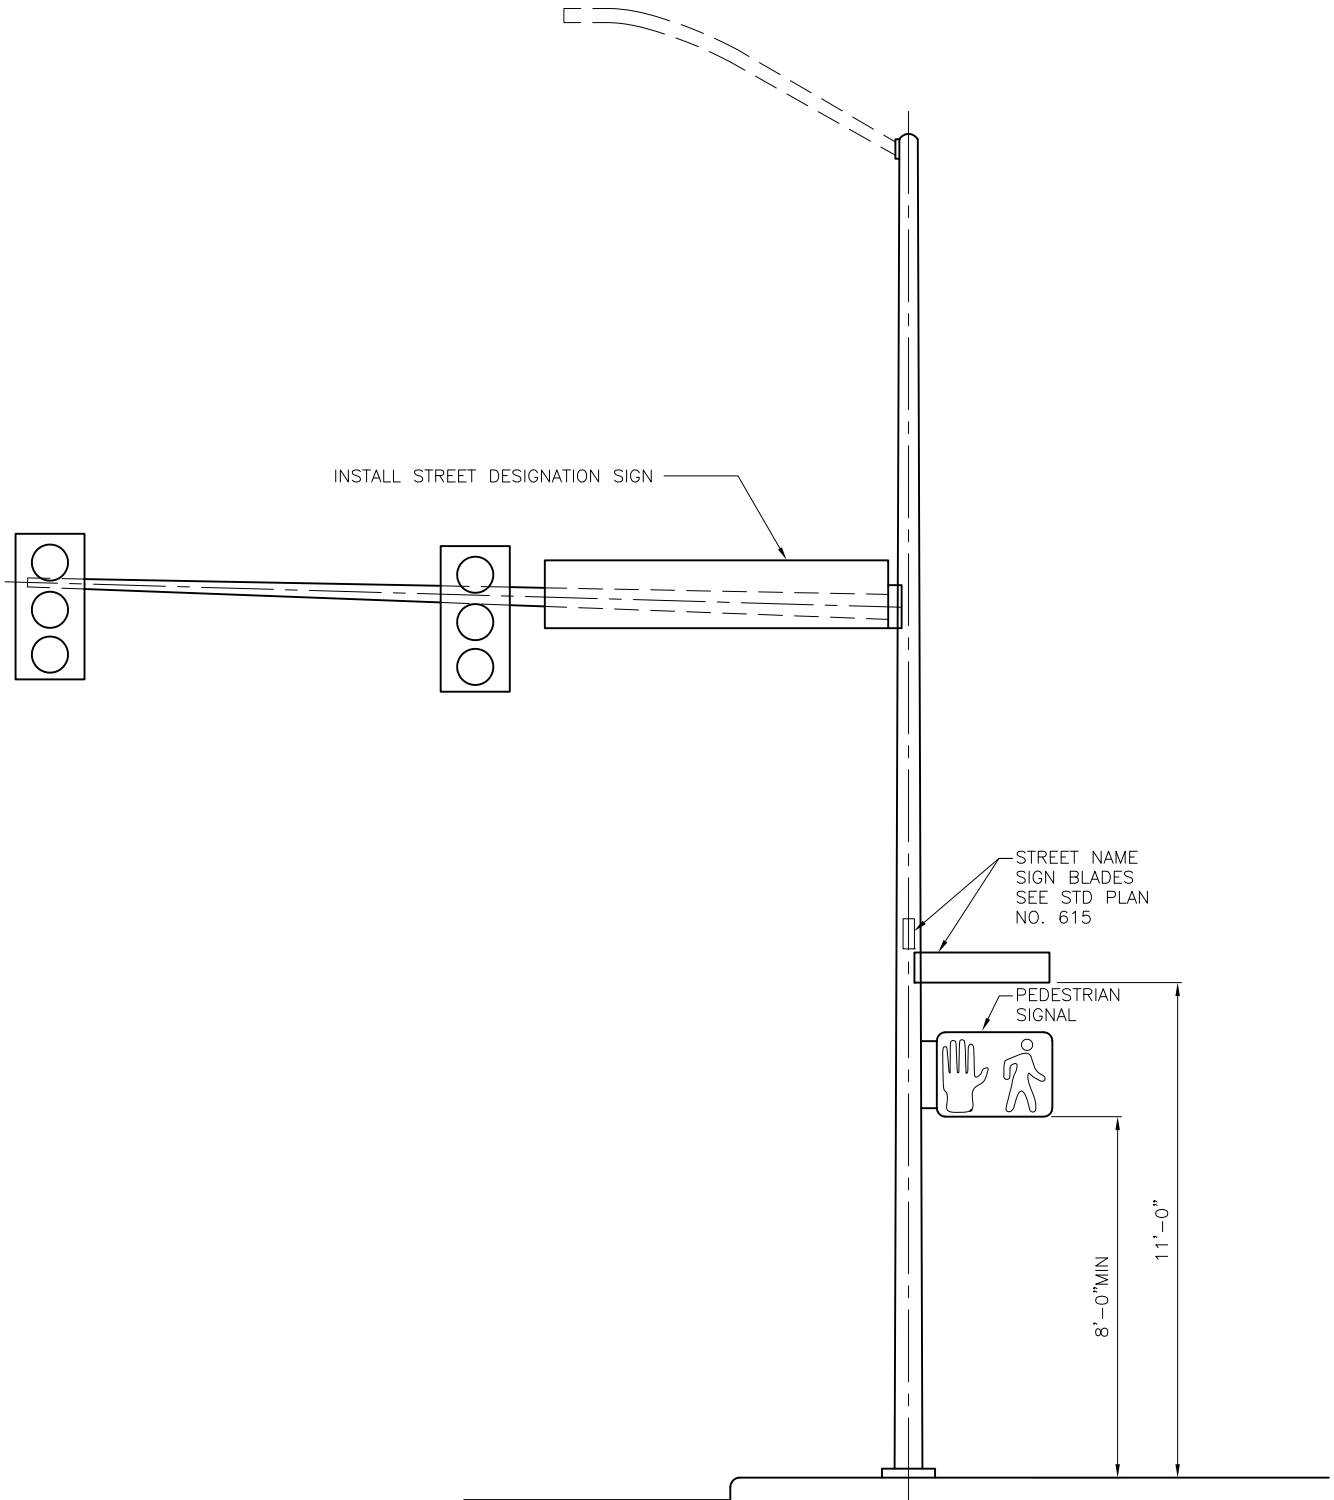



REF STD SPEC SEC 8-21



City of Seattle



NOT TO SCALE

STANDARD SIGN INSTALLATION
STEEL POLES

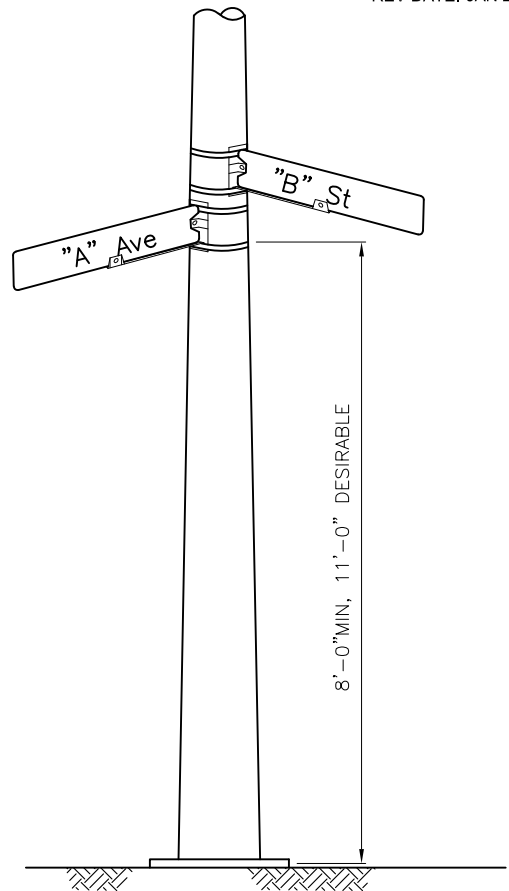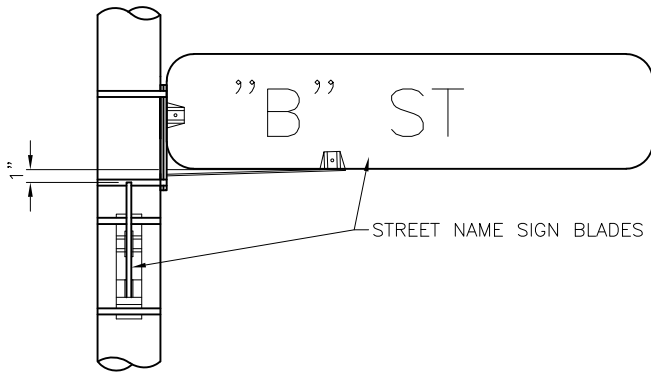

NOTES:

1. STAGGER SNS BLADES WITH THE "AVENUE" DESIGNATION BLADE BELOW THE "STREET" DESIGNATION BLADE
2. SNS MUST BE INSTALLED PARALLEL TO CORRESPONDING STREET
3. ALL NUTS, BOLTS & WASHERS TO BE STAINLESS STEEL EXCEPT ALUMINUM RIV NUTS ON ALUMINUM POLES.

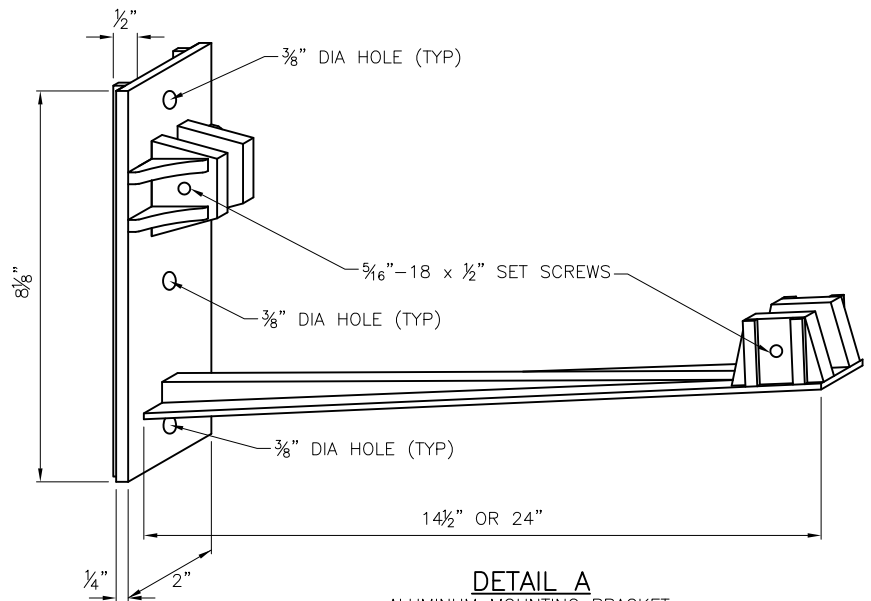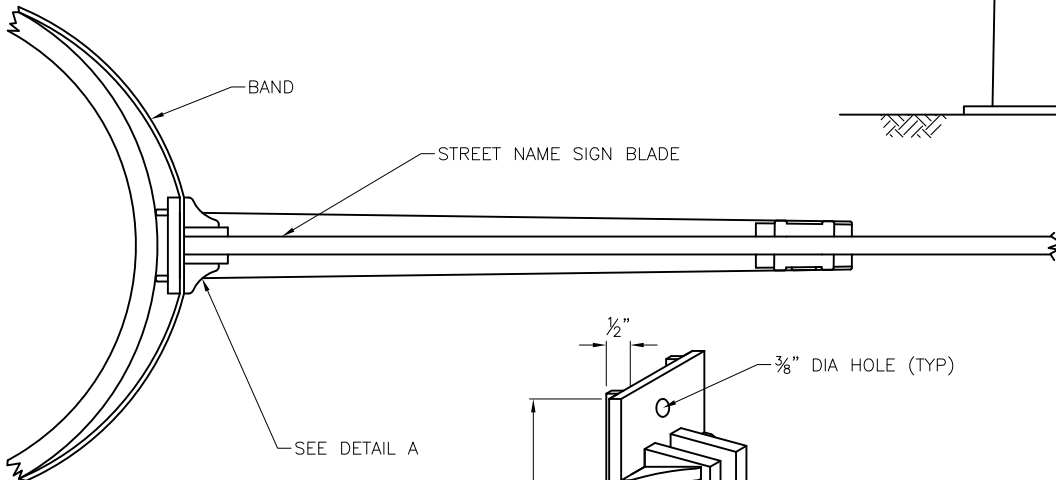

DETAIL A
ALUMINUM MOUNTING BRACKET


REF STD SPEC SEC 8-21



City of Seattle

NOT TO SCALE

**SNS BRACKET FOR
STEEL POLES**

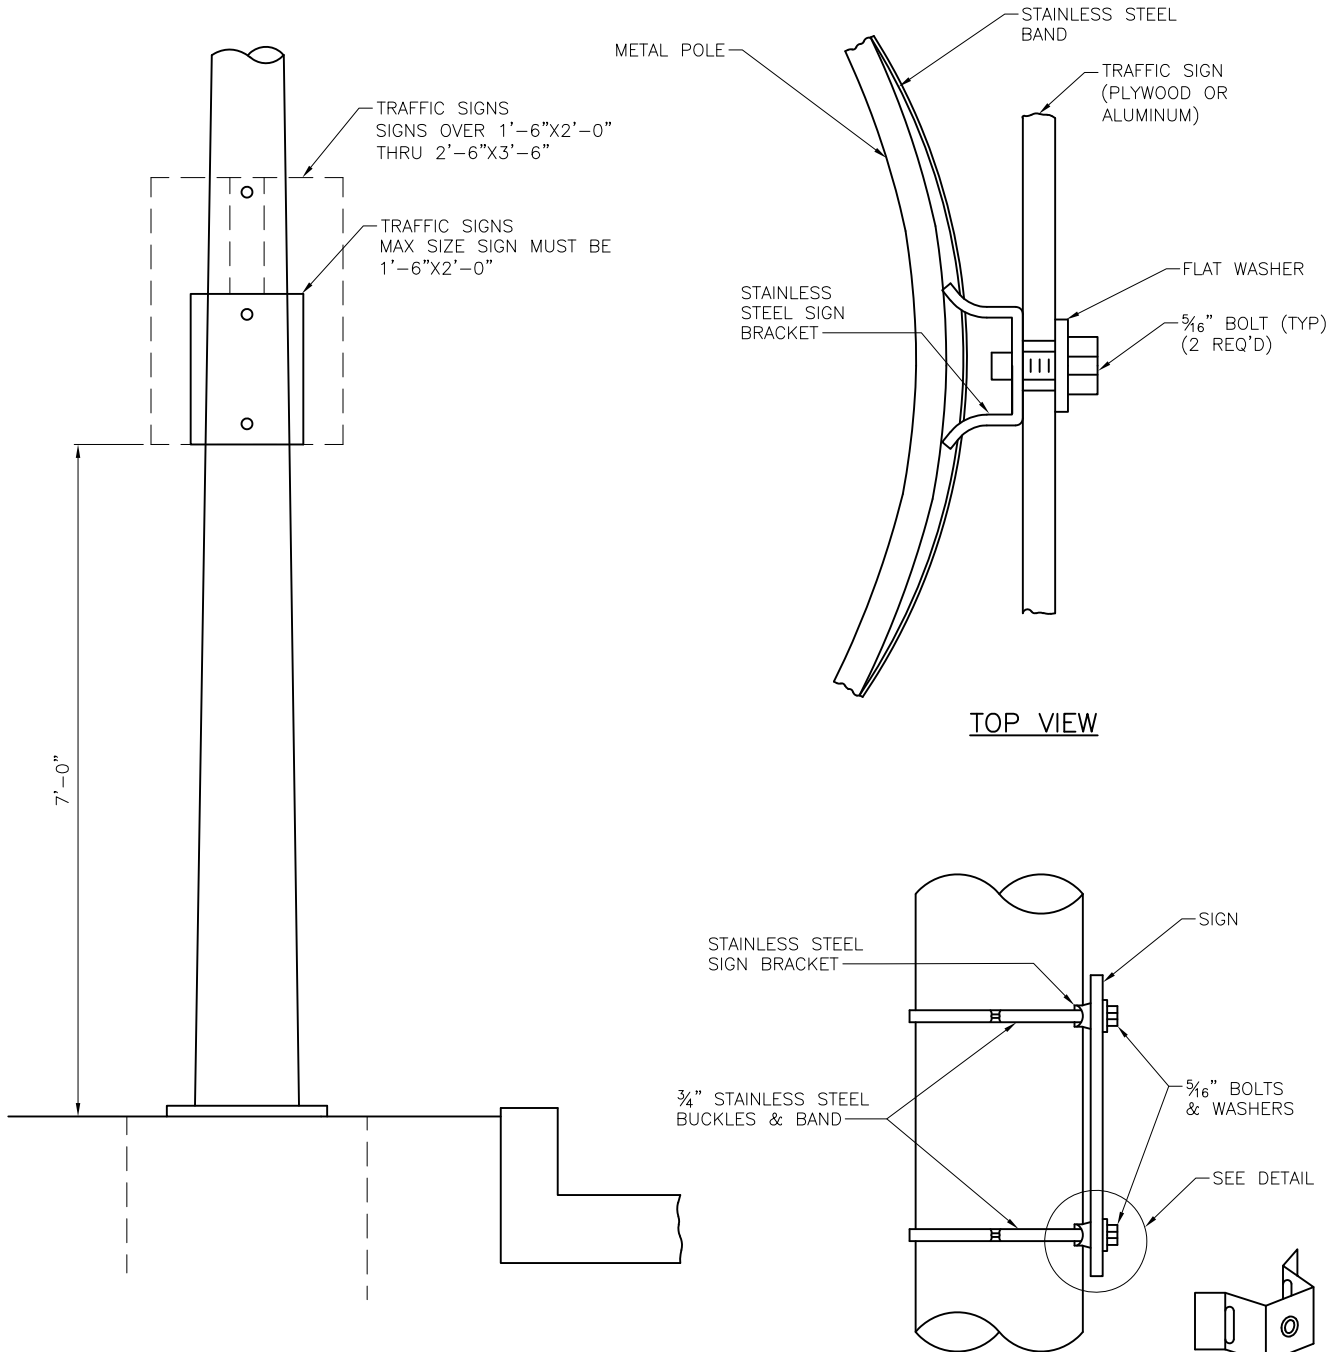

NOTES:

1. ON POLES FILLED WITH OR MADE FROM CONCRETE USE 5/16"x2 1/2" MIN STUD BOLT ANCHORS WITH HEX NUT
2. FOR SIGNS OVER 2'-6"X3'-6" MOUNT SIGNS USING SIGN BRACKETS AS SPECIFIED IN SECTION 8-21.3(1)B3 FOR STREET DESIGNATION SIGNS.
3. FOR DARK COLORED POLES PAINT BAND TO MATCH POLE
4. ALL HARDWARE TO BE STAINLESS STEEL.


REF STD SPEC SEC 8-21



City of Seattle

NOT TO SCALE

TRAFFIC SIGN MOUNTING
ON METAL POLES

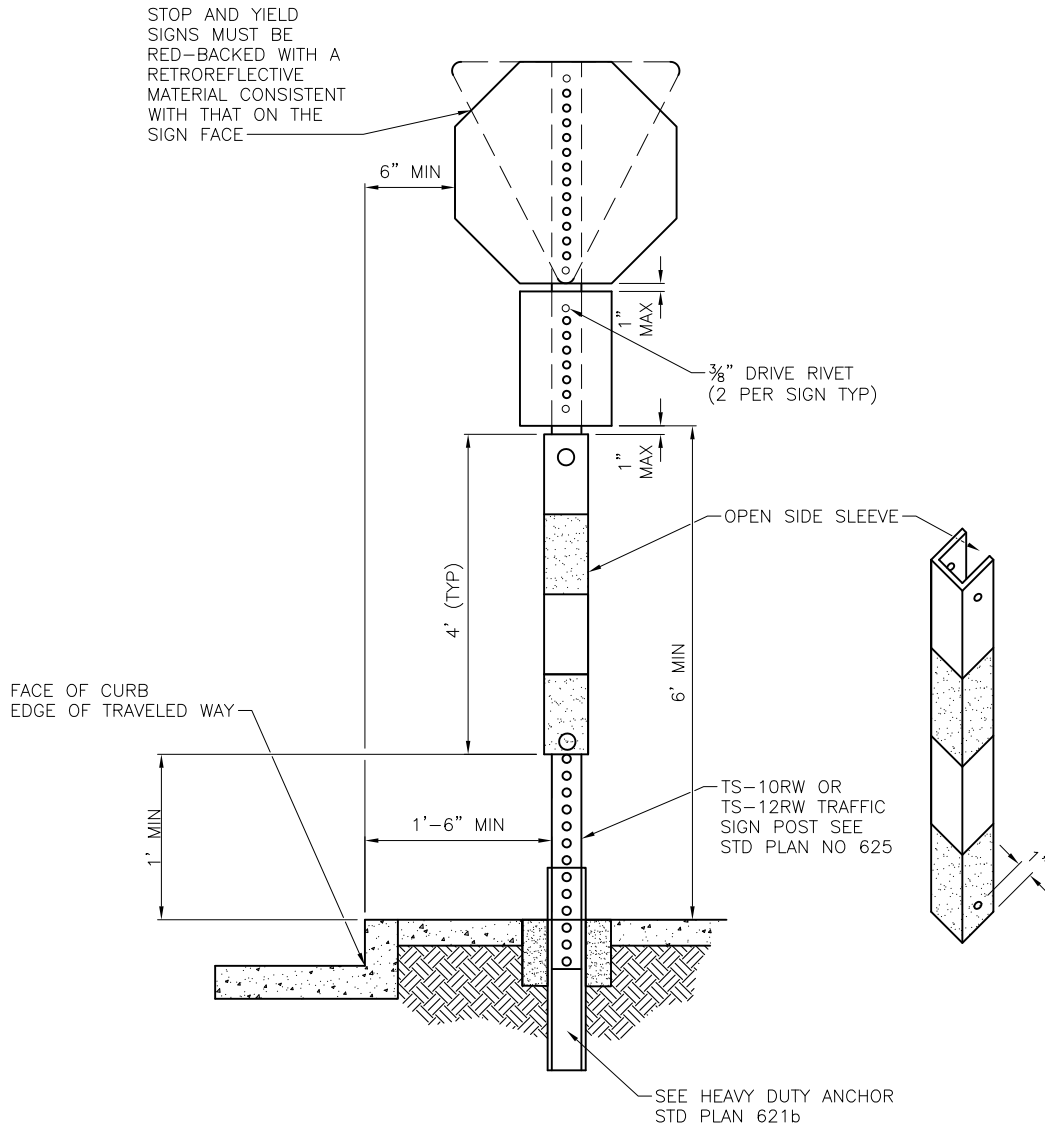

POST ANCHOR INSTALLATIONS

NOTE:

1. CONTACT SEATTLE DEPARTMENT OF TRANSPORTATION (684-5087) FOR DETAILS REGARDING SIGN MESSAGE AND FOUNDATION.
2. STEEL SELF-TAPPING #10 X 1/2" WITH HEX WASHER HEAD ZINC PLATED
3. RED AND WHITE SLEEVE
4. SEE STANDARD 621a FOR OTHER WARNING & REGULATORY SIGN POST

REF STD SPEC SEC 8-21




City of Seattle

NOT TO SCALE


**STOP AND YIELD SIGN POST
AND ANCHOR INSTALLATION**

NOTES:


1. SIGN MUST BE ATTACHED WITH TOP EDGE OF SIGN FLUSH WITH TOP OF SQUARE SECTION OF POST.
2. TS-5 ASSEMBLIES MUST BE USED ONLY WITH APPROVAL OF ENGINEER, IN AREAS NOT SUBJECT TO PEDESTRIAN TRAVEL.
3. POST SLEEVE MAY BE FLUORESCENT YELLOW GREEN OR FHWA YELLOW WHERE SHOWN ON THE DRAWINGS OR APPROVED BY THE ENGINEER.
4. SEE STANDARD PLAN 620 FOR STOP & YIELD SIGN POST.

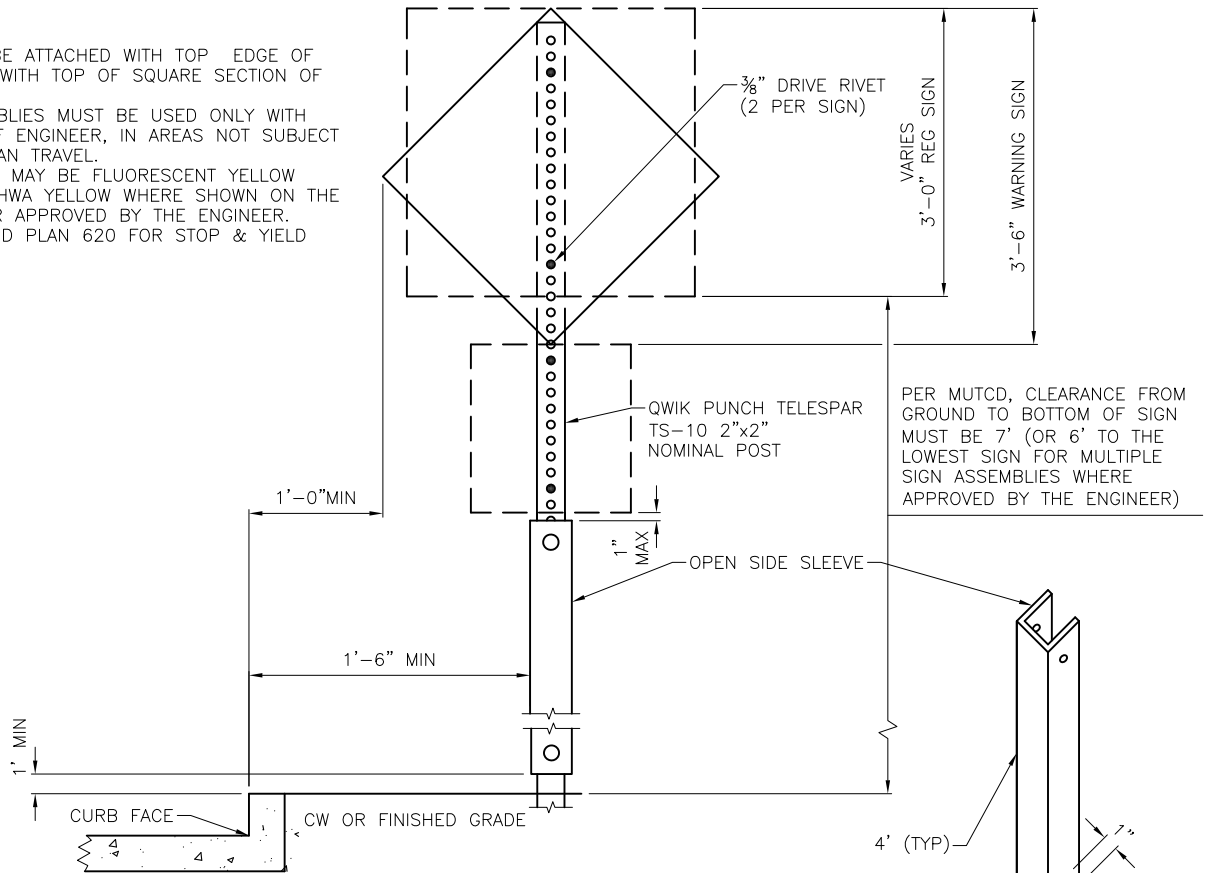

TS-10
(SEE STD PLAN NO 621b FOR POST ANCHOR DETAILS)

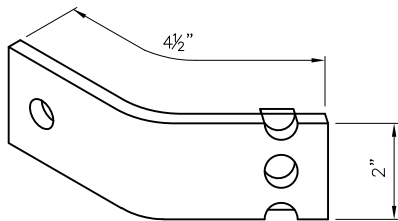

45° POST CONNECTION FITTING

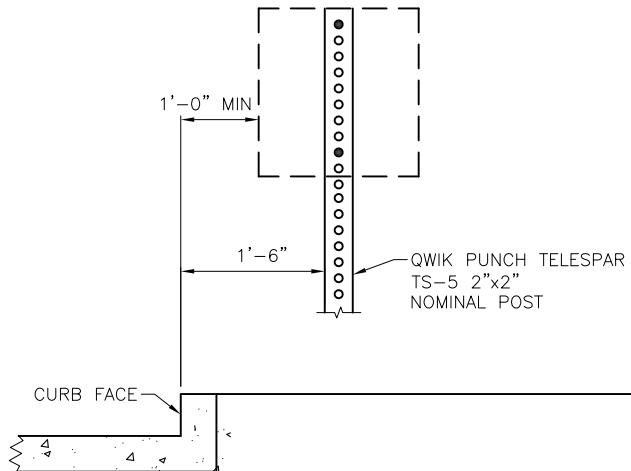

TS-5
(SEE STD PLAN NO 621b FOR POST ANCHOR DETAILS)


REF STD SPEC SEC 8-21





City of Seattle

NOT TO SCALE

WARNING AND REGULATORY SIGN POST

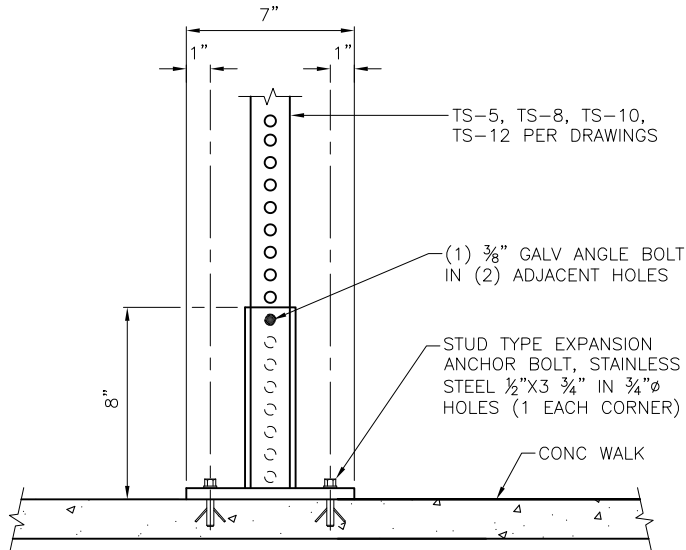

SURFACE MOUNT

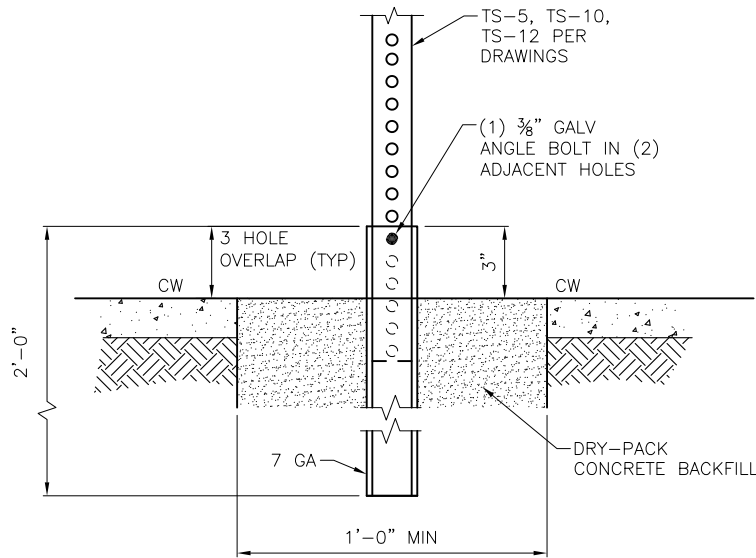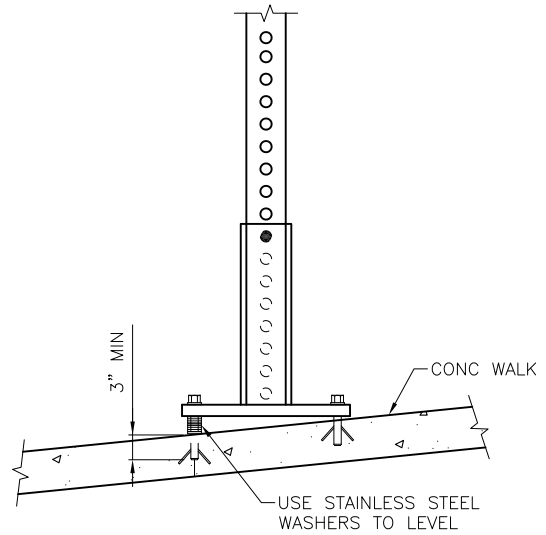

HEAVY DUTY ANCHOR

NOTES:

1. FOR UNLEVEL SIDEWALKS INSERT WASHERS AS SPACERS BETWEEN PLATE AND SIDEWALK. IF BOLT CANNOT PENETRATE SIDEWALK AT LEAST 3", CONTACT THE ENGINEER.
2. USE CONCRETE FOOTINGS FOR ALL SIGNS LARGER THAN 96 SQUARE INCHES.


REF STD SPEC SEC 8-21



City of Seattle

NOT TO SCALE

**WARNING AND REGULATORY
SIGN POST ANCHOR
INSTALLATIONS**

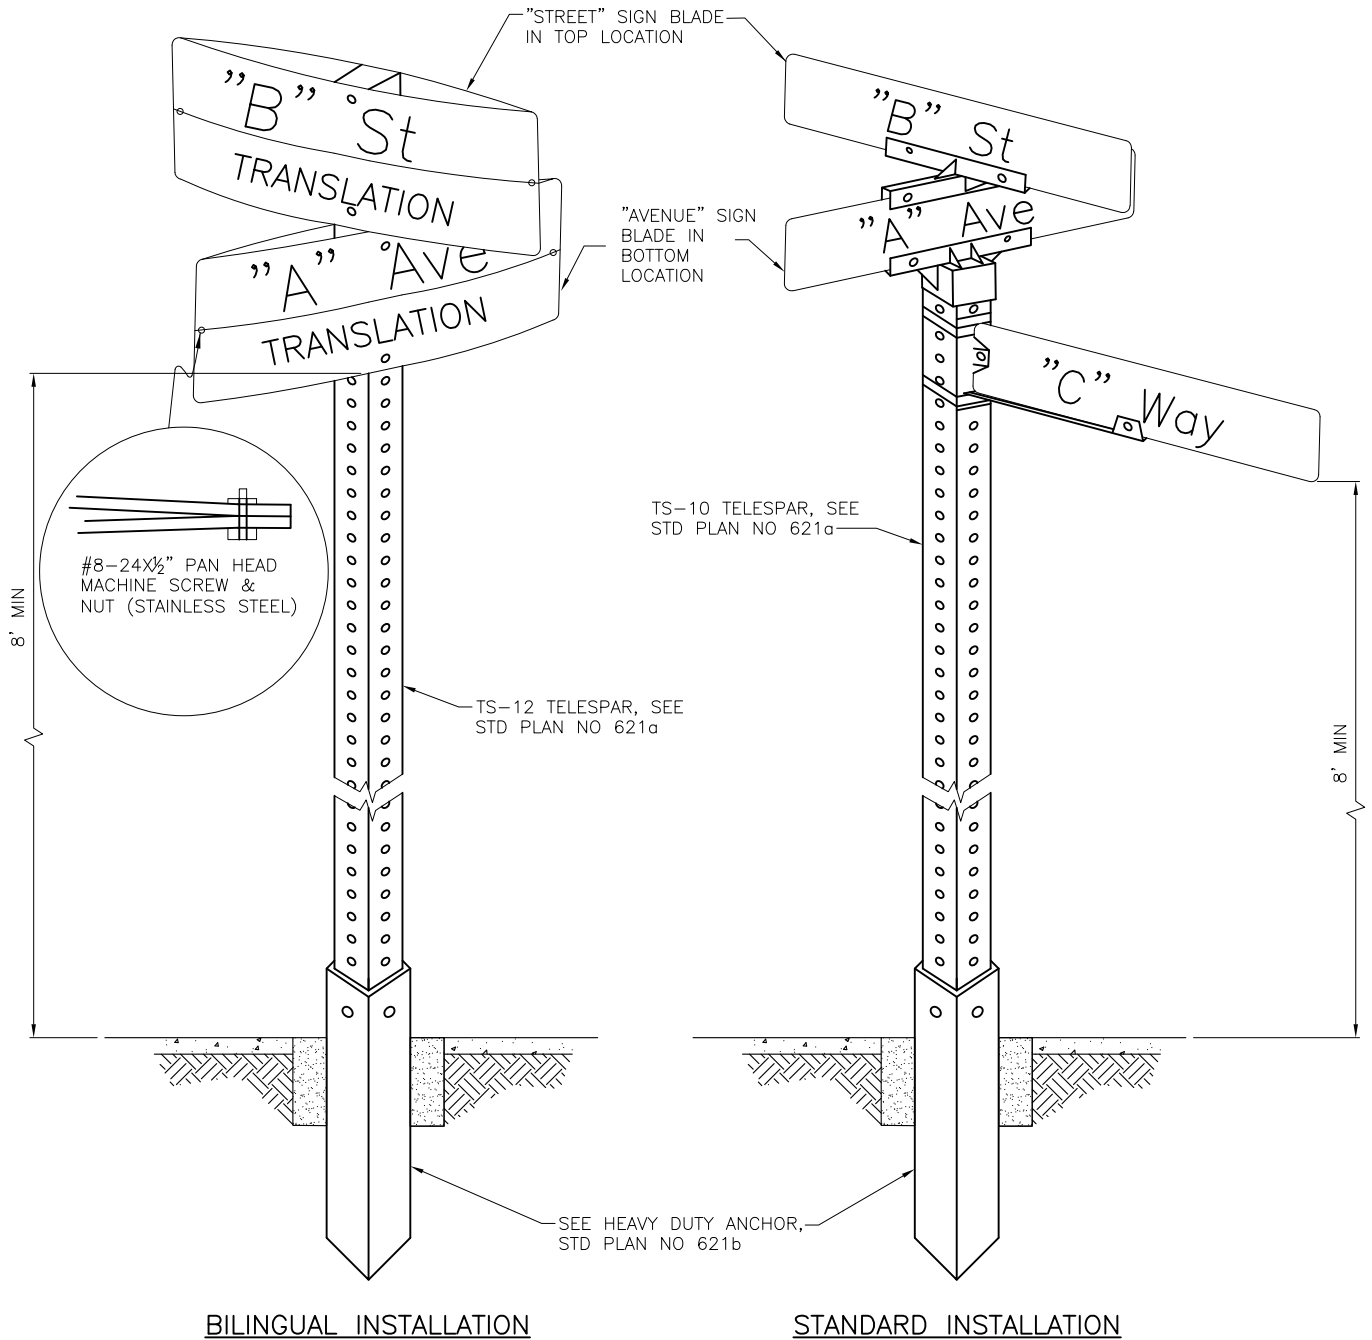

NOTES:

1. SNS BLADE MUST BE INSTALLED PARALLEL TO CORRESPONDING STREET
2. INSTALLATION OF SNS ON ANY OTHER METAL POLE MUST REQUIRE REVIEW AND APPROVAL BY THE ENGINEER
3. SNS/SP RELOCATION: OLD CONCRETE MUST BE REMOVED AND NEW CONCRETE BASE MUST BE CONSTRUCTED
4. ALL STREET NAME SIGNS WILL BE FURNISHED BY THE CITY OF SEATTLE AT PROJECT OR PERMITEE'S EXPENSE

REF STD SPEC SEC 8-21




City of Seattle

NOT TO SCALE

**STREET NAME SIGN
INSTALLATION**

"STREET" SIGN BLADE
IN TOP LOCATION

"AVENUE" SIGN BLADE
IN TOP LOCATION

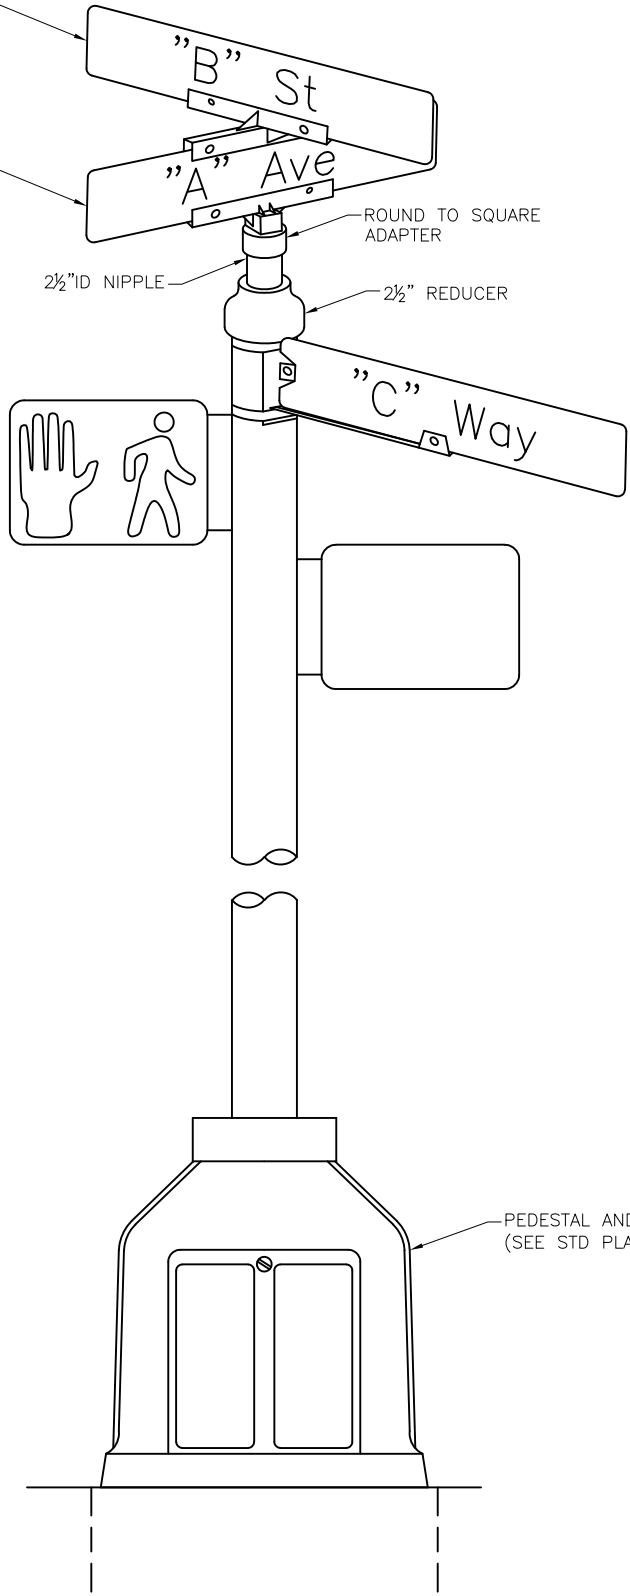

ROUND TO SQUARE
ADAPTER

2 1/2" ID NIPPLE

2 1/2" REDUCER

PEDESTAL AND FOUNDATION
(SEE STD PLAN NO 524)


REF STD SPEC SEC 8-21



City of Seattle

NOT TO SCALE

STREET NAME SIGN
PEDESTAL INSTALLATION

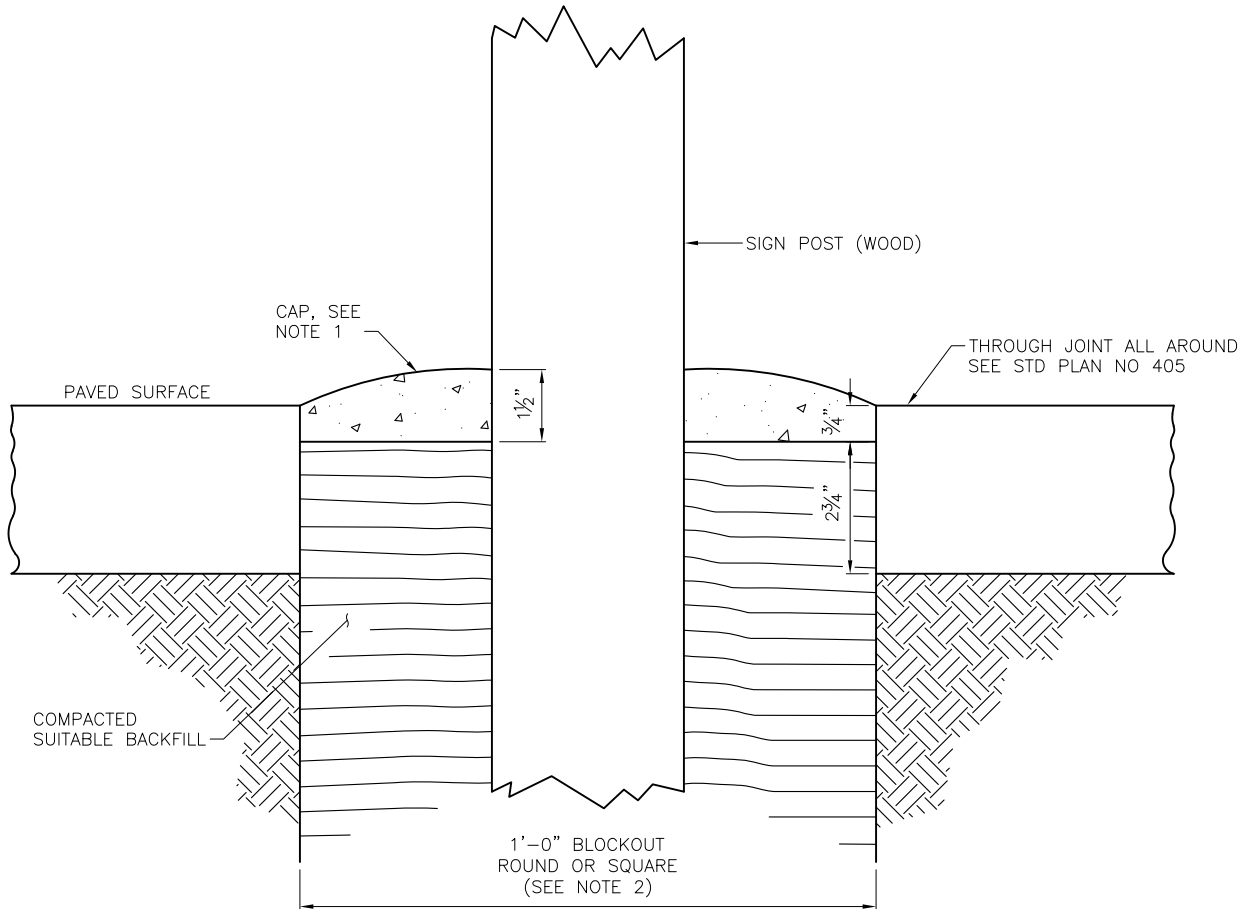

NOTES:

1. CAP MUST BE MADE OF THE SAME MATERIAL AS THE SURROUNDING PAVED SURFACE AND MUST BE MOUNDED FOR DRAINAGE AWAY FROM POST.
2. BLOCKOUTS MUST BE PROVIDED FOR POST LOCATIONS WHERE NEW CONCRETE PAVEMENT (SIDEWALK, ROADWAY, ETC) IS BEING INSTALLED.
3. WHERE POST IS BEING INSTALLED IN EXISTING PAVED AREAS, HOLE IN PAVED SURFACE MUST NOT EXCEED 1'-0" NOMINAL DIAMETER.


REF STD SPEC SEC 8-21



City of Seattle

NOT TO SCALE

POST CAP

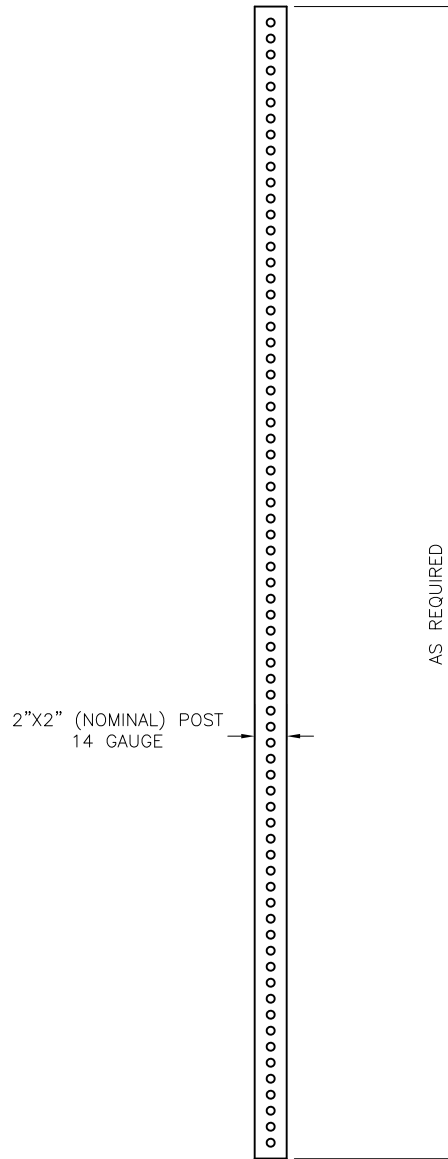

PERFORATED TELESPAR STANDARD SIGN POST
 (TS-5, TS-10, TS-12)(SEE NOTE 2)

NOTES:

- 1. SEE STD PLANS NO 620 & 621.
- 2. SUFFIXES ATTACHED TO TELESPAR NAME DESIGNATIONS INDICATE SLEEVE TYPES: RW-RED/WHITE, FYG-FLOURESCENT YELLOW GREEN, Y-FHWA YELLOW.


REF STD SPEC SEC 8-21



City of Seattle

NOT TO SCALE

TRAFFIC SIGN POSTS

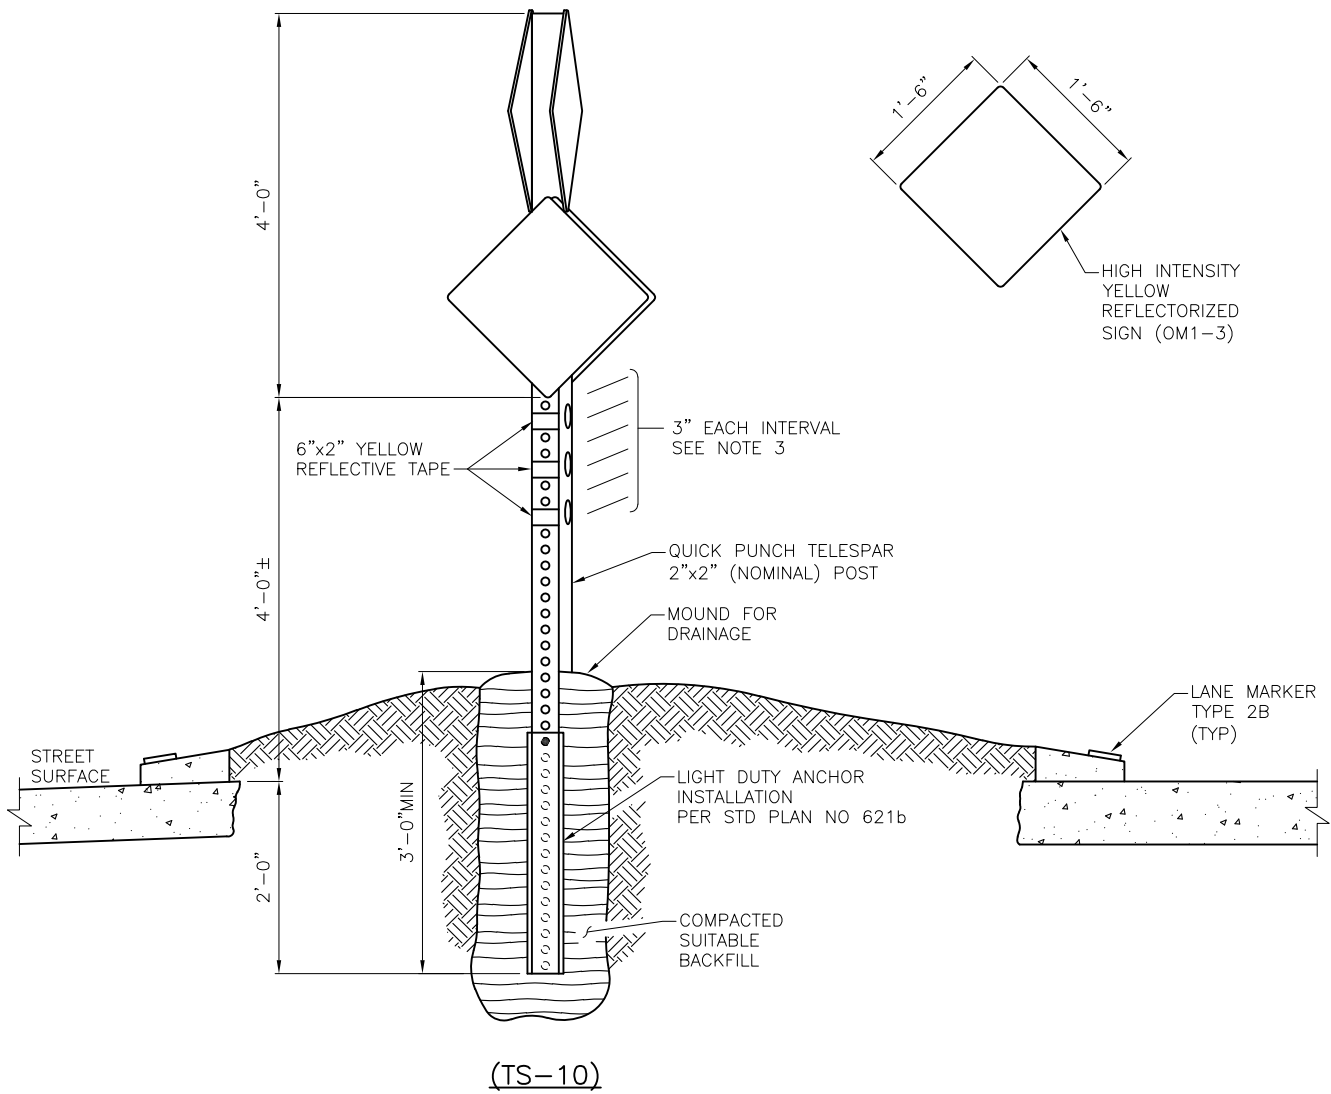

NOTES:

1. IN THE CASE WHERE ALL APPROACHES OF THE INTERSECTION ARE PRIMARILY AT THE SAME LEVEL WITH RESPECT TO GRADES (LESS THAN 3%) THE LOWER SET OF SIGNS MUST FACE THE HIGHER TRAFFIC VOLUME STREET
2. IN THE CASE WHERE AN APPROACH HAS A GRADE LARGER THAN 3% THE HIGHER SIGNS WILL FACE THE STEEPEST APPROACH TO ALLOW BETTER SIGHT DISTANCE
3. PLACE A MINIMUM OF THREE (3) REFLECTORS ON EACH AND EVERY SIDE OF POST OR PLACE THREE (3) HIGH INTENSITY REFLECTORIZED STRIPS COMPLETELY AROUND POST


REF STD SPEC SEC 8-21



City of Seattle

NOT TO SCALE


**OBJECT MARKER INSTALLATION
IN TRAFFIC CIRCLE**

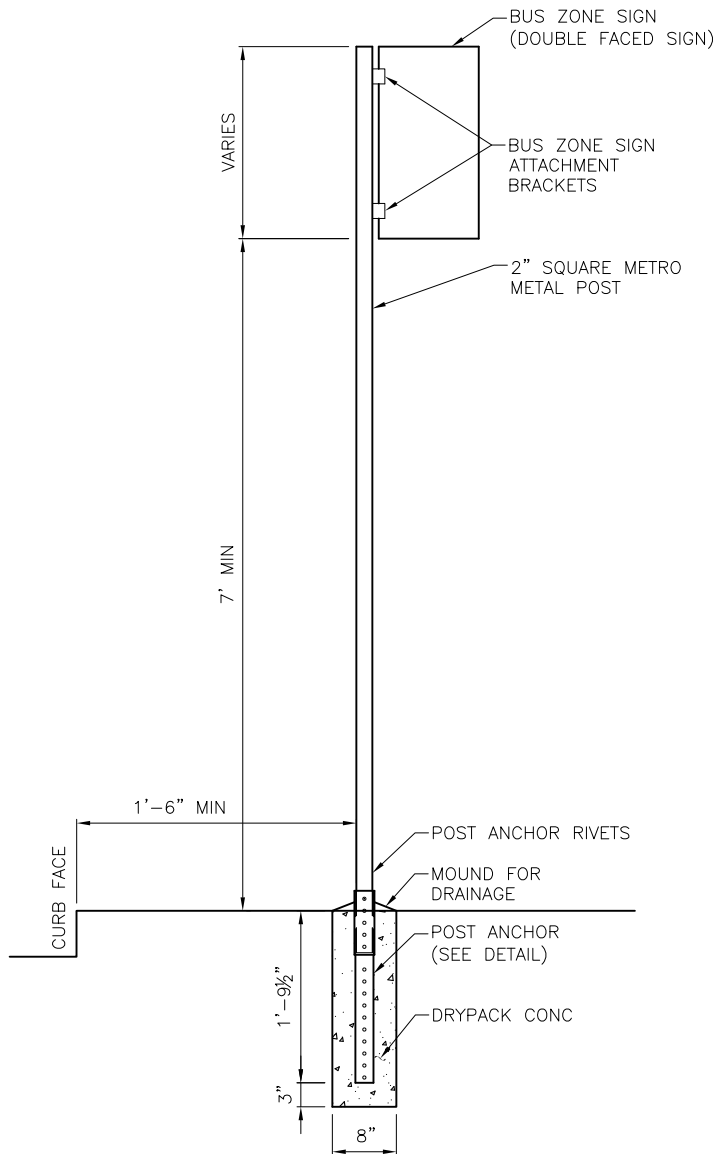


DIRECT BURIAL INSTALLATION

NOTES:


1. POST ANCHOR RIVETS MUST BE 1/2" ABOVE GROUND LEVEL
2. ATTACHMENT BRACKETS MUST FACE AWAY FROM STREET AS WHEN POST IS LOCATED 3'-0" FROM EDGE OF CURB. ATTACHMENT BRACKETS MUST FACE TOWARDS STREET (TS) WHEN POST IS LOCATED AT BACK SIDE OF SIDEWALK
3. FOR POST RELOCATIONS, OLD CONCRETE MUST BE REMOVED FROM POST
4. ALL SIGNS, STRUCTURES AND HARDWARE PROVIDED BY METRO EXCEPT WHERE NOTED OTHERWISE ON THIS STD PLAN.
5. WHERE SURFACE MOUNTED BUS ZONE SIGNS ARE REQUIRED ON SLOPED SIDEWALK, THE CONTRACTOR MUST PLUMB THE POST BY BUILDING A NON-SHRINK GROUT PAD UNDER PEDESTAL ASSEMBLY WITH SMOOTH 1H TO 1V TAPER ON THE GROUT EDGE. THE BOLT ANCHOR LENGTH MUST BE ADJUSTED TO PROVIDE A MIN 3/2" EMBEDMENT THROUGH THE GROUT INTO THE EXISTING CONCRETE.

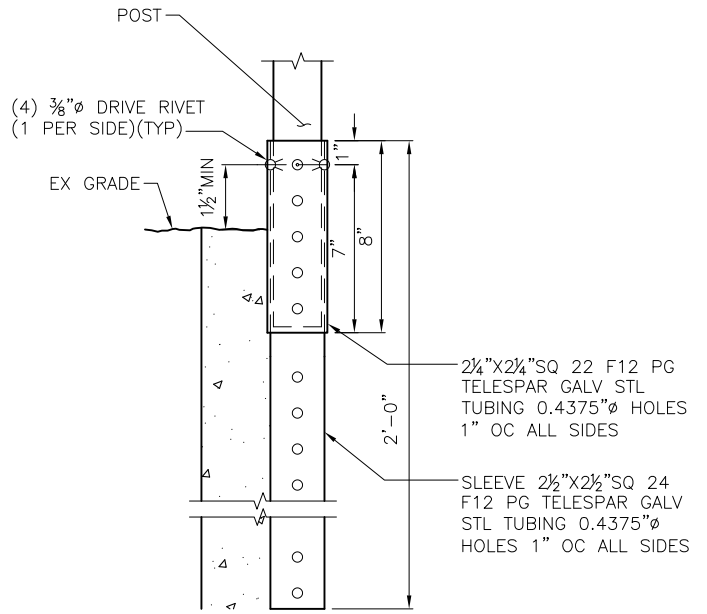

POST ANCHOR DETAIL

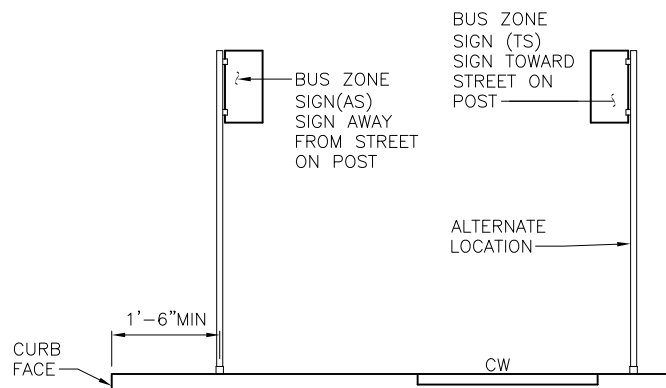

SIGN LOCATION DETAIL

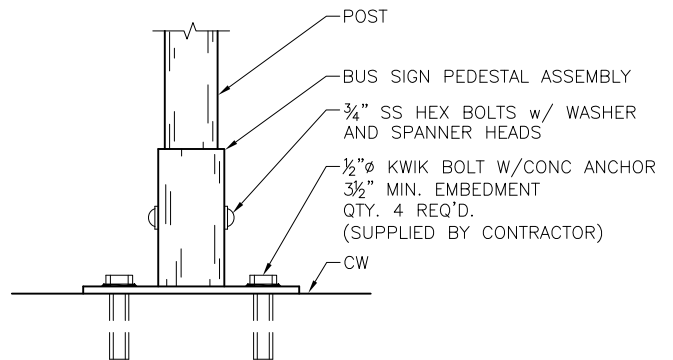

SURFACE MOUNT INSTALLATION


REF STD SPEC SEC 8-21



City of Seattle

NOT TO SCALE

METRO BUS ZONE SIGN INSTALLATION

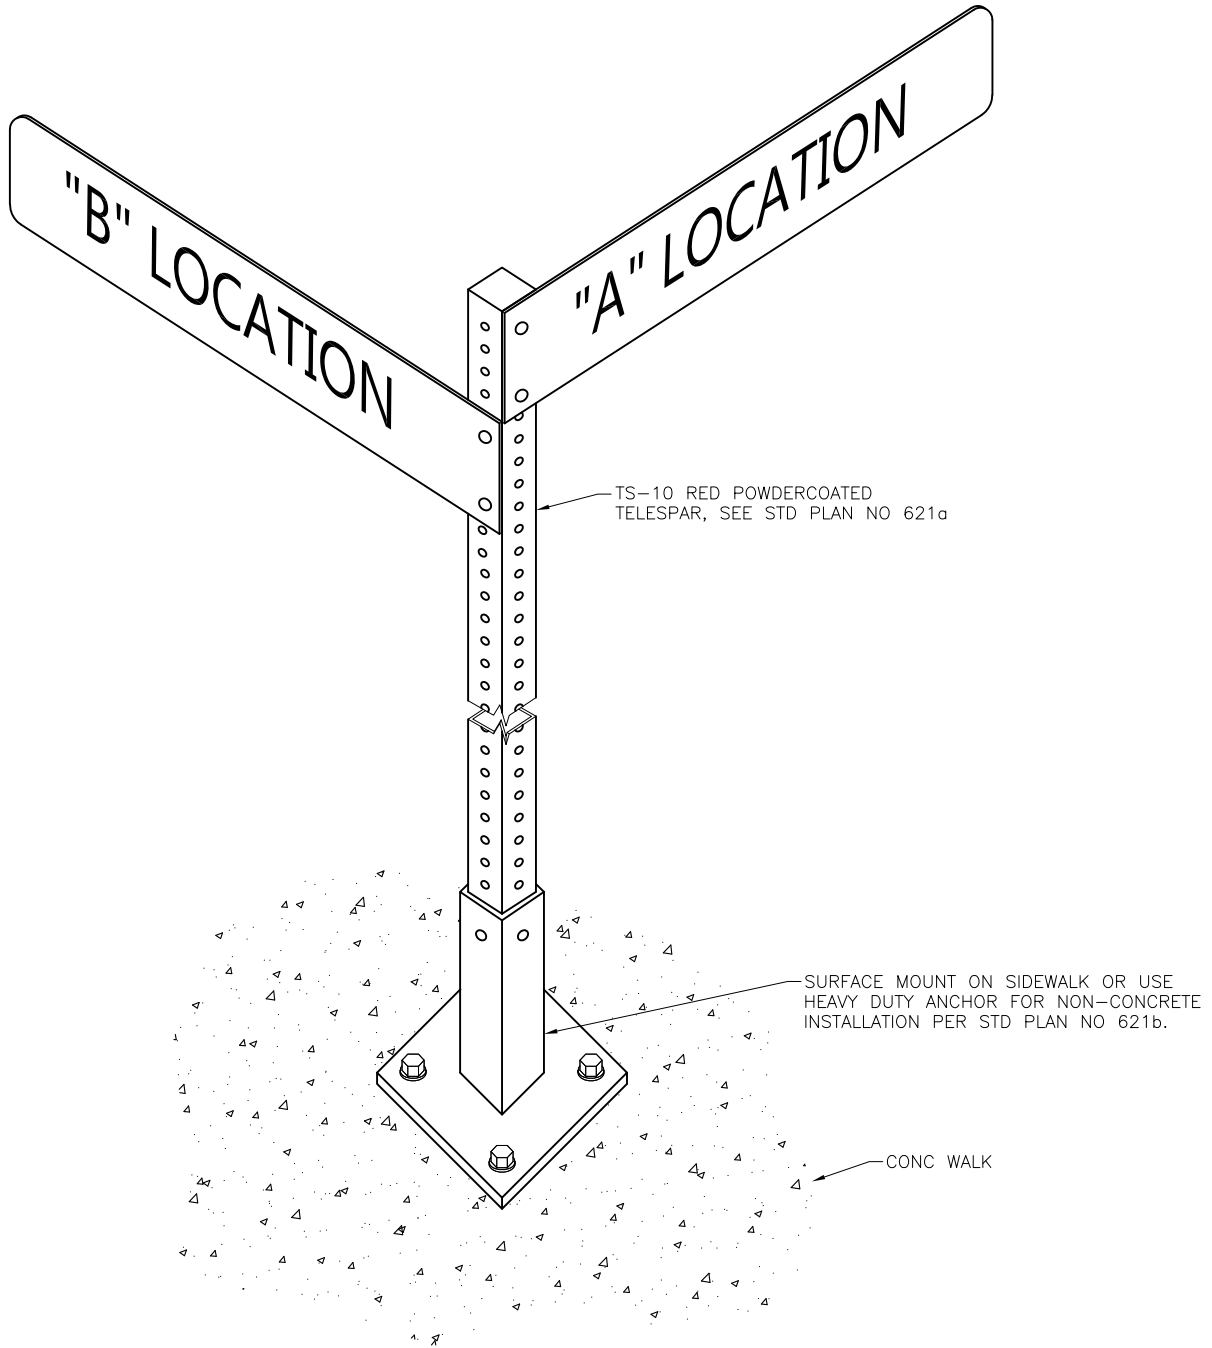

NOTES:

- 1. WAYFINDING BLADE MUST BE INSTALLED POINTING IN THE DIRECTION OF THE LOCATION ON BLADE.
- 2. CITY OF SEATTLE WILL FABRICATE WAYFINDING SIGNS. CONTRACTOR MUST SUPPLY MOUNTING HARDWARE AND INSTALL SIGNS.
- 3. MAINTAIN 8 FEET MINIMUM OF VERTICAL CLEARANCE FROM CONCRETE WALK TO THE BOTTOM OF PEDESTRIAN WAYFINDING BLADES.



REF STD SPEC SEC 8-21



City of Seattle

NOT TO SCALE

PEDESTRIAN
WAYFINDING SIGN




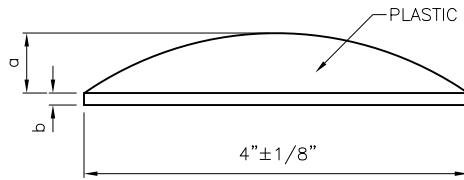
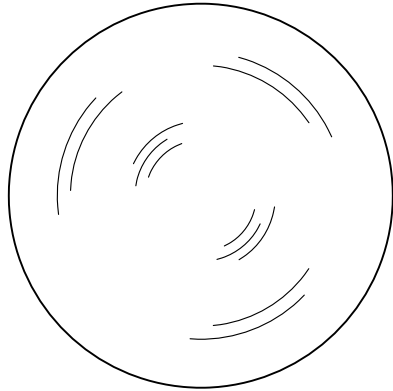


LANE MARKER-TYPE 1

$$a = 5/8 \pm 1/8"$$


$$b = 1/8 \pm 1/16"$$

▲ DIRECTION OF TRAFFIC

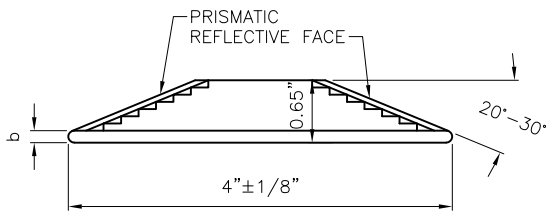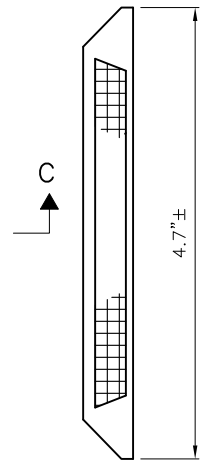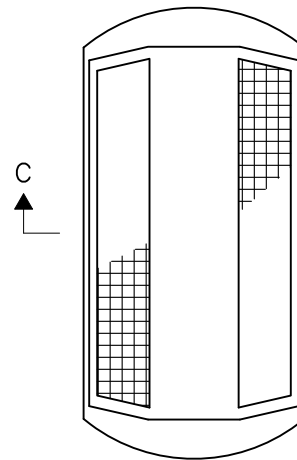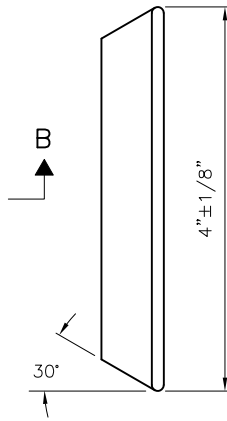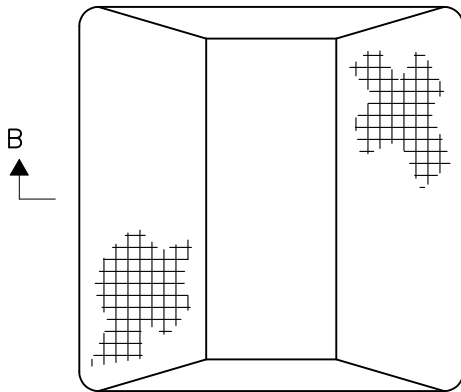

SECTION B-B

LANE MARKER-TYPE 2A
4" PRISMATIC REFLECTIVE MARKER

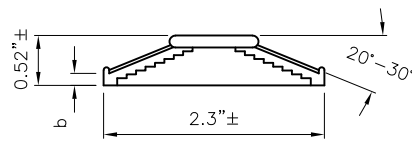

SECTION C-C

LANE MARKER-TYPE 2B


REF STD SPEC SEC 8-08



City of Seattle

NOT TO SCALE

TRAFFIC BUTTONS &
LANE MARKERS

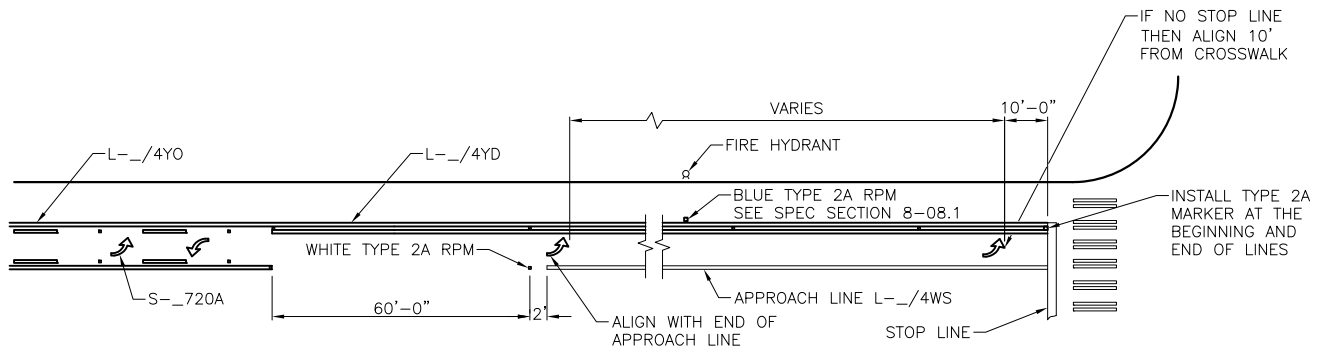


TYPICAL TURN LANE CHANNELIZATION

NUMBER OF LEGEND SETS REQUIRED BASED ON THE LENGTH OF APPROACH LINES

APPROACH LENGTH	LEGEND SETS
LESS THAN 50 FEET	1 SET AT X-WALK END OF POCKET
50 FEET TO 120 FEET	2 SETS
125 FEET TO 300 FEET	3 SETS (SECOND LEGEND LOCATED MIDWAY BETWEEN FIRST AND LAST LEGENDS)
OVER 300 FEET	ADDITIONAL SETS SPACED AT APPROX 100 FT INTERVALS BETWEEN FIRST AND LAST SETS

NOTES:

LEFT TURN LANE LAYOUT SHOWN ABOVE. SAME LAYOUT APPLIES FOR OTHER TURN LANES.

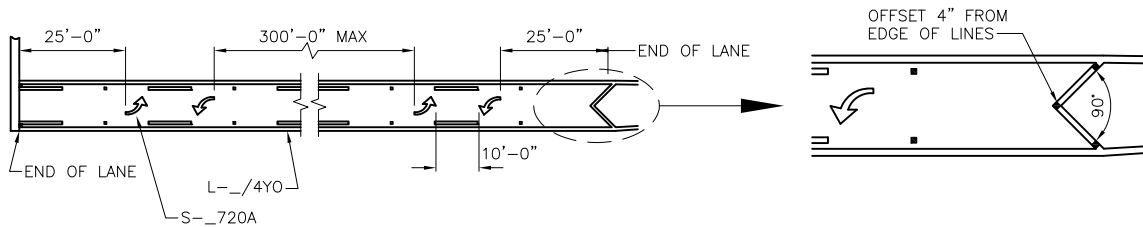

TYPICAL TWO WAY LEFT TURN LANE CHANNELIZATION

NUMBER OF LEGEND SETS REQUIRED BASED ON THE LENGTH OF TYPICAL TWO WAY LEFT TURN LANES

APPROACH LENGTH	LEGEND SETS
LESS THAN 50 FEET	1 SET AT X-WALK END OF POCKET
50 FEET TO 300 FEET	2 SETS
OVER 300 FEET	3 SETS (SECOND LEGEND LOCATED MIDWAY BETWEEN FIRST AND LAST LEGENDS) ADDITIONAL SETS SPACED AT APPROX 300 FT INTERVALS

NOTE:

LINE CALLOUTS ARE IDENTIFIED & DESCRIBED IN STD SPEC SEC 8-22.


REF STD SPEC SEC 8-22



City of Seattle

NOT TO SCALE

TYPICAL TURN LANE CHANNELIZATION AND LEGEND PLACEMENT

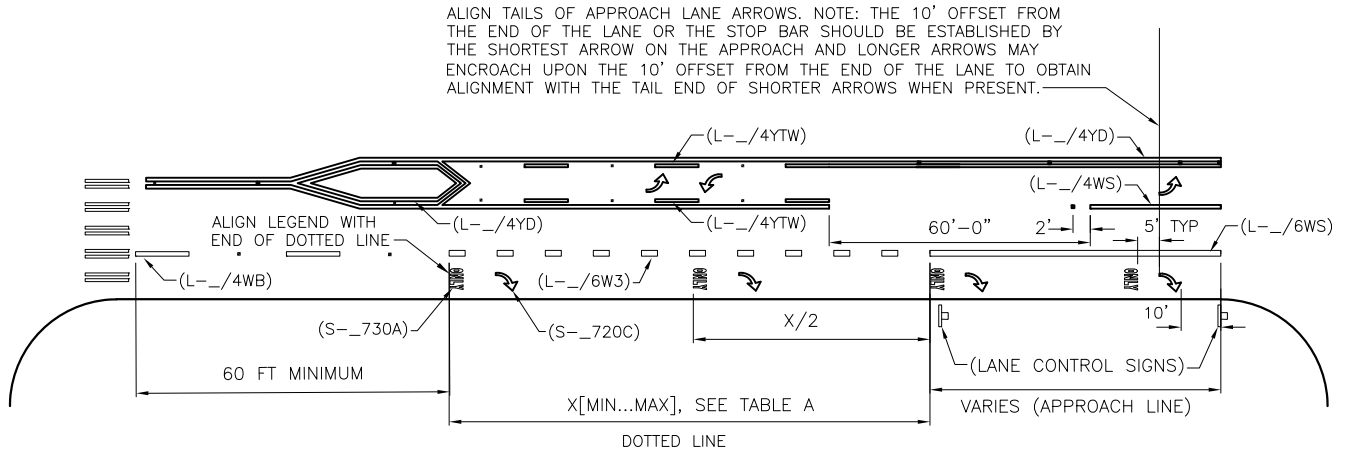

NOTE:
LEGENDS, SYMBOLS & ARROWS MUST BE CENTERED WITHIN THE LANE TO WHICH THEY APPLY, AS SHOWN.

TABLE A

POSTED OR 85TH-PERCENTILE SPEED	X	
	MAX	MIN
20 MPH	MUTCD TABLE 2C-4 CONDITION A 225 FT	MERGING TAPER 75 FT
25 MPH	325 FT	115 FT
30 MPH	460 FT	165 FT
35 MPH	565 FT	225 FT
40 MPH	670 FT	295 FT
45 MPH	775 FT	375 FT

TYPICAL LEGEND AND SYMBOL INSTALLATION DETAILS

LINE LENGTH	LEGEND SETS	
	WITHIN APPROACH LINE	WITHIN DOTTED LINE
LESS THAN 50 FEET	APPROACH LINE (1 TOTAL)	NA
50 FEET TO 120 FEET	ADD 1 SET AT BEGINNING OF APPROACH LINE (2 TOTAL)	ADD 1 SET MIDWAY BETWEEN FIRST SET AND APPROACH LINE (2 TOTAL)
125 FEET TO 300 FEET	ADD 1 SET LOCATED MIDWAY BETWEEN FIRST AND LAST SETS (3 TOTAL)	ADD 1 SET, WITH EQUAL INTERVALS, BETWEEN FIRST SET AND APPROACH LINE (3 TOTAL)
OVER 300 FEET	ADD SETS SPACED AT APPROX. 100 FEET INTERVALS BETWEEN FIRST AND LAST SETS	

NOTE:
1. SEE MUTCD SECTION 2B.20 FOR GUIDANCE ON SIGNS.
2. MANDATORY MOVEMENT LANE CONTROL SIGNS MUST BE PAIRED WITH LEGENDS PLACED WITHIN THE APPROACH LINE


REF STD SPEC SEC 8-22



City of Seattle

NOT TO SCALE

TYPICAL LANE DROP CHANNELIZATION AND LEGEND PLACEMENT

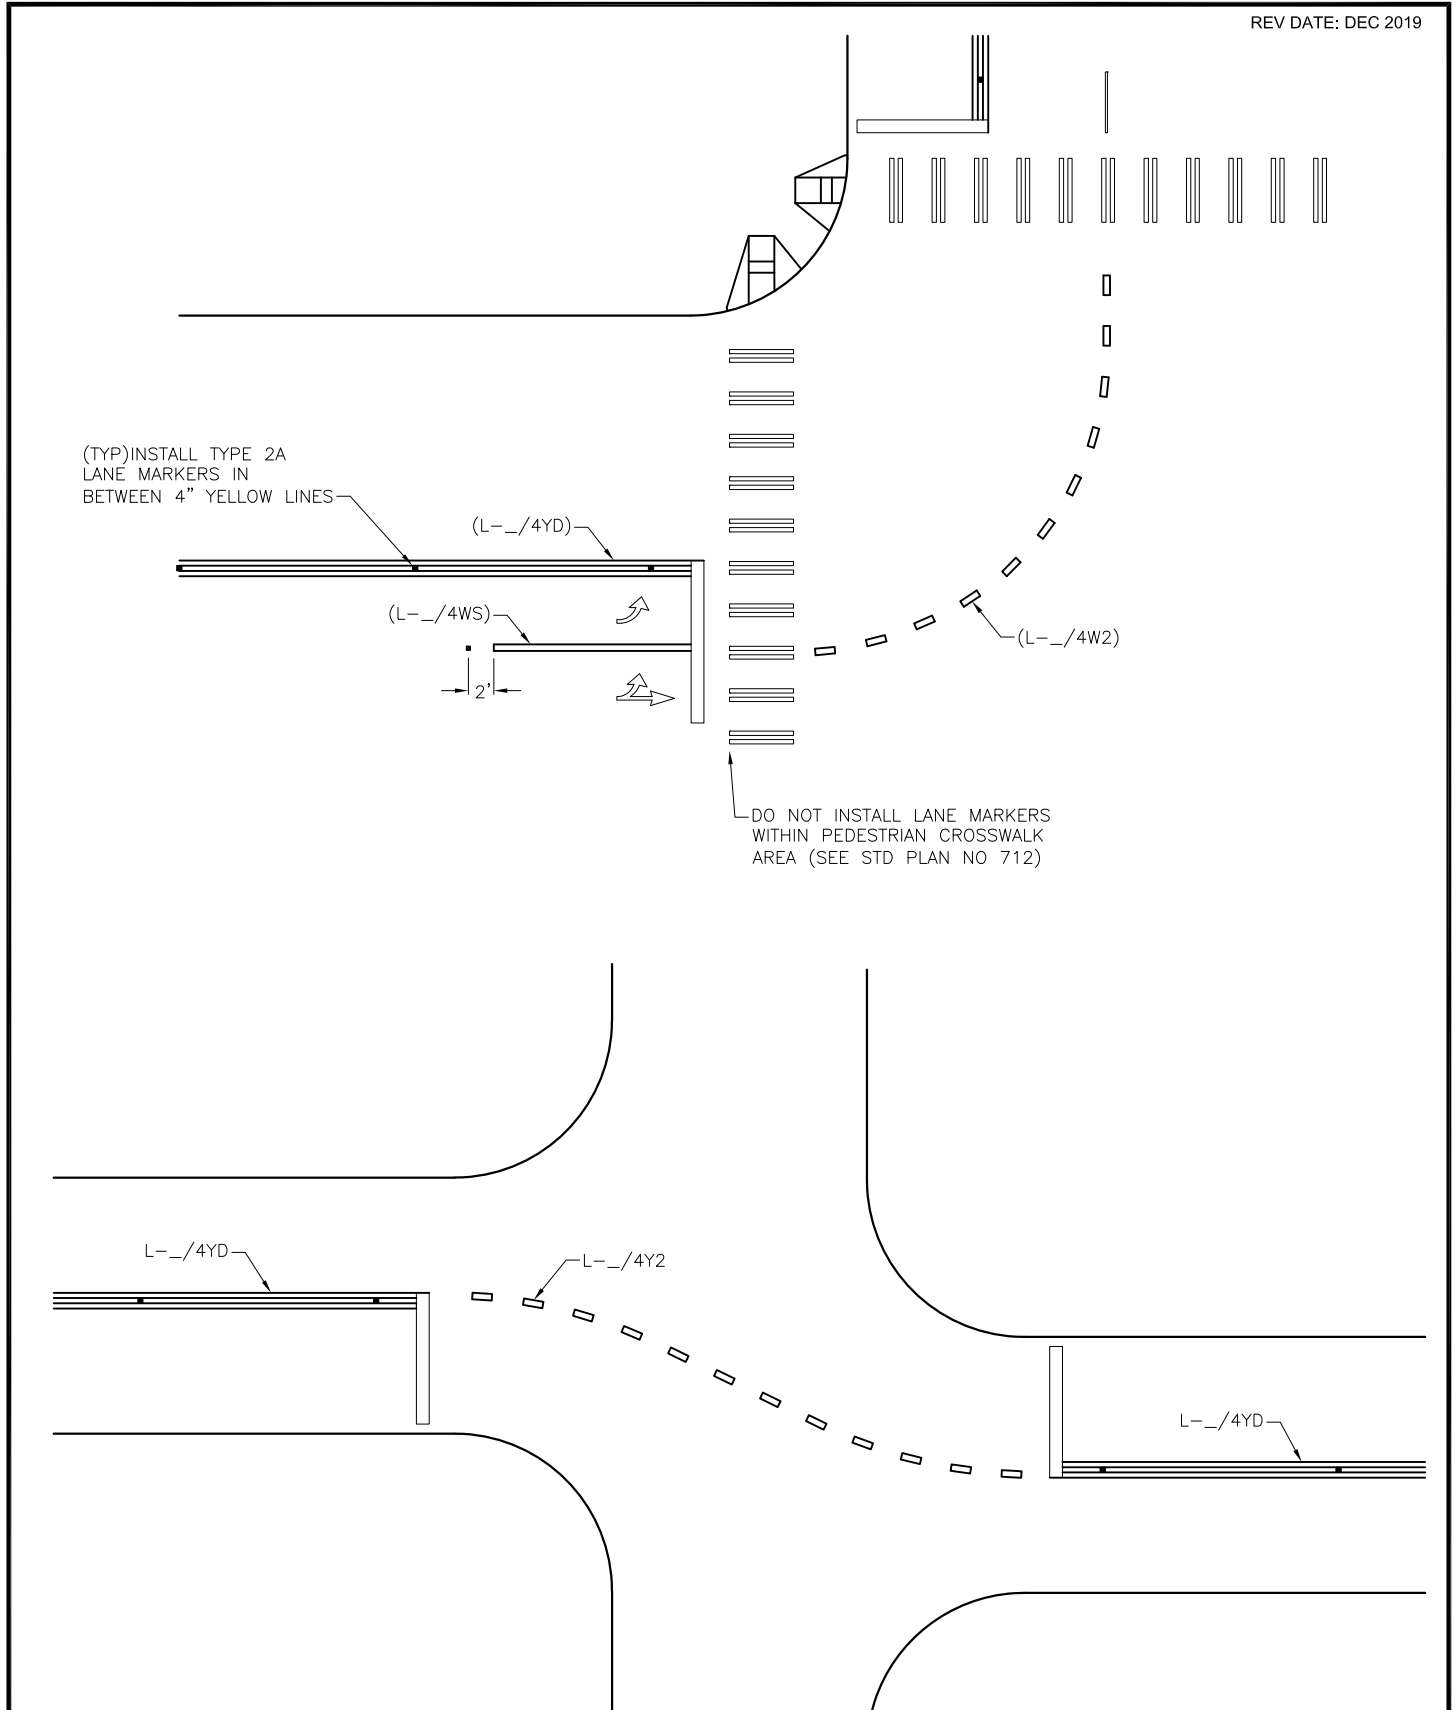


REF STD SPEC SEC 8-22



City of Seattle

NOT TO SCALE

TYPICAL INTERSECTION
GUIDELINE CHANNELIZATION

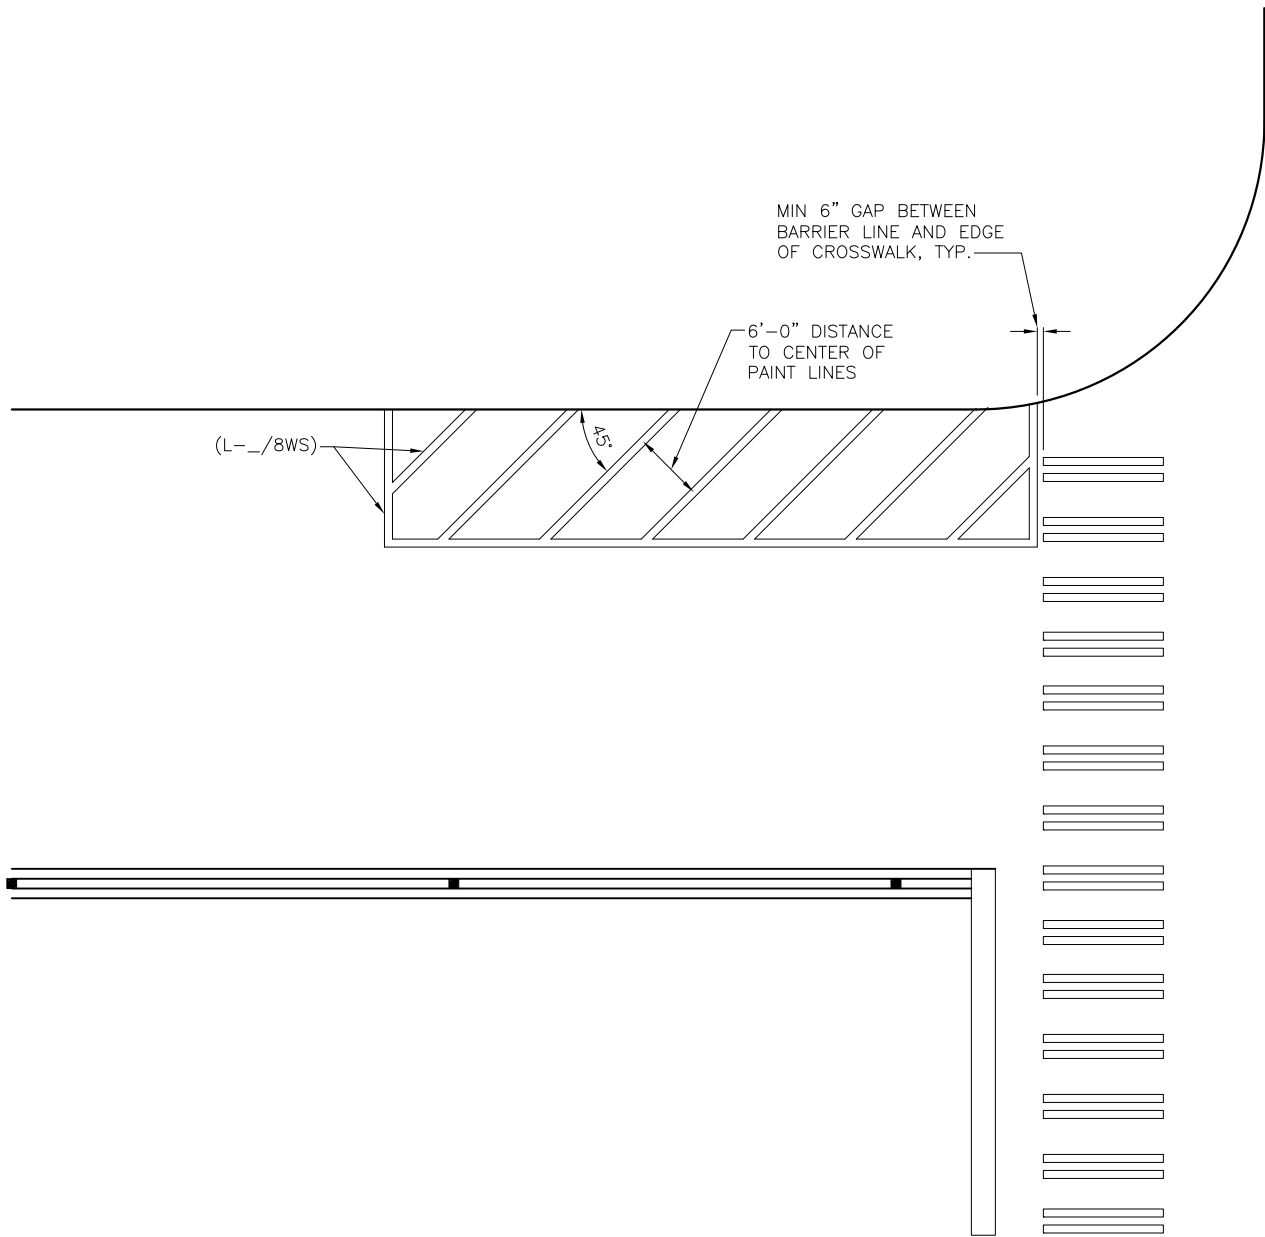


REF STD SPEC SEC 8-22



City of Seattle


NOT TO SCALE

TYPICAL WHITE BARRIER
AREA CHANNELIZATION

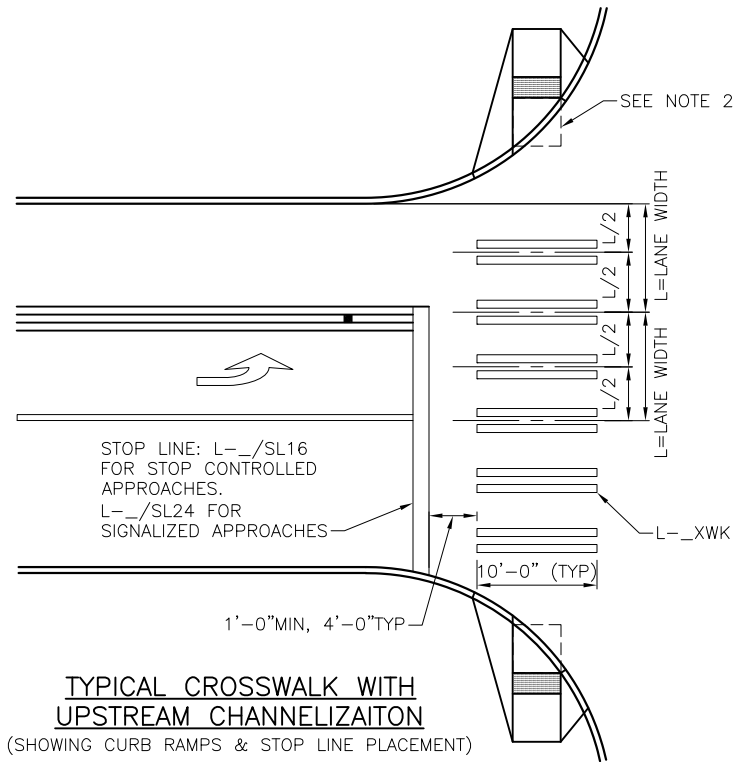

TYPICAL CROSSWALK WITH UPSTREAM CHANNELIZATION


(SHOWING CURB RAMPS & STOP LINE PLACEMENT)

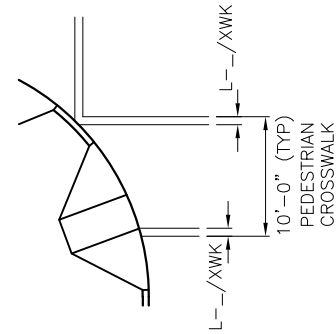

TYPICAL TRANSVERSE LINE CROSSWALK

NOTES:

1. "LADDER STYLE" CROSSWALK MUST BE USED IN MOST APPLICATIONS. "TRANSVERSE LINE" CROSSWALK (L-_/XWK2, L-_/XWK) MAY ONLY BE USED WITH APPROVAL OF ENGINEER.
2. LOWER LANDING OF CURB RAMP MUST FALL WHOLLY WITHIN CROSSWALK LINES. SEE STANDARD PLAN NO 422k.
3. WHERE EXISTING TRAFFIC LOOP LOCATIONS ARE BETWEEN 1' AND 4' FROM THE EDGE OF CROSSWALK, STOP LINE MAY BE PLACED UP TO 2' FROM THE CROSSWALK WITH THE APPROVAL OF ENGINEER.
4. EXACT LOCATION OF CROSSWALK AND STOP LINES MUST BE APPROVED BY SDOT.
5. COLORED OR TEXTURED PAVEMENT CROSSWALKS MUST BE SUPPLEMENTED WITH "TRANSVERSE LINE" CROSSWALK MARKINGS.
6. EXISTING CROSSWALK MARKINGS THAT CONFLICT WITH NEW CROSSWALK MARKINGS MUST BE REMOVED.
7. WHEN MARKED CROSSWALK ARE NOT PRESENT, STOP BAR MUST BE PLACED AT A MINIMUM DISTANCE OF 4'-0" UPSTREAM FROM THE EDGE OF THE DETECTABLE WARNING SURFACE OR ANTICIPATED PEDESTRIAN TRAVEL PATH, WHICHEVER IS GREATER.

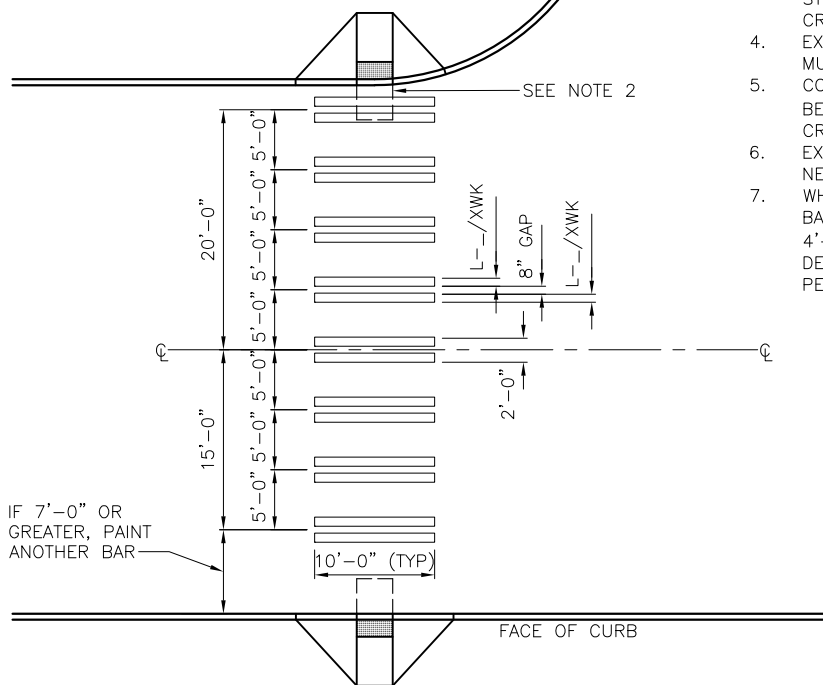

TYPICAL CROSSWALK WITHOUT UPSTREAM CHANNELIZATION

(SHOWING CURB RAMPS & STOP LINE PLACEMENT)

WHERE TRAFFIC LANE LINES ARE NOT USED, LADDER BARS MUST BE 5'-0" CENTER TO CENTER, BEGINNING AT THE MARKED CENTERLINE OF THE ROADWAY


REF STD SPEC SEC 8-22




City of Seattle

NOT TO SCALE


TYPICAL CROSSWALK & STOP LINE INSTALLATION DETAILS

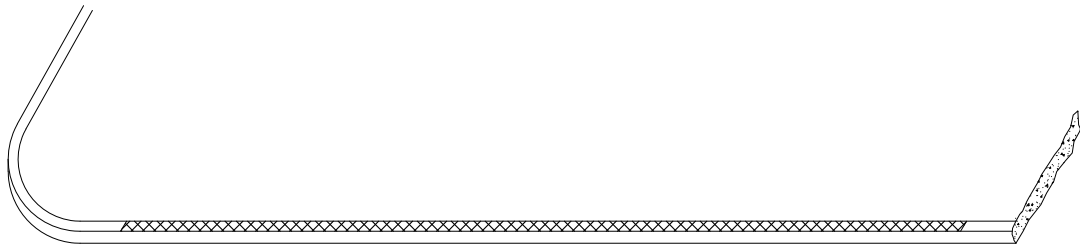


C- /W
PASSENGER LOAD ZONE, ETC
(WHITE)

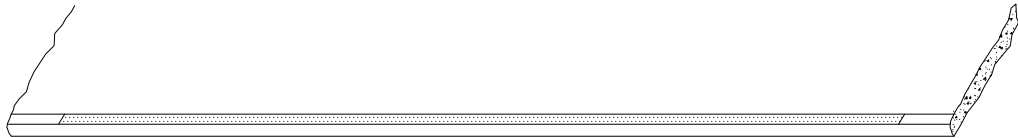


C- /R
TOW-AWAY ZONE
(RED)

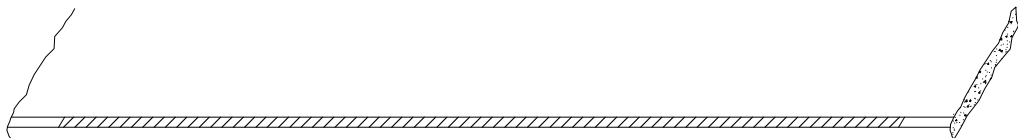

C- /Y
COMMERCIAL LOAD, TRUCK LOAD, LOAD & UNLOAD ZONE, ETC
(YELLOW)

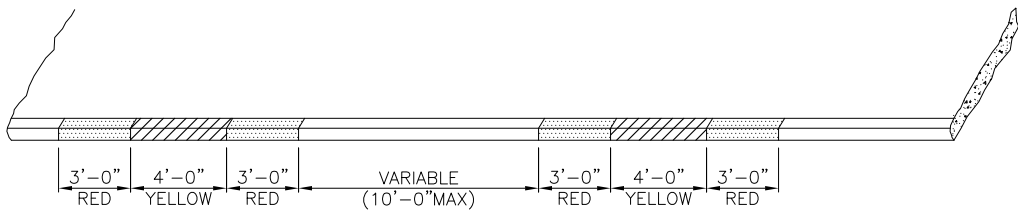

C- /BUS
BUS ZONE (NON PARKING METERED AREAS)
BUS ZONES ARE PAINTED ON TOP & FACE OF CURB

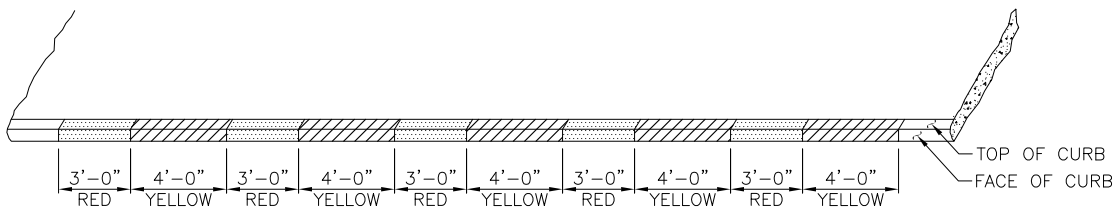

C- /BUSB
BUS ZONE (PARKING METERED AREAS)
BUS ZONES ARE PAINTED ON TOP & FACE OF CURB

NOTES:

1. TOTAL LENGTH OF CURB MARKINGS MUST BE AS SHOWN ON DRAWINGS
2. PAINT MUST BE APPLIED NEATLY ON THE CURB AND ALL PAINT SMEARS ON ADJACENT SURFACES MUST BE REMOVED

REF STD SPEC SEC 8-22




City of Seattle

NOT TO SCALE

CURB MARKING DETAILS

A	S	X	L	W	C	A	S	X	L	W	C
45°	15'	15'	21.21'	8.5'	12.02'	60°	15'	8.66'	17.32'	8.5'	9.81'
	15'	15'	21.30'	9.0'	12.75'		15'	8.5'	17.2'	9.0'	10.5'
	16'	16'	22.63'	9.0'	12.73'		16'	9.24'	18.48'	9.0'	10.39'
	17'	17'	24.04'	9.5'	13.44'		17'	9.81'	19.63'	9.5'	10.97'
	18'	18'	25.46'	10.0'	14.14'		18'	10.39'	20.78'	10.0'	11.55'

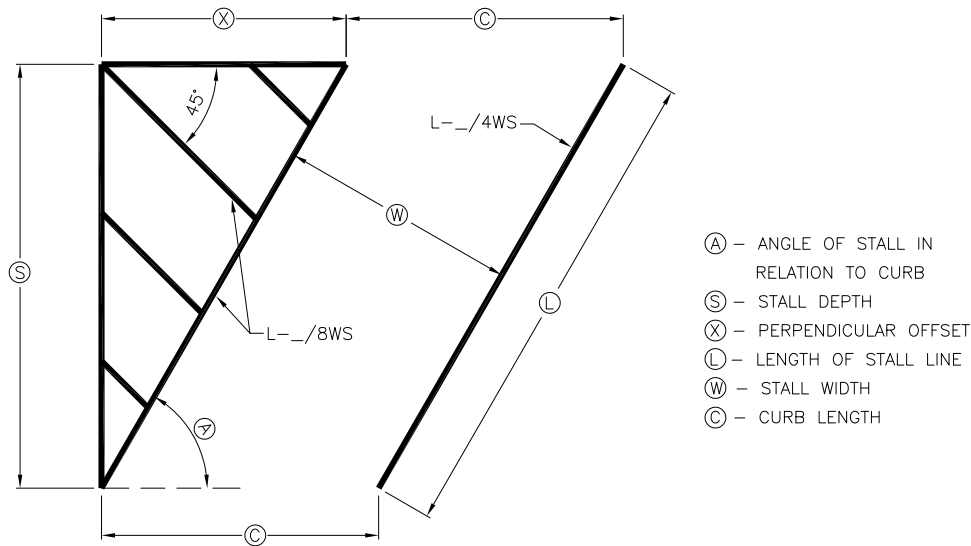

- (A) - ANGLE OF STALL IN RELATION TO CURB
- (S) - STALL DEPTH
- (X) - PERPENDICULAR OFFSET
- (L) - LENGTH OF STALL LINE
- (W) - STALL WIDTH
- (C) - CURB LENGTH

NOTES:

1. THE WIDTH OF THE TRAVEL LANE NEXT TO ANGLED PARKING SPACES MUST BE A MINIMUM OF 12'-6" FOR 45-DEGREE STALLS AND 17'-0" FOR 60-DEGREE STALLS.
2. BARRIER CROSSHATCH LINES MUST BE ALIGNED AS SHOWN, INTERSECTING THE EDGE OF THE PARKING LANE AT 45-DEGREES AND ANGLED AGAINST THE ANGLING OF THE PARKING SPACES


REF STD SPEC SEC 8-22



City of Seattle

NOT TO SCALE

TYPICAL ANGLED PARKING STALL CHANNELIZATION

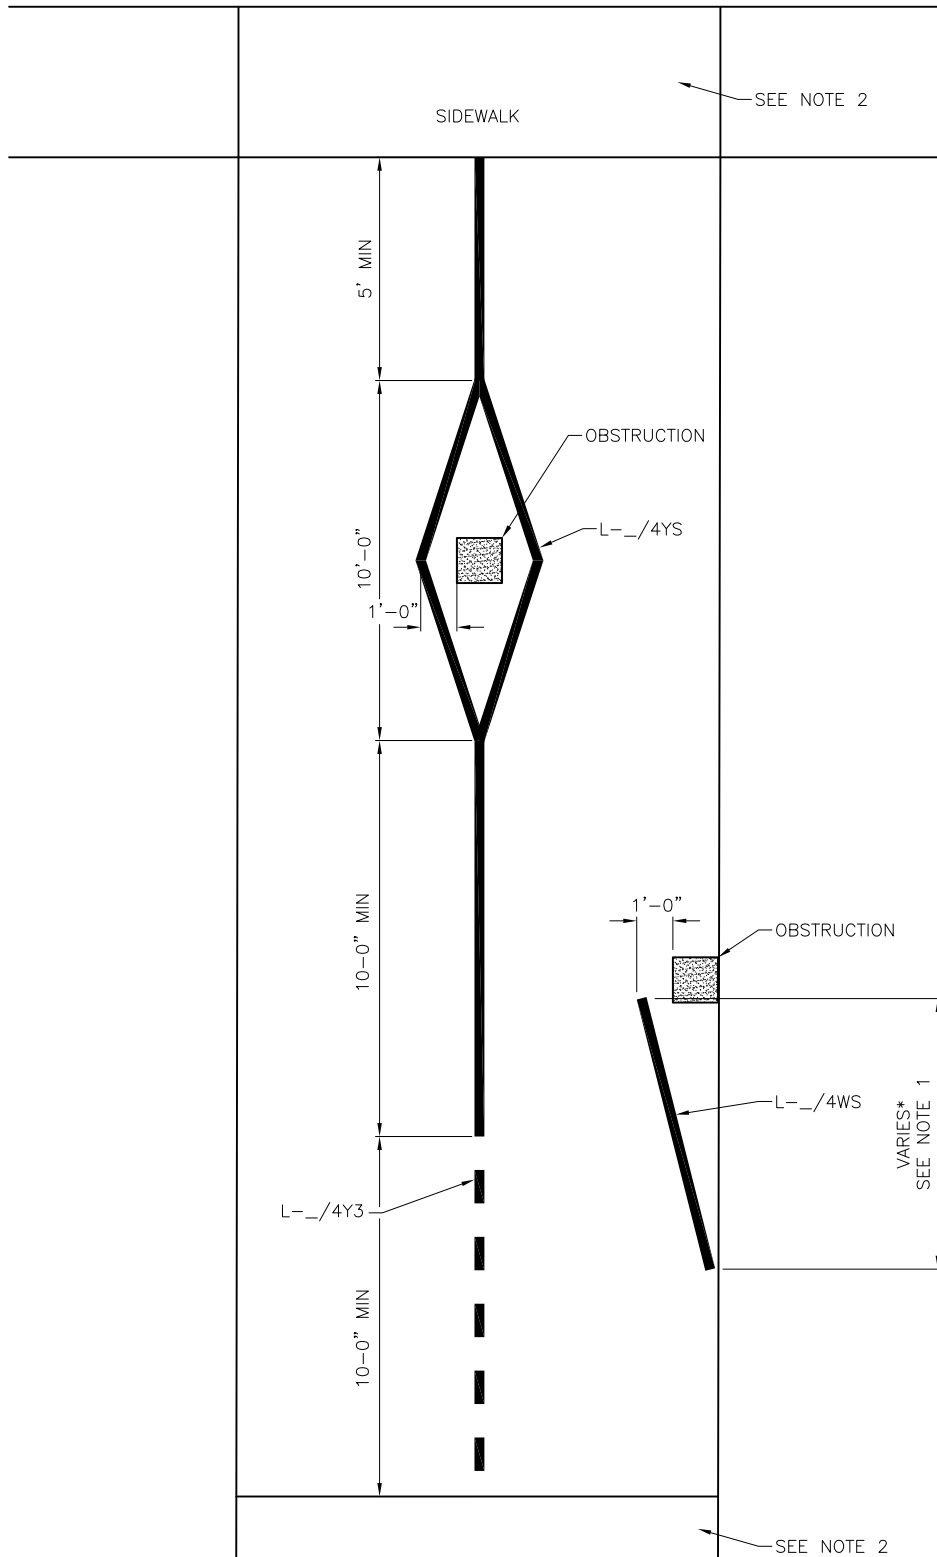

NOTE:

1. SEE 2009 MUTCD FIGURE 91-8 FOR TAPER FORMULA.
2. SEE STD PLAN NO'S 432a & 432b FOR MULTI-PURPOSE TRAIL DESIGN PLANS.


REF STD SPEC SEC 8-22



City of Seattle

NOT TO SCALE

**TRAIL OBSTRUCTION
CHANNELIZATION**

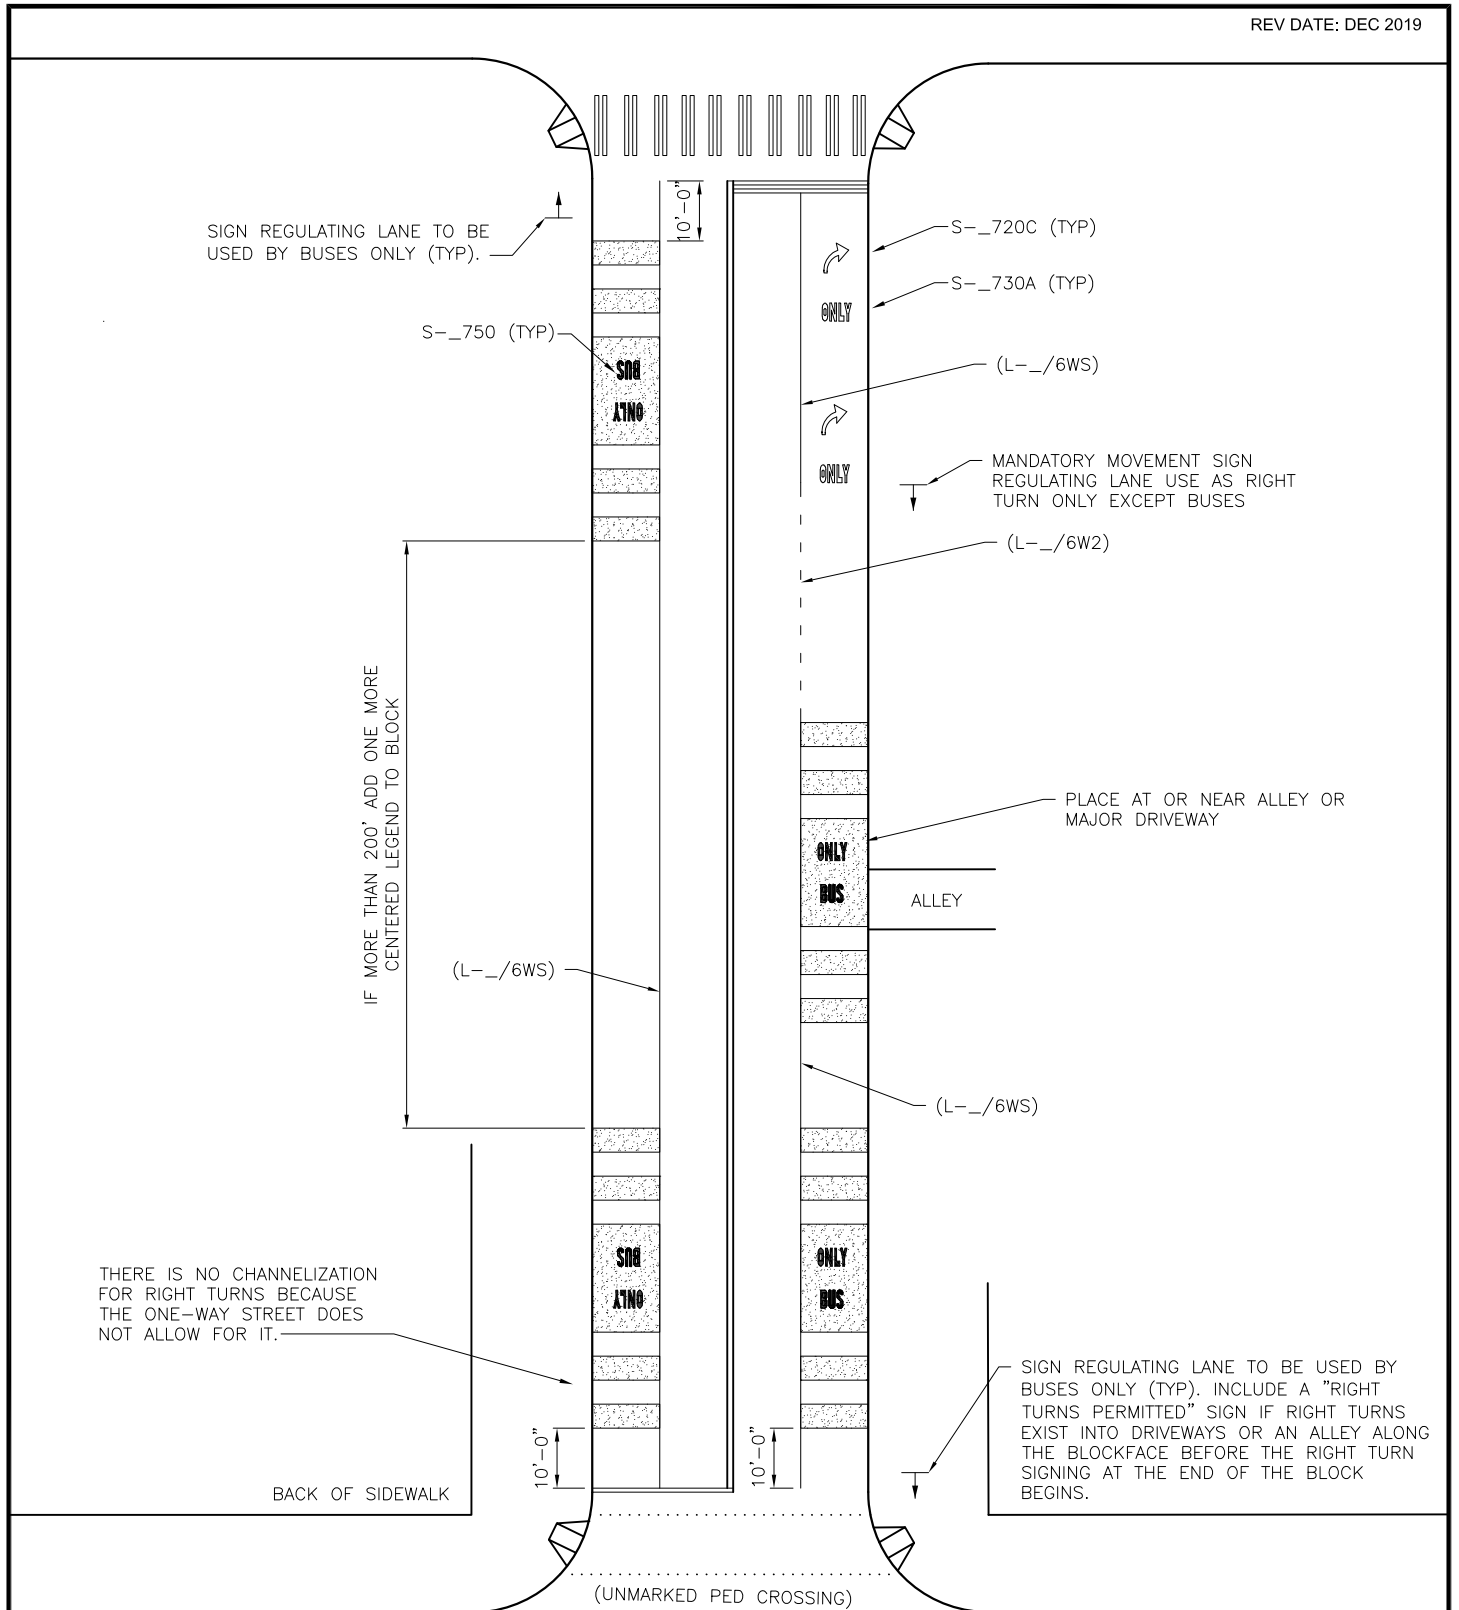


REF STD SPEC SEC 8-22




City of Seattle

NOT TO SCALE


TYPICAL CURBSIDE RED BUS LANE LAYOUT

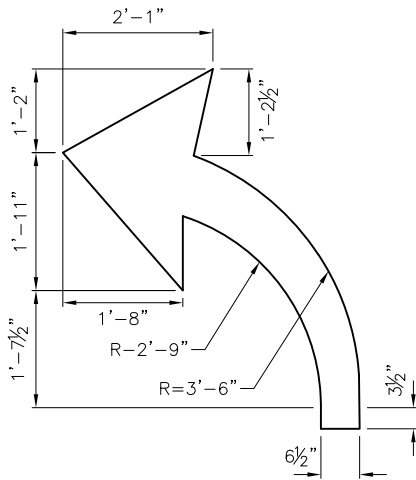


720A
LEFT ARROW

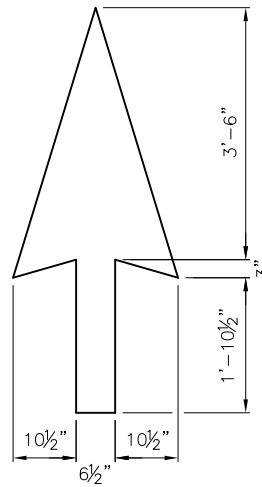


720B
THROUGH ARROW

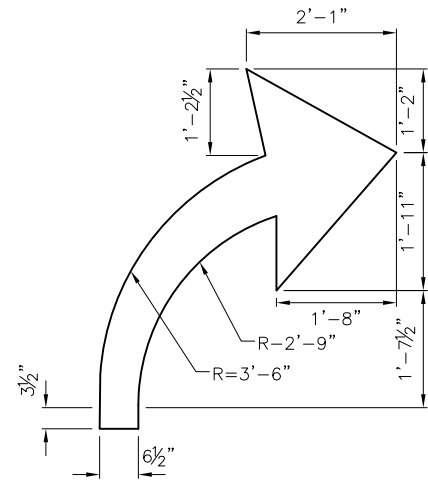

720C
RIGHT ARROW

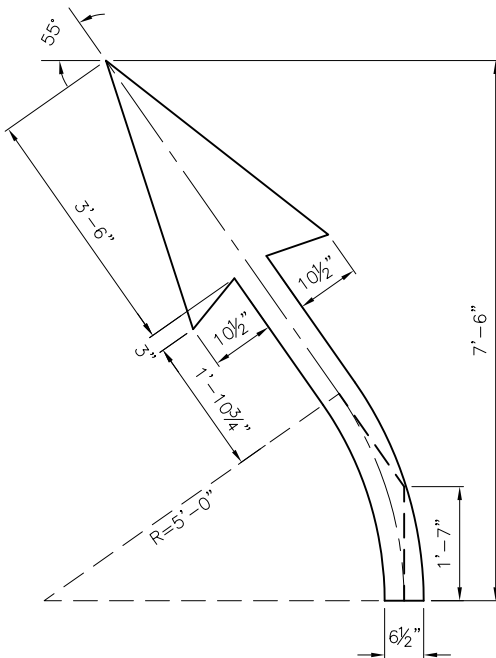

720D
OBLIQUE LEFT ARROW

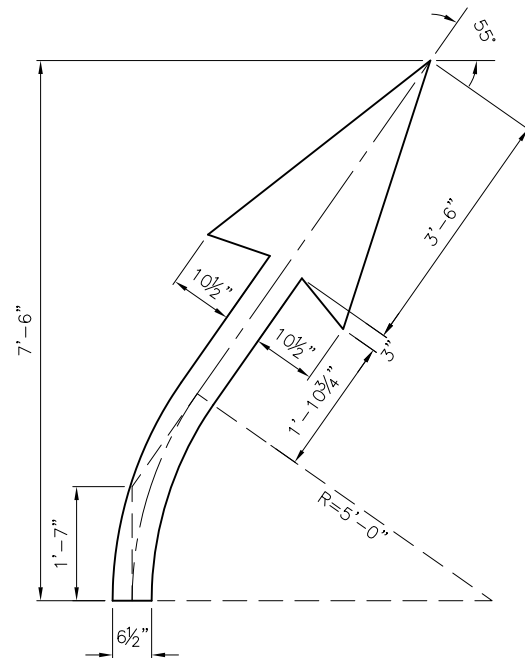

720E
OBLIQUE RIGHT ARROW


REF STD SPEC SEC 8-22




City of Seattle

NOT TO SCALE


**MANDATORY MOVEMENT
ARROWS**

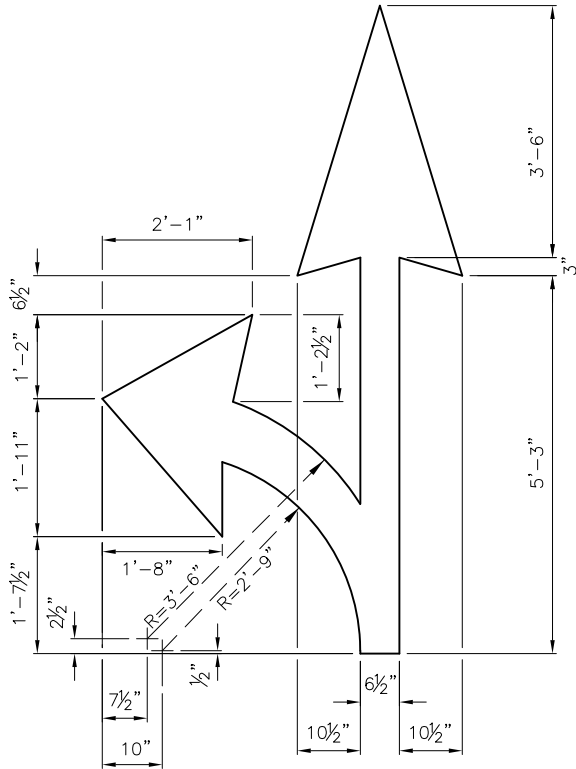

721A
LEFT & THROUGH ARROWS

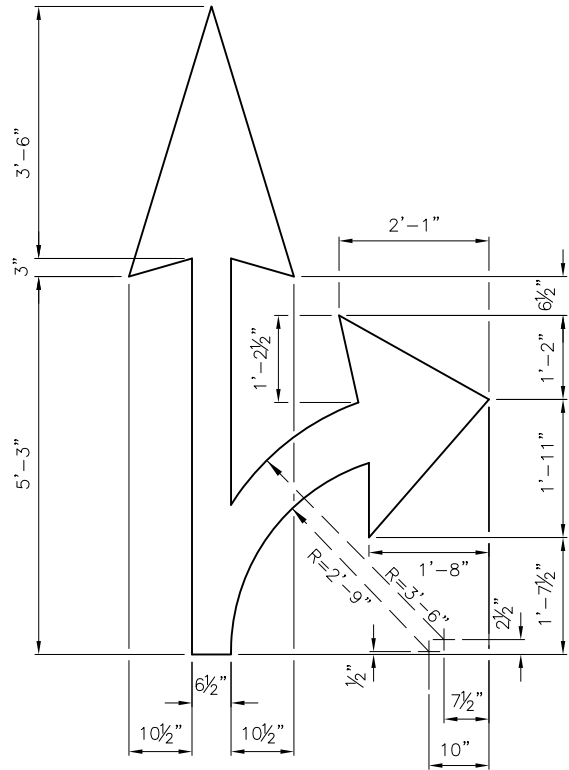

721B
RIGHT & THROUGH ARROWS

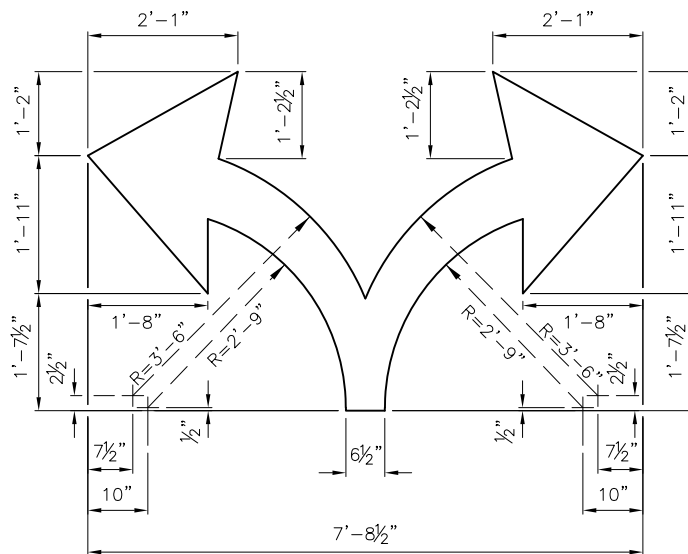

721C
LEFT & RIGHT ARROWS


REF STD SPEC SEC 8-22



City of Seattle


NOT TO SCALE

OPTIONAL MOVEMENT
ARROWS

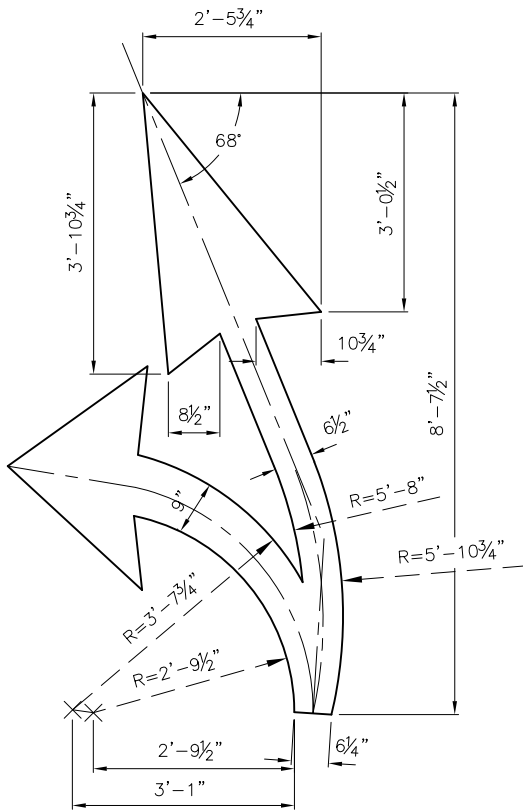

722A

LEFT & OBLIQUE LEFT ARROW

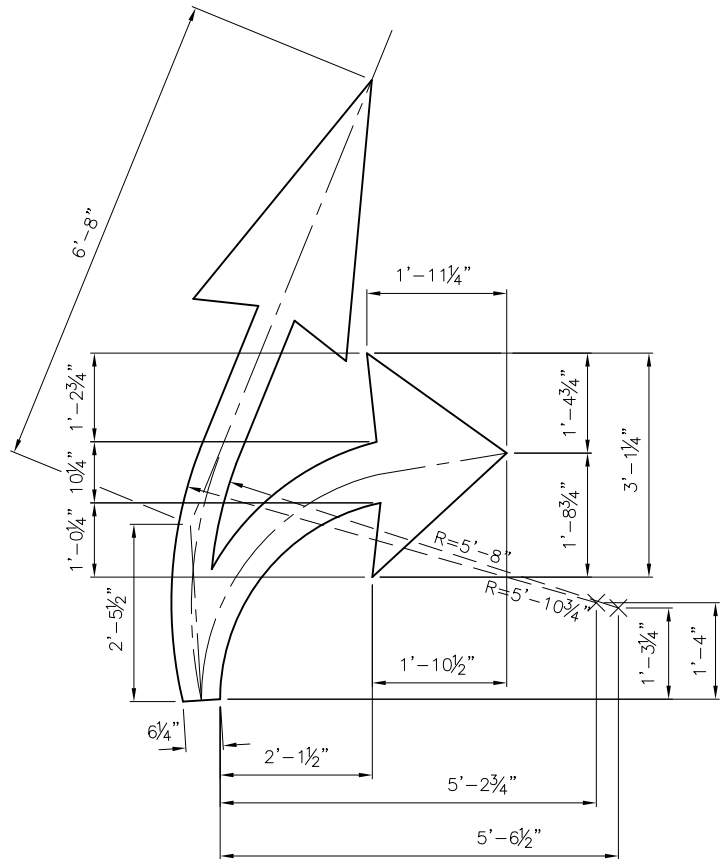

722B

RIGHT & OBLIQUE RIGHT ARROW



REF STD SPEC SEC 8-22



City of Seattle

NOT TO SCALE

OPTIONAL MOVMENT ARROWS
WITH OBLIQUE ARROWS

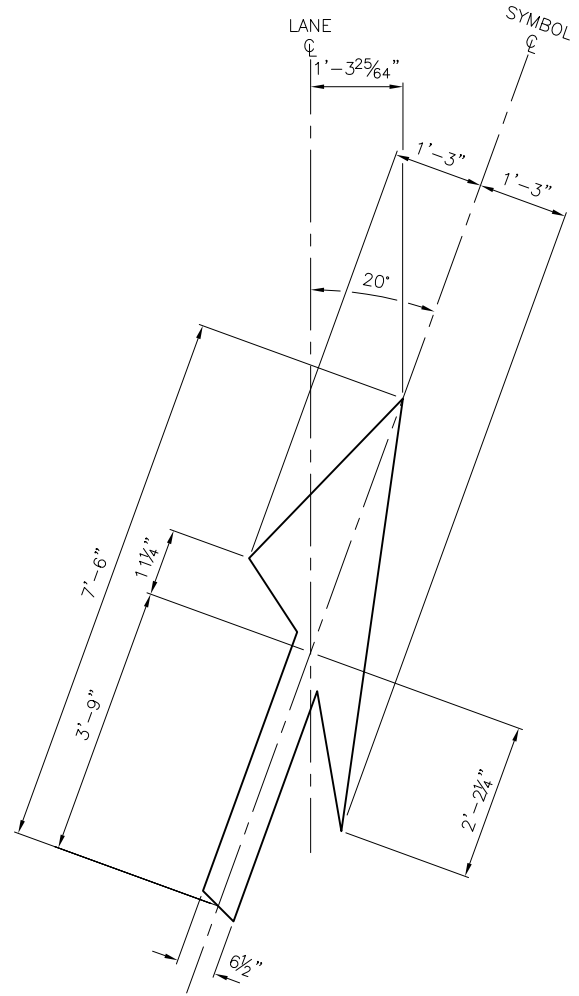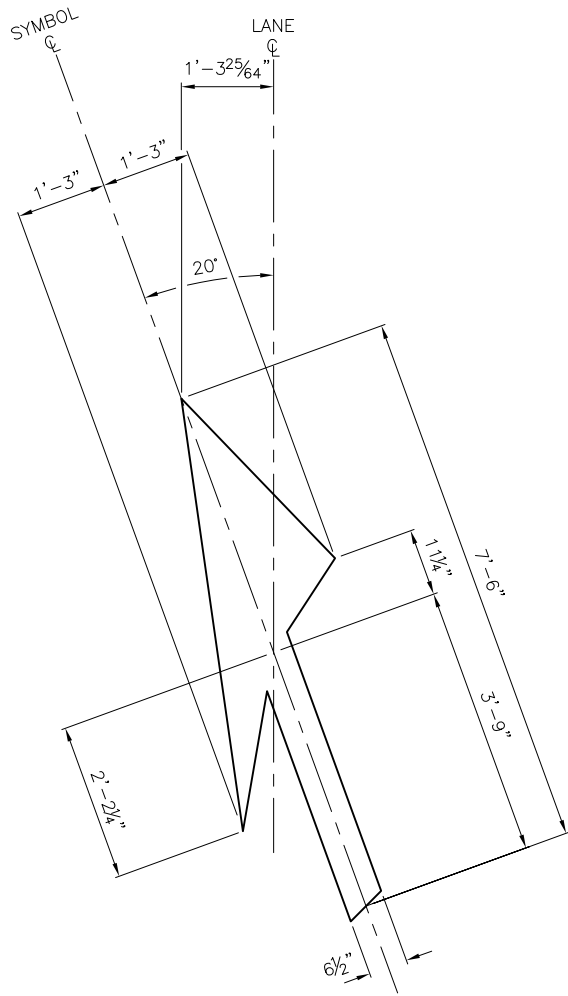

723A

LEFT MERGE/LANE REDUCTION ARROWS

723B

RIGHT MERGE/LANE REDUCTION ARROWS


REF STD SPEC SEC 8-22



City of Seattle

NOT TO SCALE


MERGE ARROWS

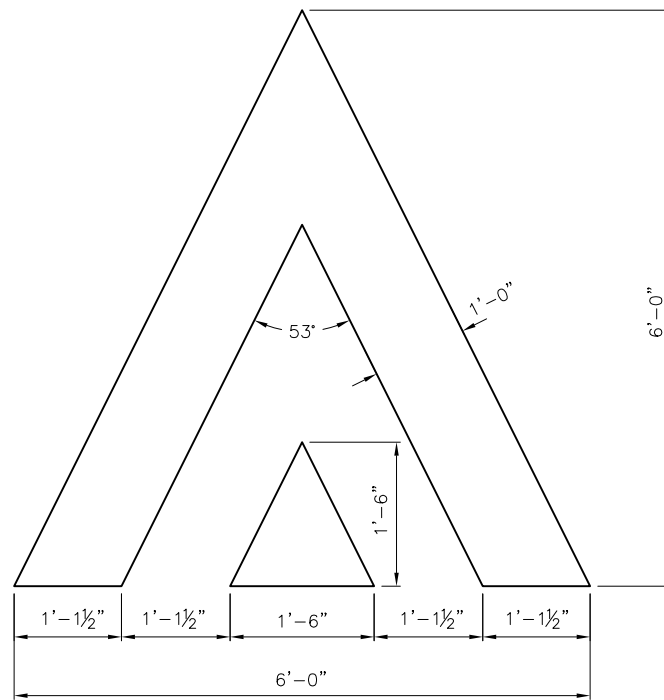

728A
CHEVRON WITH TRIANGLE

NOTE:

THIS SYMBOL MAY BE RESIZED FOR BIKE FACILITIES.
DIMENSIONS IN THOSE INSTANCES MUST BE SHOWN ON
DESIGN DRAWINGS.

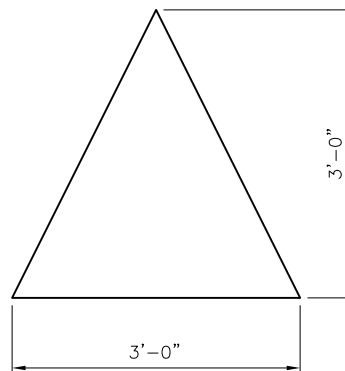

728B
CENTER CUSHION TRIANGLE


REF STD SPEC SEC 8-22




City of Seattle

NOT TO SCALE


**SPEED HUMP &
SPEED CUSHION SYMBOL**

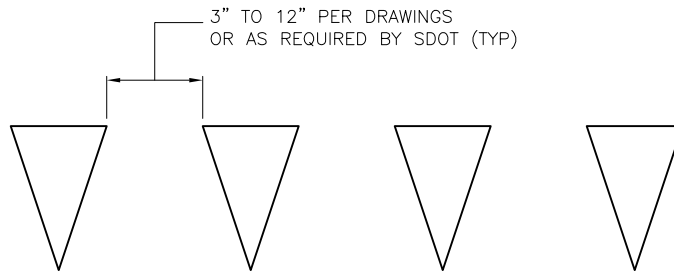

YIELD LINE LAYOUT

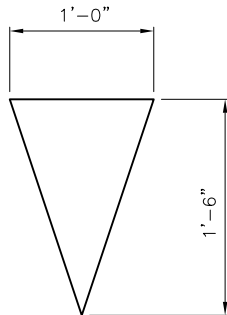

729A
YIELD LINE WITH 18" TALL TRIANGLES

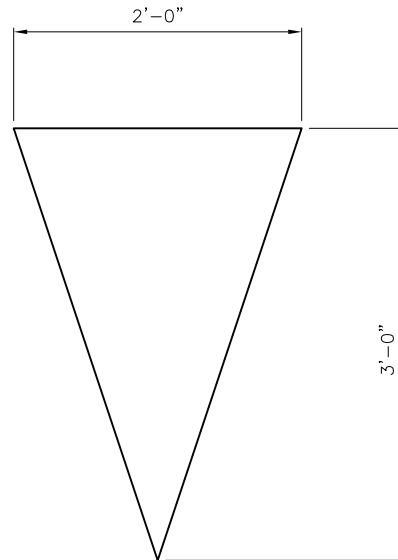

729B
YIELD LINE WITH 36" TALL TRIANGLES


REF STD SPEC SEC 8-22




City of Seattle

NOT TO SCALE


YIELD LINE LAYOUT &
YIELD LINE TRIANGLE SYMBOLS

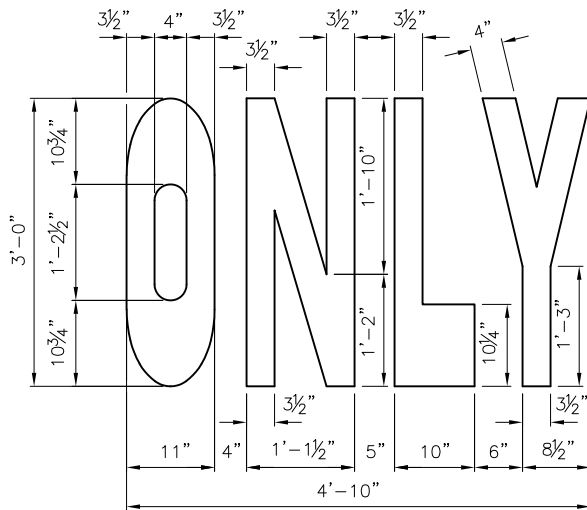


730A
"ONLY" LEGEND

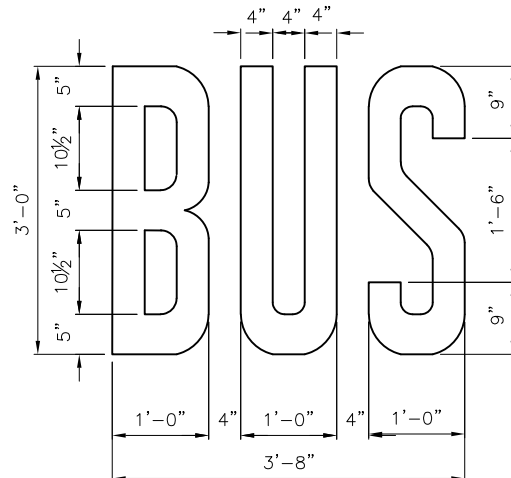

730B
"BUS" LEGEND

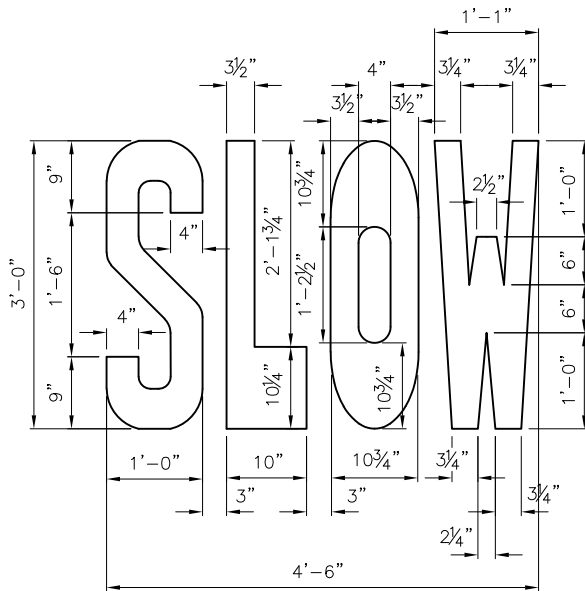

730C
"SLOW" LEGEND

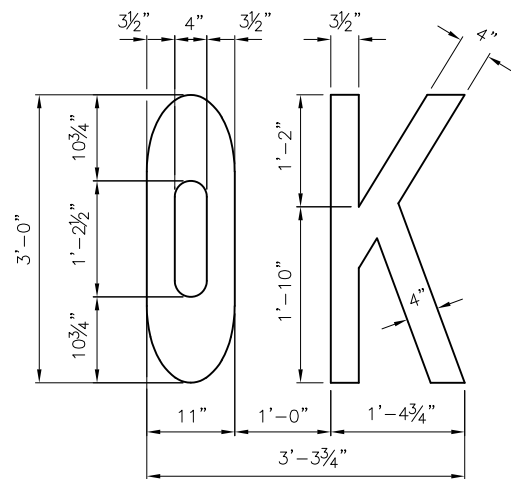

730D
"OK" LEGEND

NOTE:
THIS SYMBOL MAY BE RESIZED FOR BIKE FACILITIES


REF STD SPEC SEC 8-22



City of Seattle

NOT TO SCALE

PAVEMENT MARKINGS
LEGENDS

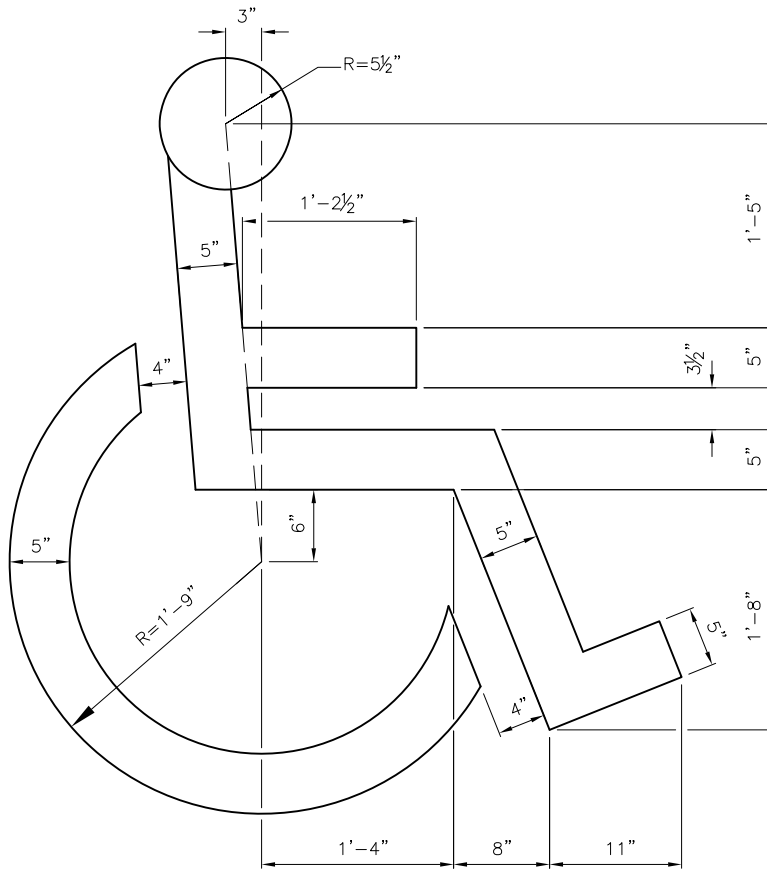

740A
INTERNATIONAL SYMBOL OF ACCESSIBILITY


REF STD SPEC SEC 8-22



City of Seattle

NOT TO SCALE

INTERNATIONAL SYMBOL
OF ACCESSIBILITY

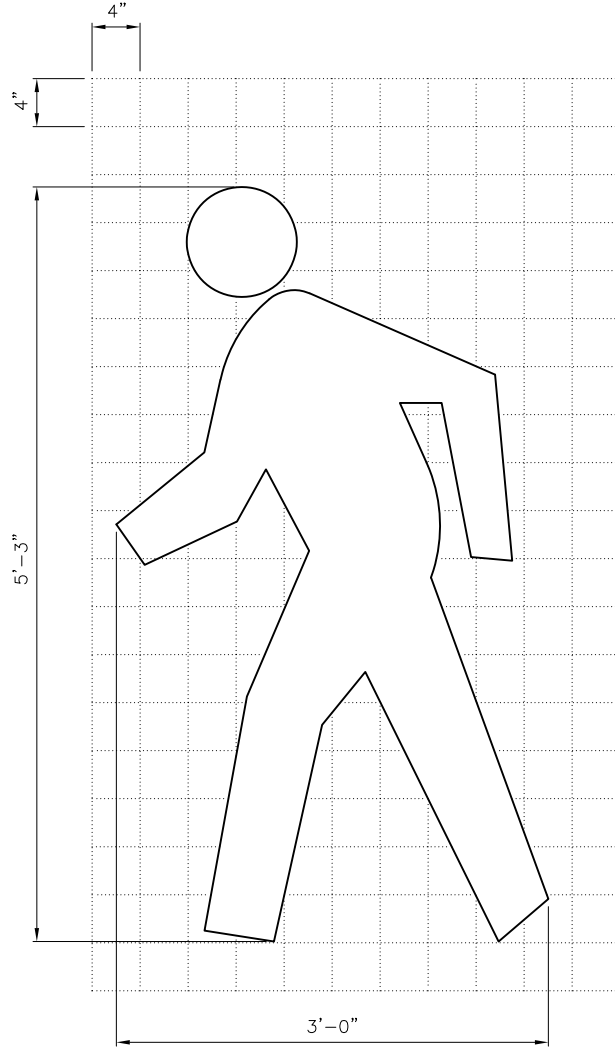

741A
PEDESTRIAN SYMBOL


REF STD SPEC SEC 8-22



City of Seattle

NOT TO SCALE

PEDESTRIAN SYMBOL

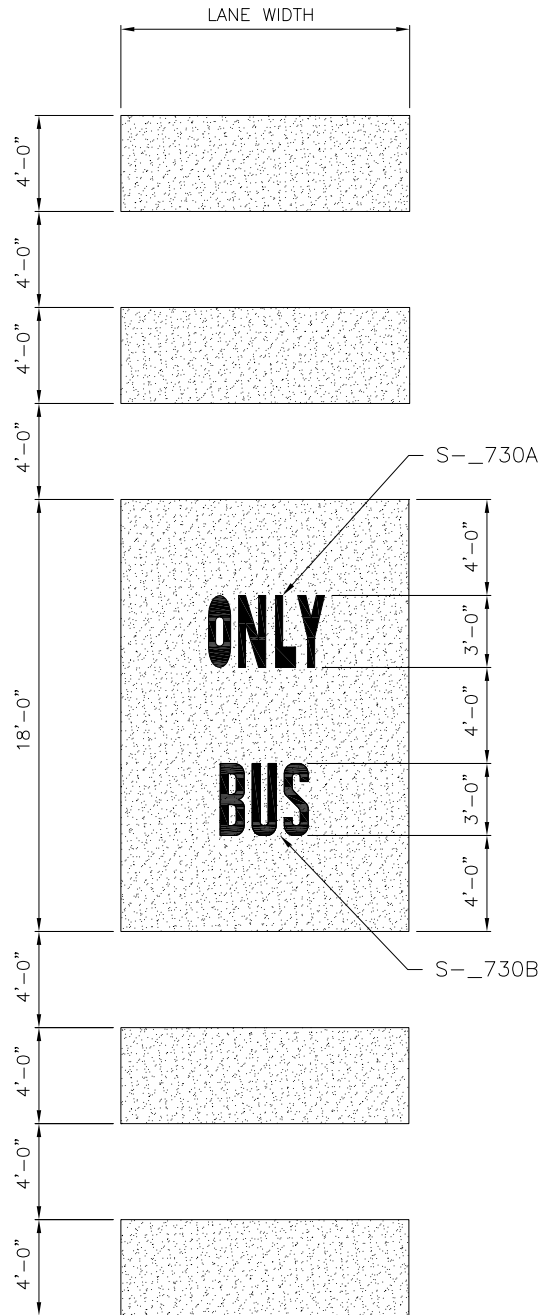

NOTES:
 FHWA APPROVED RED COLOR FOR BUS LANES
 MUST BE USED WITH THERMOPLASTIC OR MMA.

750
 RED BUS LANE MARKINGS



REF STD SPEC SEC 8-22




City of Seattle

NOT TO SCALE


RED BUS LANE MARKINGS

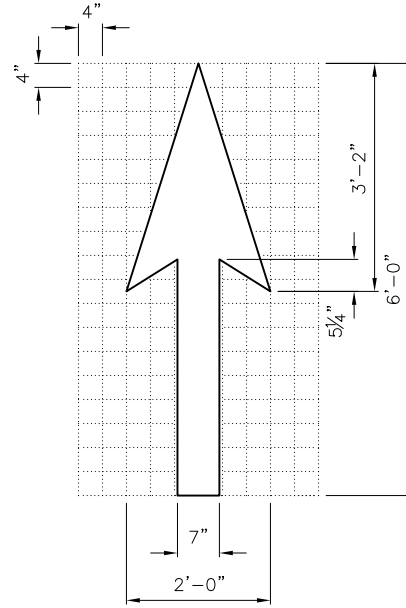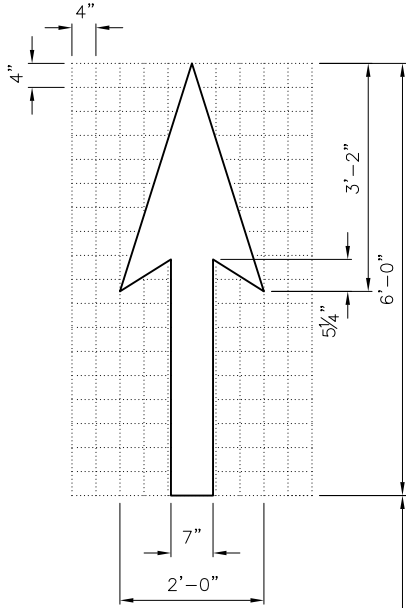

770B
BICYCLE LANE THROUGH ARROW

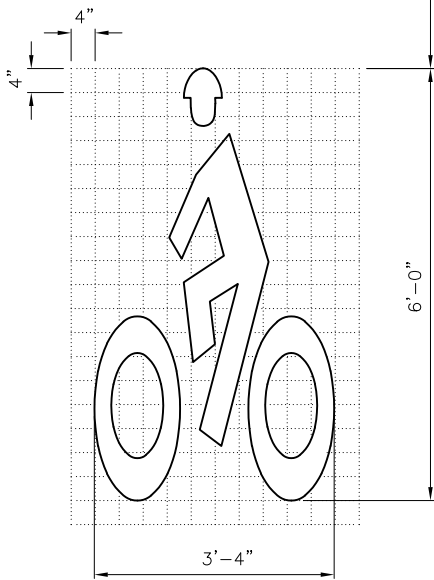

770A
HELMETED BICYCLIST SYMBOL WITH ARROW

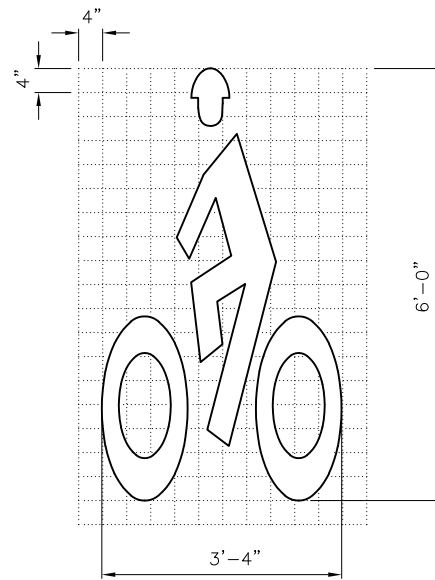

770C
HELMETED BICYCLIST SYMBOL


REF STD SPEC SEC 8-22




City of Seattle

NOT TO SCALE


HELMETED BICYCLIST SYMBOL
WITH ARROW

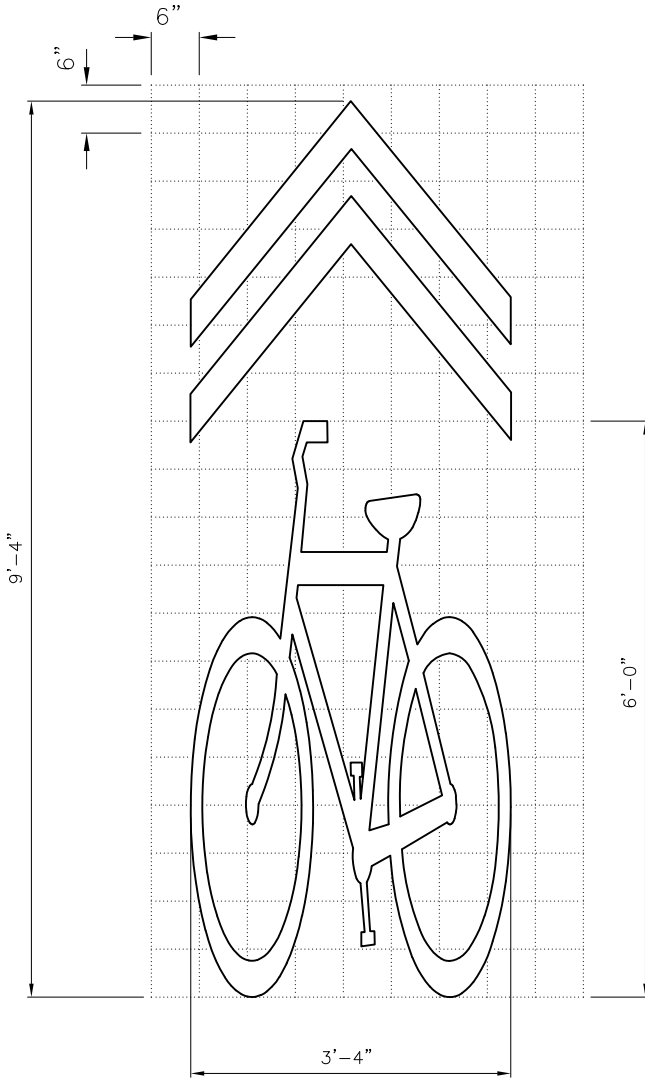

771A
SHARROW

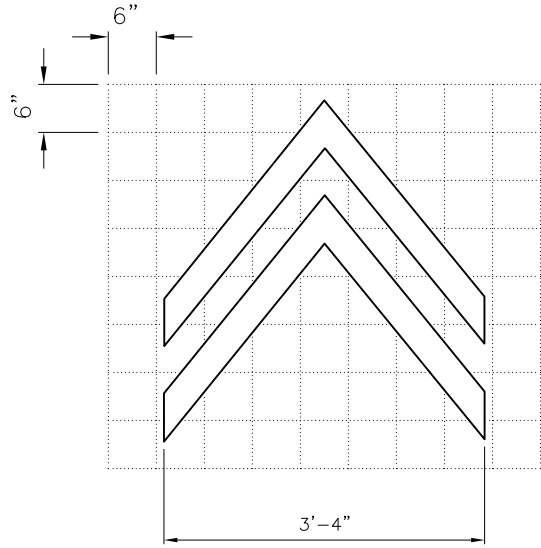

771B
CHEVRON FOR SHARROW

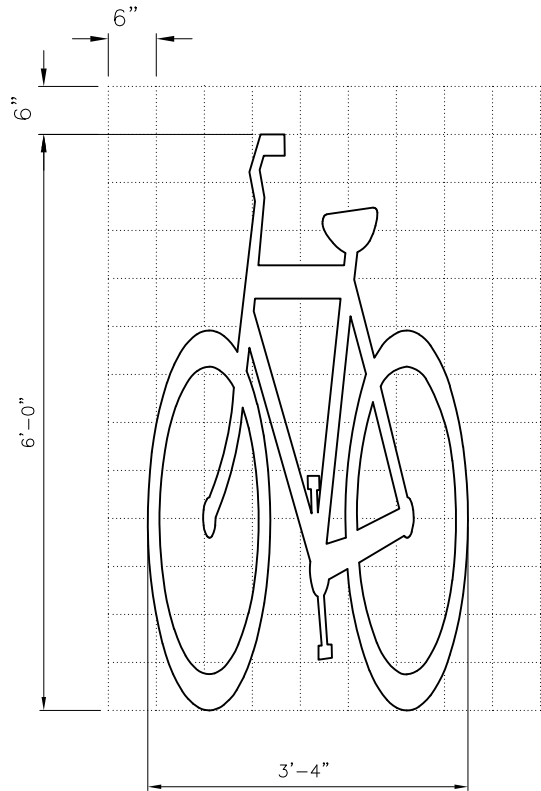

771C
BIKE SYMBOL


REF STD SPEC SEC 8-22



City of Seattle

NOT TO SCALE

SHARROW & BIKE SYMBOLS

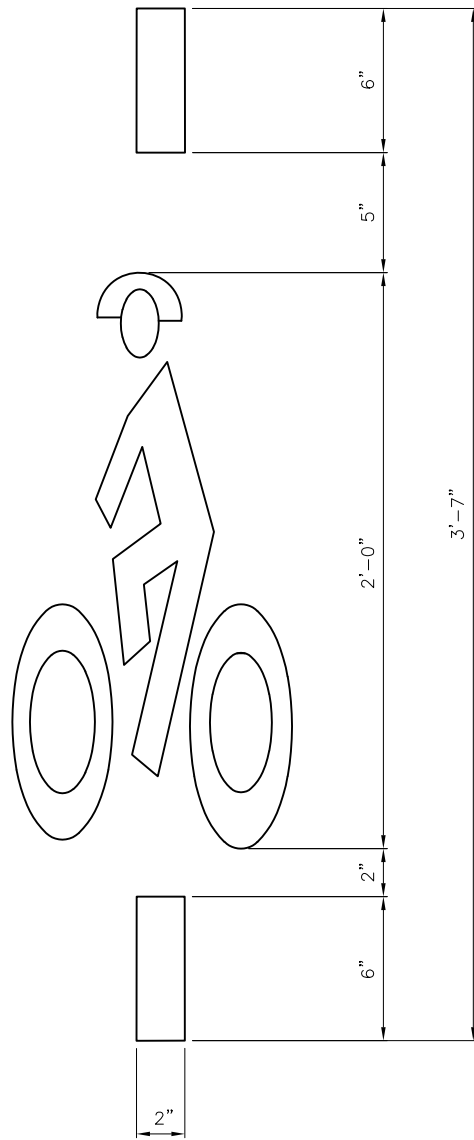

772
BICYCLE DETECTOR SYMBOL

NOTE:
SEE STD PLAN NO 530b FOR PLACEMENT


REF STD SPEC SEC 8-22




City of Seattle

NOT TO SCALE


**BICYCLE DETECTOR
SYMBOL**

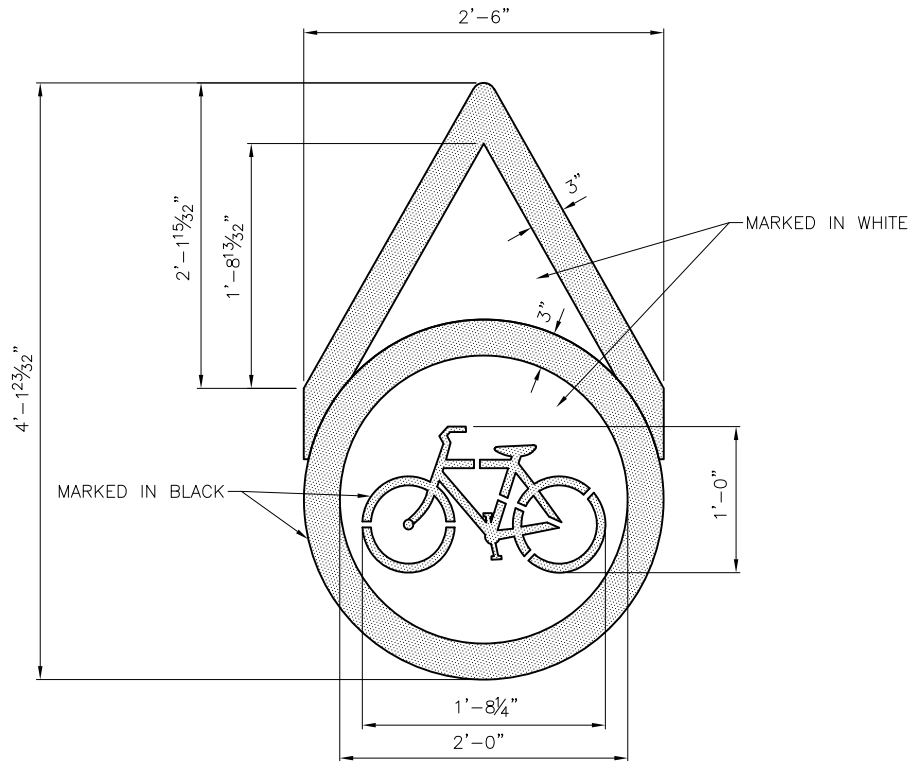

773A
BIKE DOT SYMBOL WITH ARROW

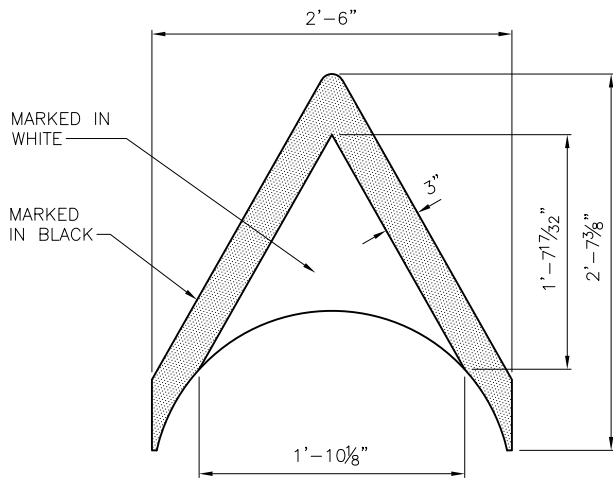

773B
BIKE DOT ARROW

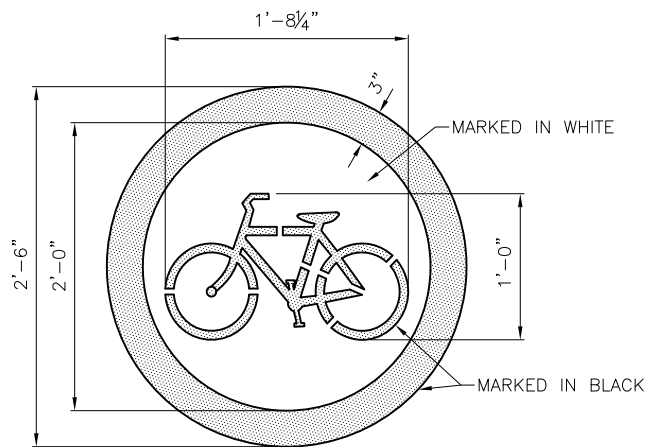

773C
BIKE DOT SYMBOL

REF STD SPEC SEC 8-22




City of Seattle

NOT TO SCALE


**BIKE DOT SYMBOL
WITH ARROW**

NOTE:


SEE STD PLAN NO 771 FOR SYMBOL DIMENSIONS.

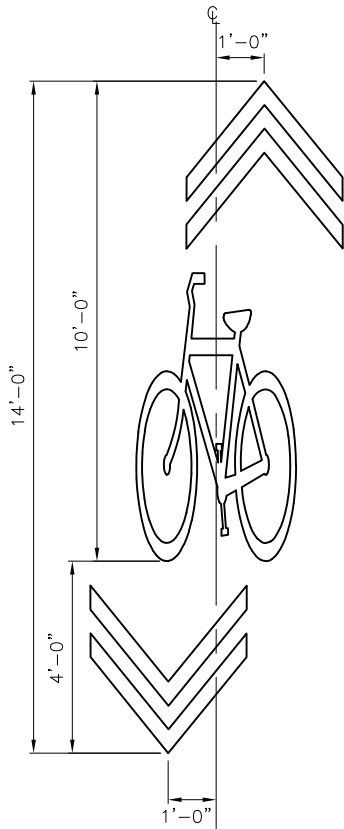


774A
GREENWAY THROUGH SYMBOL

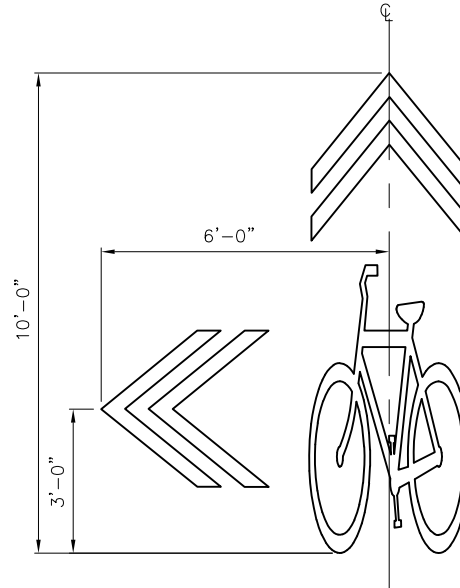

774B
GREENWAY ROUTE TURNS SYMBOL

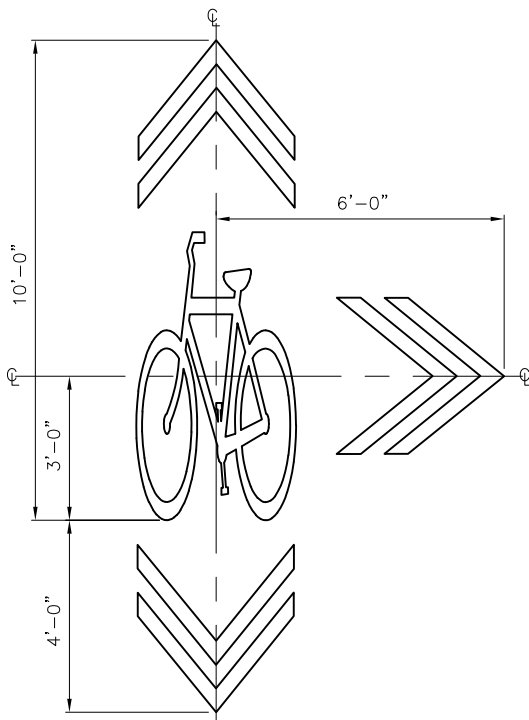

774C
GREENWAY THREE-ROUTE SYMBOL

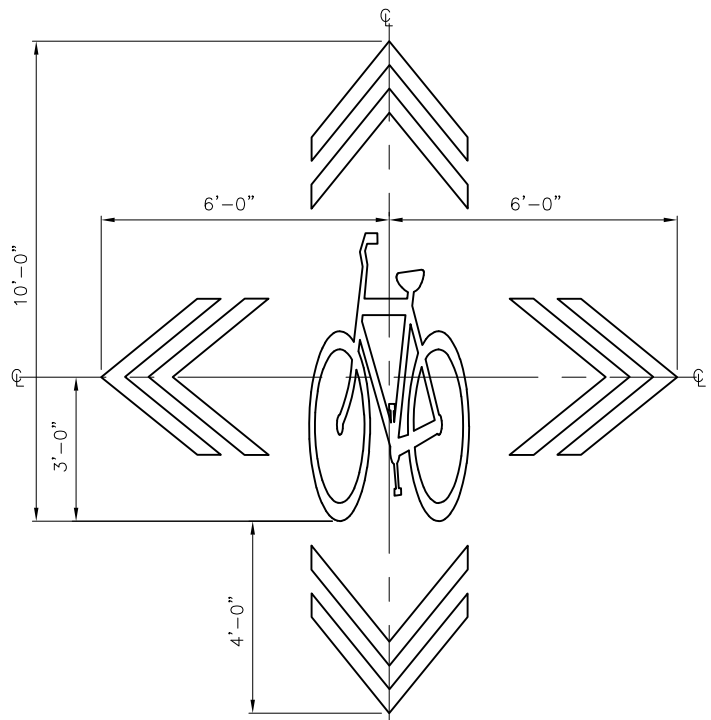

774D
GREENWAY FOUR-ROUTE SYMBOL


REF STD SPEC SEC 8-22




City of Seattle

NOT TO SCALE

GREENWAY MARKINGS

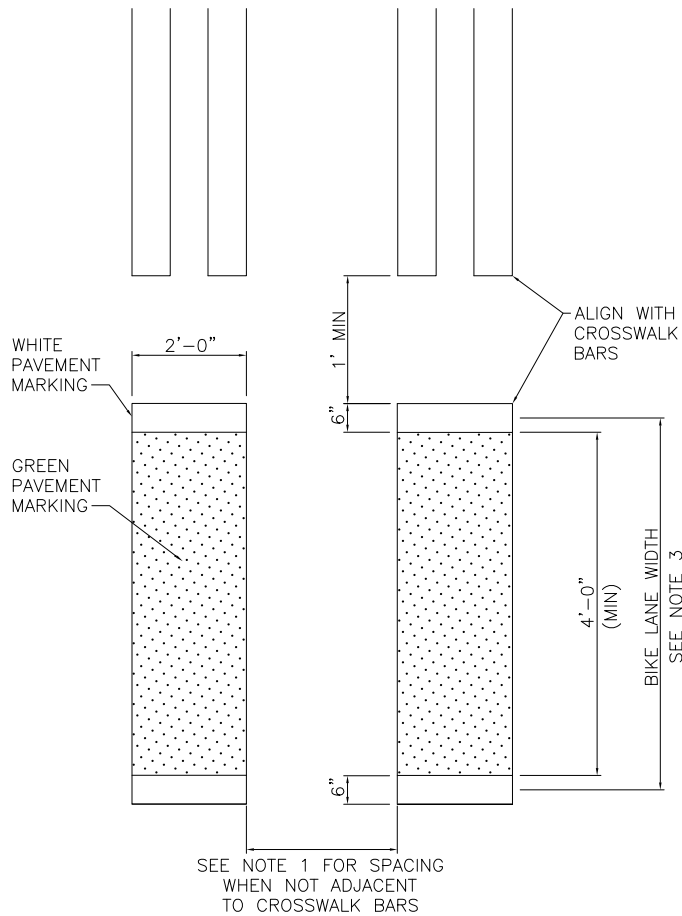

780A
ONE-WAY CROSS BIKE LAYOUT

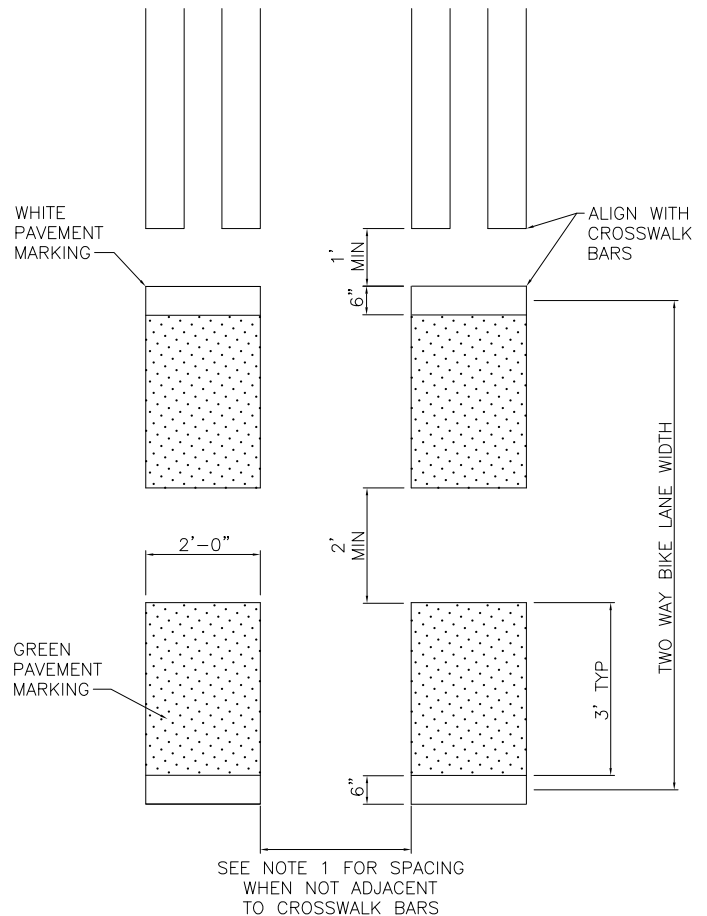

780B
TWO-WAY CROSS BIKE LAYOUT

NOTES:

1. WHERE STRIPED CROSSWALK DOES NOT EXIST, CROSS BIKE MUST BE PLACED AT LANE LINE AND 1/2 LANE WIDTH CONSISTENT WITH STANDARD PLAN 712. IF NO CROSSWALK OR LANE LINE EXISTS, CROSSBIKE MUST BE PLACED AT 5' ON CENTERS.
2. CROSS BIKE MATERIAL MUST BE MMA OR PRE-FORMED THERMOPLASTIC.
3. WHEN CONNECTING BILE LANES OF VARYING WIDTH, THE CROSSBIKE WIDTH MUST BE SIZED TO THE NARROWER OF THE TWO FACILITIES.


REF STD SPEC SEC 8-22



City of Seattle

NOT TO SCALE

**CROSS BIKE
PAVEMENT MARKING**

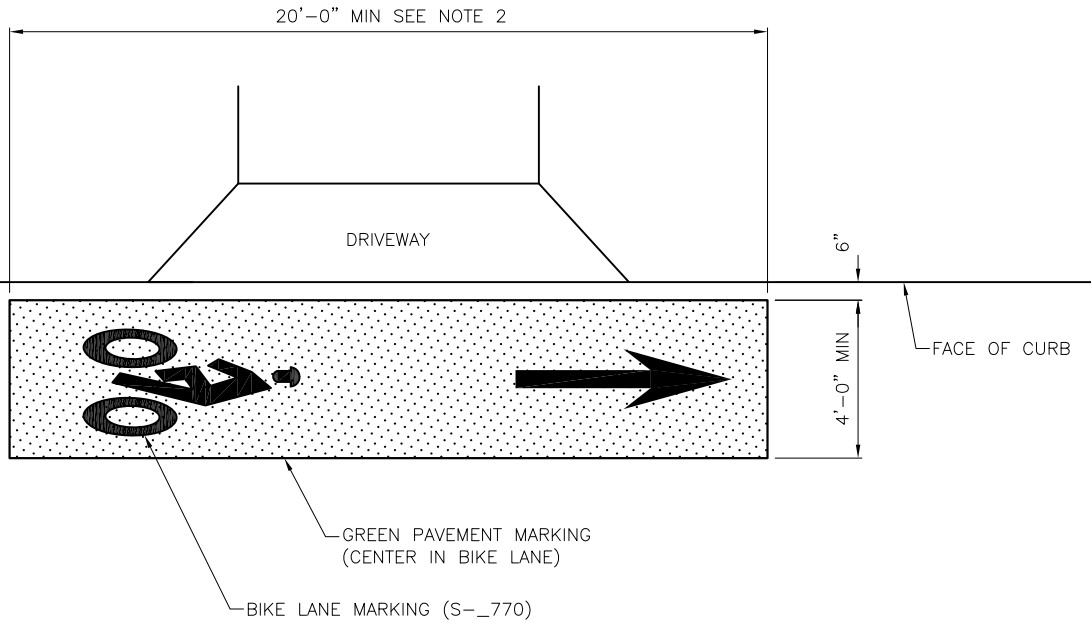

DRIVEWAY CROSSING LAYOUT

NOTES:

1. DRIVEWAY CROSSING MATERIAL MUST BE MMA OR PRE-FORMED THERMOPLASTIC
2. MATCH DRIVEWAY APRON IF WIDER THAN 20'


REF STD SPEC SEC 8-22



City of Seattle

NOT TO SCALE

**BIKE LANE PAVEMENT MARKING
AT DRIVEWAY**

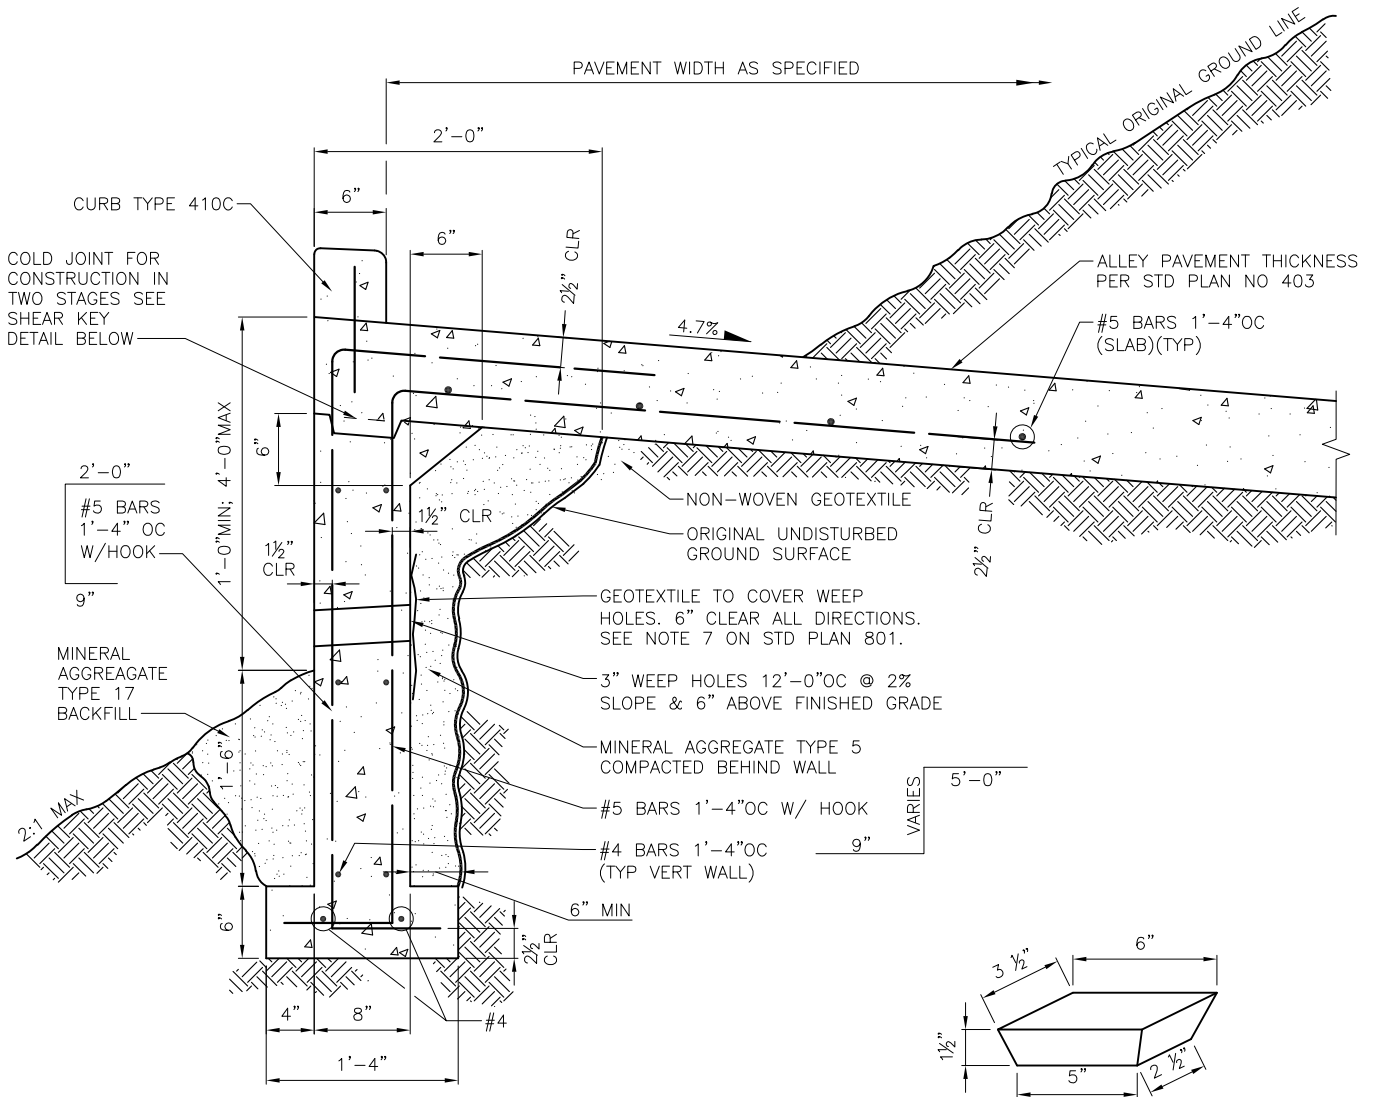

NOTES:

1. BASE OF SUPPORT WALL TO BE BEARING ON COMPACTED SUITABLE MATERIAL
2. BACK FORM FOR SUPPORT WALL MAY BE OMITTED AND CONCRETE PLACED AGAINST NATIVE EARTH WHEN GROUND CONDITIONS PERMIT. CLEARANCE TO REINF STEEL IN BACK FACE MUST BE 2 1/2"
3. WHEN CONSTRUCTION OF ALLEY PAVEMENT IS NOT PLACED INTEGRAL WITH SUPPORT WALL, SHEAR KEYS MUST BE INSTALLED 1'-6" ON CENTERS
4. CONCRETE FOR SUPPORT WALL MUST BE CLASS 4000
5. REINFORCING STEEL ASTM A706 (AASHTO M 31 GRADE 60)
6. VEHICULAR & PEDESTRIAN RAILING PER RIGHT OF WAY IMPROVEMENT MANUAL

BEVELED BLOCK FOR FORMING SHEAR KEY IN WALL SECTION TO BE MADE FROM STANDARD 2"x4"x6" WOOD OR OTHER SUITABLE MATERIAL (SEE NOTE 3)

SHEAR KEY




REF STD SPEC SEC 8-17, 8-19



City of Seattle

NOT TO SCALE

SUPPORT WALL

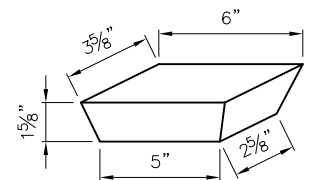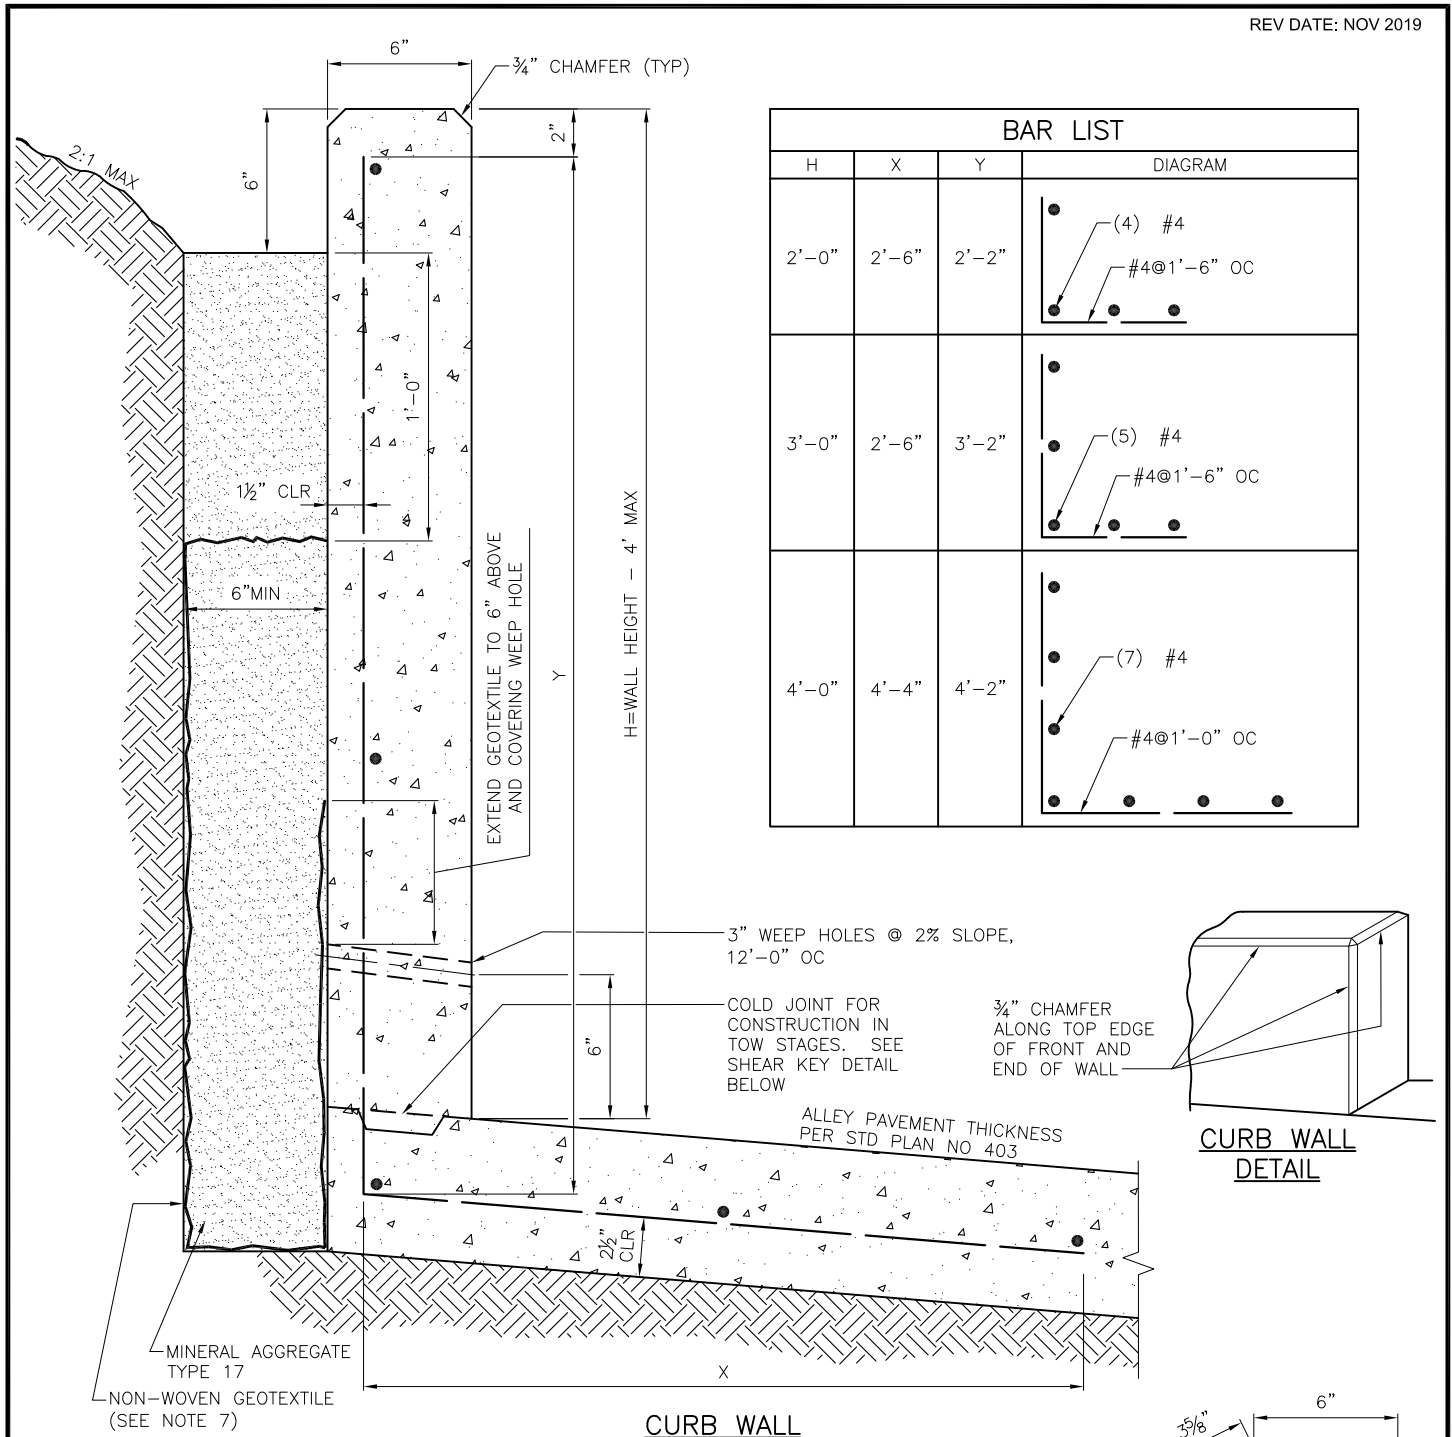

NOTES:

1. MATCH WALL THROUGH JOINTS WITH PAVEMENT THROUGH JOINTS. DISCONTINUE HORIZONTAL REINFORCEMENT AT JOINTS AND MAINTAIN 1/2' CLEAR TO ALL REINFORCING AT JOINTS
2. CONC CLASS 4000 FOR CURB WALL
3. MAX HEIGHT 4'-0" (MIN PAVEMENT WIDTH IS 12'-0" FOR WALLS HIGHER THAN 3'-0")
4. WHEN CONSTRUCTION OF WALL IS NOT PLACED INTEGRAL WITH ALLEY PAVEMENT, SHEAR KEY INDENTATIONS SPACED 1'-6" OC MUST BE INSTALLED IN THE PAVEMENT SLAB
5. REINF STEEL ASTM A706 (AASHTO M 31 GRADE 60)
6. ANY RAILING ON TOP OF WALL PER RIGHT OF WAY IMPROVEMENT MANUAL
7. NON-WOVEN GEOTEXTILE TO BE MODERATE SURVIVABILITY, ANY CLASS PER TABLES 1 AND 2 STD SPEC SEC 9-37
8. ALLEY THICKNESS PER STANDARD PLAN NO 403

REF STD SPEC SEC 8-17



City of Seattle

NOT TO SCALE

CURB WALL

This Page Intentionally Left Blank